

Doc. N° MO-0128-ING


Rev. 0

Pag. 1 of 15

# MULTIFUNCTION MOTOR PROTECTION RELAY WITH SERIAL COMMUNICATION PORT

# TYPE DIN30-M

# **OPERATION MANUAL**

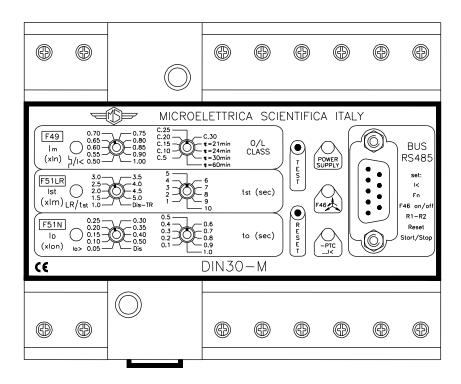

( (

Copyright 1997 Microelettrica Scientifica

0	EMISSION	22-06-00	P.Brasca	D. Ciminaghi	-
REV.	DESCRIPTION	DATA	PREP.	CONT.	APPR.



Doc. N° MO-0128-ING

Rev. 0

Pag. 2 of 15

# INDEX

1 G	General utilization and commissioning directions	<u> </u>	_ 3
1.	.1 Storage and transportation		3
1.	.2 Installation		_ 3
1.	.3 Electrical connection		_ 3
1.	.4 Measuring inputs and power supply		3
1.	.5 Outputs loading		_ 3
1.	.6 Protection earthing		3
1.			
1.	.8 Safety protection		_ 3
1.			
1.			
1.	.11 Fault detection and repair		4
2 G	Seneral characteristics and operation		4
2.	.1 Input quantities		4
2.	.2 Power Supply		4
2.	.3 Serial Communication		_ 5
	2.3.1 DIN30-M Data Base		_ 6
2.	.4 PTC Input (Terminals 15-16)		_ 8
2.			
2.	.6 Signalizations and controls		8
	2.6.1 Thermal image element F49		8
	2.6.2 Starting sequence control and locked ro	tor element F51LR	9
	2.6.3 Earth Fault element F51N		10
	2.6.4 Phase loss or phase reversal F46		_ 10
	2.6.6 Undercurrent F37		11
	2.6.7 PTC		11
3 Th	nermal Images Curves		 12
4 C	Connection diagram		 13
5 O	Overall dimensions		_ 14
	laintenance		
7 EI	lectrical characteristics		15



Doc. N° MO-0128-ING

Rev. 0

Pag. 3 of 15

#### 1. GENERAL UTILIZATION AND COMMISSIONING DIRECTIONS

Always make reference to the specific description of the product and to the Manufacturer's instruction. Carefully observe the following warnings.

#### 1.1 STORAGE AND TRANSPORTATION

must comply with the environmental conditions stated on the product's instruction or by the applicable IEC standards.

#### 1.2 INSTALLATION

must be properly made and in compliance with the operational ambient conditions stated by the Manufacturer.

#### 1.3 ELECTRICAL CONNECTION

must be made strictly according to the wiring diagram supplied with the Product, to its electrical characteristics and in compliance with the applicable standards particularly with reference to human safety.

#### 1.4 MEASURING INPUTS AND POWER SUPPLY

carefully check that the value of input quantities and power supply voltage are proper and within the permissible variation limits.

## 1.5 OUTPUTS LOADING

must be compatible with their declared performance.

#### 1.6 PROTECTION EARTHING

When earthing is required, carefully check its efficiency.

# 1.7 SETTING AND CALIBRATION

Carefully check the proper setting of the different functions according to the configuration of the protected system, the safety regulations and the co-ordination with other equipment.

#### 1.8 SAFETY PROTECTION

Carefully check that all safety means are correctly mounted, apply proper seals where required and periodically check their integrity.

#### 1.9 HANDLING

Notwithstanding the highest practicable protection means used in designing M.S. electronic circuits, the electronic components and semiconductor devices mounted on the modules can be seriously damaged by electrostatic voltage discharge which can be experienced when handling the modules.

The damage caused by electrostatic discharge may not be immediately apparent but the design reliability and the long life of the product will have been reduced. The electronic circuits produced by M.S. are completely safe from electrostatic discharge (8 KV IEC 255.22.2) when housed in their case; withdrawing the modules without proper cautions expose them to the risk of damage.



Doc. N° MO-0128-ING

Rev. 0

Pag. 4 of 15

#### 1.10 MAINTENANCE

Make reference to the instruction manual of the Manufacturer; maintenance must be carried-out by specially trained people and in strict conformity with the safety regulations.

#### 1.11 FAULT DETECTION AND REPAIR

Internal calibrations and components should not be alterated or replaced. For repair please ask the Manufacturer or its authorised Dealers.

Misapplication of the above warnings and instruction relieves the Manufacturer of any liability.

#### 2. GENERAL CHARACTERISTICS AND OPERATION

#### 2.1 Input quantities are supplied to three current transformers:

of for phase current measurement with taps for rated input  $I_n = 1$  or 5A; measurement is linear from 0.1 to  $10I_n$  with resolution of  $0.01I_n$  in the calculation of RMS value

In = 1A : burden  $10m\Omega$  (0,01VA @ 1A)

In = 5A : burden  $3m\Omega$  (0,075VA @ 5A)

Permissible overload: 10A permanent, 200A for 1s.

Recommended C.Ts. ≥3VA class 5P10

1 for measurement of residual current with taps for rated input  $I_{on} = 1$  or 5A; measurement is linear from 0,01 to 2 x  $I_{on}$  with resolution 0,004 in the calculation of the RMS value.

 $I_{on} = 1A$ : burden  $10m\Omega$  (0,01VA @ 1A)  $I_{on} = 5A$ : burden  $3m\Omega$  (0,075VA @ 5A)

If input is supplied by a core balance CT for high sensitivity Earth Fault detection, it is recommended to select a Ratio 100/1 Burden  $\geq$  0,1VA.

# 2.2 Power supply

Power supply input (terminals 1-2) is multi-voltage autoranging 2kV isolated has no polarity and can accept any AC or DC voltage in the range  $\underline{a}$  or  $\underline{b}$  - Consumption  $\leq 3VA$ .



Doc. N° MO-0128-ING

Rev. 0

Pag. **5** of **15** 

#### 2.3 Serial Communication

An RS485/RS232 serial communication port is available on relay's front.

The communication is supported by a Jbus/Modbus compatible protocol.

The relay can be connected either directly to any IBM compatible P.C. via a dedicated cable or to an RS485 serial bus. The latter configuration allows the user to connect more than one relay to a P.C. via the same physical serial line.

A communication software (MS-COM) for Windows 95/98/NT4.0-SP3 is available.

Please refer to the MS-COM instruction manual for more information.

The serial port provides the following functions/information:

- Control the Test and Reset functions
- □ Read the actual R.M.S. measurement of the input quantities given as a number to be related to input current (see DATA BASE)
- □ Read the actual motor estimated temperature given as a percentage of the steady state temperature reached when the motor nominal input current is injected.
- □ Read the value of the different parameters as set on the rotary switches of relay's front face.
- Modify the following settings:
  - F37 tripping level.
  - Nominal frequency (50 or 60Hz).
  - F46 enable/disable.
  - Configuration of output relays (normally energized or normally deenergized).
  - R1 reset mode (auto/man).
  - ON/OFF control of relay R2, when the starting transition function id disabled.
- □ Monitor the status of the protection elements (normal/above set level/tripped).
- □ Monitor the self diagnostic function (E<sup>2</sup>P error, Calibration error)

The above data can be accessed as words whose logical addresses are listed in the following table:



Doc. N° MO-0128-ING

Rev. 0

Pag. 6 of 15

# 2.3.1 - DIN30-M : DATA BASE

Word number (.Bit Number)	Type (I, O, I/O)	Meaning	Range	Unit	Factory default
67	0	Phase A current	065535	1200 => Phase nominal current <sup>1</sup>	//
68	0	Phase B current	065535	1200 => Phase nominal current <sup>1</sup>	//
69	0	Phase C current	065535	1200 => Phase nominal current <sup>1</sup>	//
70	0	Motor estimated temperature	065535	%Tn	//
71	0	Zero sequence current	065535	11998 => Zero sequence nominal current <sup>2</sup>	//
78.0	0	E2PROM status	0/1	0 => OK 1 => E2PROM error	//
78.1	0	Calibration status	0/1	0 => calibration completed successfully 1 => error during calibration	//
78.2 => 78.15	//	Reserved	//	//	//
80.0	0	Level of test push button	0/1	0 => test push button is depressed 1 => test push button is pressed	//
80.1	0	Level of reset push button	0/1	0 => reset push button is depressed 1 => reset push button is pressed	//
80.2	0	Status of input 1516	0/1	0 => 1516 input is 0 1 => 1516 input is 1	//
80.3	//	Reserved	//	//	//
80.4 => 80.15	//	Reserved	//	//	//
81.0	0	Trip status, F49	0/1	0 => F49 not tripped 1 => F49 tripped	//
81.1	0	Trip status, F46	0/1	0 => F46 not tripped 1 => F46 tripped	//
81.2	0	Trip status, F37	0/1	0 => F37 not tripped 1 => F37 tripped	//
81.3	0	Trip status, test	0/1	0 => No test trip 1 => Test trip	//
81.4	0	Trip status, F51LR	0/1	0 => F51LR not tripped 1 => F51LR tripped	//
81.5	0	Trip status, F51N	0/1	0 => F51N not tripped 1 => F51N tripped	//
81.6	0	Trip status, PTC	0/1	0 => PTC not tripped 1 => PTC tripped	//
81.7	0	Trip status, F50	0/1	0 => F50 not tripped 1 => F50 tripped	//
81.8 => 81.15	//	Reserved	//	//	//
82.0	0	Thermal overload alarm	0/1	0 => No alarm 1 => Alarm	//
82.1	0	F37 pick up	0/1	0 => no F37 pick up 1 => F37 picked up	//
82.2	0	F51LR pick up	0/1	0 => no F51LR pick up 1 => F51LR picked up	//
82.3	0	F51N pick up	0/1	0 => no F51N pick up 1 => F51N picked up	//
82.482.6	//	Reserved	//	//	//
82.7	0	Motor on	0/1	0 => motor off 1 => motor on	//
82.8 => 82.14	//	Reserved	//	//	//
82.15	0	End of transition	0/1	0 => Transition time not expired 1 => Transition time expired	//
84	0	Im : motor nominal current	21194238	4238 => In <sup>3</sup>	2119 (0.5ln)



Doc. N° MO-0128-ING

Rev. 0

Pag. 7 of **15** 

Word number (.Bit Number)	Type (I, O, I/O)	Meaning	Range	Unit	Factory default
85	0	τ: motor thermal overload time constant	1807200	1s	180 (3min), 360 (6min) with motor off
86	0	Ist: starting current	1050	0.1lm	10 (1lm)
87	0	tst: starting time	10100	0.1s	10 (1.0s)
88	0	F51N tripping level	211921188	42377 => On <sup>4</sup>	2119 (0.05On)
89	0	F51N tripping time	10100	0.01s	10 (0.1s)
90	I/O	F37 tripping level	28	0.1lm	8 (0.8lm)
91	I/O	Nominal frequency	01	0 => 50Hz, 1 => 60Hz	0 (50Hz)
106.0	I/O	Remote test command	0/1	0 => No Remote Test 1 => Remote Test	//
106.1	I/O	Remote reset command	0/1	0 => No Remote Reset 1 => Remote Reset	//
106.2	I/O	Load default settings	0/1	0 => Don't load default settings 1 => Load default settings <sup>5</sup>	//
106.3	I/O	R2 status	0/1	0 => no command 1 => R2 start	//
106.4	I/O	R2 status	0/1	0 => no command 1 => R2 stop	//
106.5106.15	//	Reserved	//	//	//
110.0	I/O	F46 enable	0/1	0 => Disable F46 1 => Enable F46	0 (F46 disabled)
110.1	I/O	F37 enable	0/1	0 => Disable F37 1 => Enable F37	0 (F37 disabled)
110.2	I/O	F50 enable	0/1	0 => Disable F50 1 => Enable F50	0 (F50 disabled)
110.3	I/O	Type of R1 reset	0/1	0 => Manual reset 1 => Automatic reset	0
110.4	I/O	R1 configuration	0/1	0 => R1 normally deenergized 1 => R1 normally energized	0
110.5	I/O	R2 configuration	0/1	0 => R2 normally deenergized 1 => R2 normally energized	0
110.5110.15	//	Reserved	//	//	//
111	0	ld word #1	//	ASCII	Constant = 'DI'
112	0	ld word #2	//	ASCII	Constant = 'N3'
113	0	ld word #3	//	ASCII	Constant = '0-'
114	0	Id word #4	//	ASCII	Constant = 'M '
115	0	ld word #5	//	ASCII	Constant = ' '
123	I/O	Node address	1255	1	1

<sup>&</sup>lt;sup>1</sup> Phase currents are represented using a conventional unit. A value equal to 4238 corresponds to the nominal phase current (In).

<sup>&</sup>lt;sup>2</sup> Zero sequence current is represented using a conventional unit. A value equal to 42377 corresponds to the nominal zero sequence current (On).

3 Phase tripping levels are represented using a conventional unit. A value equal to 4238 corresponds to the nominal phase current (In).

<sup>&</sup>lt;sup>4</sup> Zero sequence tripping levels are represented using a conventional unit. A value equal to 42377 corresponds to the nominal zero sequence current (On). <sup>5</sup>This bit is enabled only during relay automatic calibration.



Doc. N° MO-0128-ING

Rev. 0

Pag. **8** of **15** 

#### 2.4 PTC Input (Terminals 15-16)

This input is detected by the relay in the open state when a resistor greater than  $1600\Omega$  +/- 5% is connected to it.

## 2.5 Output relays R1 - R2

Two contacts with a common point are controlled by relays R1 and R2 (one for each relay)

☐ Maximum continuos rating : 5A - 250V.

□ Maximum switching power
 □ Maximum switching voltage
 : 1250VA (5A resistive)
 □ 250Vac - 110Vdc.

☐ Maximum make current : 20A - 0,5s.

□ Maximum DC brake current : 0,2A - 110Vdc L/R=40ms.

Relay R1 is operated on tripping of whichever of the relays' elements (F46,F49, F37, F51LR, F50, F51N, PTC). R1 can be configured via serial port as Normally Deenergized (energized on trip) or Normally Energized (deenergized on trip).

Relay R2 is operated by the starting switch-over control function. If such function is not enabled, R2 can be accessed by sending start/stop commands via the serial communication interface. No start command will be accepted by the relay during a trip or an internal fault.

Just like R1, R2 can be configured as Normally Deenergized or Normally Energized.

#### 2.6 Signalizations and controls (see Fig. 1)

#### 2.6.1 Thermal image element F49

Im = (0.5-1)In : motor nominal current given as p.u. of the relay nominal current.

O/L Class : motor thermal overload class or time constant. IEC classes from 5 up to 30

can be selected. Furthermore the user can choose time constants up to 1h.

Switch Position	IEC Class	Time constant $\tau = min$
C.5	5	3
C.10	10	6
C.15	15	9
C.20	20	12
C.25	25	15
C.30	30	18
$\tau = 21 \text{min}$	-	21
$\tau = 24min$	-	24
$\tau = 30$ min	-	30
$\tau = 60$ min	-	60

See fig. 2 for the element's tripping curve. The term *I* in fig. 2 is given by the following formula:

$$I = \sqrt{I_d^2 + 3I_s^2}$$

where  $I_d$  and  $I_s$  are respectively the R.M.S. values of the positive and negative sequence components of motor current.



Doc. N° MO-0128-ING

Rev. 0

Pag. 9 of 15

- 10-step Rotary Switch for setting the value [Im]
- 10-step Rotary Switch for setting of the thermal overload class [O/L CLASS].
- Red signal led F49

The led is:

- (a) Flashing in case of thermal overload alarm (actual estimated temperature over 100% full load temperature).
- (b) Illuminated on tripping of the F49 or F37 element.
- □ Reset from status a is automatic
- Reset from status b is manual by the Reset button (11) or via the serial communication interface
- (\*)The status of the LEDs is memorized even on failure of power supply

## 2.6.2 Starting sequence control and locked rotor element F51LR

Ist = (1 - 5)In - Dis-Tr : switch-over current (p.u. of motor full load current).

tst = (1 - 10)s : switch-over time

Operation.

- A) For any set value of I<sub>st</sub> from 1 to 5 I<sub>m</sub> and any set value of t<sub>st</sub> the element operates as follows:
  - ☐ As soon as motor current exceeds 0.1I<sub>m</sub> the timer t<sub>st</sub> is started.
  - ☐ If during t<sub>st</sub> current drops below the set value l<sub>st</sub>, the relay R2 is operated to control starting changeover (wye –delta, autotransformer, etc.)
  - ☐ If motor current stays above I<sub>st</sub> longer than t<sub>st</sub> the locked rotor element is tripped and relay R1 is operated.
  - □ During normal motor running (after 2t<sub>st</sub>), if current exceeds 2.5l<sub>m</sub> for more than 2sec, the locked rotor element trips and operates R1.
- B) When I<sub>st</sub> is set to Dis Tr., the starting sequence function is deactivated:
  - ☐ At motor start-up the locked rotor function is disabled for 2\*t<sub>st</sub> seconds.
  - □ After 2t<sub>st</sub>, if current exceeds 2.5l<sub>m</sub> form more than 2sec, the locked rotor element trips and operates R1.
- 4 10-step Rotary Switch for setting the value [Ist]
- 5 10-step Rotary Switch for setting t<sub>st</sub>
- 6 Red signal Led F51LR The led is:
  - (a) Flashing:
  - □ When motor current is greater than l<sub>st</sub> during motor starting time [t<sub>st</sub>].
  - □ During the F51LR trip time delay (2s).
  - (b) Illuminated on tripping of the F51LR element.:
  - □ Reset from status a is automatic
  - Reset from status b is manual by the Reset button (11) or via the serial communication Interface.
  - (\*)The status of the LEDs is memorized even on failure of power supply



Doc. N° MO-0128-ING

Rev. 0

Pag. **10** of **15** 

#### 2.6.3 - Earth Fault element F51N

lo = (0.05-0.5)lon in minimum earth fault pick-up current given as p.u. of relay's rated

residual input current

to = (0.1-1)s : trip time delay (sec) of relay R1 for earth fault

7 10-step Rotary Switch for setting the value [lon]

8 - 10-step Rotary Switch for setting of the trip time delay [to]

General Section 1.
 General Section 1.
 General Section 2.
 Fig. 1.
 Fig. 1.
 Fig. 2.
 Fig.

(a) Flashing during the trip time delay to

(b) Illuminated on tripping after to:

□ Reset from status - a - is automatic

Reset from status - b - is manual by the Reset button 11 or via the serial communication Interface.

(\*)The status of the LEDs is memorized even on failure of power supply

#### 2.6.4 Phase loss or phase reversal F46.

This function can only be enabled or disabled via the serial communication interface. No other settings can affect it. A trip takes place after a 100ms time delay whenever the ratio between the R.M.S. value of the negative sequence component and the R.M.S. value of the positive sequence component is greater than 0.4. This value is largely exceeded in case of Phase Reversal (Is>Id) and in case of single phase running (Is=Id)

(13) - Yellow signal Led F46/50:

□ The led is illuminated on tripping of the F46 element

Reset is manual by the Reset button (11) or via the serial communication interface

#### 2.6.5 Overcurrent protection F50.

This function can only be enabled or disabled via the serial communication interface. No other setting can affect it. A trip takes place instantaneously ( $\approx$  50ms) as soon as the current of any phase exceeds  $2xI_{st}$ . If lst is not defined (transition control disabled) the trip level for this function is equal to  $10I_m$ .

(13) - Yellow signal Led F46/50:

□ The led is flashing on tripping of the F50 element.

Reset is manual by the Reset button 11 or via the serial communication interface



Doc. N° MO-0128-ING

Rev. 0

Pag. 11 of 15

#### 2.6.6 Undercurrent F37

Imin = (0.2-0.8)Im : F37 tripping level. It can be set via the serial communication interface.

A trip occurs when the maximum among the three phase currents is smaller than I<sub>min</sub> for more than 3s. This function can also be disabled via the serial communication interface.

#### 2.6.7 PTC

A trip takes place whenever the PTC input is detected in the open state for at least 300ms (see also par. 2.4)

(14)

- Red signal Led PTC:

The led is:


- (a) Flashing during the F37 trip time delay tl< (3s) and after tripping of the F37 element.
- (b) Illuminated on tripping of the PTC element.

In case of overlapping trips of both the PTC and F37 elements, the led is illuminated.

- □ Reset from status a is automatic
- □ Reset from status b is manual by the Reset button (11) or via the serial communication interface
- (10) Test push button : When pressed makes all the functions trip and all the leds lit-on
- 11 Reset push button : Press to reset the signal leds after function's tripping. When Manual Reset is programmed, this button also resets the R1 relay.
  - Illuminated in normal operation when power input is energized.
- (12) Green Led "Power Supply" : Flashing when a relay's internal fault is detected by the

autodiagnostic function.

Fig.1

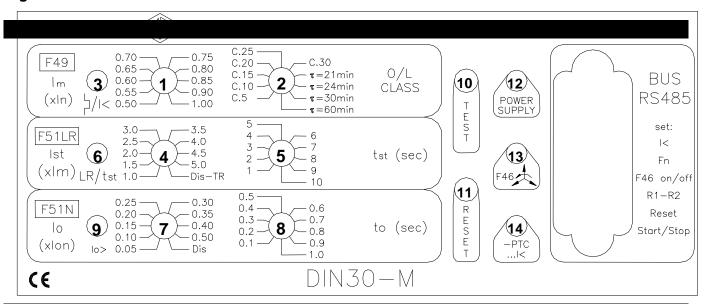




Doc. N° MO-0128-ING

Rev. 0

Pag. 12 of 15

# 3. THERMAL IMAGE CURVES

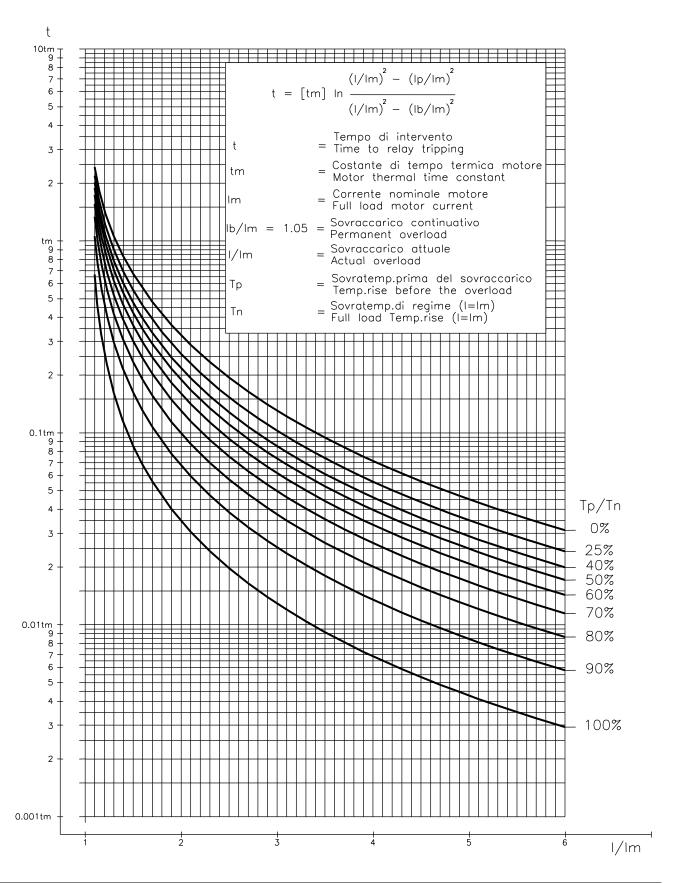




Doc. N° MO-0128-ING


Rev. 0

Pag. 13 of 15

# 4 - CONNECTION DIAGRAM (SCE1520 Rev.1)

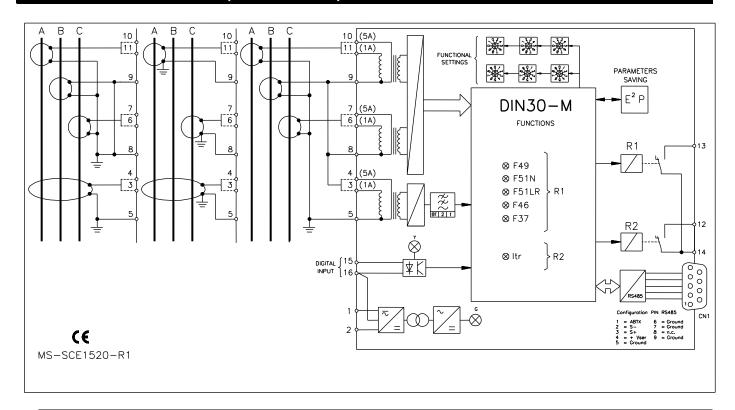

# 4.1 - CONNECTION DIAGRAM (SCE1684 Rev.0)

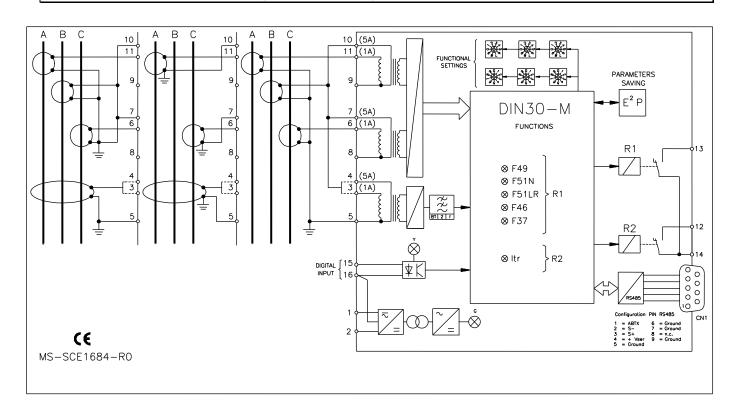





Doc. N° MO-0128-ING

Rev. 0

Pag. 14 of 15

# 5 - OVERALL DIMENSIONS (D46030 Rev.1)

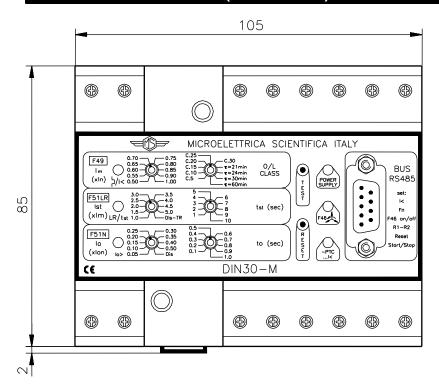

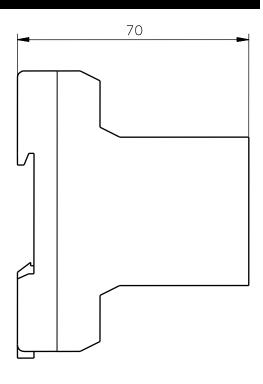

# 6 - MAINTENANCE

No maintenance is required. Periodically a functional check-out can be made by operating the TEST button on relay's front. In case of malfunctioning please contact Microelettrica Scientifica Service or the local Authorised Dealer mentioning the relay's Serial No reported in the label on relays enclosure.

IMPORTANT NOTICE: in case of E<sup>2</sup>PROM error (green led (12) flashing after power-up or a test) try the following recover procedure:

- 1. Push the test button and then the reset button
- 2. If the error is reset (green led (12) lit-on) turn the relay off and then on again. Check relay's settings via the serial communication interface before restarting normal operation.
- 3. If the error is not reset repeat the operations listed at point 1.
- 4. If the error can't be corrected please contact Microelettrica Scientifica Service or the local Authorised Dealer



Doc. N° MO-0128-ING

Rev. 0

Pag. **15** of **15** 

# 7 - ELECTRICAL CHARACTERISTICS

Reference standards
Dielectric test voltage
Impulse test voltage
Immunity to high frequency burst

Immunity to electrostatic discharge Immunity to sinusoidal wave burst Immunity to radiated E.M. field Immunity to 50-60 Hz magnetic field Immunity to impulse magnetic field Immunity to magnetic burst Resistance to vibration and shocks Rated current phase input Rated current residual current input Current overload Burden on current inputs Average power supply consumption Output relays

Operation ambient temperature Storage temperature

IEC 255, 801; CEI 41-1; IEEE C37; CE 2000 V, 50 Hz, 1 min. 5kV (MC), 1kV (MD) - 1,2/50μs 1 kV (MC), 0,5 kV (MD) - 0,1 MHz 2,5 kV (MC), 1 kV (MD) - 1 MHz 15 kV

100 V - (0,01-1) MHz 10 V/m - (20-1000) MHz 1000 A/m

1000 A/m - 8/20μs 100A/m - (0,1-1) MHz 10-500 Hz - 1 g - 0,075 mm

In = 1 or 5 A On = 1 or 5 A

200 a for 1 sec; 10 A continuos

 $Z_F{=}2m\Omega$  phase at In;  $Z_0{=}3/10m\Omega$  at On = 1/5A

2,5 VA

rating 5 A; 250V AC

Max switching power = 1250VA

Max switching current = 5A (resistive)

Max switching voltage = 250V AC - 110V DC

Max make current = 0.2A, 110V DC, L/R=40ms

-20°C / +60°C -30°C / +80°C

**Microelettrica Scientifica S.p.A.** - 20089 Rozzano (MI) - Italy - Via Alberelle, 56/68 Tel. (##39) 02 575731 - Fax (##39) 02 57510940

 $\underline{\text{http://www.microelettrica.com}} \ \ \underline{\text{e-mail}} : \underline{\text{ute@microelettrica.com}}$ 

The performances and the characteristics reported in this manual are not binding and can modified at any moment without notice