


MICROPROCESSOR MOTOR PROTECTION RELAY

TYPE

MM30-743

OPERATION MANUAL

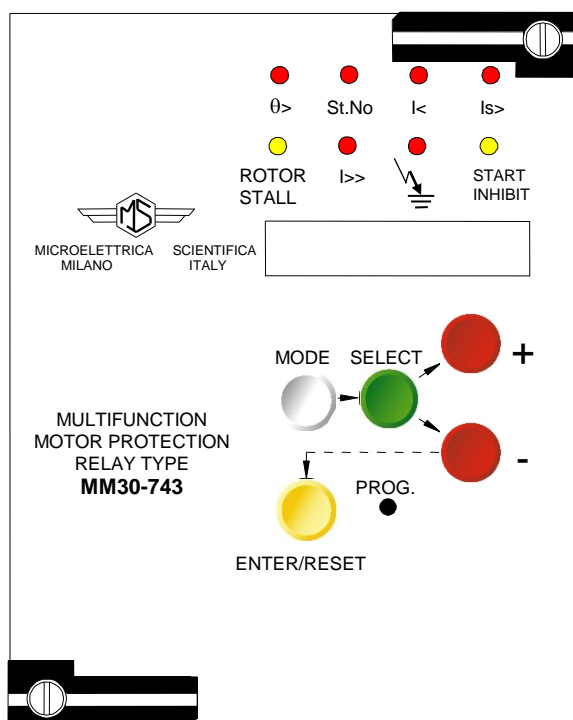

**INDEX**

1. General utilization and commissioning directions	3
1.1 - Storage and Transportation	3
1.2 - Installation	3
1.3 - Electrical Connection	3
1.4 - Measuring Inputs and Power Supply	3
1.5 - Outputs Loading	3
1.6 - Protection Earthing	3
1.7 - Setting and Calibration	3
1.8 - Safety Protection	3
1.9 - Handling	3
1.10 - MAINTENANCE	4
1.11 - FAULT DETECTION AND REPAIR	4
2. GENERAL CHARACTERISTICS	4
2.1 - Power Supply	4
2.2 - Operation and Algorithms	5
2.2.1 - Reference input variables	5
2.2.2 - Input quantities	5
2.2.2.1 - Mains Frequency	5
2.2.2.2 - Phase Current inputs	5
2.2.2.3 - Earth Fault Current Input	5
2.2.3 - Functions and Settings	6
2.2.3.1 - F49 - Thermal Image (See curves § 20)	6
2.2.3.2 - F51LR - Locked Rotor Protection (Rotor jam)	7
2.2.3.2 - F46 - Current Unbalance (Negative Sequence Current) protection (See curve 21)	7
2.2.3.4 - F37 - No-Load Running protection	7
2.2.3.5 - F51 - Overcurrent protection	8
2.2.3.6 - F64 - Earth Fault protection	8
2.2.3.7 - Limitation of the Starts Number	8
2.2.3.8 - Starting Sequence Control	9
2.2.3.9 - Trip Circuit Supervision (Optional)	9
2.2.3.10 - Autosetting	10
2.3 - Oscillographic Recording	10
2.4 - Clock and Calendar	11
2.4.1 - Clock synchronization.	11
2.4.2 - Date and time setting.	11
2.4.3 - Time resolution.	11
2.4.4 - Operation during power off.	11
2.4.5 - Time tolerance.	11
3. CONTROLS AND MEASUREMENTS	12
4. SIGNALIZATIONS	13
5. OUTPUT RELAYS	14
6. SERIAL COMMUNICATION	14
7. DIGITAL INPUTS	15
8. TEST	15
9. KEYBOARD AND DISPLAY OPERATION	16
10. READING OF MEASUREMENTS AND RECORDED PARAMETERS	17
10.1 - ACT.MEAS	17
10.2 - MAX VAL	17
10.3 - LASTTRIP - Recording of the last five trippings	18
10.4 - TRIP NUM	18
11. READING OF PROGRAMMED SETTINGS AND RELAY'S CONFIGURATION	18
12. PROGRAMMING	19
12.1 - PROGRAMMING OF FUNCTIONS SETTINGS	19
12.2 - PROGRAMMING THE CONFIGURATION OF OUTPUT RELAYS	21
13. MANUAL AND AUTOMATIC TEST OPERATION	22
13.1 Mode "TESTPROG" subprogram "W/O TRIP"	22
13.2 Mode "TESTPROG" subprogram "WithTRIP"	22
14. MAINTENANCE	22
15. POWER FREQUENCY INSULATION TEST	22
16. ELECTRICAL CHARACTERISTICS	23
17. CONNECTION DIAGRAM (SCE1811 Rev.0 Standard Output)	24
17.1 - CONNECTION DIAGRAM (SCE1798 Rev.0 Standard Output with F74)	24
18. WIRING THE SERIAL COMMUNICATION BUS (SCE1309 Rev.0)	25
19. CHANGE PHASE CURRENT RATED INPUT 1 OR 5A	25
20. THERMAL IMAGE CURVES (TU0249 Rev.1)	26
21. INVERSE TIME UNBALANCE PROTECTION ELEMENT (TU0248 Rev.1)	27
22. DIRECTION FOR PCB'S DRAW-OUT AND PLUG-IN	28
22.1 - Draw-out	28
22.2 - Plug-in	28
23. MOUNTING	29
24. KEYBOARD OPERATIONAL DIAGRAM	30
25. SETTING'S FORM	31

 Microelettrica Scientifica	MM30-743	Doc. N° MO-0181-ING
		Rev. 0 Date 28.04.2003

1. General utilization and commissioning directions

Always make reference to the specific description of the product and to the Manufacturer's instruction. Carefully observe the following warnings.

1.1 - Storage and Transportation

must comply with the environmental conditions stated on the product's instruction or by the applicable IEC standards.

1.2 - Installation

must be properly made and in compliance with the operational ambient conditions stated by the Manufacturer.

1.3 - Electrical Connection

must be made strictly according to the wiring diagram supplied with the Product, to its electrical characteristics and in compliance with the applicable standards particularly with reference to human safety.

1.4 - Measuring Inputs and Power Supply

carefully check that the value of input quantities and power supply voltage are proper and within the permissible variation limits.

1.5 - Outputs Loading

must be compatible with their declared performance.

1.6 - Protection Earthing

When earthing is required, carefully check its efficiency.

1.7 - Setting and Calibration

Carefully check the proper setting of the different functions according to the configuration of the protected system, the safety regulations and the co-ordination with other equipment.

1.8 - Safety Protection

Carefully check that all safety means are correctly mounted, apply proper seals where required and periodically check their integrity.

1.9 - Handling

Notwithstanding the highest practicable protection means used in designing M.S. electronic circuits, the electronic components and semiconductor devices mounted on the modules can be seriously damaged by electrostatic voltage discharge which can be experienced when handling the modules. The damage caused by electrostatic discharge may not be immediately apparent but the design reliability and the long life of the product will have been reduced. The electronic circuits produced by M.S. are completely safe from electrostatic discharge (8 KV IEC 255.22.2) when housed in their case; withdrawing the modules without proper cautions expose them to the risk of damage.

 Microelettrica Scientifica	<h1>MM30-743</h1>	Doc. N° MO-0181-ING Rev. 0 Date 28.04.2003
---	-------------------	--

- a. Before removing a module, ensure that you are at the same electrostatic potential as the equipment by touching the case.
- b. Handle the module by its front-plate, frame, or edges of the printed circuit board. Avoid touching the electronic components, printed circuit tracks or connectors.
- c. Do not pass the module to any person without first ensuring that you are both at the same electrostatic potential. Shaking hands achieves equipotential.
- d. Place the module on an antistatic surface, or on a conducting surface which is at the same potential as yourself.
- e. Store or transport the module in a conductive bag.

More information on safe working procedures for all electronic equipment can be found in BS5783 and IEC 147-OF.

1.10 - MAINTENANCE

Make reference to the instruction manual of the Manufacturer ; maintenance must be carried-out by specially trained people and in strict conformity with the safety regulations.

1.11 - FAULT DETECTION AND REPAIR

Internal calibrations and components should not be altered or replaced.
For repair please ask the Manufacturer or its authorised Dealers.

Misapplication of the above warnings and instruction relieves the Manufacturer of any liability.

2. GENERAL CHARACTERISTICS

Input currents are supplied to 3 current transformers: - two measuring phase current (the third current is computed as vector sum of the two others) - one measuring the earth fault zero-sequence current. Phase current rated input can be 1 or 5A (Selectable by movable bridges an relay card)
For zero-sequence current taps for 1A and 5A input are provided on relay's terminal board.
Make electric connection in conformity with the diagram reported on relay's enclosure.
Check that input currents are same as reported on the diagram and on the test certificate.
The auxiliary power is supplied by a built-in interchangeable module fully isolated an self protected.

2.1 - Power Supply

The relay can be fitted with two different types of **power supply** module :

- | | | | | | |
|--------|---|-----------------------------|--------|---|-----------------------------|
| a) - { | { | 24V(-20%) / 110V(+15%) a.c. | b) - { | { | 80V(-20%) / 220V(+15%) a.c. |
| | | 24V(-20%) / 125V(+20%) d.c. | | | 90V(-20%) / 250V(+20%) d.c. |

Before energising the unit check that supply voltage is within the allowed limits.

2.2 – Operation and Algorithms

2.2.1 - Reference input variables

Display		Description	Setting Range	Step	Unit
NodAd	1	Identification number for connection serial communication	1 - 250	1	1
Fn	50 Hz	Mains frequency	50 - 60	10	Hz
In	500 Ap	Rated primary current of the phase C.Ts.	1 - 9999	1	A
On	500 Ap	Rated primary current of the C.Ts. or of the tore C.T. detecting earth fault current	1 - 9999	1	A
Im	1.0 In	Motor full-load current (p.u. of phase C.Ts. rated current)	0.1 – 1.5	0.01	In
Ist	6 Im	Motor start-up current (p.u. of motor full load current)	0.5 – 10	0.1	Im
tst	5 s	Motor starting time	1 – 120	1	s
ltr	0.5 Ist	Switch-over current of motor starter (p.u. of motor starting current)	Dis – 0.1 – 1	0.1	Ist
tTr	6 s	Max switch-over time from start-up	0.5 – 50	0.1	s

2.2.2 - Input quantities

2.2.2.1 - Mains Frequency

The relay can operate either in 50Hz or 60Hz systems.
 The rated Mains Frequency “Fn” must be set accordingly.

2.2.2.2 - Phase Current inputs

The relay directly displays the r.m.s. value of the Phase Currents “**IA**”, “**IB**”, “**IC**” flowing in the Primary of the input Current Transformers and refers all its measurements to that value.
 To make the relay properly working with any C.T., when programming the relay settings we have to input the value of the Rated Primary Current “In” of the phase C.Ts.

2.2.2.3 - Earth Fault Current Input

Same as for the Phase Currents, the relay directly displays the r.m.s. value of the Zero Sequence Residual Current flowing at the Primary of the Current Transformers.

If the input of the Earth Fault element is supplied by the residual connection of the 3 phase C.Ts., we shall set for “On” the same value as “In”.

If the input of the Earth Fault elements is supplied by a separated Core Balance C.T., or by another CT, “On” value will be the Rated Primary Current of this C.T., normally different from “In”.

The rated Secondary Current of the C.Ts. can be either 1A or 5A.

For the Phase Current inputs, 1A or 5A configuration can be selected by moving the jumpers J1-J2 and J3 provided on the C.T. input card (See § 19).

For the earth Fault current input 1A and 5A taps are provided on relays terminals board: 1A or 5A configuration is obtained connectively to terminals 32-33 or 32-31 (See connection Diagram § 16)

Example :

- ☐ Phase CTs 1500/5A and Core Balance CT 100/1A
- ☐ Load In = 1500A and On = 100A
- ☐ Configure CT input card with jumpers J1, J2, J3 in the 5A position.
- ☐ Connect Earth Fault input to terminals 32-33

2.2.3 - Functions and Settings

2.2.3.1 - F49 – Thermal Image (See curves § 20)

The current “ **I** ” producing motor warming-up is computed as a conventional composition of Positive Sequence “ **Id** ” and Negative Sequence “ **Is** ” components of the motor current.

- Computed current: $I = \sqrt{Id^2 + 3Is^2}$
- *Allowed overloading time* (See Curve § 19)

The trip time delay “ **t** ” of the thermal element, depends on the warming-up time constant “ **tm** ” of the motor, on the previous thermal status (**Ip**), on the admissible continuous overload (**Ib**) and, of course, on the actual load (**I**)

$$t = tm \ln \left[\frac{(I/Im)^2 - (Ip/Im)^2}{(I/Im)^2 - (Ib/Im)^2} \right]$$

tm	=	(1-60)min.	
I	=	computed current	
Ip	=	preheating current	
Ib	=	continuously admissible current	(1-1.3)Im, step 0.01Im
Im	=	motor rated current	(0.1-1.5)In, step 0.1In

- Steady motor *cooling-down* time constant : **to** = (1-10)tm, step 1tm

The cooling-down time constant of the motor when running is “**tm**”; it is automatically changed to “ **to** ” when the motor current drops below 0.1 Im (running/steady motor discrimination level).

- *Thermal prealarm* : **Ta/n** = (50-110)%Tn, step 1%Tn

An alarm signal is issued when the simulated warming exceeds the set percentage of the motor rated temperature Tn.

Automatic 1% drop out percentage.

- *Restart inhibition* : **Ts/n** = (40-100)%Tn, step 1%Tn

To inhibit a new motor starting before cooling down to 99% Ts/n, reset after tripping of the thermal element takes places when $T < 0.99[Ts]$.

2.2.3.2 – F51LR – Locked Rotor Protection (Rotor jam)

At motor starting this function is disabled for the set time “ **2tSt** ” : when this time has elapsed, if current exceeds the set level “ **ILR** ”, the relay trips with a delay of “ **tLR** ” sec.

- *Current level* : **ILR** = (1-5)Im, step 0.1Im.
If **ILR** = DIS. the function is disactivated.
- *Trip time delay* : **tLR** = (1-120)s, step 1s
- *Inhibition time of the locked rotor function* : **2tSt**
tSt = (1-120)s, step 1s = motor start-up time

2.2.3.2 - F46 - Current Unbalance (Negative Sequence Current) protection (See curve 21)

Besides its contribution to the thermal image algorithm, current unbalance also controls another inverse time element

- *Minimum Negative Sequence current operation level* : **Is>** = (0.1-0.8)Im, step 0.1Im.
If **Is>** = DIS. the function is disactivated.
- *Time current curve* : **tIs>** = (1-8)s, step 1s

Actual trip time delay is given by: $t = \frac{0.9}{Is/Im - 0.1} tIs>$ (tIs >= trip time at Is = Im)

“ **Is** ” is the actual Negative Sequence Current

2.2.3.4 - F37 - No-Load Running protection

This function performs the protection against no-load running: it is activated by motor under current.

- *Under current level* : **I<** = (0.15-1)Im, step 0,01Im
If **I<** = DIS. the function is disactivated.

When current is below 0.1Im in all phases the function is activated.

- *Trip time delay* : **tI<** = (0.1-90)s, step 0.1s.

2.2.3.5 - F51 - Overcurrent protection

- *Minimum Pick-up Current level in at least one phase* : **I>** = (1-5)I_{st}, step 0.1 I_{st} (limited to 20 times I_n)
I_{st} (motor locked rotor current) = (0.5-10)I_m, step 0.1I_m
 If **I>** = DIS. the function is disactivated
- *Trip time delay* : **tl>** = (0.05-1)s, step 0,01s.

Any of the output relays can be associated to the time delayed element "**tl>**" as well as to the instantaneous element "**I>**" of this function for signalling or for blocking other relays. The output relay controlled by the **I>** level remains energized for the time **tl>** + **tBO**. After this delay the relay it is anyhow reset.

tBO = (0.05-0.5)s, step 0.05s.

2.2.3.6 - F64 - Earth Fault protection

- *Minimum Pick-up Zero Sequence Residual Current level* : **O>** = (0.02-2)O_n, step 0.01O_n.
 If **O>** = DIS. the function is disactivated.
- *Trip time delay* : **tO>** = (0.05-5)s, step 0.01s.

As for function F51, any of the output relays can also be associated to the instantaneous element of "**O>**" level.

2.2.3.7 - Limitation of the Starts Number

- *Allowed Number of startings* : **St No** = (1-60), step 1
 If **St No** = DIS the number of startings is unlimited.
- *Time interval in which the StNo is counted* : **tStNo** = (1-60)min. step 1 min.

If during the time "**tStN**" the "**StNo**" is attained, a new start is inhibited for the time **tBst**.
- *Restart Inhibition time* : **tBst** = (1-60)min., step 1min.

On the set **tBst**= 0 the inhibition is disactivated

On the set **tBst**= Rm the inhibition is permanent until the RESET key is operated.

2.2.3.8 - Starting Sequence Control

During start-up of the motor, the unit can control an output relay used to operate the switch-over of motor starter (star-delta, resistance or impedance, autotransformer, etc...) thus allowing to automatically manage the starting transition by controlling the following parameters:

- Switch-over (transition) current : $I_{Tr} = (0.1-1)I_{st}$, step $0.1I_{st}$
- Maximum switch-over (transition) time delay : $t_{Tr} = (0.5-50)s$, step $0.1s$.

At motor start counting of "tTr" begins. If during "tTr" the motor current drops below "Itr", switching-over is operated; if motor current stays above "Itr" longer than "tTr", the Locked Rotor element is activated.

2.2.3.9 - Trip Circuit Supervision (Optional)

As Optional, the relay includes a complete Circuit Breaker Trip Circuit Supervision unit that is associated to the Contact "21-22" of the "R1" Output relay.

The contact "21-22" of "R1" is used to trip the C/B as reported in the drawing here below.

The supervision works when the C/B is closed and recognizes the Trip Circuit as sound as far as the current flowing exceeds "1mA".


In case of Trip Circuit fault detection, the diagnostic relay R5 is deenergized and the yellow Led "START INHIBIT" starts flashing (see §5).

To have Supervision also with the C/B open it is needed one N/C contact (52b) from the C/B and an external resistor "R"

$$R[k\Omega] \leq \frac{V}{1mA} - R_{52} \quad \text{where } R_{52} = \text{Trip Coil internal resistance [k}\Omega\text{]}$$

$$V = \text{Trip Circuit Voltage}$$

$$P_R \geq 2 \cdot \frac{V^2}{R} [W]$$

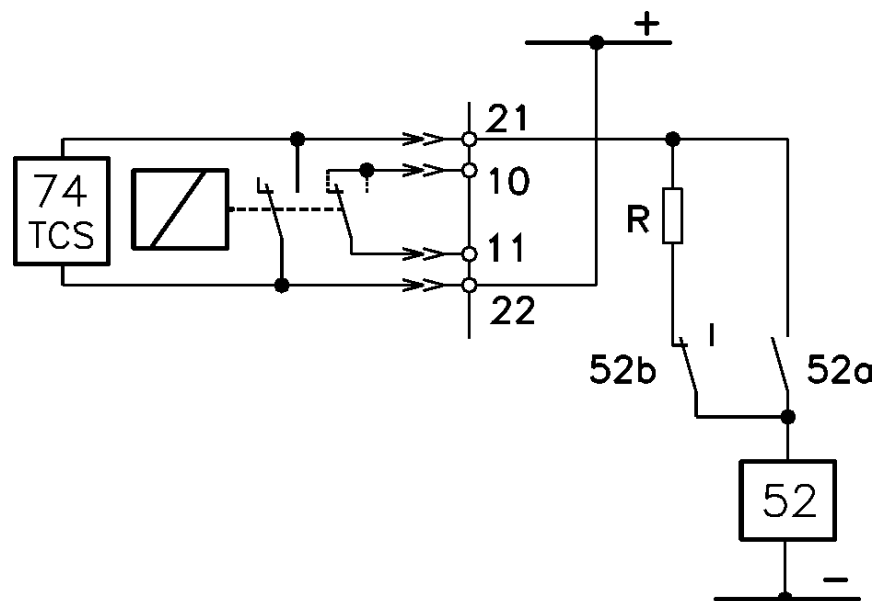

2.2.3.10 - Autosetting

The complexity of properly set a motor protection, frequently produces undesired tripping or non-operation of some of the functions.

The relay MM30 can automatically select the best setting of the parameters according to motor and system basic data. These data are:

- System frequency	=	Fn	=	50 o 60	Hz	
- Rated primary current of phase C.Ts.	=	In	=	0-9999	A	step 1A
- Rated primary current of earth fault C.T	=	On	=	0-9999	A	step 1A
- Motor rated current	=	Im	=	0.1-1.5	In	step 0.01In
- Motor starting current	=	Ist	=	0.5-9.9	Im	step 0.1 Im
- Starting time	=	tst	=	1-120	s	step 1s
- Transition current level	=	ITr	=	0.11	Ist	step 0.1 Ist
- Transition time	=	tTr	=	0.5-50	s	step 0,1s

Once these settings have been programmed, the "AUTASET" function can be activated by the key "ENTER" and all the parameters are computed and automatically set at values suitable for a normal duty of the motor.

Particularly the motor warming-up time constant "tm" is computed so that the motor, when stopped after having run continuously at Rated Power (Rated current Im), can be immediately restarted at least one time.

The parameters can anyhow be manually modified if different setting is needed.

2.3 - Oscillographic Recording

The relay continuously records the measured samples of the 3-phase Currents and the Residual Current. As soon as output Relay "R1" is operated by tripping of a protection Function, the record is stored into memory. The complete buffer includes three records each containing the wave forms of the four currents. The duration of each record corresponds to 14 cycles: 7 before trigger and 7 after trigger. Once 3 events are recorded a next event will replace the oldest of the 3 former events (FIFO).

 Microelettrica Scientifica	MM30-743	Doc. N° MO-0181-ING
		Rev. 0 Date 28.04.2003

2.4 - Clock and Calendar

The unit features a built in clock calendar with Years, Months, Days, Hours, Minutes, Seconds, Tenths of seconds and Hundredths of seconds.

2.4.1 - Clock synchronization.

The clock can be synchronized via the serial communication interface.

The following synchronization periods can be set: 5, 10, 15, 30, 60 minutes.

Synchronization can also be disabled, in which case the relay ignores the serial broadcast signal.

In case synchronization is enabled, the unit expects to receive a sync signal at the beginning of every hour and once every T_{syn} minutes. When a sync signal is received, the clock is automatically set to the nearest expected synchronization time.

For example: if T_{syn} is 10min and a sync signal is received at 20:03:10 January the 10th, 98, then the clock is set to 20:00:00 January the 10th, 1998.

On the other hand, if the same sync signal were received at 20:06:34, the clock would be set to 20:10:00, January the 10th 98.

Note that if a sync signal is received exactly in the middle of a T_{syn} period, the clock is set to the previous expected synchronization time.

2.4.2 - Date and time setting.

When the PROG/SETTINGS menu is entered, the current date is displayed with one of the groups of digits (YY, MMM or DD) blinking.

The DOWN key operates as a cursor. It moves through the groups of digits in the sequence YY => MMM => DD => YY => ...

The UP key allows the user to modify the currently blinking group of digits.

If the ENTER button is pressed the currently displayed date is set.

Pressing the SELECT button the current time is displayed which can be modified using the same procedure as for the date.

If synchronization is enabled and the date (or time) is modified, the clock is stopped until a sync signal is received via the serial port. This allows the user to manually set many units and have them to start their clocks in a synchronized fashion.

If synchronization is disabled the clock is never stopped.

Note that the setting of a new time always clears 10ths and 100ths of sec.

2.4.3 - Time resolution.

The clock has a 10ms resolution. This means that any event can be time-stamped with a 10ms accuracy, although the information concerning 10ths and 100ths of sec. can be accessed only via the serial communication interface.

2.4.4 - Operation during power off.

The unit has an on board Real Time Clock which maintains time information for at least 1 hour in case of power supply failure.

2.4.5 - Time tolerance.

During power on, time tolerance depends on the on board crystal (+/-50ppm typ, +/-100ppm max. over full temperature range).


During power off, time tolerance depends on the RTC's oscillator (+65 /-270 ppm max over full temperature range).

3. CONTROLS AND MEASUREMENTS

Five key buttons allow for local management of all relay's functions.

A 8-digit high brightness alphanumerical display shows the relevant readings (xxxxxxx) (see synoptic table fig.1)


FIG.1

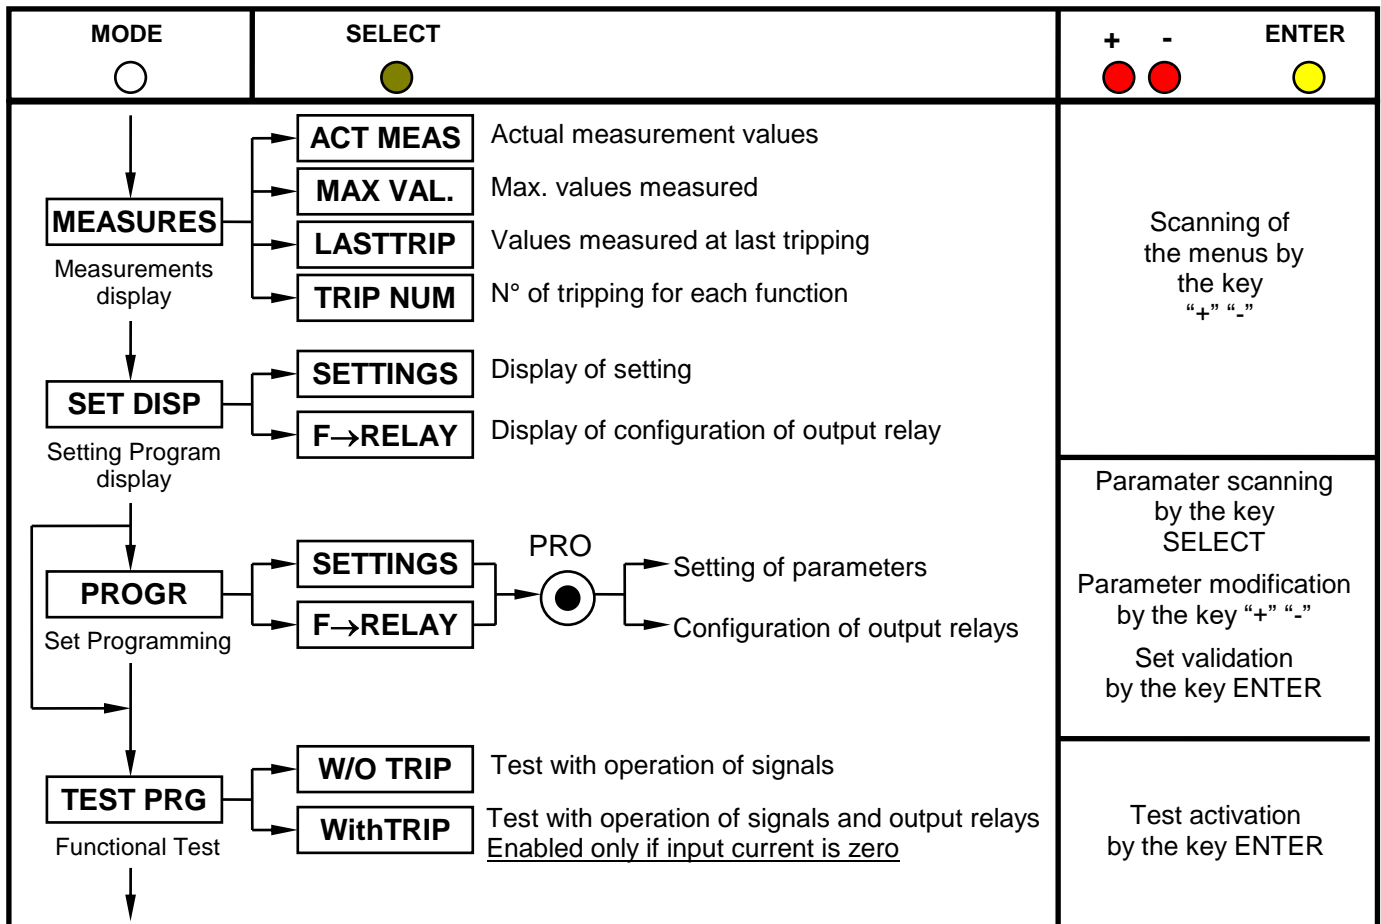

Pressing this button progressively selects between Measurements Display, Setting Display, Programming, and Test modes

The SELECT button chooses which category of values within the chosen mode to display

When in Program mode, this button stores the newly selected value. If not in Program mode and the relay has tripped, this button resets the relay and all output contacts. If not tripped, this button restores the default display.

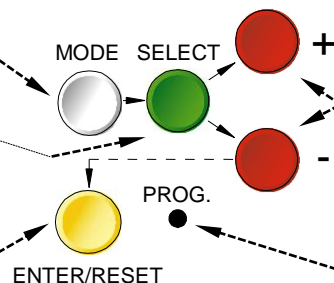


The + and - buttons are used to select the actual measurement or display desired when in Measurements Display or Settings Display modes. When in Program mode, these buttons increase or decrease the value of the displayed setting.

When in Program mode, and when all input currents are zero, pressing this recessed button places the relay into active programming mode, allowing any or all of the relay's settings to be altered.

4. SIGNALIZATIONS

Eight signal leds (normally off) are provided:

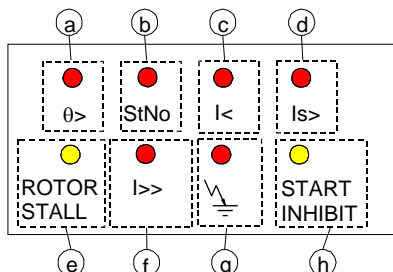

a)	Red LED	$\Theta >$	<input type="checkbox"/> Flashing when the motor heating T overcomes the set alarm level [Ta]. <input type="checkbox"/> Illuminated on over-temperature trip. – Also illuminated on activation of RTD input.
b)	Red LED	St N°	<input type="checkbox"/> Illuminated on tripping of the element for limitation of the number of startings.
c)	Red LED	$I <$	<input type="checkbox"/> Flashing as soon as motor current drops below the set level [$I <$] <input type="checkbox"/> Illuminated at the end of trip time delay.
d)	Red LED	$I_s >$	<input type="checkbox"/> Flashing as soon as motor unbalance overpasses the set level [$I_s >$] <input type="checkbox"/> Illuminated on trip after delay [$tI_s >$].
e)	Yellow LED	ROTOR STALL	<input type="checkbox"/> Illuminated on trip of the Locked Rotor element ($I > I_{LR}$) and/or on activation of the Speed Control input SpC.
f)	Red LED	$I >>$	<input type="checkbox"/> Flashing when motor current is above the set level [$I >$] <input type="checkbox"/> Illuminated on trip after delay [$tI >$].
g)	Red LED	V_{\perp}	<input type="checkbox"/> Flashing when earth fault current is above the set level [$O >$] <input type="checkbox"/> Illuminated on trip after delay [$tO >$].
h)	Yellow LED	START INHIBIT	<input type="checkbox"/> Flashing when in PROGRAM MODE and/or when Trip Circuit Failure is detected. <input type="checkbox"/> Illuminated when relay internal fault is detected.

The reset of the leds takes place as follows:

<input type="checkbox"/> Leds	a,c,d,f,g	<input type="checkbox"/> From flashing to off, automatically when the lit-on cause disappears. <input type="checkbox"/> From ON to OFF, by "ENTER/RESET" push button only if the tripping cause has disappeared.
<input type="checkbox"/> Leds	b,e	<input type="checkbox"/> From ON to OFF, by "ENTER/RESET" push button only if the tripping cause has disappeared.
<input type="checkbox"/> Leds	h	<input type="checkbox"/> From flashing or illuminated to off, automatically when the lit-on cause disappears.

In case of auxiliary power supply failure the status of the leds is recorded and reproduced when power supply is restored.

	MM30-743	Doc. N° MO-0181-ING
		Rev. 0 Date 28.04.2003

5. OUTPUT RELAYS

Five output relays are available (R1, R2, R3, R4, R5)

a) - The relays **R1,R2,R3,R4** are normally deenergized (energized on trip): these output relays are user programmable and any of them can be associated to one of the MM30's functions.

One relay eventually associated to instantaneous element of the function 51 or 51N(64), after pick-up normally drops-out as soon as the tripping cause is cleared (current below the set trip level).

If the current remains above the trip level longer than the time delay programmed for the same function, the drop-out of the instantaneous relay is anyhow forced after an adjustable waiting time [tBO]. (Breaker failure protection control)

The reset after tripping of the relays associated to the time delayed functions takes place automatically as soon as the pick-up cause is cleared.

b) - The relay **R5**, normally energized, is not programmable and is deenergized on:

- ☐ Internal fault
- ☐ Power supply failure
- ☐ During the programming
- ☐ Trip Circuit Failure Detection

6. SERIAL COMMUNICATION

The relays fitted with the serial communication option can be connected via a cable bus or (with proper adapters) a fiber optic bus for interfacing with a Personal Computer (type IBM or compatible).

All the operations which can be performed locally (for example reading of measured data and changing of relay's settings) are also possible via the serial communication interface.

Furthermore the serial port allows the user to read the demand recording data.

The unit has a RS232 / RS485 interface and can be connected either directly to a P.C. via a dedicated cable or to a RS485 serial bus, thus having many relays to exchange data with a single master P.C. using the same physical serial line. A RS485/232 converter is available on request.

The communication protocol is MODBUS RTU (only functions 3, 4 and 16 are implemented).

Each relay is identified by its programmable address code (NodeAd) and can be called from the P.C.

A dedicated communication software (MSCOM) for Windows 95/98/NT4 SP3 (or later) is available.

Please refer to the MSCOM instruction manual for more information Microelettrica Scientifica.

7. DIGITAL INPUTS

On request (Optional) are provided three inputs activated when the relevant terminals are shorted:

- | | | |
|--------------------------------------|--------------------|---|
| <input type="checkbox"/> R.T. | (terminals 1 - 2) | : Remote trip control.
Activation of the input R.T. (Terminals 1-2 shorted) produces the following operation : <ul style="list-style-type: none"> - The output relay associated to the function R.T. is energized - The Trip Number Counter R.T. is incremented by 1 unit - The event recording is activated and shows "CAUSE: RT" |
| <input type="checkbox"/> SpC | (terminals 1 - 3) | : Speed switch
The Speed Control input is connected to an external N/O contact which closes as soon as the motor is running. If the contact does not close within the set start time [tst] from the moment the motor is energised, the Locked Rotor function is tripped. The relay and the signal led associated to ILR are energised, the recording on Last Trip will show cause SpC and trip N° LR will be increased.
If the Speed Control function is not used, it must be deactivated by programming the variable [Spc] = OFF (see § 12.1) |
| <input type="checkbox"/> RTD | (terminals 1 - 14) | : Thermal probe.
This function is enabled by programming the variable [RTD] = ON (see § 12.1)
If the function is enabled, the input RTD is activated when the resistance connected to the terminals 1-14 exceeds the limits $50\Omega > R_{1-14} > 2900\Omega$.
This limits respectively correspond to "Shorted Probe" ($<50\Omega$) or to "Overtemperature" ($R > 2900\Omega$) (*)
In this case activation of the input 1-14 (terminals shorted) produces the following operation: <ul style="list-style-type: none"> - The relay associated to R.T. is energized - The Led T> is lit-on. - The counter of Trip Number of the function T> is incremented - LastTrip recording shows : "CAUSE RTD" <p style="text-align: right; margin-top: 10px;"> (*) If Pt100 thermal probes are used, calibrated accordingly.
 <u>Please specify when ordering!</u> </p> |

8. TEST


Besides the normal "WATCHDOG" and "POWERFAIL" functions, a comprehensive program of self-test and self-diagnostic provides:

- ☐ Diagnostic and functional test, with checking of program routines and memory's content, run every time the aux. power is switched-on: the display shows the type of relay and its version number.
- ☐ Dynamic functional test run during normal operation every 15 min. (relay's operation is suspended for less than $\leq 4ms$). If any internal fault is detected, the display shows a fault message, the Led "PROG/IRF" illuminates and the relay R5 is deenergized.
- ☐ Complete test activated by the keyboard or via the communication bus either with or without tripping of the output relays.

9. KEYBOARD AND DISPLAY OPERATION

All controls can be operated from relay's front or via serial communication bus.

The keyboard includes five hand operable buttons (**MODE**) - (**SELECT**) - (**+**) - (**-**) - (**ENTER/RESET**) plus one indirect operable key (**PROG**) (see synoptic table a fig.1):

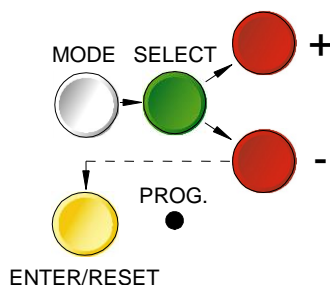

a) - White key	MODE	:	when operated it enters one of the following operation modes indicated on the display :
	MEASURES	=	Reading of all the parameters measured and of those recorded in the memory
	SET DISP	=	Reading of the settings and of the configuration of the output relays as programmed.
	PROG	=	Access to the programming of the settings and of relay configuration.
	TEST PROG	=	Access to the manual test routines.
b) - Green key	SELECT	:	When operated it selects one of the menus available in the actual operation MODE
c) - Red key	“+” AND “-”	:	When operated they allow to scroll the different information available in the menu entered by the key SELECT
d) - Yellow key	ENTER/RESET	:	It allows the validation of the programmed settings - the actuation of test programs - the forcing of the default display indication - the reset of signal Leds.
e) - Indirect key	●	:	Enables access to the programming.

10. READING OF MEASUREMENTS AND RECORDED PARAMETERS

Enter the MODE "MEASURES", SELECT the menus "ACT.MEAS"-"MAX VAL"-"LASTTRIP"-"TRIP NUM", scroll available information by key "+" or "-" .

10.1 - ACT.MEAS

Actual values as measured during the normal operation.
The values displayed are continuously refreshed.

Display			Description
xxXXXxx			Date : Day, Month, Year
xx:xx:xx			Hour : Hours, Minutes, Seconds
T/Tn	xxx	%	Actual temperature rise displayed as % of the motor full load temperature rise (0 - 999%)
IA	xxxxx	A	True R.M.S. value of the current of phase A displayed as primary Amps. (0 - 99999)
IB	xxxxx	A	As above, phase B.
IC	xxxxx	A	As above, phase C.
Io	xxxxx	A	As above, earth fault current.
Id/m	xxx	%	Positive sequence component of motor current displayed as % of motor full load current. (0 - 999)%
Is/m	xxx	%	Negative sequence component of motor current displayed as % of motor full load current. (unbalance degree) (0 - 999)%

NB: If no key is operated within 60 sec. the display is automatically switched to the default indication

10.2 - MAX VAL

Highest values recorded during motor run after the starting time (refreshed at each higher value) plus highest values recorded during the starting time (refreshed at each new starting).

Display			Description
T/Tn	xxx	%	Highest temperature recorded since the start of the run. (0 - 99,9)%
IA	xxxxx	A	Current of phase A measured during run after starting time (0-99999)
IB	xxxxx	A	As above, phase B.
IC	xxxxx	A	As above, phase C.
Io	xxxxx	A	As above, zero sequence current.
Id/m	xxx	%	Positive sequence component of motor current.
Is/m	xxx	%	Negative sequence component of motor current
SA	xxxxx	A	Current of phase A during the starting time.
SB	xxxxx	A	As above, phase B.
SC	xxxxx	A	As above, phase C.
So	xxxxx	A	As above, earth fault current.
Sd/m	xxx	%	Positive sequence current component during starting time.
Ss/m	xxx	%	Negative sequence current component during starting time.
tSt	xxxx	s	Measure of the start time.

10.3 - LASTTRIP – Recording of the last five trippings

Display of the function which caused the tripping of the relay and values of the parameters at the moment of tripping. The memory buffer is refreshed at each new relay tripping.

Display		Description
LastTr-x		Indication of the recorded event (x= 0 to 4) Example: Last event (LastTr -0) Last but one event (LastTr-1) etc...
xxXXXxx		Date : Day, Month, Year
xx:xx:xx		Hour : Hours, Minutes, Seconds
Cause xxx		Function which caused the last tripping: T>; Is>; I>; O>; I<; LR; StN; ITr; TCS.
IA xxxxx A		Current of phase A.
IB xxxxx A		Current of phase B.
IC xxxxx A		Current of phase C.
Io xxxxx A		Earth fault current.
Id/m xxx %		Positive sequence component of current.
Is/m xxx %		Negative sequence component of current.
T/Tn xxx %		Motor heating

10.4 - TRIP NUM

Counters of the number of operations for each of the relay functions.
The memory is non-volatile and can be cancelled only with a secret procedure.

Display		Description
T> xxxxx		Motor overload.
Is> xxxxx		Current unbalance.
I> xxxxx		Overcurrent.
O> xxxxx		Earth fault.
I< xxxxx		No load running.
LR xxxxx		Locked rotor.
StN> xxxxx		No of consecutive startings.
ITr xxxxx		Too long starting.
RT xxxxx		Remote trip.
TCS xxxxx		C/B Trip Circuit Failure

11. READING OF PROGRAMMED SETTINGS AND RELAY'S CONFIGURATION

Enter the mode "SET DISP", select the menu "SETTINGS" or "F→RELAY", scroll information available in the menu by keys "+" or "-".

SETTINGS= values of relay's operation parameters as programmed

F→RELAY= output relay associated to the different functions as programmed.

12. PROGRAMMING

The relay is supplied with the standard default programming used for factory test. [Values here below reported in the " Display " column].


All parameters can be modified as needed in the mode PROG and displayed in the mode SET DISP. **Local Programming by the front face key board is always enabled. Programming via the serial port is always enabled but a password is required to access the programming mode. The default password is the null string; in the standard application program for communication "MS-COM" it is also provided an emergency password which can be disclosed on request only.**

As soon as programming is enabled, the Led PRG/IRF flashes and the reclosing lock-out relay R5 is deenergized. Enter MODE "PROG" and SELECT either "SETTINGS" for programming of parameters or "F→RELAY" for programming of output relays configuration; enable programming by the indirect operation key PROG.

The key SELECT now scrolls the available parameters. By the key (+) , (-) the displayed values can be modified; to speed up parameter's variation press the key SELECT while "+" or "-" are pressed.

Press key "ENTER/RESET" to validate the set values.

12.1 - PROGRAMMING OF FUNCTIONS SETTINGS

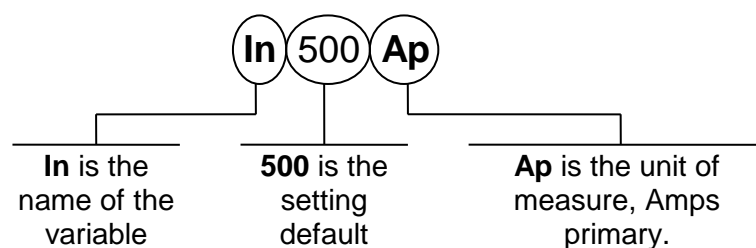

Mode PROG menu SETTINGS. (Production standard settings here under shown).

Display	Description			Setting Range	Step	Unit
xxxxxxx	Current date			DDMMYY	-	-
xx:xx:xx	Current time			HH:MM:SS	-	-
NodAd	1	Identification number for connection on serial communication bus			1 - 250	1
Fn	50	Hz	Mains frequency	50 - 60	10	Hz
In	500	Ap	Rated primary current of the phase C.Ts.	1 - 9999	1	A
On	500	Ap	Rated primary current of the C.Ts. or of the tore C.T. detecting earth fault current	1 - 9999	1	A
Im	1.0	In	Motor full-load current (p.u. of phase C.Ts. rated current)	0.10 - 1.50	0.01In	In
Ist	6	Im	Motor start-up current (p.u. of motor full load current)	0.5 - 10	0.1	Im
tst	5	s	Motor starting time	1 - 120	1	s
Itr	0.5	Ist	Switch-over current of motor starter (p.u. of motor starting current)	Dis - 0.1 - 1	0.1	Ist
tTr	6	s	Max switch-over time from start-up	0.5 - 50	0.1	s


 Microelettrica Scientifica	<h1>MM30-743</h1>	Doc. N° MO-0181-ING
		Rev. 0 Date 28.04.2003

Display	Description	Setting Range	Step	Unit
AUTOSET? + ENTER	Automatic setting of all the following parameters computed on the base of the setting of the previous parameters			
tm 34 min	Thermal time constant of motor while running tm is computed to allow at least one restarting with the motor at its rated full load temperature	1 - 60	1	min
to/tm 3	Steady/running motor thermal time constant	1 - 10	1	1
Ta/n 90 %	Prealarm motor heating level (% of motor full-load temperature rise)	50 - 110	1	%Tn
Ts/n 100 %	Motor restart heating level	40 - 100	1	%Tn
Ib 1.05 Im	Rated maximum continuous current of the motor	1.00 – 1.30	0.05	Im
StNo 6	Max. No of startings allowed within the time tStNo	Dis - 1 - 60	1	-
tStNo 60 m	Time into which the StNo is counted	1 - 60	1	m
tBSt 12 m	Restart inhibition time after tripping of the function StNo (Rm = restart inhibited until manual RESET is operated)	Rm - 1 - 60	1	min
ILR 2 Im	Trip level of Locked Rotor function	Dis - 1 - 5	0.1	Im
tLR 1 s	Trip time delay of LR element during run	1 – 25	1	s
Is> 0.3 Im	Trip level of inverse time current unbalance protection element	Dis - 0.1 - 0.8	0.1	Im
tIs> 4 s	Trip time delay of inverse time current unbalance protection when Is=Im	1 - 8	1	s
I< 0.2 Im	Trip level of undercurrent (no-load running) element	Dis - 0.15 - 1	0.01	Im
tI< 3 s	Trip time delay of undercurrent element	0.1 - 90	0.1	s
I> 2 Ist	Trip level of overcurrent element	Dis - 1 - 5	0.1	Ist
tI> 0.1 s	Trip time delay of overcurrent element	0.05 - 1	0.01	s
O> 0.1 On	Trip level of earth fault element	Dis - 0.02 - 2	0.01	On
tO> 0.2 s	Trip time delay of earth fault element	0.05 - 5	0.01	s
tBO 0.15 s	Reset time delay of the blocking output relay	0.05 - 0.5	0.01	s
RTD OFF	Input from external thermal probe	ON - OFF	-	-
SpC OFF	Speed switch control	ON - OFF	-	-
TCS OFF	Trip Circuit Supervision	ON - OFF	-	-
Tsyn Dis m	Clock synchronisation Time Expected time interval between sync. signal.	5 - 60 - Dis	5-10 15-30 60-Dis	m

The setting Dis indicates that the function is disactivated.



12.2 - PROGRAMMING THE CONFIGURATION OF OUTPUT RELAYS

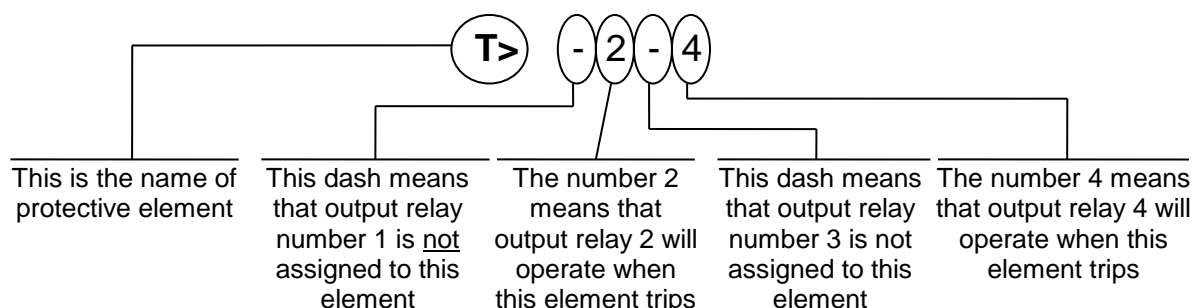

Mode PROG menu F→RELAY (Production standard settings here under shown).

The key "+" operates as cursor; it moves through the digits corresponding to the four programmable relays in the sequence 1,2,3,4,(1= relay R1, etc.) and makes start flashing the information actually present in the digit. The information present in the digit can be either the number of the relay (if this was already associated to the function actually on programming) or a dot (-) if the relay was not yet addressed.

The key "-" changes the existing status from the dot to the relay number or viceversa.

After programming of any function (T>, Ta, etc.), press the key ENTER to validate the configuration selected,

Display	Descrizione
T> 1 - - -	Overload tripping
Ta - 2 - -	Overload prealarm tripping
ITr - - - -	Starting switch-over tripping
StNo - - - -	Start No limitation tripping
ILR 1 - - -	Locked Rotor tripping
tl> 1 - - -	Time delayed unbalance tripping
I< - - - 4	No load running tripping
I> - - - -	Instantaneous overcurrent tripping
tl> 1 - - -	Time delayed overcurrent tripping
O> - - - -	Instantaneous earth fault tripping
tO> 1 - - -	Time delayed earth fault tripping
RT - - - -	Remote trip control.

13. MANUAL AND AUTOMATIC TEST OPERATION

13.1 Mode "TESTPROG" subprogram "W/O TRIP"

Operation of the yellow key activates a complete test of the electronics and the process routines. All the leds are lit-on and the display shows (TEST RUN). If the test routine is successfully completed the display switches-over to the default reading (T/Tnxxx%).
If an internal fault is detected, the display shows the fault identification code and the relay R5 is deenergized. This test can be carried-out even during the operation of the relay without affecting the relay tripping in case a fault takes place during the test itself.

13.2 Mode "TESTPROG" subprogram "WithTRIP"

Access to this program is enabled only if the current detected is zero (breaker open). Pressing the yellow key the display shows "TEST RUN?". A second operation of the yellow key starts a complete test which also includes the activation of all the output relays.
The display shows (TEST RUN) with the same procedure as for the test with W/O TRIP.
Every 15 min during the normal operation the relay automatically initiates an auto test procedure (duration ≤ 10 ms). If any internal fault is detected during the auto test, the relay R5 is deenergized, the relevant led is activated and the fault code is displayed.

Further operation of key SELECT instead of the TEST programs gives the indication of the version and production date of the firmware.



WARNING

Running the **WithTRIP** test will operate all of the output relays. Care must be taken to ensure that no unexpected or harmful equipment operations will occur as a result of running this test.
It is generally recommended that this test be run only in a bench test environment or after all dangerous output connections are removed.

14. MAINTENANCE

No maintenance is required. Periodically a functional check-out can be made with the test procedures described under MANUAL TEST chapter. In case of malfunctioning please contact Microelettrica Scientifica Service or the local Authorised Dealer mentioning the relay's Serial No reported in the label on relays enclosure.



WARNING

In case of Internal Relay Fault detection, proceed as here-below indicated :

- ☐ If the error message displayed is one of the following "DSP Err", "ALU Err", "KBD Err", "ADC Err", switch off power supply and switch-on again. If the message does not disappear send the relay to Microelettrica Scientifica (or its local dealer) for repair.
- ☐ If the error message displayed is "E2P Err", try to program any parameter and then run "W/OTRIP".
- ☐ If message disappear please check all the parameters.
- ☐ If message remains send the relay to Microelettrica Scientifica (or its local dealer) for repair.

15. POWER FREQUENCY INSULATION TEST

Every relay individually undergoes a factory insulation test according to IEC255-5 standard at 2 kV, 50 Hz 1min. Insulation test should not be repeated as it unusefully stresses the dielectrics.
When doing the insulation test, the terminals relevant to serial output must always be short circuited to ground. When relays are mounted in switchboards or relay boards that have to undergo the insulation tests, the relay modules must be drawn-out of their enclosures and the test must only include the fixed part of the relay with its terminals and the relevant connections. This is extremely important as discharges eventually taking place in other parts or components of the board can severely damage the relays or cause damages, not immediately evident to the electronic components.

16. ELECTRICAL CHARACTERISTICS

APPROVAL: CE

REFERENCE STANDARDS IEC 60255 - EN50263 - CE Directive - EN/IEC61000 - IEEE C37

<input type="checkbox"/> Dielectric test voltage	IEC 60255-5	2kV, 50/60Hz, 1 min.
<input type="checkbox"/> Impulse test voltage	IEC 60255-5	5kV (c.m.), 2kV (d.m.) – 1,2/50µs
<input type="checkbox"/> Insulation resistance	> 100MΩ	

Environmental Std. Ref. (IEC 68-2-1 - 68-2-2 - 68-2-33)

<input type="checkbox"/> Operation ambient temperature	-10°C / +55°C
<input type="checkbox"/> Storage temperature	-25°C / +70°C
<input type="checkbox"/> Humidity	IEC68-2-3 RH 93% Without Condensing AT 40°C

CE EMC Compatibility (EN50081-2 - EN50082-2 - EN50263)

<input type="checkbox"/> Electromagnetic emission	EN55022 industrial environment				
<input type="checkbox"/> Radiated electromagnetic field immunity test	IEC61000-4-3	level 3	80-1000MHz	10V/m	
	ENV50204		900MHz/200Hz	10V/m	
<input type="checkbox"/> Conducted disturbances immunity test	IEC61000-4-6	level 3	0.15-80MHz	10V	
<input type="checkbox"/> Electrostatic discharge test	IEC61000-4-2	level 4	6kV contact / 8kV air		
<input type="checkbox"/> Power frequency magnetic test	IEC61000-4-8		1000A/m		50/60Hz
<input type="checkbox"/> Pulse magnetic field	IEC61000-4-9		1000A/m, 8/20µs		
<input type="checkbox"/> Damped oscillatory magnetic field	IEC61000-4-10		100A/m, 0.1-1MHz		
<input type="checkbox"/> Electrical fast transient/burst	IEC61000-4-4	level 3	2kV, 5kHz		
<input type="checkbox"/> HF disturbance test with damped oscillatory wave (1MHz burst test)	IEC60255-22-1	class 3	400pps, 2,5kV (m.c.), 1kV (d.m.)		
<input type="checkbox"/> Oscillatory waves (Ring waves)	IEC61000-4-12	level 4	4kV(c.m.), 2kV(d.m.)		
<input type="checkbox"/> Surge immunity test	IEC61000-4-5	level 4	2kV(c.m.), 1kV(d.m.)		
<input type="checkbox"/> Voltage interruptions	IEC60255-4-11				
<input type="checkbox"/> Resistance to vibration and shocks	IEC60255-21-1 - IEC60255-21-2 10-500Hz 1g				

CHARACTERISTICS

<input type="checkbox"/> Accuracy at reference value of influencing factors	2% In for measure 0,2% On 2% +/- 10ms for times
<input type="checkbox"/> Rated Current	In = 1 or 5A - On = 1 or 5A
<input type="checkbox"/> Current overload	200 A for 1 sec; 10A continuous
<input type="checkbox"/> Burden on current inputs	Phase : 0.01VA at In = 1A; 0.2VA at In = 5A Neutral : 0.03VA at On = 1A; 0.2VA at On = 5A
<input type="checkbox"/> Average power supply consumption	8.5 VA
<input type="checkbox"/> Output relays	rating 5 A; Vn = 380 V A.C. resistive switching = 1100W (380V max) make = 30 A (peak) 0,5 sec. break = 0.3 A, 110 Vcc, L/R = 40 ms (100.000 op.)


Microelettrica Scientifica S.p.A. - 20089 Rozzano (MI) - Italy - Via Alberelle, 56/68

Tel. (##39) 02 575731 - Fax (##39) 02 57510940


<http://www.microelettrica.com> e-mail : ute@microelettrica.com

The performances and the characteristics reported in this manual are not binding and can modified at any moment without notice

17. CONNECTION DIAGRAM (SCE1811 Rev.0 Standard Output)

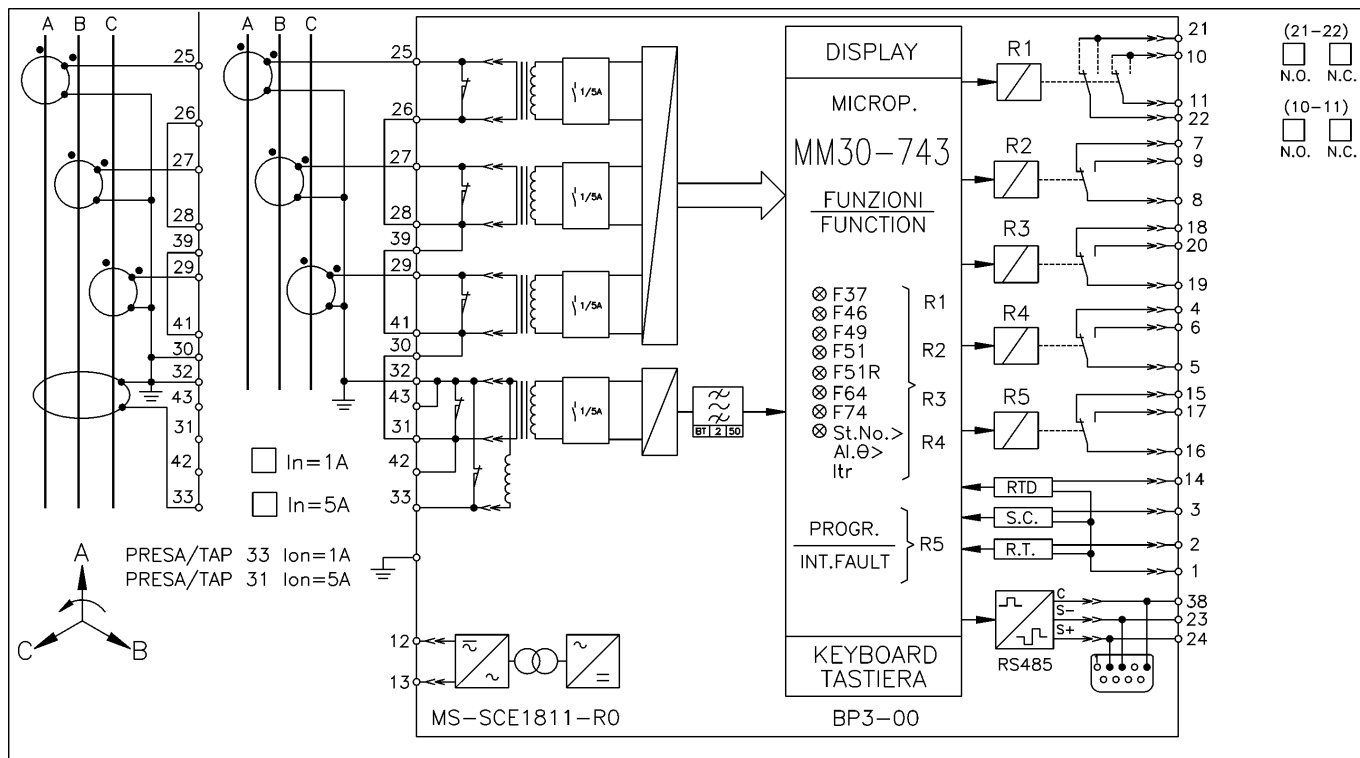


17.1 - CONNECTION DIAGRAM (SCE1798 Rev.0 Standard Output with F74)

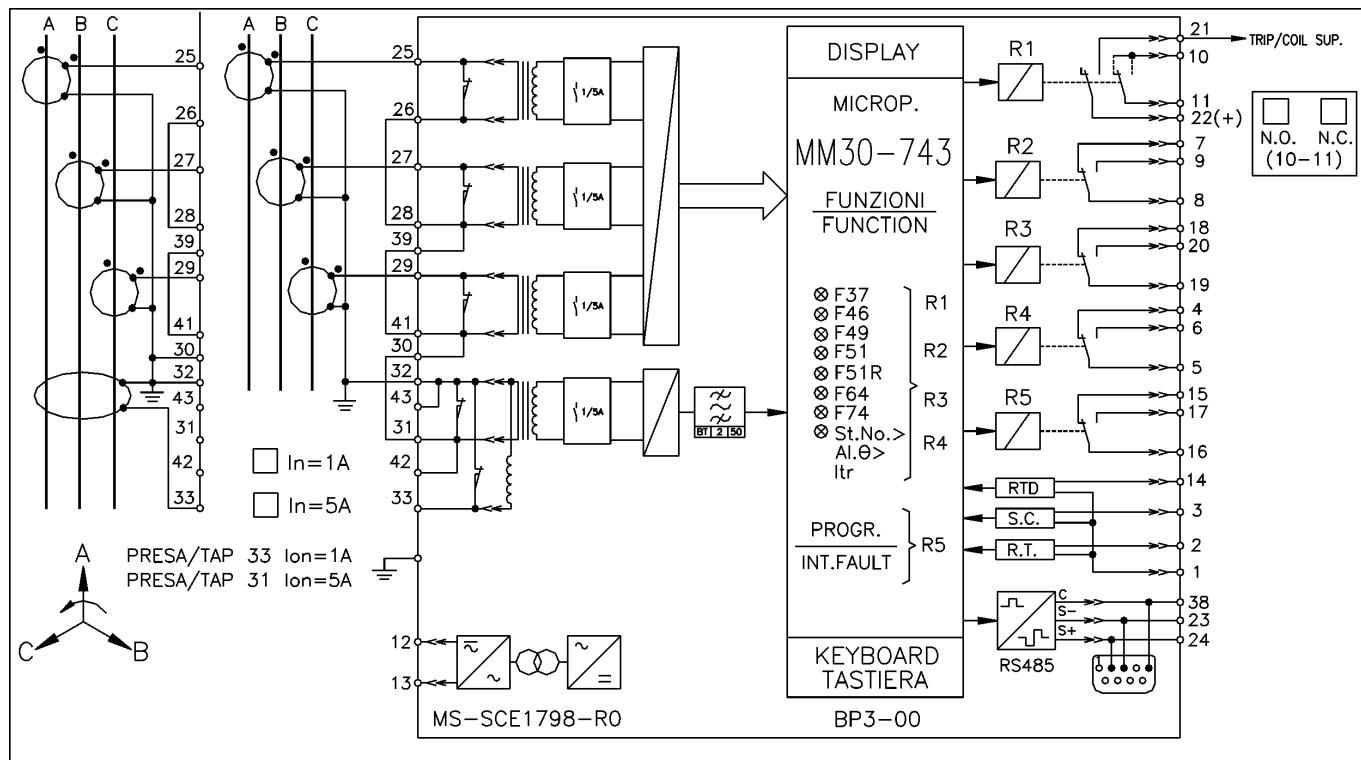


18. WIRING THE SERIAL COMMUNICATION BUS (SCE1309 Rev.0)


CONNECTION TO RS485

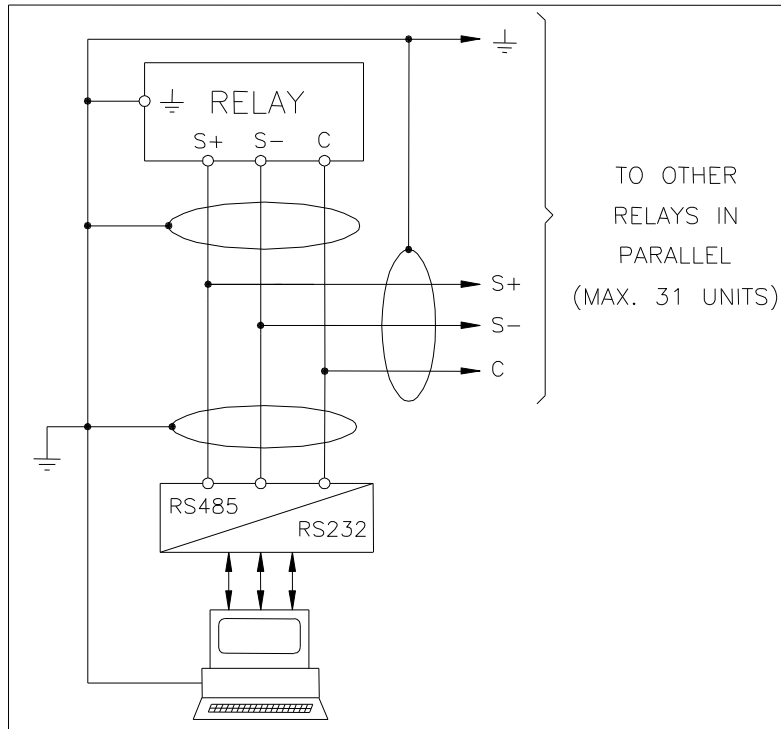

FIBER OPTIC CONNECTION

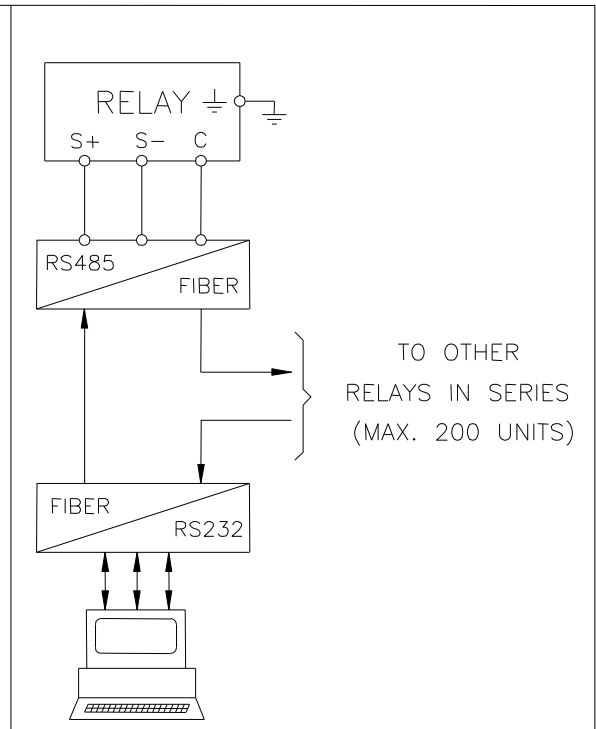


19. CHANGE PHASE CURRENT RATED INPUT 1 OR 5A

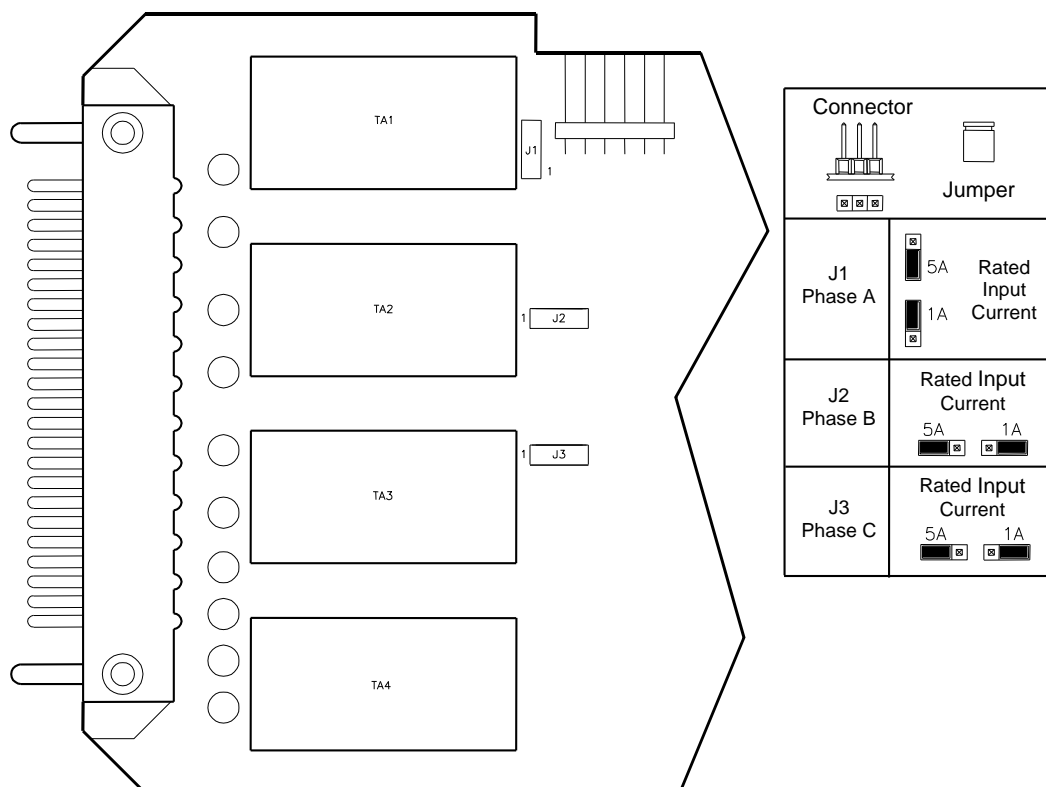




20. THERMAL IMAGE CURVES (TU0249 Rev.1)

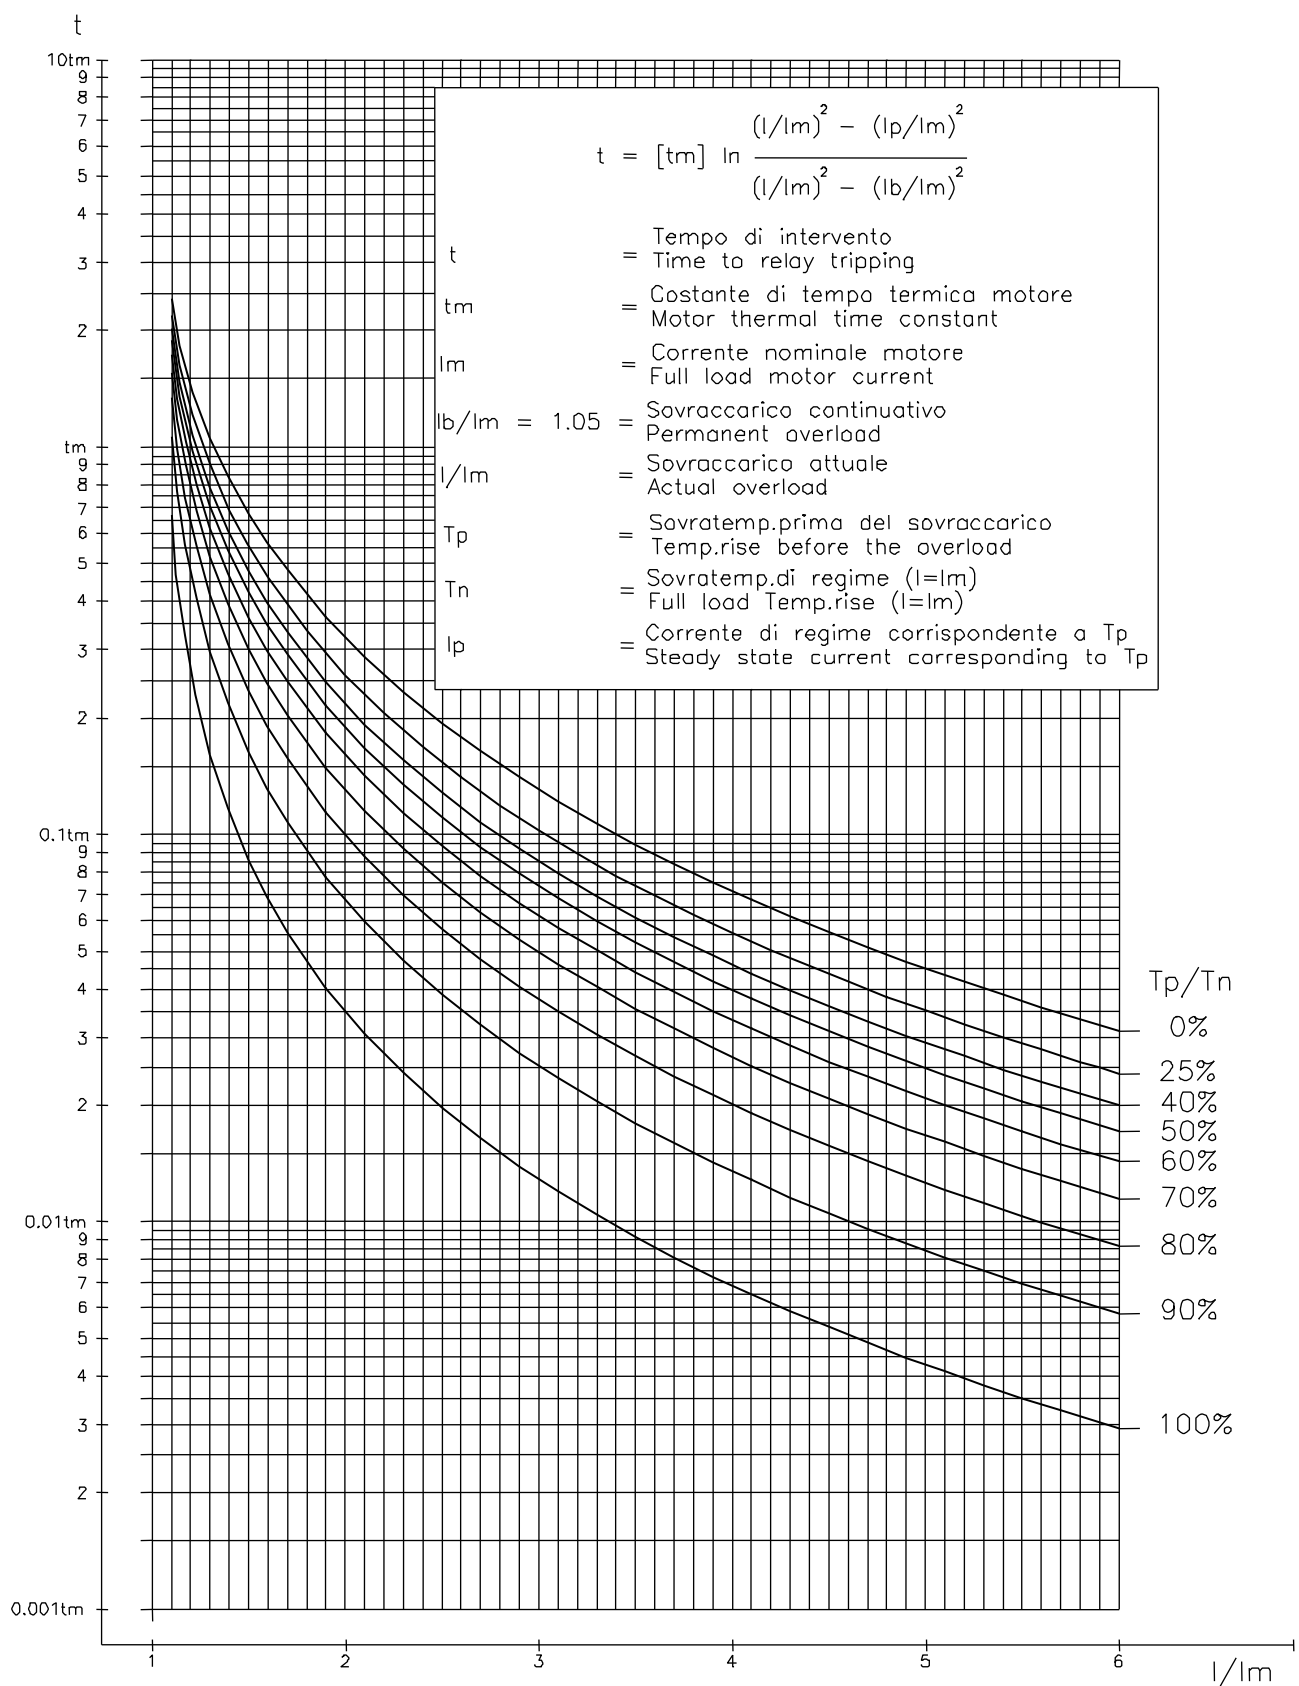



21. INVERSE TIME UNBALANCE PROTECTION ELEMENT (TU0248 Rev.1)

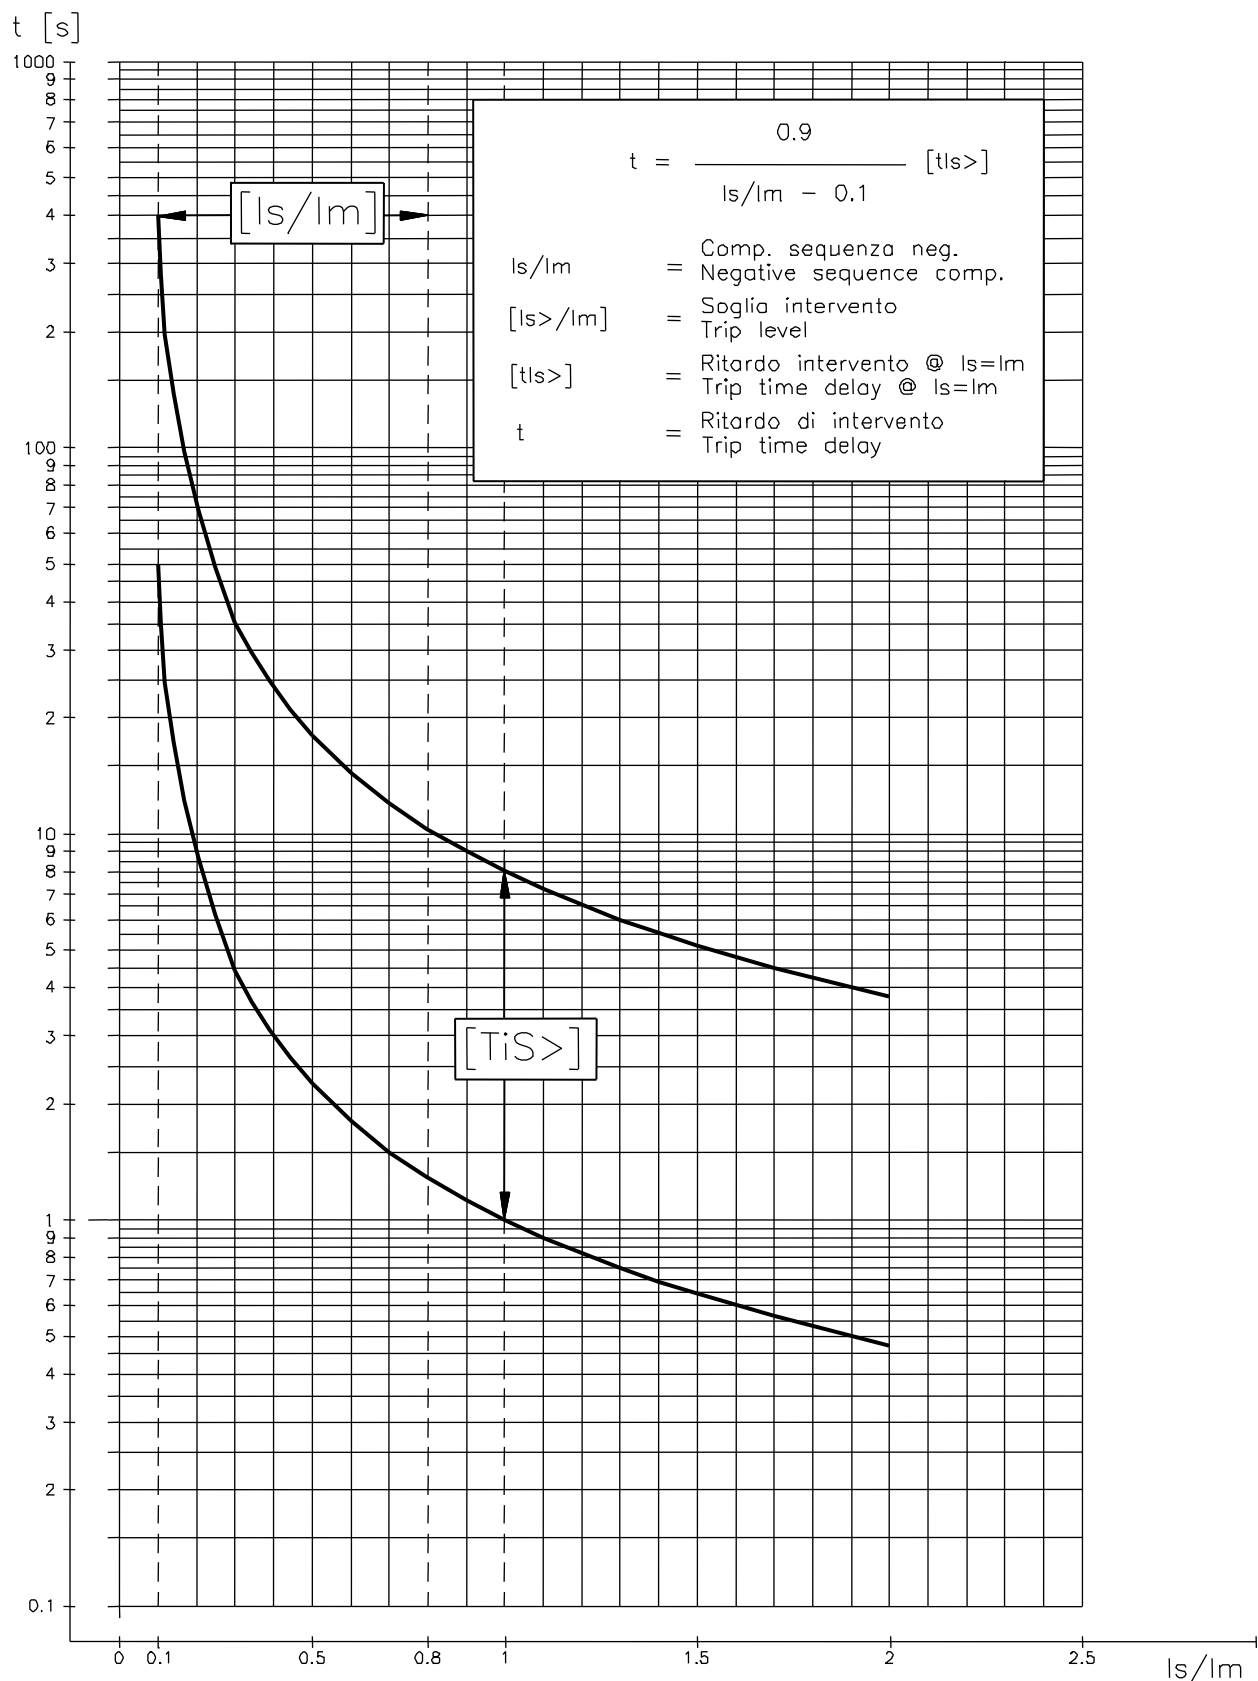


22. DIRECTION FOR PCB'S DRAW-OUT AND PLUG-IN

22.1 - Draw-out


Rotate clockwise the screws ① and ② in the horizontal position of the screws-driver mark.
 Draw-out the PCB by pulling on the handle ③

22.2 - Plug-in



Rotate clockwise the screws ① and ② in the horizontal position of the screws-driver mark.
 Slide-in the card on the rails provided inside the enclosure.
 Plug-in the card completely and by pressing the handle to the closed position.
 Rotate anticlockwise the screws ① and ② with the mark in the vertical position (locked).

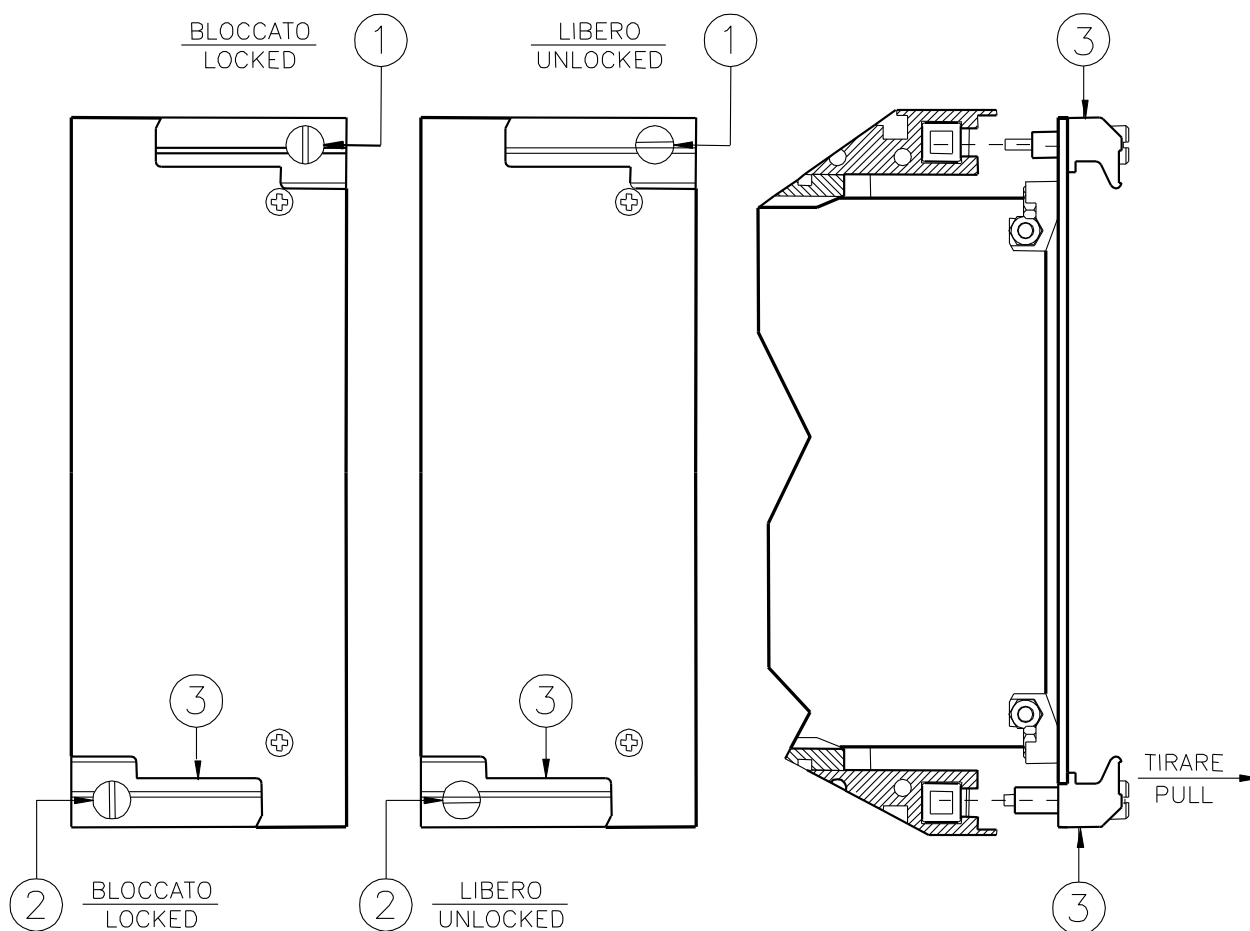

23. MOUNTING

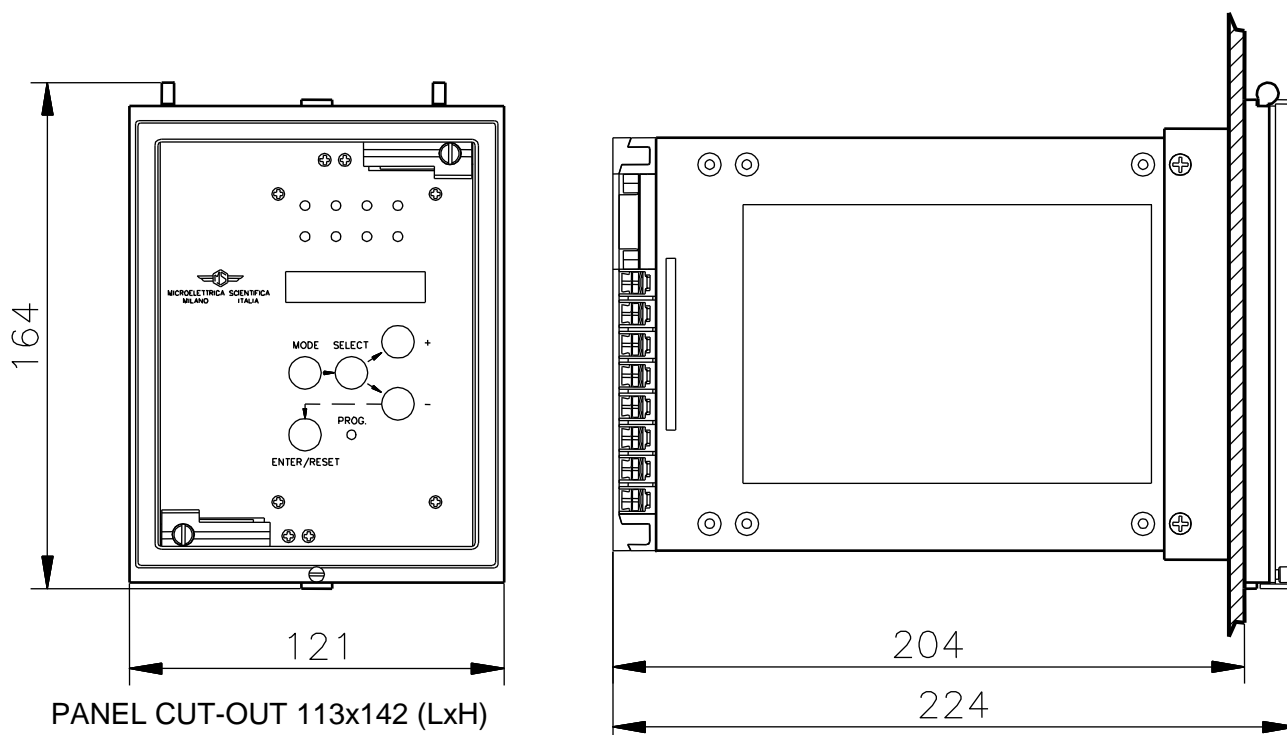

**View of Rear
Terminal Connection**

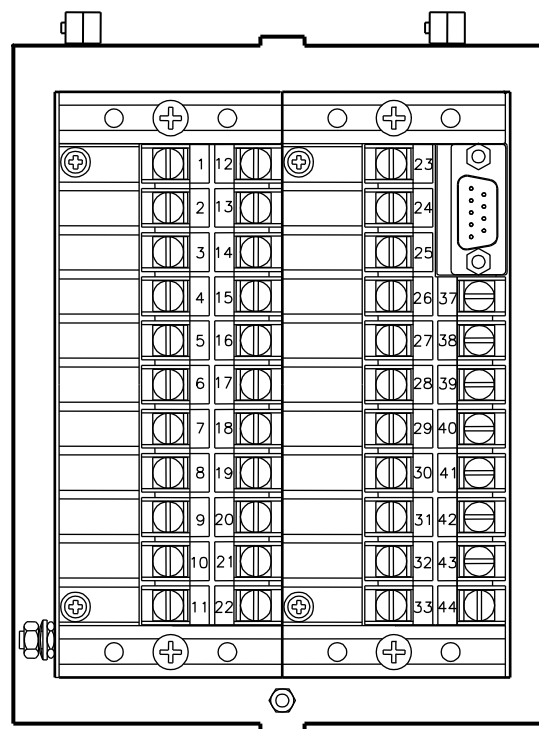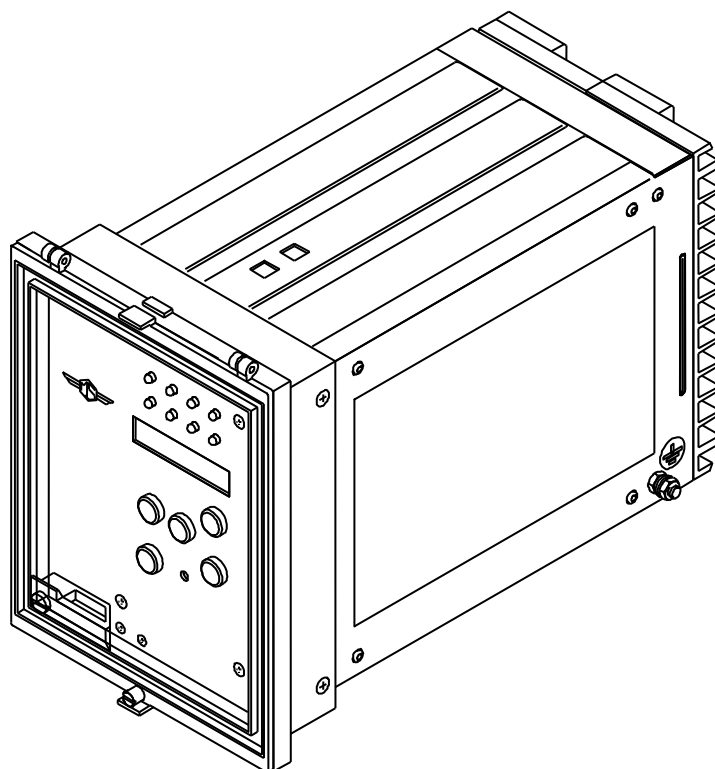



Microelettrica Scientifica

MM30-743

Doc. N° MO-0181-ING

Rev. 0

Date 28.04.2003

25. SETTING'S FORM

Relay Type	MM30-743	Station :	Circuit :
Date :	/ /	FW Version:	Relay Serial Number :
Power Supply	<input type="checkbox"/> 24V(-20%) / 110V(+15%) a.c. 24V(-20%) / 125V(+20%) d.c. <input type="checkbox"/> 80V(-20%) / 220V(+15%) a.c. 90V(-20%) / 250V(+20%) d.c.	Rated Current In :	<input type="checkbox"/> 1A <input type="checkbox"/> 5A <input type="checkbox"/> 1A <input type="checkbox"/> 5A

RELAY PROGRAMMING

Variable	Description	Setting Range	Default Setting	Actual Setting	Test Result
					Pick-up Reset
xxXXXxx	Current date	Random -	DDMMYY		
xx:xx:xx	Current time	Random -	HH:MM:SS		
NodAd	Identif. number for connection on serial comm. bus	1 - 250 -	1		
Fn	Mains frequency	50 - 60 Hz	50		
In	Rated primary current of the phase C.Ts.	1 - 9999 Ap	500		
On	Rated primary current of the C.Ts.	1 - 9999 Ap	500		
Im	Motor full-load current	0.1 - 1.5 In	1.0		
Ist	Motor start-up current	0.5 - 10 Im	6		
tst	Motor starting time	1 - 120 s	5		
Itr	Switch-over current of motor starter	Dis -0.1- 1 Ist	0.5		
tTr	Max switch-over time from start-up	0.5 - 50 s	6		

AUTOSET? + ENTER

Automatic setting of all the following parameters computed on the base of the setting of the previous parameters

tm	Thermal time constant of motor while running	1 - 60 min	34		
to/tm	Steady/running motor thermal time constant	1 - 10 -	3		
Ta/n	Prealarm motor heating level	50 - 110 %	90		
Ts/n	Motor restart heating level	40 - 100 %	100		
Ib	Rated maximum continuous current of the motor	1.00 - 1.30 Im	1.05		
StNo	Max. No of startings allowed within the time tStNo	Dis - 1 - 60 -	6		
tStNo	Time into which the StNo is counted	1 - 60 m	60		
tBSt	Restart inhibition time after tripping of the funct. StNo	1 - 60 - Rm m	12		
ILR	Trip level of Locked Rotor function	Dis - 1 - 5 Im	2		
tLr	Trip time delay of LR element during run	1 - 120 s	1		
Is>	Trip level of inverse time current unbalance protect. element	Dis-0.1-0.8 Im	0.3		
tIs>	Trip time delay of inv. time current unbalance prot.	1 - 8 s	4		
I<	Trip level of undercurrent (no-load running) element	Dis-0.15-1 Im	0.2		
tl< 3s	Trip time delay of undercurrent element	0.1 - 90 s	3		
I>	Trip level of overcurrent element	Dis - 1 - 5 Ist	2		
tl>	Trip time delay of overcurrent element	0.05 - 1 s	0.1		
O>	Trip level of earth fault element	Dis -0.02- 2 On	0.1		
tO>	Trip time delay of earth fault element	0.05 - 5 s	0.2		
tBO	Reset time delay of the blocking output relay	0.05 - 0.5 s	0.15		
RTD	Thermal probe	ON - OFF -	-		
SpC	Speed switch	ON - OFF -	-		
TCS	Trip Circuit Supervision	ON - OFF -	-		
Tsyn	Clock synchronisation Time	Dis m	5-60-Dis		

CONFIGURATION OF OUTPUT RELAYS

Default Setting					Actual Setting				
Protect. Element	Output Relays				Description	Protect. Element	Output Relays		
T>	1	-	-	-	Overload tripping operates relay	T>			
Ta	-	2	-	-	Overload prealarm tripping operates relay	Ta			
Itr	-	-	-	-	Starting switch-over tripping operates relay	Itr			
StNo	-	-	-	-	Start No limitation tripping operates relay	StNo			
ILR	1	-	-	-	Locked Rotor tripping operates relay	ILR			
tIs>	1	-	-	-	Time delayed unbalance tripping operates relay	tIs>			
I<	-	-	-	4	No load running tripping operates relay	I<			
I>	-	-	-	-	Instantaneous overcurrent tripping operates relay	I>			
tl>	1	-	-	-	Time delayed overcurrent tripping operates relay	tl>			
O>	-	-	-	-	Instantaneous earth fault tripping operates relay	O>			
tO>	1	-	-	-	Time delayed earth fault tripping operates relay	tO>			
RT	-	-	-	-	Remote trip control.	RT			

Commissioning Engineer : _____

Date : _____

Customer Witness : _____

Date : _____