


 Microelettrica Scientifica	MD32-T	Doc. N° MO-0236-ING
		Rev. 1 Date 06.07.2005

DIGITAL-MULTIFUNCTION TRANSFORMER DIFFERENTIAL PROTECTION RELAY TYPE **MD32-T** **OPERATION MANUAL**

Addendum

For version with IRIG-B Time synchronization

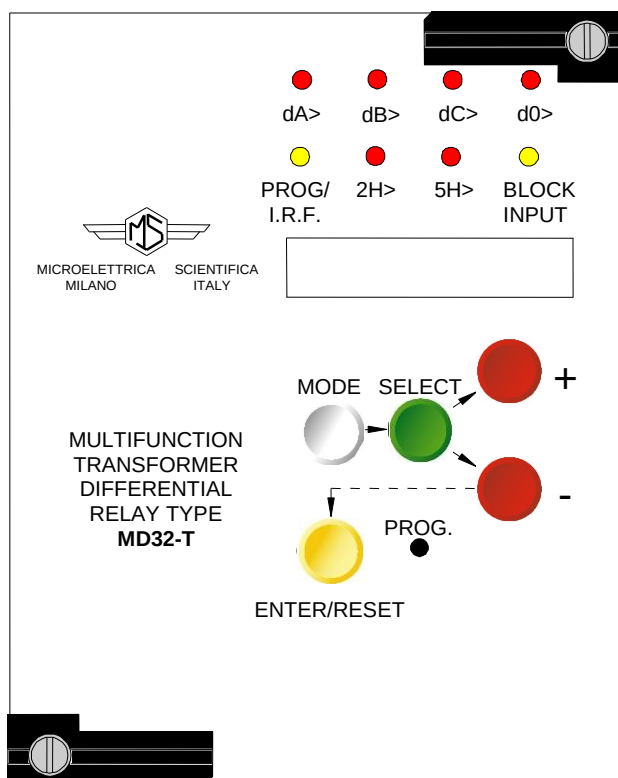

 Microelettrica Scientifica	MD32-T	Doc. N° MO-0236-ING
		Rev. 0 Date 14.12.2004

INDEX

2.7.1 - Clock synchronization.	3
8. DIGITAL INPUTS	3
13.1 - Programming of functions settings	3
18. CONNECTION DIAGRAM - 87T + 87N - (SCE1938 Rev.0 Standard Output)	4
18.1 - Connection Diagram - 87T + 51G - (SCE1939 Rev.0 Standard Output)	4
18.2 - Connection Diagram - 87T + 51N - (SCE1940 Rev.0 Standard Output)	5
18.3 - Connection Diagram - 87T - (SCE1941 Rev.0 Standard Output)	5

 Microelettrica Scientifica	MD32-T	Doc. N° MO-0236-ING	
		Rev. 1	Date 06.07.2005

2.7.1 - Clock synchronization.

The clock can be synchronized via the IRIG-B digital input (terminals 1 – 14) or the serial communication interface.

By programming the variable ($T_{syn} = 5', 10', 15', 30', 60', \text{IRIG-B, Dis}$) the Synchronization is made in different ways :

- $T_{syn} = \text{Dis}$: The current date can only be modified manually either via the front panel keyboard (SETTING MENU) or via the serial communication interface (programming mode).
- $T_{syn} = \text{IRIG-B}$: The clock is automatically updated by the IRIG-B input signal.
- $T_{syn} = 5', 10', 15', 30', 60'$: The clock is updated via the serial interface as follows

The unit expects to receive a sync signal at the beginning of every hour and once every T_{syn} minutes. When a sync signal is received, the clock is automatically set to the nearest expected synchronization time.

For example: if T_{syn} is 10min and a sync signal is received at 20:03:10 January the 10th, 98, then the clock is set to 20:00:00 January the 10th, 1998. On the other hand, if the same sync signal were received at 20:06:34, the clock would be set to 20:10:00, January the 10th 98.

Note that if a sync signal is received exactly in the middle of a T_{syn} period, the clock is set to the previous expected synchronization time.

8. DIGITAL INPUTS

Three inputs active when the relevant terminals are shorted are provided:


- **B1** (terminals 1 - 2) : For function blocking
- **B2** (terminals 1 - 3) : To activate harmonic restraint variation at inrush
- **B3** (terminals 1 - 14) : Another optoisolated input is available for a IRIG-B time Synchronisation input from GPS – Accuracy 10ms – Time Synchronization can also be made via serial communication interface (see § 2.7.1)
ATTENTION!
 Connection of a GPS system to the IRIG-B input must be made through a proper adapter device supplied on request as optional.
- **B4** (terminals 1 - 44) : External trigger for oscillographic records

13.1 - Programming of functions settings


1In	500	A	Rated primary current of Cts on Transformer's side 1	1 - 65500	1	A
2In	500	A	Rated primary current of Cts on Transformer's side 2	1 - 65500	1	A
Tsyn	Dis	m	Synchronization Time Expected time interval between sync. pulse.	5 - 60 – IRIG-B - Dis	5-10 15-30 IRIG-B 60-Dis	m



18. CONNECTION DIAGRAM - 87T + 87N - (SCE1938 Rev.0 Standard Output)

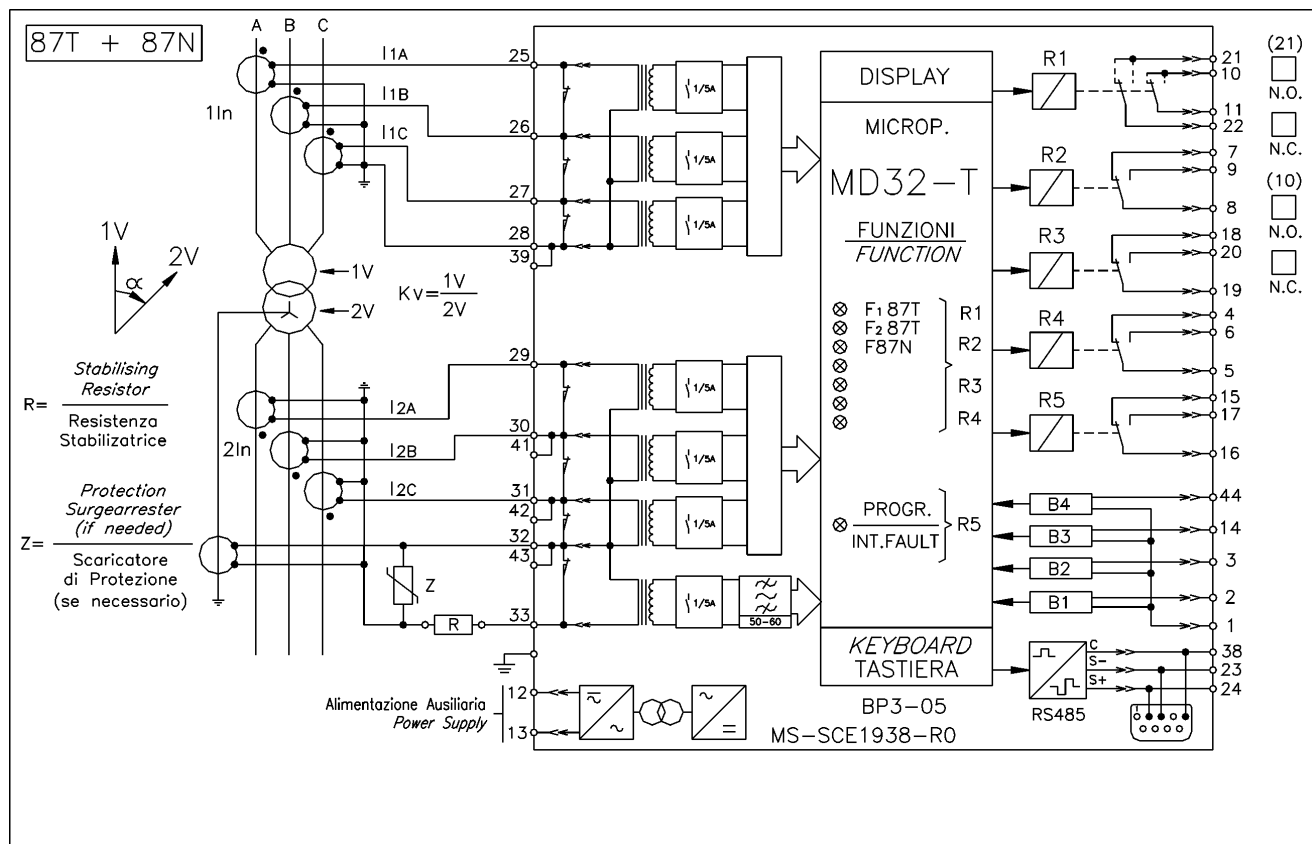

18.1 - Connection Diagram - 87T + 51G - (SCE1939 Rev.0 Standard Output)

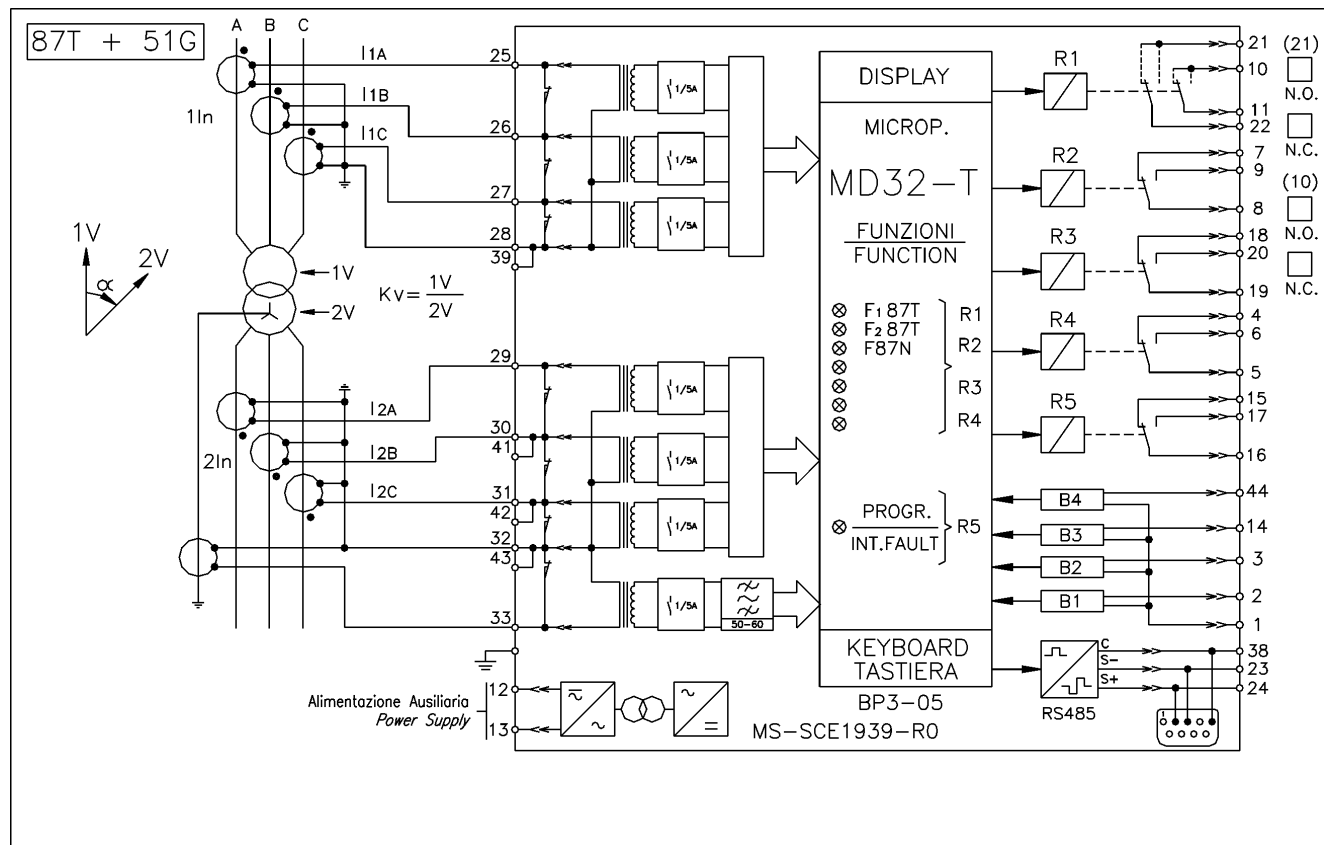




Microelettrica Scientifica

MD32-T

Doc. N° MO-0236-ING

Rev. 1
Date 06.07.2005

18.2 - Connection Diagram - 87T + 51N - (SCE1940 Rev.0 Standard Output)

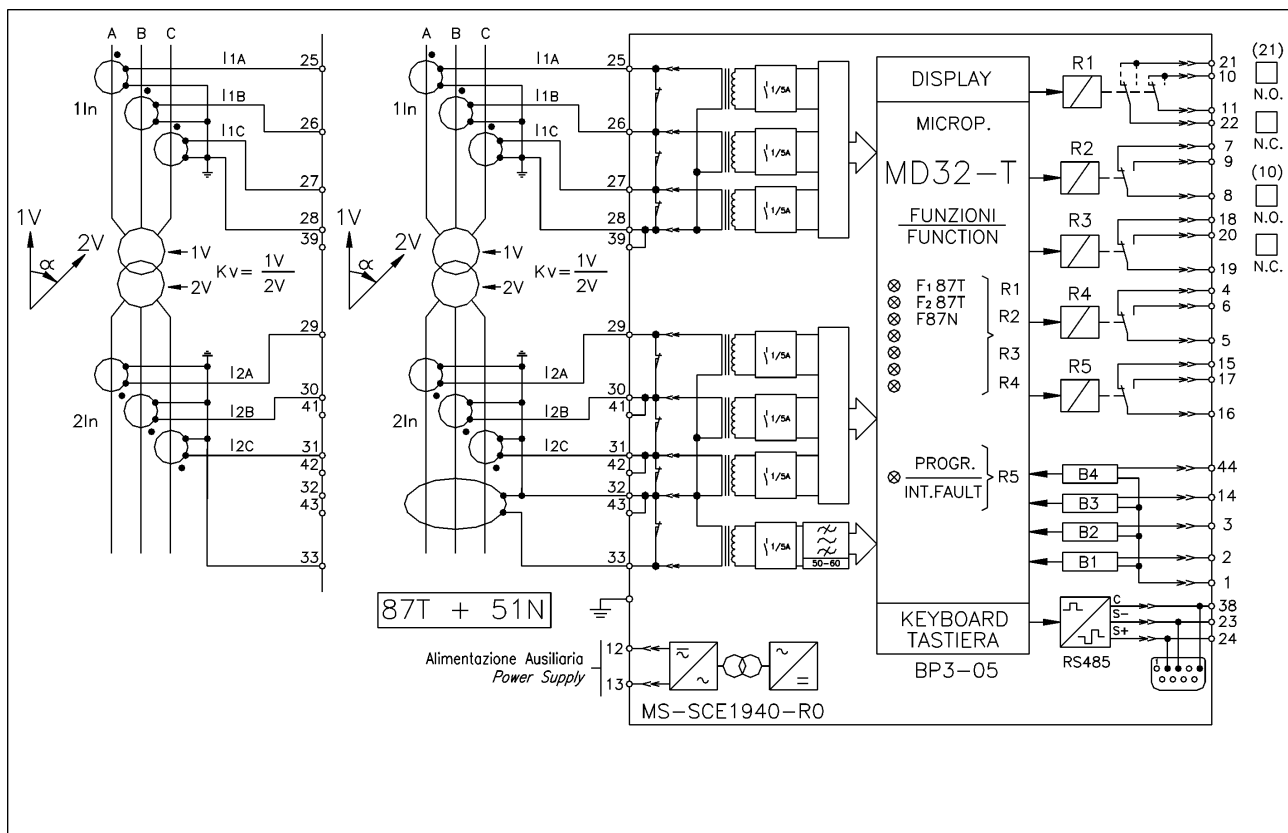

18.3 - Connection Diagram - 87T - (SCE1941 Rev.0 Standard Output)

