




FEEDER MANAGER RELAY

TYPE







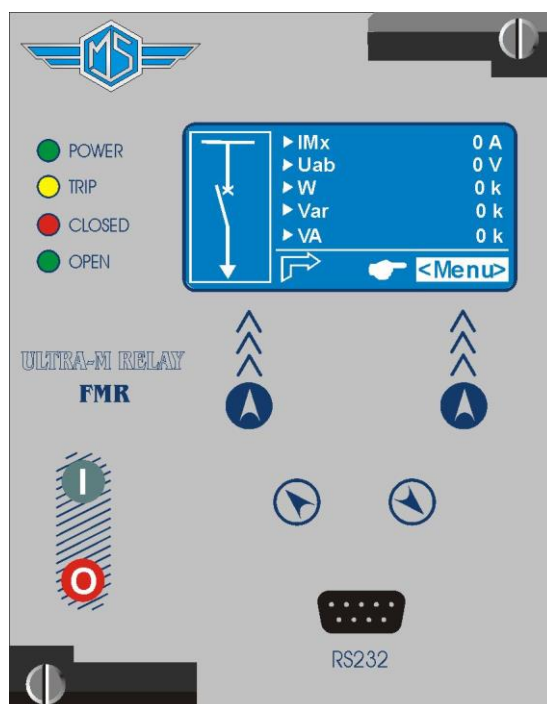



FMR-L

ULTRA Line

OPERATION MANUAL








**INDEX**

1. GENERAL UTILIZATION AND COMMISSIONING DIRECTIONS	5
1.1 - Storage and Transportation	5
1.2 - Installation	5
1.3 - Electrical Connection	5
1.4 - Measuring Inputs and Power Supply	5
1.5 - Outputs Loading	5
1.6 - Protection Earthing	5
1.7 - Setting and Calibration	5
1.8 - Safety Protection	5
1.9 - Handling	5
1.10 - Maintenance	5
1.11 - Fault Detection and Repair	6
2. GENERAL	6
2.1 - Power Supply	6
3. FRONT PANEL	6
4. KEYBOARD AND DISPLAY	7
4.1 - Display	7
5. ICONS OF DISPLAY	8
6. SIGNALIZATION	9
6.1 - Leds Manual Reset	9
7.  LOCAL COMMANDS	10
8.  MEASURE	11
9.  MAXIMUM VALUES (MAX DEMAND)	12
10.  ENERGY	13
11.  TRIP RECORDING	14
12.  PARTIAL COUNTERS	16
13.  TOTAL COUNTERS	18
14.  EVENTS	20
15.  SYSTEM (System parameters)	21
16.  SETTINGS	24
16.1. Modifying the setting of variables	25
16.2. Password	26
16.3 – Menu: Communic. (Communication)	27
16.3.1 – Description of variables	27
16.3.2 – Front Panel serial communication port (RS232)	27
16.3.3 – Cable for direct connection of Relay to Personal Computer	27
16.3.4 – Main serial communication port (RS485)	27
16.4 - Menu: Customize	28
16.4.1 – Description of variables	28
16.5 - Function: 1I> (First Overcurrent Element F50/51)	29
16.5.1 - Description of variables	29
16.5.2 - Algorithm of the time current curves	30
16.5.3 - IEC Curves	31
16.5.4 – IEEE Curves	32
16.5.5 – Operation of the phase Overcurrent Elements in function of variable “f(a)”	33
16.5.6 – Operation of the Overcurrent Element with Voltage Control f(U)	35
16.5.7 – Blocking Logic (BO-BI)	36
16.5.8 - Automatic doubling of Overcurrent thresholds on current inrush	36



16.6 - Function: 2I> (Second Overcurrent Element F50/51)	37
16.6.1 - Description of variables	37
16.7 - Function: 3I> (Third Overcurrent Element F50/51)	38
16.7.1 - Description of variables	38
16.8 - Function: 4I> (Fourth Overcurrent Element F50/51)	39
16.8.1 - Description of variables	39
16.9 - Function: 5I> (Fifth Overcurrent Element F50/51)	40
16.9.1 - Description of variables	40
16.10 - Function: 6I> (Sixth Overcurrent Element F50/51)	41
16.10.1 - Description of variables	41
16.11 - Function: 1Io> (First Earth Fault Element 50N/51N)	42
16.11.1 - Description of variables	42
16.11.2 - Operation mode of the Earth Fault elements programming the variable "f(a ₀)"	43
16.12 - Function: 2Io> (Second Earth Fault Element 50N/51N)	44
16.12.1 - Description of variables	44
16.13 - Function: 3Io> (Third Earth Fault Element 50N/51N)	45
16.13.1 - Description of variables	45
16.14 - Function: 4Io> (Fourth Earth Fault Element 50N/51N)	46
16.14.1 - Description of variables	46
16.15 - Function: 1Is> (First Negative Sequence Element F46)	47
16.15.1 - Description of variables	47
16.15.2 - Time/Current operation of the first Current Unbalance element "f(t)"	47
16.16 - Function: 2Is> (Second Negative Sequence Element F46)	48
16.16.1 - Description of variables	48
16.17 - Function: 1U> (First OverVoltage Element F59)	49
16.17.1 - Description of variables	49
16.18 - Function: 2U> (Second OverVoltage Element F59)	49
16.18.1 - Description of variables	49
16.19 - Function: 3U> (Third OverVoltage Element F59)	50
16.19.1 - Description of variables	50
16.20 - Function: 1U< (First UnderVoltage Element F27)	51
16.20.1 - Description of variables	51
16.21 - Function: 2U< (Second UnderVoltage Element F27)	51
16.21.1 - Description of variables	51
16.22 - Function: 3U< (Third UnderVoltage Element F27)	52
16.22.1 - Description of variables	52
16.23 - Function: 1f> (First OverFrequency Element F81>)	53
16.23.1 - Description of variables	53
16.24 - Function: 2f> (Second OverFrequency Element F81>)	53
16.24.1 - Description of variables	53
16.25 - Function: 3f> (Third OverFrequency Element F81>)	54
16.25.1 - Description of variables	54
16.26 - Function: 4f> (Fourth OverFrequency Element F81>)	54
16.26.1 - Description of variables	54
16.27 - Function: 1f< (First UnderFrequency Element F81<)	55
16.27.1 - Description of variables	55
16.28 - Function: 2f< (Second UnderFrequency Element F81<)	55
16.28.1 - Description of variables	55
16.29 - Function: 3f< (Third UnderFrequency Element F81<)	56
16.29.1 - Description of variables	56
16.30 - Function: 4f< (Fourth UnderFrequency Element F81<)	56
16.30.1 - Description of variables	56
16.31 - Function: 1Uo> (First Zero Sequence Overvoltage Element F59Uo)	57
16.31.1 - Description of variables	57
16.32 - Function: 2Uo> (Second Zero Sequence Overvoltage Element F59Uo)	57
16.32.1 - Description of variables	57
16.33 - Function: I2H (Inrush Detection – 2 nd Harm./Fund.)	58
16.33.1 - Description of variables	58
16.34 - Function: I2/I1 (Broken Conductor Detection – I2/I1)	58
16.34.1 - Description of variables	58
16.35 - Function: Wi (Circuit Breaker maintenance level)	59
16.35.1 - Description of variables	59
16.35.2 - Operation (Accumulation of the interruption Energy)	59



16.36 - Function: TCS (Trip Circuit Supervision)	60
16.36.1 - Description of variables	60
16.36.2 - Operation	60
16.37 - Function: IRF (Internal Relay Fault)	61
16.37.1 - Description of variables	61
16.37.2 - Operation	61
16.38 - Function: BreakerFail (Breaker Failure)	61
16.38.1 - Description of variables	61
16.38.2 - Operation	61
16.39 - Function: Oscillo (Oscillographic Recording)	62
16.39.1 - Description of variables	62
16.39.2 - Operation	62
16.40 - Function: C/B Command (Close/Open Breaker Command)	63
16.40.1 - Description of variables	63
 17. INPUT – OUTPUT	64
17.1 – Operation	64
17.2 – Physical Input	66
17.2.1 – Example	68
17.3 – Physical Outputs	69
17.3.1 – Example	71
 18. OSCILLOGRAPHIC RECORDING	73
 19. DATE and TIME	74
19.1.1 – Clock synchronization	75
 20. HEALTHY (Diagnostic Information)	76
 21. DEV.INFO (Relay Version)	76
22. BATTERY	77
23. MAINTENANCE	77
24. POWER FREQUENCY INSULATION TEST	77
25. FMR - WIRING DIAGRAM	78
25.1 – FMR/1S - WIRING DIAGRAM + 1 EXPANSION MODULE	78
25.2 – FMR/2S - WIRING DIAGRAM + 2 EXPANSION MODULE	79
26. WIRING THE SERIAL COMMUNICATION BUS (SCE1309 Rev.0)	79
27. FMR - OVERALL DIMENSIONS / MOUNTING	80
27.1 – FMR/1S – 3U RACK - OVERAL DIMENSIONS – (FMR + 1 EXPANSION MODULE)	81
27.2 – FMR/1S – FLUSH MOUNTING - OVERAL DIMENSIONS – (FMR + 1 EXPANSION MODULE)	81
27.1 – FMR/2S – 3U RACK - OVERAL DIMENSIONS – (FMR + 2 EXPANSION MODULE)	82
27.2 – FMR/2S – FLUSH MOUNTING - OVERAL DIMENSIONS – (FMR + 2 EXPANSION MODULE)	82
28. DIRECTION FOR PCB'S DRAW-OUT AND PLUG-IN	83
28.1 - Draw-out	83
28.2 – Plug-in	83
29. ELECTRICAL CHARACTERISTICS	84



1. GENERAL UTILIZATION AND COMMISSIONING DIRECTIONS

Always make reference to the specific description of the product and to the Manufacturer's instruction. Carefully observe the following warnings.

1.1 - Storage and Transportation

Must comply with the environmental conditions stated in the product's specification or by the applicable IEC standards.

1.2 - Installation

Must be properly made and in compliance with the operational ambient conditions stated by the Manufacturer.

1.3 - Electrical Connection

Must be made strictly according to the wiring diagram supplied with the Product, to its electrical characteristics and in compliance with the applicable standards particularly with reference to human safety.

1.4 - Measuring Inputs and Power Supply

Carefully check that the value of input quantities and power supply voltage are proper and within the permissible variation limits.

1.5 - Outputs Loading

Must be compatible with their declared performance.

1.6 - Protection Earthing

When earthing is required, carefully check its effectiveness.

1.7 - Setting and Calibration

Carefully check the proper setting of the different functions according to the configuration of the protected system, the safety regulations and the co-ordination with other equipment.

1.8 - Safety Protection

Carefully check that all safety means are correctly mounted, apply proper seals where required and periodically check their integrity.

1.9 - Handling

Notwithstanding the highest practicable protection means used in designing M.S. electronic circuits, the electronic components and semiconductor devices mounted on the modules can be seriously damaged by electrostatic voltage discharge which can be experienced when handling the modules. The damage caused by electrostatic discharge may not be immediately apparent but the design reliability and the long life of the product will have been reduced. The electronic circuits produced by M.S. are completely safe from electrostatic discharge (8 KV IEC 255.22.2) when housed in their case; withdrawing the modules without proper cautions expose them to the risk of damage.

1.10 - Maintenance

Make reference to the instruction manual of the Manufacturer; maintenance must be carried-out by specially trained people and in strict conformity with the safety regulations.

1.11 - Fault Detection and Repair

Internal calibrations and components should not be altered or replaced.
For repair please ask the Manufacturer or its authorized Dealers.

Misapplication of the above warnings and instruction relieves the Manufacturer of any liability.

2. GENERAL

Input currents are supplied to 4 current transformers: - three measuring phase current - one measuring the earth fault zero-sequence current.

Current input can be selected 1A or 5A by movable jumpers available on relay cards.

Input voltage are supplied to 4 Potential Transformers: three measuring phase-to-neutral voltage and one measuring the zero sequence voltage supplied by the secondary of three system P.Ts. Y/Open Delta connected.

The Measuring Ranges of the different inputs respectively are:

Phase Currents	: (0.1-40)In	Phase Voltage	: (0.01-2)Un
Neutral Current	: (0.01-10)On	Neutral Voltage	: (0.01-2)Un

Make electric connection in conformity with the diagram reported on relay's enclosure.

Check that input currents and voltages are same as reported on the diagram and on the test certificate.

The auxiliary power is supplied by a built-in interchangeable module fully isolated and self protected.


2.1 - Power Supply

The relay can be fitted with two different types of **power supply**:

Type 1) - {	24V(-20%) / 110V(+15%) a.c.	Type 2) - {	80V(-20%) / 220V(+15%) a.c.
	24V(-20%) / 125V(+20%) d.c.		90V(-20%) / 250V(+20%) d.c.

Before energizing the unit check that supply voltage is within the allowed limits.

3. FRONT PANEL

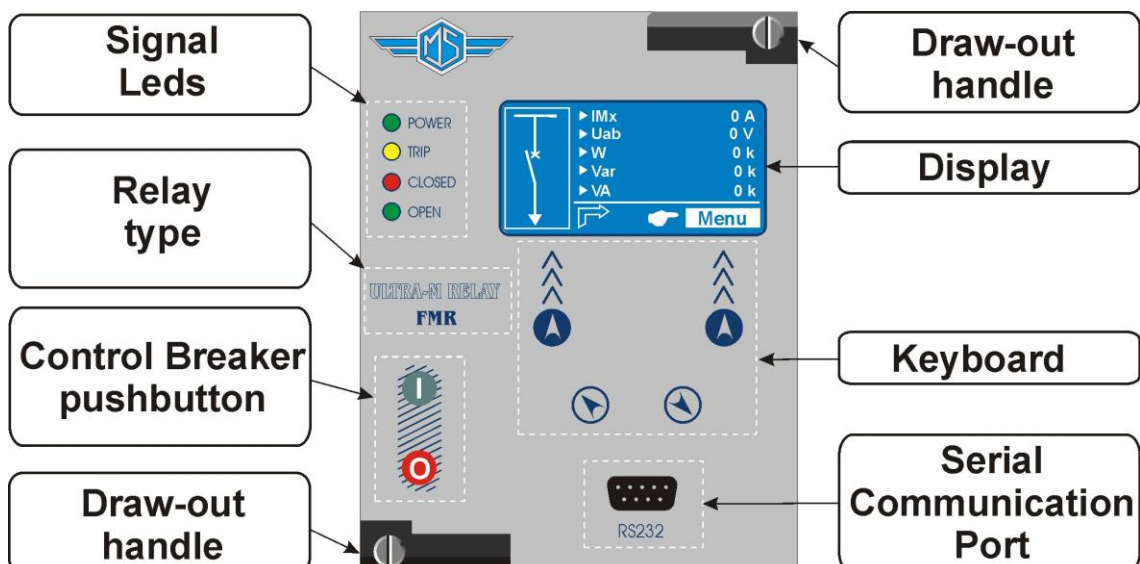



4. KEYBOARD AND DISPLAY

		Navigation menu	By these buttons the options showed in correspondence on the display are selected.
		Increase	These buttons are used to scroll the items of the different menus (Local Control, Measurements, Energy metering etc).
		Decrease	
		Open	these buttons (when enabled) operate Circuit Breaker Open/Close control (see § 16.31)
		Close	


□ By the key ② select the windows showing the ICONS of the available menus.

□ By the key ③, ④ select the desired icon and enter by key ①

□ The different elements can be selected by the key ③ and ④.
The details of the individual menus are given in the following paragraphs.





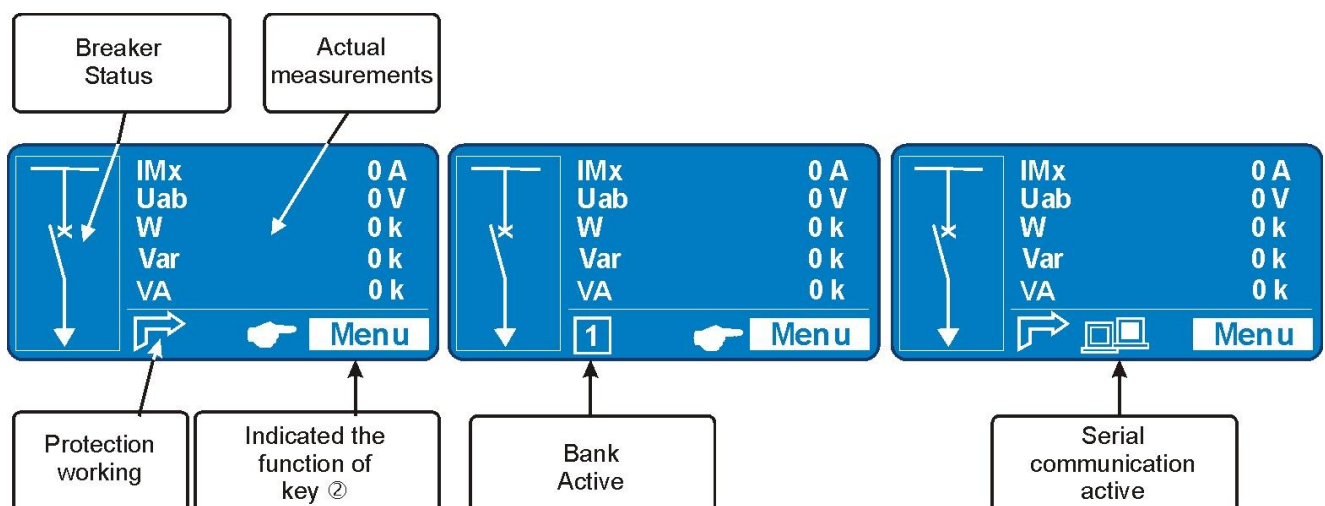









4.1 - Display

The 128x64 pixel LCD display the available information (menu, etc.).






5. ICONS OF DISPLAY





	LocalCmd	LOCAL COMMANDS
	Measure	ACTUAL MEASUREMENTS
	MaxVal	MAXIMUM VALUES (MAX DEMAND RECORD)
	Energy	ENERGY MEASUREMENTS
	TripRec.	TRIP RECORDING
	Counter	PARTIAL COUNTERS (RESETTABLE COUNTER)
	ROCnt	TOTAL COUNTER (READ ONLY COUNTER)
	Events	EVENT RECORDING
	Setting	FUNCTION SETTINGS
	System	SYSTEM SETTINGS
	Inp-Out	INPUT - OUTPUT
	Record	OSCILLOGRAPHIC RECORDING
	TimeDate	TIME AND DATE
	Healthy	DIAGNOSTIC INFORMATION
	Dev.Info	RELAY VERSION

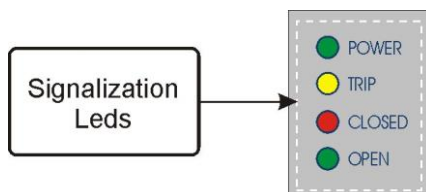

6. SIGNALIZATION

Four signal leds are provided:



Green Led		<input type="checkbox"/> Illuminated <input type="checkbox"/> Flashing	<ul style="list-style-type: none">- Relay working properly.- Internal Relay Fault
Yellow Led		<input type="checkbox"/> Off <input type="checkbox"/> Illuminated <input type="checkbox"/> Flashing	<ul style="list-style-type: none">- No Trip- Trip occurred- fUNCTION TIMING
Reset from Illuminated status is manual (see § 6.1)			
Red Led		<input type="checkbox"/> Off <input type="checkbox"/> Illuminated	<ul style="list-style-type: none">- C/B Open- C/B Close
Green Led		<input type="checkbox"/> Off <input type="checkbox"/> Illuminated	<ul style="list-style-type: none">- C/B Close- C/B Open
<div>Both Flashing</div> <div>Operation of Trip Circuit Supervision element.</div>			
<input type="checkbox"/> In case of auxiliary power supply failure the status of the leds is recorded and reproduced when power supply is restored.			

6.1 - Leds Manual Reset

For Leds' manual reset operate as follows:

- Press "**Menu**" for access to the main menu with icons.
- Select icon "**LocalCmd**".
 - Press "**Select**",
- Select "**LedClear**".
 - Press "**Select**" to execute the command. (See § Password).
- When command has been executed the display shows "**! Command Done**";







7. LOCAL COMMANDS

“**LOCAL COMMANDS**” allow to operate from relay front face controls like Thermal Memory reset, Leds reset, etc.


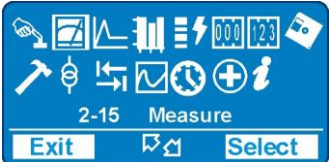

Menu	Description	Password
→ Led Clear	Reset of signal Leds	No
→ Relays Clear	Manual reset of output relays	No
→ Breaker Close	Manual C/B closing (conditioned by Password)	Yes
→ Breaker Open	Manual C/B opening (conditioned by Password)	Yes
→ HistFail Clear	Reset of Internal Failure Historic records	Yes
→ Reset Term	Reset to zero of the accumulations relevant to Thermal Image and Interruption Energy.	Yes
→ Leds Test	Signal Leds test	No

To operate one command by the Front Face Keyboard, proceed as follows (Led Reset in the present example).

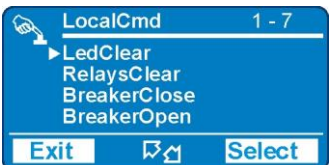- 
 - Press “**Menu**” for access to the main menu with icons.
- 
 - Select “**LocalCmd**” icon with pushbutton “**Increase**” or “**Decrease**”.
 - Press “**Select**” for access.
- 
 - Select with pushbutton “**Increase**” or “**Decrease**” the menu “**LedClear**”.
 - Press “**Select**” to execute the command.
(if Password is request, see § Password).
- 
 - When command has been executed the display shows “**! Command Done**”; go to “3”.

8. MEASURE

Real time values as measured during the normal operation.




- 1 
 - Press "**Menu**" for access to the main menu with icons.
- 2 
 - Select "**Measure**" icon with pushbutton "**Increase**" or "**Decrease**".
 - Press "**Select**" for access.
- 3 
 - Scroll the menu "**Measure**" with pushbutton "**Increase**" or "**Decrease**" to display the measurement.
 - Press "**Exit**" to go to the main menu.

→ IMx	(0 ÷ 9999)	A	Largest phase current (Ia, Ib, Ic).	
→ Ia	(0 ÷ 9999)	A	Phase A current	(R.M.S. ampere)
→ Ib	(0 ÷ 9999)	A	Phase B current	(R.M.S. ampere)
→ Ic	(0 ÷ 9999)	A	Phase C current	(R.M.S. ampere)
→ Io	(0 ÷ 9999)	A	Zero Sequence Current	(fondamental frequency value 3Io)
→ I1	(0.00 ÷ 99.99)	In	Positive sequence current	
→ I2	(0.00 ÷ 99.99)	In	Negative sequence current	
→ Frq	(0.00 ÷ 99.99)	Hz	Frequency	
→ Uan	(0 ÷ 999999)	V	Phase Voltage "A-N"	(R.M.S. value)
→ Ubn	(0 ÷ 999999)	V	Phase Voltage "B-N"	(R.M.S. value)
→ Ucn	(0 ÷ 999999)	V	Phase Voltage "C-N"	(R.M.S. value)
→ Uab	(0 ÷ 999999)	V	Phase-to-phase Voltage "A-B"	(R.M.S. value)
→ Ubc	(0 ÷ 999999)	V	Phase-to-phase Voltage "B-C"	(R.M.S. value)
→ Uca	(0 ÷ 999999)	V	Phase-to-phase Voltage "C-A"	(R.M.S. value)
→ Uo	(0 ÷ 999999)	V	Zero Sequence Voltage	(fondamental frequency value 3Vo)
→ V1	(0.00 ÷ 99.99)	Vn	Positive Sequence Voltage	
→ V2	(0.00 ÷ 99.99)	Vn	Negative Sequence Voltage	
→ PhA	(0 ÷ 359)	Dg	Phase angle "Ia ^ Uan"	(Dg = °)
→ PhB	(0 ÷ 359)	Dg	Phase angle "Ib ^ Ubn"	(Dg = °)
→ PhC	(0 ÷ 359)	Dg	Phase angle "Ic ^ Ucn"	(Dg = °)
→ Ph0	(0 ÷ 359)	Dg	Phase angle "Io ^ Uo"	(Dg = °)
→ W	(0.00 ÷ 99.99 ÷ 999.9 ÷ 9999999)	k	Three Phase Active Power	(kW)
→ VAr	(0.00 ÷ 99.99 ÷ 999.9 ÷ 9999999)	k	Three Phase Reactive Power	(kVAr)
→ VA	(0.00 ÷ 99.99 ÷ 999.9 ÷ 9999999)	k	Three Phase Apparent Power	(kVA)
→ Cos	(0.000 ÷ 1.000)	-	Power Factor	
→ Tem	(0 ÷ 9999)	%T	Thermal status as % of the full load continuous operation temperature Tn	
→ Wir	(100 ÷ 0)	%	Amount still remaining of permissible interruption energy before Circuit Breaker maintenance is requested.	



9. MAXIMUM VALUES (MAX DEMAND)

Maximum demand values recorded starting from 100ms after closing of main Circuit Breaker (updated any time the breaker closes).

- 1 
 - Press “**Menu**” for access to the main menu with icons.
- 2 
 - Select “**MaxVal**” icon with pushbutton “**Increase**” or “**Decrease**”.
 - Press “**Select**” for access.
- 3 
 - Scroll the menu “**Measure**” with pushbutton “**Increase**” or “**Decrease**” to display the measure
 - Press “**Exit**” to go back to the main menu.







→ IMx	(0 ÷ 9999)	A	Maximum phase current (Ia, Ib, Ic).	
→ Ia	(0 ÷ 9999)	A	Phase A current	(R.M.S. ampere)
→ Ib	(0 ÷ 9999)	A	Phase B current	(R.M.S. ampere)
→ Ic	(0 ÷ 9999)	A	Phase C current	(R.M.S. ampere)
→ Io	(0 ÷ 9999)	A	Zero Sequence Current	(fondamental frequency value 3Io)
→ I1	(0.00 ÷ 99.99)	In	Positive sequence current	
→ I2	(0.00 ÷ 99.99)	In	Negative sequence current	
→ Frq	(0.00 ÷ 99.99)	Hz	Frequency	
→ Uan	(0 ÷ 999999)	V	Phase Voltage “A-N”	(R.M.S. value)
→ Ubn	(0 ÷ 999999)	V	Phase Voltage “B-N”	(R.M.S. value)
→ Ucn	(0 ÷ 999999)	V	Phase Voltage “C-N”	(R.M.S. value)
→ Uab	(0 ÷ 999999)	V	Phase-to-phase Voltage “A-B”	(R.M.S. value)
→ Ubc	(0 ÷ 999999)	V	Phase-to-phase Voltage “B-C”	(R.M.S. value)
→ Uca	(0 ÷ 999999)	V	Phase-to-phase Voltage “C-A”	(R.M.S. value)
→ Uo	(0 ÷ 999999)	V	Zero Sequence Voltage	(fondamental frequency value 3Vo)
→ V1	(0.00 ÷ 99.99)	Vn	Positive Sequence Voltage	
→ V2	(0.00 ÷ 99.99)	Vn	Negative Sequence Voltage	
→ PhA	(0 ÷ 359)	Dg	Phase angle “Ia ^ Uan”	(Dg = °)
→ PhB	(0 ÷ 359)	Dg	Phase angle “Ib ^ Ubn”	(Dg = °)
→ PhC	(0 ÷ 359)	Dg	Phase angle “Ic ^ Ucn”	(Dg = °)
→ Ph0	(0 ÷ 359)	Dg	Phase angle “Io ^ Uo”	(Dg = °)
→ W	(0.00 ÷ 99.99 ÷ 999.9 ÷ 9999999)	k	Three Phase Active Power	(kW)
→ VAr	(0.00 ÷ 99.99 ÷ 999.9 ÷ 9999999)	k	Three Phase Reactive Power	(kVAr)
→ VA	(0.00 ÷ 99.99 ÷ 999.9 ÷ 9999999)	k	Three Phase Apparent Power	(kVA)
→ Cos	(0.000 ÷ 1.000)	-	Power Factor	
→ Tem	(0 ÷ 9999)	%T	Thermal status as % of the full load continuous operation temperature Tn	
→ Wir	(100 ÷ 0)	%	Amount still remaining of permissible interruption energy before Circuit Breaker maintenance is requested.	



10. ENERGY

Real time energy measurements

Display	→ + kWh	(0 – 9999999)	Exported Active Energy
	→ - kWh	(0 – 9999999)	Imported Active Energy
	→ + kRh	(0 – 9999999)	Exported Reactive Energy
	→ - kRh	(0 – 9999999)	Imported Reactive Energy
Erase	→ All Energy counters are cleared		

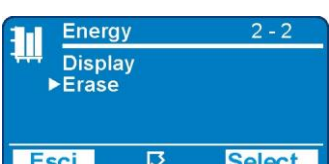- 
 - Press “**Menu**” for access to the main menu with icons.
- 
 - Select “**Energy**” icon with pushbutton “**Increase**” or “**Decrease**”.
 - Press “**Select**” for access.
- 
 - Select “**Display**” with pushbutton “**Increase**” or “**Decrease**”.
 - Press “**Select**” for access.
- 
 - Display of Real time Energy measurements.
 - Press “**Exit**” to go back to the level “3”.
- 
 - Select “**Erase**” with pushbutton “**Decrease**” to clear all reading.
 - Press “**Select**”. (if Password is request, see § Password).
- 
 - When command has been execute the display shows “**! Command Done**”; to go to the level “5”.
 - Press “**Exit**” to go back to the main menu.

11. TRIP RECORDING

Display of the function which caused the tripping of the relay plus values of the measurement at the moment of tripping. The last 10 events are recorded.

The memory buffer is refreshed at each new relay tripping (FIFO logic).


Display	→ Reading of recorded Trips.
----------------	------------------------------

Erase	→ Clear all Trip recorded.
--------------	----------------------------


- 1 
 - Press "**Menu**" for access to the main menu with icons.
- 2 
 - Select "**TripRec.**" icon with pushbutton "**Increase**" or "**Decrease**".
 - Press "**Select**" for access.
- 3 
 - Select "**Display**" with pushbutton "**Increase**" or "**Decrease**".
 - Press "**Select**" for access.
 - For "**Erase**" go to "8"
- 4 
 - If no trip is recorded the display shows "**! No Trips**".
- 5 
 - If any trip was recorded, select "**View**" to display the chronological list of the records.
 - By the keys "**Increase**" or "**Decrease**" select the date of the record to be checked.
- 6 
 - Will be shown:
 - "**Descr**" the function that caused the event
 - "**Edge**" if the function was tripped (Rise) or reset (Fall)
 - "**Date**", date of trip, year/month/day, hour:minutes:seconds:milliseconds
 - Press "**Value**", for reading the value of input quantities on tripping.




- 7

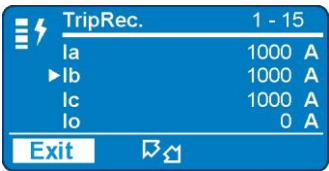

- Scroll with pushbuttons "**Increase**" or "**Decrease**" the available measurements.
 - Select "**Exit**" to go back to "5" for another selection, or "2" go back to the main menu.
- 8



- Select "**Erase**" with button "**Decrease**".
 - Press "**Select**" to execute the commands; **All** Trips recorded are erased. (if Password is request, see § Password).
- 9

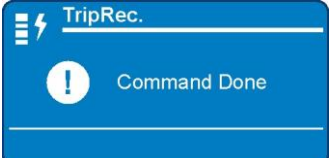

- When command has been executed the display shows "**! Command Done**";
 - Press "**Exit**" to go back to the main menu.





12. PARTIAL COUNTERS


Partial counters of the number of operations for each of the relay functions.


Display	→ 1l>	0	Operations counters	First overcurrent element
	→ 2l>	0	Operations counters	Second overcurrent element
	→ 3l>	0	Operations counters	Third overcurrent element
	→ 4l>	0	Operations counters	Fourth overcurrent element
	→ 5l>	0	Operations counters	Fifth overcurrent element
	→ 6l>	0	Operations counters	Sixth overcurrent element
	→ 1lo>	0	Operations counters	First Earth Fault element
	→ 2lo>	0	Operations counters	Second Earth Fault element
	→ 3lo>	0	Operations counters	Third Earth Fault element
	→ 4lo>	0	Operations counters	Fourth Earth Fault element
	→ 1ls>	0	Operations counters	First Negative Sequence element
	→ 2ls>	0	Operations counters	Second Negative Sequence element
	→ 1U>	0	Operations counters	First Overvoltage element
	→ 2U>	0	Operations counters	Second Overvoltage element
	→ 3U>	0	Operations counters	Third Overvoltage element
	→ 1U<	0	Operations counters	First Undervoltage element
	→ 2U<	0	Operations counters	Second Undervoltage element
	→ 3U<	0	Operations counters	Third Undervoltage element
	→ 1f>	0	Operations counters	First Overfrequency element
	→ 2f>	0	Operations counters	Second Overfrequency element
	→ 3f>	0	Operations counters	Third Overfrequency element
	→ 4f>	0	Operations counters	Fourth Overfrequency element
	→ 1f<	0	Operations counters	First Underfrequency element
	→ 2f<	0	Operations counters	Second Underfrequency element
	→ 3f<	0	Operations counters	Third Underfrequency element
	→ 4f<	0	Operations counters	Fourth Underfrequency element
	→ 1Uo>	0	Operations counters	First Zero Sequence overvoltage element
	→ 2Uo>	0	Operations counters	Second Zero Sequence overvoltage element
	→ TCS	0	Operations counters	Trip Circuit Supervision
	→ BrkF	0	Operations counters	Breaker failure to open
	→ Wi	0	Operations counters	Circuit Breaker maintenance alarm
	→ nTrip	0	Counters	Number of C/B on load interruptions
	→ nOps	0	Counters	Number of C/B mechanical operations
	→ IRF	0	Operations counters	Internal Relay Fault
	→ I2H	0	Operations counters	Inrush Detection
	→ I2/I1	0	Operations counters	Broken Conductor Detection
Erase	→	Reset all Counters (By the interface program "MSCom II" it is possible to individually reset the counters and set an initial starting number)		





- 

 - Press "**Menu**" for access to the main menu with icons.
- 

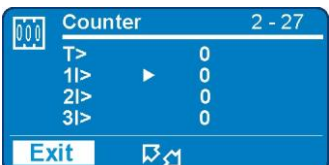 - Select "**Counter**" icon with pushbutton "**Increase**" or "**Decrease**".
 - Press "**Select**" for access.
- 

 - Select "**Display**" with pushbutton "**Increase**" or "**Decrease**".
 - Press "**Select**" for access.
 - For "**Erase**" to go to "5"
- 

 - Display of the number of operations of each individual function.
 - With pushbuttons "**Increase**" or "**Decrease**" scroll the parameters
 - Press "**Exit**" go back to "3".
- 

 - Select "**Erase**" with pushbutton "**Decrease**".
 - Press "**Select**".
(if Password is request, see § Password).
- 

 - When command has been executed the display shows "**! Command Done**"; and return to "5".
 - With pushbutton "**Exit**" to go back to the main menu.




13. TOTAL COUNTERS


Counters of the total number of operation of each individual function.
These counters cannot be reset


Display	→ 1l>	0	Operations counters	First overcurrent element
	→ 2l>	0	Operations counters	Second overcurrent element
	→ 3l>	0	Operations counters	Third overcurrent element
	→ 4l>	0	Operations counters	Fourth overcurrent element
	→ 5l>	0	Operations counters	Fifth overcurrent element
	→ 6l>	0	Operations counters	Sixth overcurrent element
	→ 1lo>	0	Operations counters	First Earth Fault element
	→ 2lo>	0	Operations counters	Second Earth Fault element
	→ 3lo>	0	Operations counters	Third Earth Fault element
	→ 4lo>	0	Operations counters	Fourth Earth Fault element
	→ 1ls>	0	Operations counters	First Negative Sequence element
	→ 2ls>	0	Operations counters	Second Negative Sequence element
	→ 1U>	0	Operations counters	First Overvoltage element
	→ 2U>	0	Operations counters	Second Overvoltage element
	→ 3U>	0	Operations counters	Third Overvoltage element
	→ 1U<	0	Operations counters	First Undervoltage element
	→ 2U<	0	Operations counters	Second Undervoltage element
	→ 3U<	0	Operations counters	Third Undervoltage element
	→ 1f>	0	Operations counters	First Overfrequency element
	→ 2f>	0	Operations counters	Second Overfrequency element
	→ 3f>	0	Operations counters	Third Overfrequency element
	→ 4f>	0	Operations counters	Fourth Overfrequency element
	→ 1f<	0	Operations counters	First Underfrequency element
	→ 2f<	0	Operations counters	Second Underfrequency element
	→ 3f<	0	Operations counters	Third Underfrequency element
	→ 4f<	0	Operations counters	Fourth Underfrequency element
	→ 1Uo>	0	Operations counters	First Zero Sequence overvoltage element
	→ 2Uo>	0	Operations counters	Second Zero Sequence overvoltage element
	→ TCS	0	Operations counters	Trip Circuit Supervision
	→ BrkF	0	Operations counters	Breaker failure to open
	→ Wi	0	Operations counters	Circuit Breaker maintenance alarm
	→ nTrip	0	Counters	Number of C/B on load interruptions
	→ nOps	0	Counters	Number of C/B mechanical operations
	→ IRF	0	Operations counters	Internal Relay Fault
	→ I2H	0	Operations counters	Inrush Detection
	→ I2/I1	0	Operations counters	Broken Conductor Detection



- 1


 - Press “**Menu**” for access to the main menu with icons.
- 2


 - Select “**ROCnt**” icon with pushbutton “**Increase**” or “**Decrease**”.
 - Press “**Select**” for access.
- 3

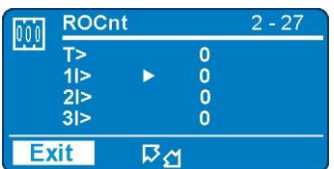


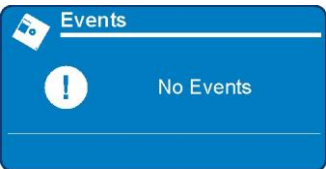
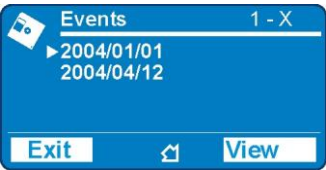
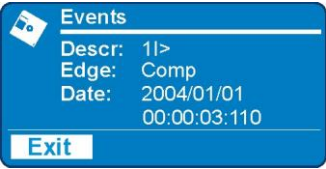



 - With pushbuttons “**Increase**” or “**Decrease**” scroll the parameters.
 - With pushbutton “**Exit**” to go back to the main menu.

14. EVENTS

Display of the function which caused any of the following events: - *Status change of digital Inputs/Outputs.* - *Start of protection functions – Trip of protection function – Function reset.*
The last 100 events are recorded.

The memory buffer is updated at each new event.

Display	→	Reading events recorded.
Erase	→	Clear all events recorded.

- 1 
 - Press “**Menu**” for access to the main menu with icons.
- 2 
 - Select “**Events**” icon with pushbutton “**Increase**” or “**Decrease**”.
 - Press “**Select**” for access.
- 3 
 - Select “**Display**” with pushbutton “**Increase**” or “**Decrease**”.
 - Press “**Select**” for access.
 - For “**Erase**” go to “7”
- 4 
 - If no event is recorded the display shows message “**! No Events**”.
- 5 
 - If any event was recorded, select “**View**” to display the chronological list of the records.
 - By the keys “**Increase**” or “**Decrease**” select the date of the record to be checked.
- 6 
 - Will be shown:
 - “**Descr**” the function that caused the event
 - “**Edge**” if the function was tripped (Rise) or reset (Fall)
 - “**Date**”, date of trip, year/month/day, hour:minutes:seconds:milliseconds
- 7 
 - Select “**Erase**” with button “**Decrease**”.
 - Press “**Select**” to execute the commands; **All** Events recorded are erased. (if Password is request, see § Password).
- 8 
 - When command has been execute the display shows “**! Command Done**”;
 - Press “**Exit**” to go back to the main menu.




15. SYSTEM (System parameters)

Setting of system parameters.

CT&PTs	Phase CT	Prim.	→	1000	A	(1 ÷ 9999)	step	1	A	(1)
		Sec.	→	1	A	(1 / 5)				
	PT (Ph-Ph)	Prim.	→	10.00	kV	(0.10 ÷ 500.00)	step	0.01	kV	(2)(3)
		Sec.	→	100	V	(50 ÷ 150)	step	1	V	
	Neut. CT	Prim.	→	1000	A	(1÷9999)		1	A	(1)
		Sec.	→	1	A	(1 / 5)				
	Sys.Ratings (System Rated Values)		→	fn	50	Hz	(50 / 60)			
			→	In	500	A	(1÷9999)		1	A
→			Un	10.00	kV	(0.10 ÷ 500.00)		0.01	kV	
SettingBank		→	Bank	1		(1 / 2)				

(1) Move the switch in the corresponding founding to the required input current as herebelow shorted.

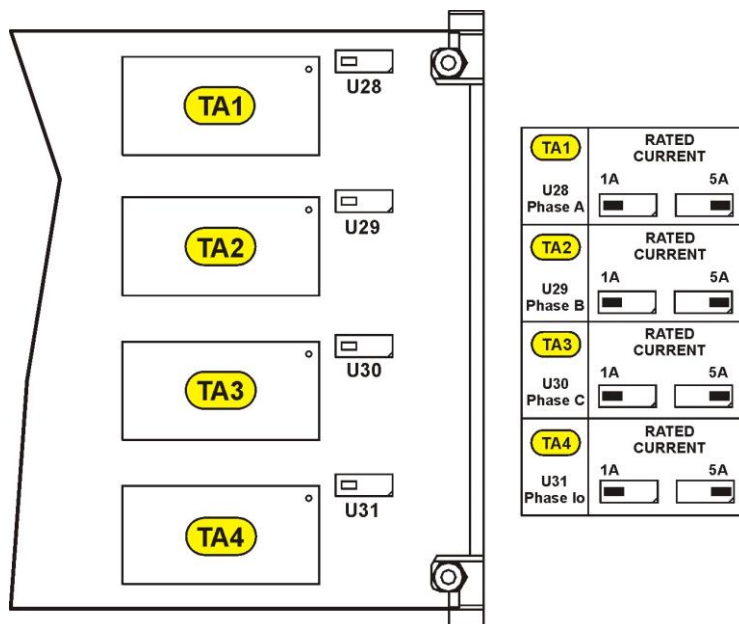

(2) Set the value of the phase-to-phase PT voltage.

$$\text{Example: Example : TV} \quad \frac{10000 : \sqrt{3}}{100 : \sqrt{3}} \rightarrow \text{set} \quad \frac{\text{Prim.} = 10000}{\text{Sec.} = 100}$$


(3) Zero sequence voltage input is to be supplied by three system P.Ts. Y/Open Delta connected; the open delta connected secondaries are rated 1/3 of the phase-to-phase secondary voltage (Example: 10000 / 100:√3 / 100:3).





- Press **"Menu"** for access to the main menu with icons.
- Select **"System"** icon with pushbuttons **"Increase"** or **"Decrease"**.
 - Press **"Select"** for access.
- Select **"CT&PTs"**.
 - Press **"Select"** for access.
- Select **"Phase CT"**.
 - Press **"Select"** for access.
- Select **"Prim."** to modify the primary value of Phase CT, or press **"Decrease"** and select **"Sec."** to modify the secondary value of Phase CT.
 - Press **"Modify"** to modify the parameter.
(if Password is request, see § Password).
- The value appear as bold figure.
 - Use pushbuttons **"Increase"** or **"Decrease"** to set the value.
 - Press **"Write"** to confirm the value
- The value is now set.
 - To set a new value return to the point "5".
 - Press **"Exit"**.
- The display show **"Confirm the change?"**.
 - Choose **"Yes"** to convalidate the changes.
 - Choose **"No"** to not confirm the changes.
 - After set confirmation (or non confirmation) the display goes back to point "4".




- 9


 - To modify the input quantities, select with pushbutton “**Decrease**”, “**Sys.Ratings**”.
 - Press “**Select**” for access.
- 10

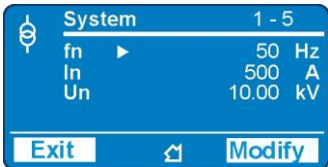

 - To set the input quantities see points “5-6-7-8” .
- 11



 - To select the Active Bank of setting press “**SettingBank**”.
- 12



 - Select with pushbuttons “**Increase**” or “**Decrease**”, the Bank to be Active.

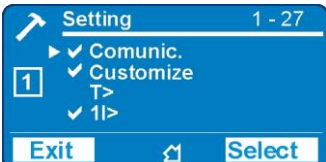16. SETTINGS

Two complete banks of settings of the programmable variables are available in the “**SETTING**” menu. Both “Bank #1” and “Bank #2” include the hereunder listed variables.

1 

 Indicates the Setting Bank that is actually being modified.

 This symbol indicates that the function aside is enabled; symbol missing indicates that the function is disabled.

→ Comunic.	Serial communication parameters
→ Customize	Visualization parameters
→ 1l>	First overcurrent Element
→ 2l>	Second overcurrent Element
→ 3l>	Third overcurrent Element
→ 4l>	Fourth overcurrent Element
→ 5l>	Fifth overcurrent Element
→ 6l>	Sixth overcurrent Element
→ 1lo>	First Earth Fault Element
→ 2lo>	Second Earth Fault Element
→ 3lo>	Third Earth Fault Element
→ 4lo>	Fourth Earth Fault Element
→ 1ls>	First Negative Sequence Current Element
→ 2ls>	Second Negative Sequence Current Element
→ 1U>	First Overvoltage Element
→ 2U>	Second Overvoltage Element
→ 3U>	Third Overvoltage Element
→ 1U<	First Undervoltage Element
→ 2U<	Second Undervoltage Element
→ 3U<	Third Undervoltage Element
→ 1f>	First Overfrequency Element
→ 2f>	Second Overfrequency Element
→ 3f>	Third Overfrequency Element
→ 4f>	Fourth Overfrequency Element
→ 1f<	First Underfrequency Element
→ 2f<	Second Underfrequency Element
→ 3f<	Third Underfrequency Element
→ 4f<	Fourth Underfrequency Element
→ 1Uo>	First Zero Sequence Voltage Element
→ 2Uo>	Second Zero Sequence Voltage Element
→ I2H	Inrush Detection Element
→ I2/I1	Broken conductor Detection Element
→ Wi	Amount of Energy to reach the C/B maintenance level
→ TCS	Setting variables for Trip Circuit Supervision
→ IRF	Internal Relay Fault
→ BreakerFail	Setting variables for Breaker Failure detection
→ Oscillo	Setting variables for Oscillographic recording
→ CB Commands	Setting variables for C/B control





16.1. Modifying the setting of variables


To modify any variable setting by the keyboard proceed as follows:


(example: change setting of element "1I>", from "Is 4.000 In" to "Is 3.500 In")


- 1

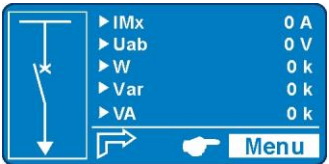

 - Press "**Menu**" for access to the main menu with icons.
- 2



 - Select icon "**Setting**" by pushbuttons "**Increase**" or "**Decrease**".
 - Press "**Select**".
- 3

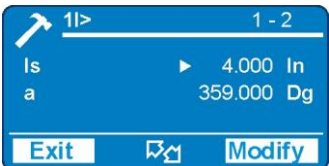

 - Select by pushbuttons "**Increase**" or "**Decrease**" the parameter "1I>".
 - Press "**Select**".
- 4



 - Select by buttons "**Increase**" or "**Decrease**" the menu "**Oper.Levels**".
 - Press "**Select**".
- 5



 - The arrow aside "**Is**" shows the parameter selected for changing
 - Press "**Modify**".
 - If Password is request, see § Password
- 6


 - The value appear as bold figure.
- 7

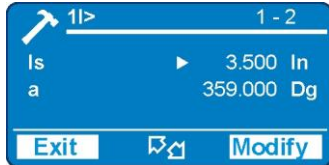
 - Set new values pushbuttons "**Increase**" or "**Decrease**" buttons
 - Press "**Write**".
- 8

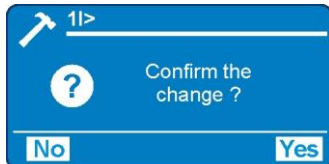
 - If the change of parameters is completed, press "**Exit**".
- 9


 - "**Yes**" confirm all changes.
 - "**No**" voids all the changes.
- 10


 - The relay returns to point "4".



16.2. Password

The password is requested any time the user wishes to modify any password protected parameter (example "1I>" menu "Setting").

The factory default password is "1111".

The password is only modifiable with "MSCom II" software (see Manual "MSCom II").

When password is requested, proceed as follows:


- | | | | |
|----------|--|----------|---|
| <p>1</p> | <ul style="list-style-type: none"> Use the key "Increase" and "Decrease" and set the first digit of password. | <p>5</p> | <ul style="list-style-type: none"> Use the key "Increase" or "Decrease" to set the third digit. |
| <p>2</p> | <ul style="list-style-type: none"> Press "Next" to validate and go to the next digit. | <p>6</p> | <ul style="list-style-type: none"> Press "Next" to validate and go to the next digit. |
| <p>3</p> | <ul style="list-style-type: none"> Use the key "Increase" or "Decrease" to set second digit. | <p>7</p> | <ul style="list-style-type: none"> Use the key "Increase" or "Decrease" to set the fourth digit. |
| <p>4</p> | <ul style="list-style-type: none"> Press "Next" to validate and go to the next digit. | <p>8</p> | <ul style="list-style-type: none"> Press "Next" to validate and go to modify the next parameter. |



By key "**Prev**" go back to previous digit.



The password validity expires 60 sec after the last setting modification or as soon as you go back to the main menu

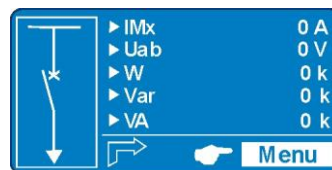

- | | | | |
|----------|--|----------|---|
| <p>1</p> | <ul style="list-style-type: none"> If set the incorrect password the display shows "! Wrong code". | <p>2</p> | <ul style="list-style-type: none"> The display will repeat the initial interrogation |
|----------|--|----------|---|



16.3 – Menu: **Communic.** (**Communication**)

Options	→ BRLoc	38400	[9600 / 19200 / 38400 / 57600]
	→ BRRem	19200	[9600 / 19200 / 38400]
	→ PRRem	Modbus	[Modbus / IEC103]
Node Address	→ Indir.	1	[1 ÷ 255]


16.3.1 – Description of variables

- ❑ **BRLoc** : RS232 local (Front Panel) serial communication speed
- ❑ **BRRem** : RS485 remote (Rear terminal block) serial communication speed
- ❑ **PRRem** : Protocol for remote (Rear terminal block) serial communication RS485
- ❑ **Indir.** : Identification number for the connection on serial communication bus

16.3.2 – Front Panel serial communication port (RS232)

A D-Sub, -pin female socket is available on Relay's front face for connection to the local RS232 serial communication line. Through this port - and by the interface program available from Microelettrica Scientifica S.p.A. (MCom II for Windows 98/ME/2000/XP) – it is possible to connect a Personal Computer to download all available information, operate any control and program the relay; the protocol used is "Modbus RTU".

16.3.3 – Cable for direct connection of Relay to Personal Computer

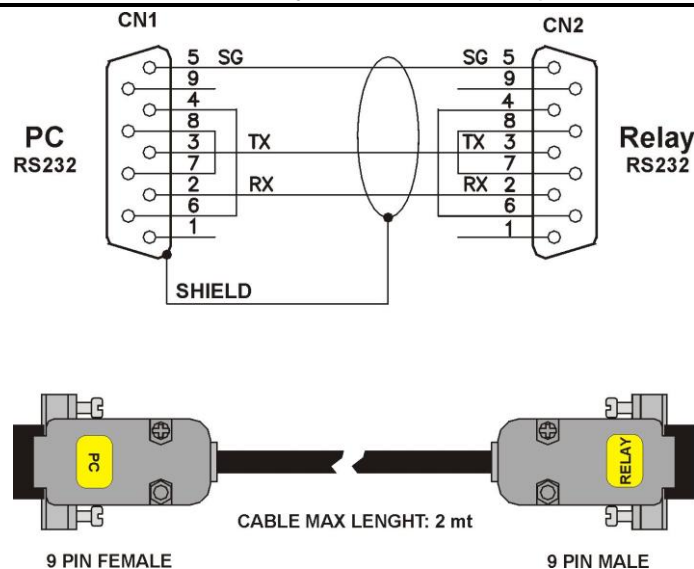

16.3.4 – Main serial communication port (RS485)

From the Relay's back terminal board, a RS485 ports is available for communication with SCADA system with Protocol Modbus RTU or IEC60870-5-103 (selectable).

The communication interface allows to program all settings, operate all commands and download all information and records.

The physical connection can be via a normal pair of wires (RS485) or, on request, via fiber optic.



16.4 - Menu: **Customize**

Options	→ Lang	English	[English / Loc.Lang]
	→ Ligh	On	[Autom. / On]

16.4.1 – Description of variables







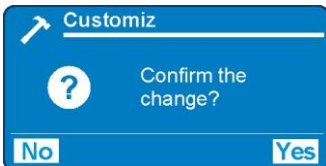
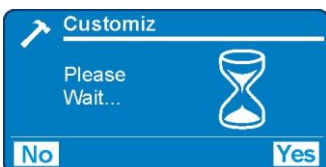
- ❑ **Lang** : Set Language
- ❑ **Ligh** : Set Display backlight

This menu allows to customize the Language and the Display's backlight.

The standard languages are English and Italian. On request, other languages can be loaded (French, German, etc..).

The Display backlight can be programmed always on "ON" or switched-on "Automatically" for a few second at any operation of the keyboard "Auto".

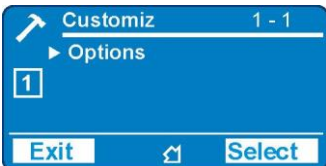Example: set Local Language.

- 1 
 - Press "**Menu**" for access to the main menu with icons.
- 2 
 - Select icon "**Setting**" by pushbuttons "**Increase**" or "**Decrease**".
 - Press "**Select**".
- 3 
 - Select "**Bank 1**" or "**Bank 2**".
 - Select "**Customize**".
 - Select "**Options**".
 - Press "**Select**".
- 4 
 - Select "**Lang**".
 - Press "**Modify**".
- 5 
 - Select "**Loc.Lang**".
 - Press "**Write**".
 - If Password is requested, see § Password
- 6 
 - Press "**Exit**".
- 7 
 - "**Yes**" confirms all changes.
 - "**No**" void all changes.
- 8 
 - After set confirmation the display shows "**Please Wait**".


16.5 - Function: 1I> (First Overcurrent Element F50/51)

Status	→ Enab.	No	[No / Yes]
Options	→ f(t)	Type - D	[D / I / VI / EI / MI / SI / A / B / C]
	→ tBI	Disable	[Disable / 2tBO] (1)
	→ f(a)	Disable	[Disable / Sup / Dir]
	→ f(U)	Disable	[Disable / Enable]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Is	4.000	In (0.100÷4) step 0.010 In
	→ a	359.000	Dg (0.000÷359) step 1.000 Dg
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s
	→ tBO	0.75	s (0.05÷0.75) step 0.01 s (1)

16.5.1 - Description of variables

- ❑ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ❑ **f(t)** : Operation characteristic (Time/Current curve): (see § 16.6.2)
 - (D) = Independent definite time
 - (I) = IEEE Inverse Curve
 - (VI) = IEEE Very Inverse Curve
 - (EI) = IEEE Extremely Inverse Curve
 - (MI) = IEEE Moderate Inverse Curve
 - (SI) = IEEE Short Inverse Curve
 - (A) = IEC Inverse Curve type A
 - (B) = IEC Very Inverse Curve type B
 - (C) = IEC Extremely Inverse Curve type C
- ❑ **tBI** : Blocking input reset time (see § 16.6.7)
 - Disable = Permanent block
 - 2tBO = Set 2xtBO.
- ❑ **f(a)** : Operation mode: (see § 16.6.5)
 - Disable = Non Directional
 - Sup. = Directional Supervision
 - Dir. = Total Directional
- ❑ **f(U)** : Voltage restraint (see § 16.6.6)
- ❑ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ❑ **Is** : Minimum operation level
- ❑ **a** : Reference phase current displacement angle for Directional operation
- ❑ **ts** : Trip time delay
- ❑ **tBO** : Time to reset of the Blocking Output after expiring of the Trip time delay. "tBO" is also the trip time delay of the Breaker Failure function. (see § 16.6.7)



16.5.2 - Algorithm of the time current curves

The Time Current Curves are generally calculated with the following equation

$$(1) \quad t(I) = \left[\frac{A}{\left(\frac{I}{I_s}\right)^a - 1} + B \right] \cdot K \cdot T_s + T_r \quad \text{where}$$

$t(I)$ = Actual trip time delay when the input current equals “I”

I_s = Set minimum pick-up level

$$K = \left(\frac{A}{10^a - 1} + B \right)^{-1}$$

T_s = Set time delay: $t(I) = T_s$ when $\frac{I}{I_s} = 10$

t_r = Operation time of the output relay on pick-up.

The parameters A, B and a have different values for the different Time Current Curves.

Curve Name	Curve Identifier	A	B	a
IEC A Inverse	A	0.14	0	0.02
IEC B Very Inverse	B	13.5	0	1
IEC C Extremely Inverse	C	80	0	2
IEEE Moderate Inverse	MI	0.0104	0.0226	0.02
IEEE Short Inverse	SI	0.00342	0.00262	0.02
IEEE Very Inverse	VI	3.88	0.0963	2
IEEE Inverse	I	5.95	0.18	2
IEEE Extremely Inverse	EI	5.67	0.0352	2

For the IEC curves, being $B = 0$, the Time/Current equation (1), becomes:

$$(1') \quad t(I) = \frac{(10^a - 1)T_s}{\left(\frac{I}{I_s}\right)^a - 1} + t_r = \frac{Kt}{\left(\frac{I}{I_s}\right)^a - 1} + t_r$$

Where $Kt = (10^a - 1)T_s$ is the time multiplier


When “f(t) = D” is programmed, the trip time delay is Definite and independent from the current: excess “t = ts”.

The maximum measuring current is “40xIn” for phase elements and “10xOn” for the neutral elements.

Trip takes place when the current measured exceeds (no matter how much) the set level “Is” for the set time “ts”.



16.5.3 - IEC Curves

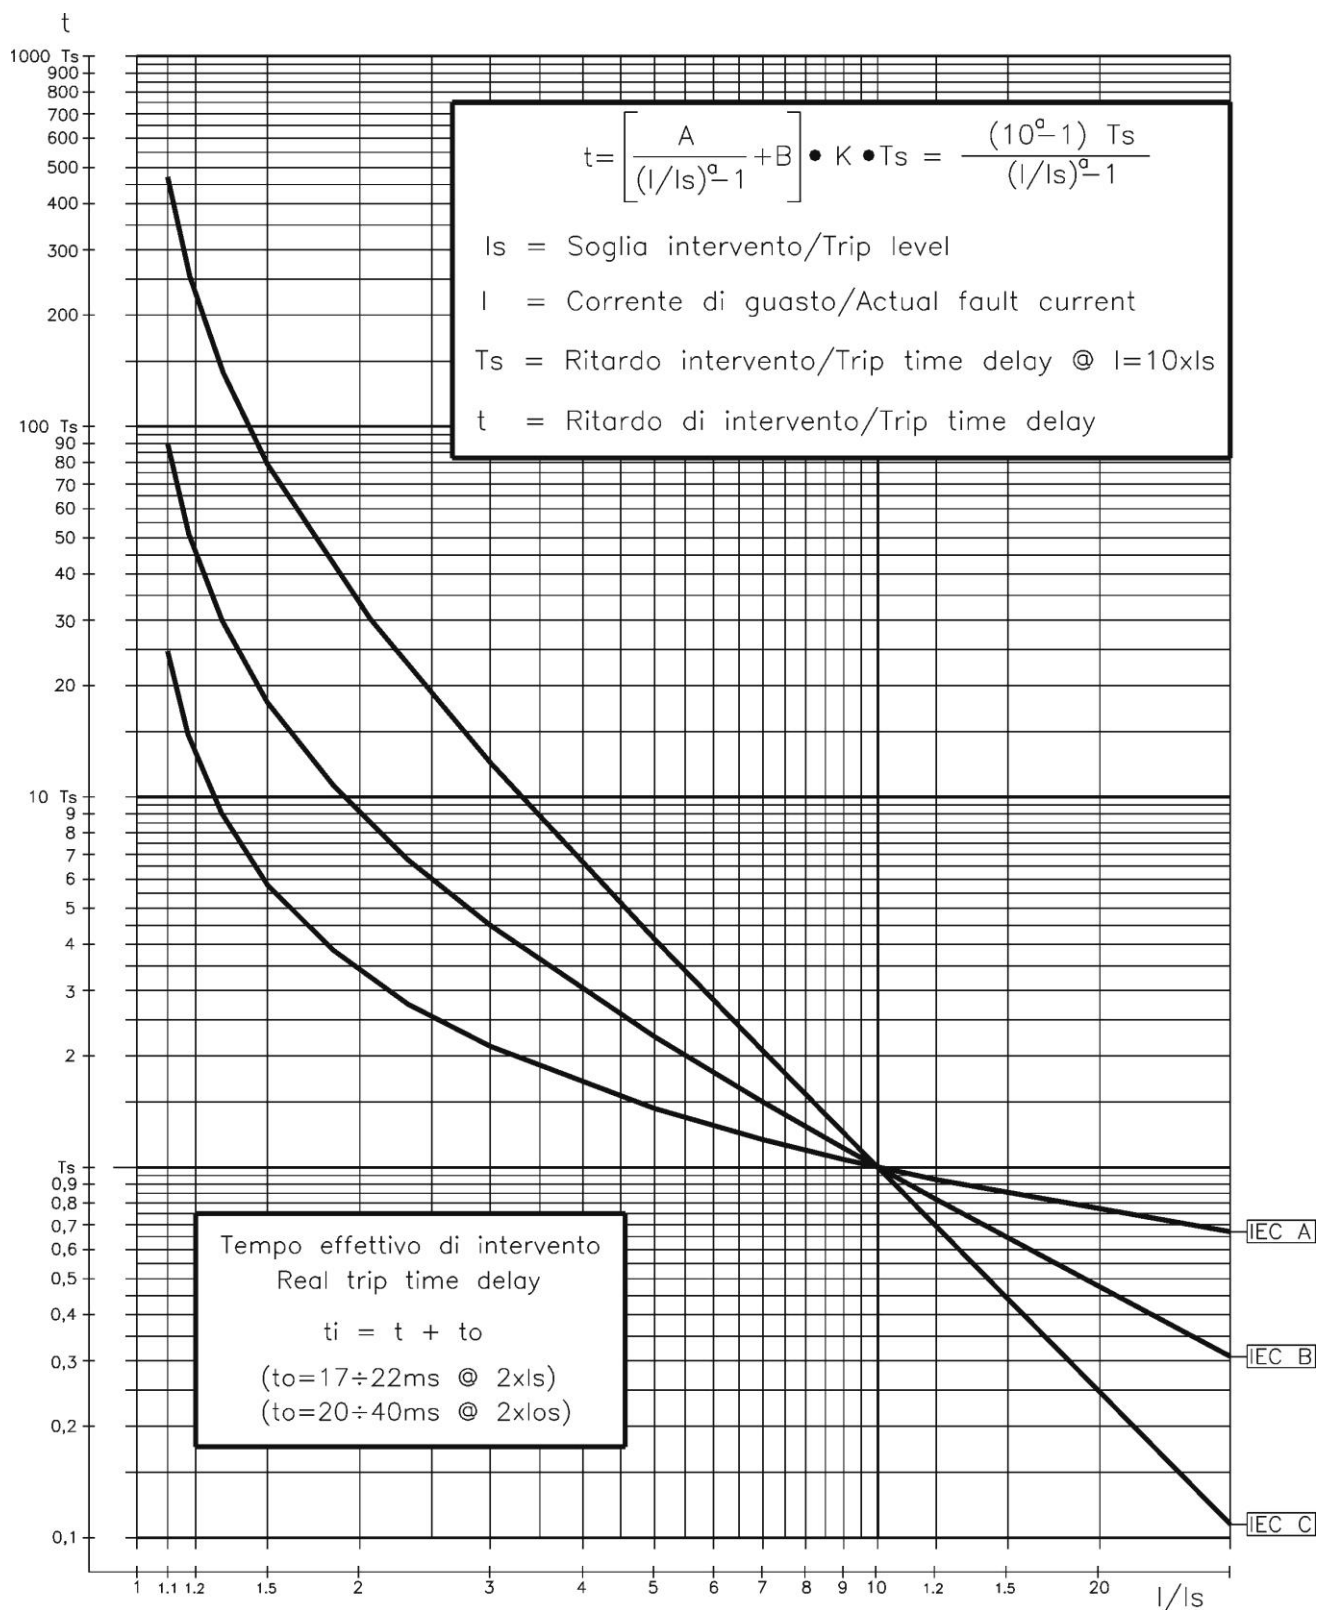


Curve Type	A	B	K	a
IEC A	0.14	0	0.336632	0.02
IEC B	13.5	0	0.666667	1
IEC C	80	0	1.2375	2

Max. "I" Phase = $40 \times I_n$
 Max. "I" Neutral = $10 \times I_n$



16.5.4 – IEEE Curves

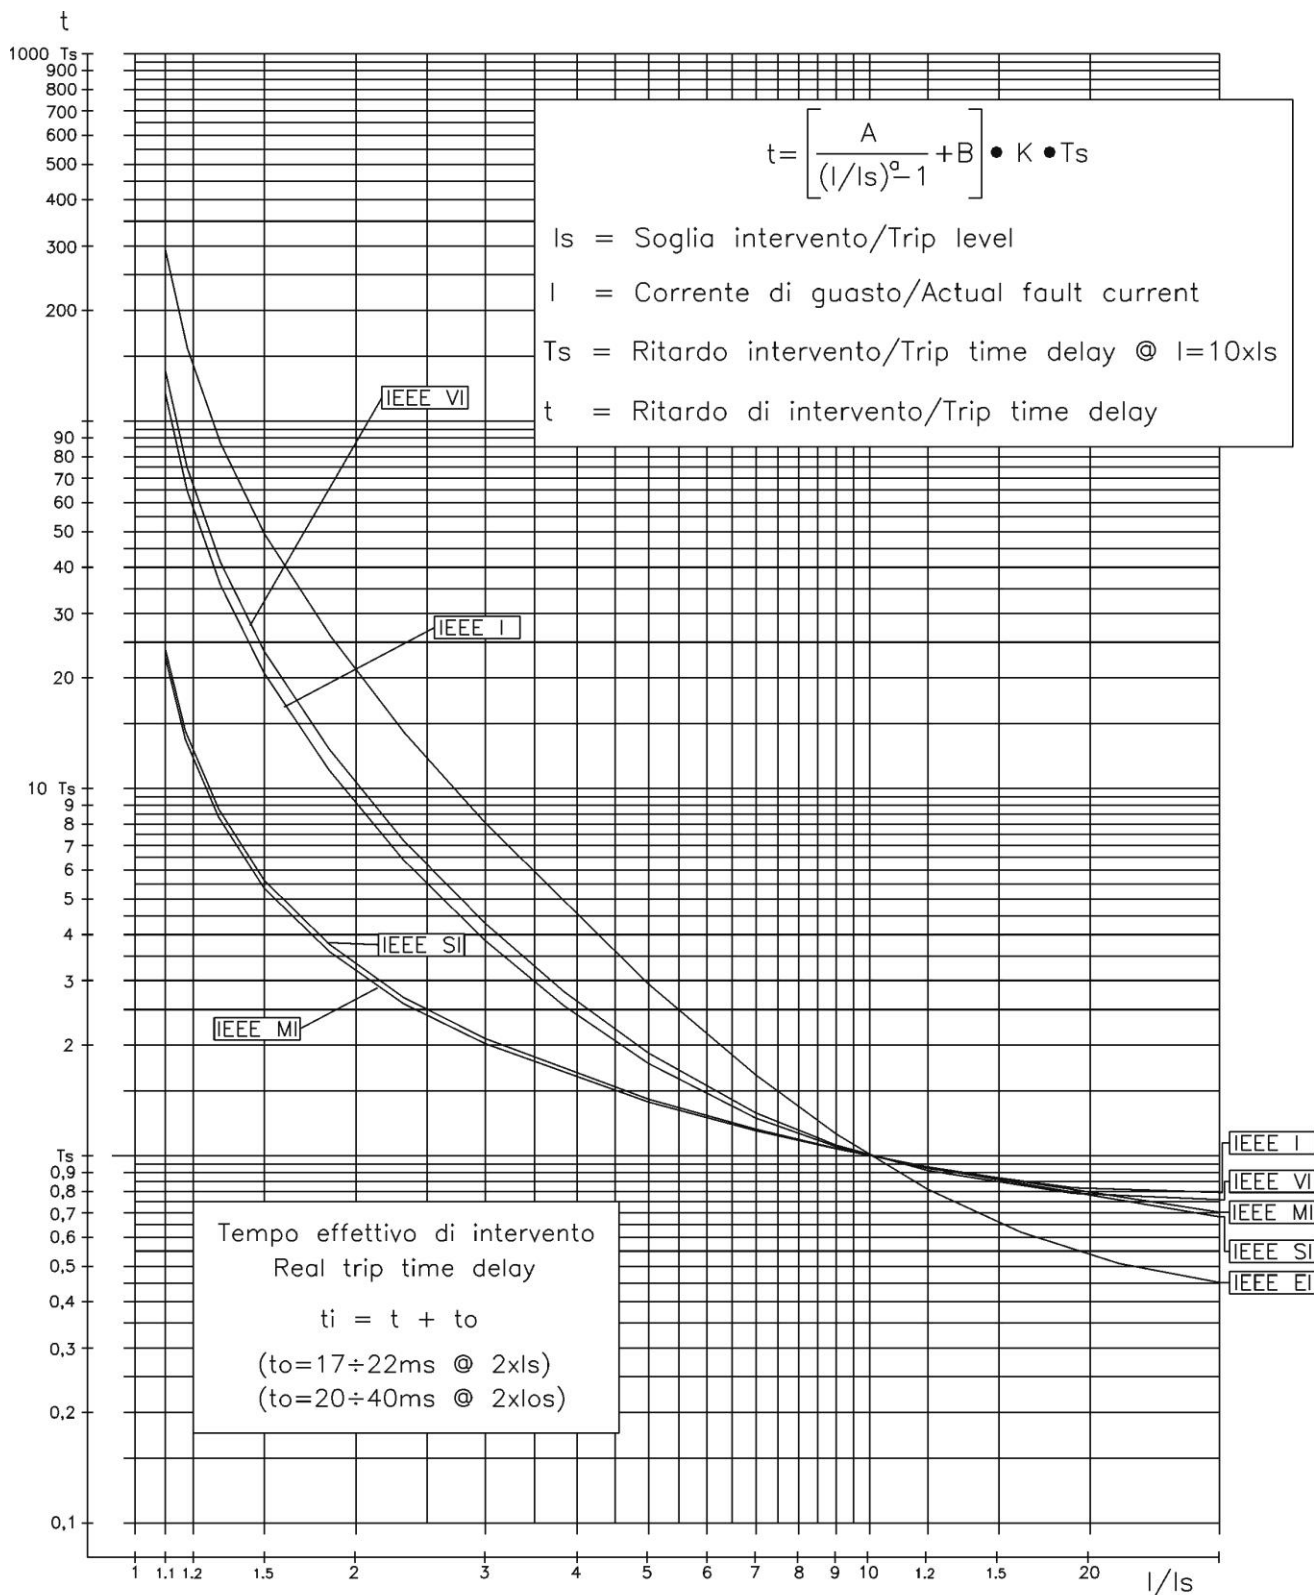

Curve Type	A	B	K	a
MI= IEEE Moderate Inv.	0.0104	0.0226	4.110608	0.02
SI= IEEE Short Inv.	0.00342	0.00262	13.30009	0.02
VI= IEEE Very Inv.	3.88	0.0963	7.380514	2
I= IEEE Inverse	5.95	0.18	4.164914	2
EI= IEEE Extremely Inv.	5.67	0.0352	10.814	2

Max. "I" Phase = $40 \times I_n$
 Max. "I" Neutral = $10 \times I_{0n}$


16.5.5 – Operation of the phase Overcurrent Elements in function of variable “f(a)”

On each phase the relay measures the current “I_x” and its displacement “φ_x” from the relevant phase-to-neutral voltage “E_x”.

Different operation modes are possible according to the programming of the variable “f(a)”.


- I_s = Minimum operation current level.
- a = Operation reference angle (phase x; x = A, B, C).
- I_x = Measured input current (largest among the three phase currents I_A, I_B, I_C).
- φ_x = Phase displacement of current “I_x” from phase-to-neutral “E_x” (X = A, B, C).
- I_{dx} = Component of “I_x” on the direction “a”.

A) Set f(a) = Disab.

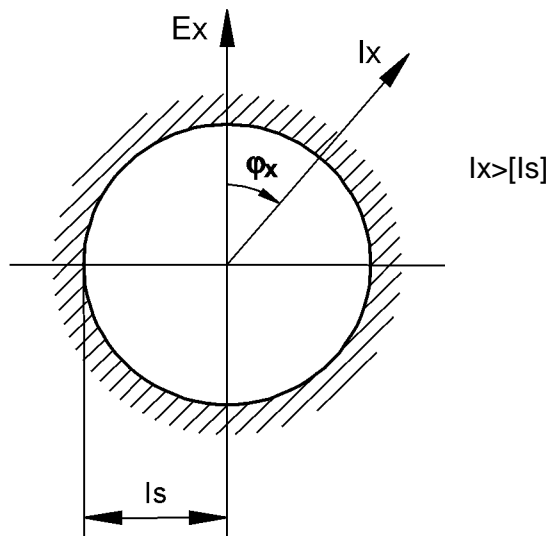

The overcurrent element operates independently from the current direction.

B) Set f(a) = Sup.

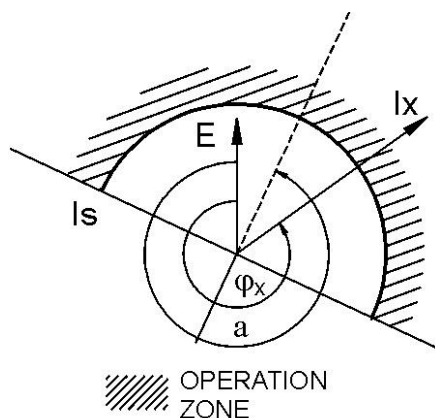

The Overcurrent element only supervises the direction of the current:


the operation conditions are:

- Input voltage above 1-2% of the rated input value.
- Input current above the set level: I_x > [I_s]
- Phase displacement “φ_x” within ±90° from the reference direction “a”.

$$(a - 90^\circ) < \varphi_x < (a + 90^\circ)$$



C) Set $f(a) = \text{Dir.}$

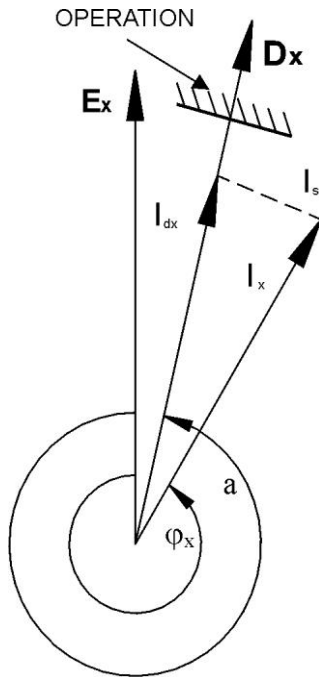

The overcurrent element operates in a real directional mode measuring the component " I_{dx} " of the input current in the reference direction " a " ($x = A, B, C$).

$$I_{dA} = I_A \cos(\phi_A - a) \quad I_{dB} = I_B \cos(\phi_B - a) \quad I_{dC} = I_C \cos(\phi_C - a)$$


The overcurrent starts to operate when the component " I_{dx} " of the input current in the direction " D_x " (versor displaced of " a " from the phase-to-neutral voltage " E_x ") exceeds the set level " I_s ".

$$I_{dx} = I_x \cos(\phi_x - a) \geq I_s$$

In details:

- When $\phi_x = a$: $I_{dx} = I_x \rightarrow$ operation if $I_x > I_s$
- When $(\phi_x - a) = 90^\circ$: $I_{dx} = 0 \rightarrow$ no operation
- When $(\phi_x - a) > 90^\circ$: I_{dx} opposite to $D_x \rightarrow$ no operation

The operation is practically independent from the voltage as low as 1-2% of rated value.

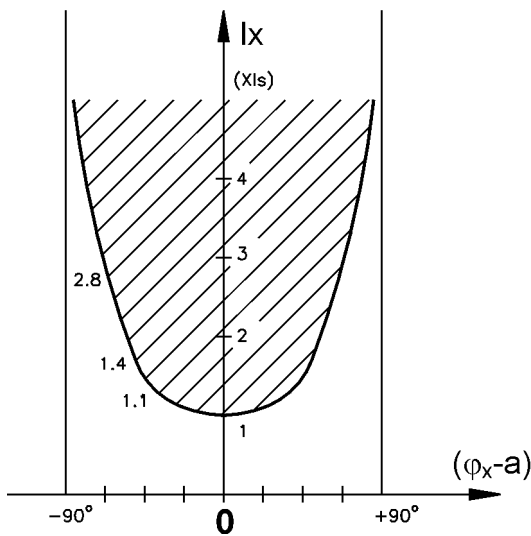


Recommended Reference angles for different applications:

- Measurement of resistive component of current (active power) :
Direct : $a = 0^\circ$ - Reverse : $a = 180^\circ$
- Directional phase fault detection:
Direct : $a = 300^\circ$ (60° lag) - Reverse : $a = 120^\circ$
- Measurement of inductive reactive component:
Direct : $a = 270^\circ$ (90° lag) - Reverse : $a = 90^\circ$
- Measurement of capacitive reactive component:
Direct : $a = 90^\circ$ (90° lead) - Reverse : $a = 270^\circ$



16.5.6 – Operation of the Overcurrent Element with Voltage Control f(U)

When the “Voltage Restraint” function is enabled (F(U)=Enable), the set minimum pick-up level “Is” of the overcurrent elements, changes proportionally to the smallest of the input phase-to-phase voltages: $I_s = F(U)$.

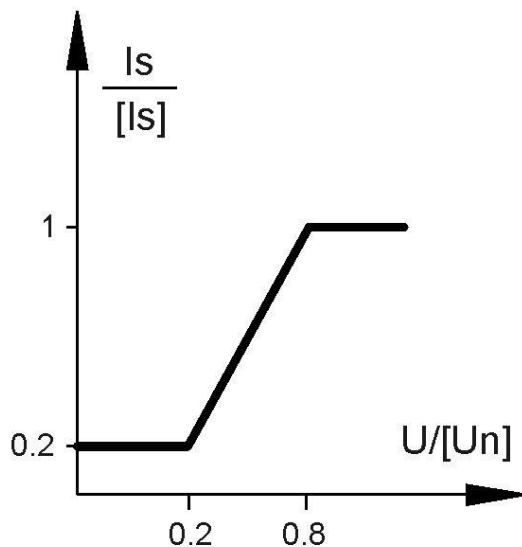

$$\frac{I_s}{[I_s]} = \frac{\text{Actual pick - up level}}{[\text{Set pick - up level}]}$$

$$\frac{U}{[U_{ns}]} = \frac{\text{Actual input voltage}}{[\text{Set rated input voltage}]}$$

the algorithm uses the smallest among the ratios $\frac{E_x \cdot \sqrt{3}}{[U_{ns}]} (x = A, B, C)$

Practically, between 0.2 U_{ns} and 0.8 U_{ns} , the trip level of the Overcurrent element varies according to the equation:

$$\frac{I_s}{[I_s]} = \frac{0.8}{0.6} \cdot \left(\frac{U}{[U_{ns}]} - 0.8 \right) + 1$$

Below 0.2 $[U_n]$ $\frac{I_s}{[I_s]} = 0.2$

Above 0.8 $[U_n]$ $\frac{I_s}{[I_s]} = 1$



16.5.7 – Blocking Logic (BO-BI)

For each Protection Function it is possible to activate a Blocking Logic allowing for inhibiting their operation by external signals supplied to the Digital Input.

16.5.7.1 – Output Blocking signal “BO”

All the protection functions that can be programmed to operate in the blocking logic mode, element, have an instantaneous element (beside the time delayed) which is operated as soon as the controlled quantity exceeds the set trip level ($I > [I_s]$ for current, etc..) and is instantaneously reset when the input quantity drops below the reset level (normally $0.95I_s$).

The instantaneous element can control one of the user programmable output relays that, by its contacts, makes the signal available for blocking an external element (BO = Blocking Output). In case, “tBO” sec after the set trip time “ts” has expired, the Protection function is still in operation (current above trip level), the Blocking Output relay (instantaneous element) is anyhow reset to eventually remove the Blocking signal from a back-up protection.

16.5.7.2 – Blocking Input “BI”

For all the functions controllable by the Blocking Logic, it is possible to inhibit the time delayed tripping by an external signal that activates a Digital Input programmed for this functionality. The programmed Digital Input gets activated by an external cold contact closing across its terminals.

With the variable “tBI” set to “OFF” (tBI=OFF), the tripping of the delayed function is blocked as long as the Blocking Input signal is present at the terminals of the Digital Input.

With the variable “tBI” set to “2xtBI” (tBI=2xtBI), 2xtBI seconds after the set trip time delay of the function has expired the blocking input is anyhow ignored and the function enabled to trip.

16.5.8 - Automatic doubling of Overcurrent thresholds on current inrush

For some of the phase Overcurrent functions it is possible to have the set trip level $[I_s]$ automatically doubled when strong inrush current is detected.

If at circuit Breaker switch-on (i.e. when the input current rises from zero to a minimum measurable value) the current increases from 0 to 1.5 times the rated value $[I_n]$ in less than 60ms, the set minimum pick-up level $[I_s]$ is dynamically doubled ($[I_s] \rightarrow [2I_s]$) and keeps this value until the input current drops below $1.25 \times I_n$ or the set time $[t_{2xI}]$ has elapsed.

This functionality is very useful to avoid spurious tripping of the instantaneous, or short-time delayed Overcurrent elements, that could be experienced at switch-on of reactive loads like Transformer or Capacitors.


16.6 - Function: 2I> (Second Overcurrent Element F50/51)

Status	→ Enab.	No	[No / Yes]
Options	→ f(t)	Type - D	[D / I / VI / EI / MI / SI / A / B / C]
	→ tBI	Disable	[Disable / 2tBO] (1)
	→ f(a)	Disable	[Disable / Sup / Dir]
	→ f(U)	Disable	[Disable / Enable]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Is	4.000	In (0.100÷4) step 0.010 In
	→ a	359.000	Dg (0.000÷359) step 1.000 Dg
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s
	→ tBO	0.75	s (0.05÷0.75) step 0.01 s (1)

16.6.1 - Description of variables

- **Enab.** : Function enabling (No = Disable / Yes = Enable)
- **f(t)** : Operation characteristic (Time/Current curve): (see § 16.5.2)
 - (D) = Independent definite time
 - (I) = IEEE Inverse Curve
 - (VI) = IEEE Very Inverse Curve
 - (EI) = IEEE Extremely Inverse Curve
 - (MI) = IEEE Moderate Inverse Curve
 - (SI) = IEEE Short Inverse Curve
 - (A) = IEC Inverse Curve type A
 - (B) = IEC Very Inverse Curve type B
 - (C) = IEC Extremely Inverse Curve type C
- **tBI** : Blocking input reset time (see § 16.5.7)
 - Disable = Permanent block
 - 2tBO = Set 2xtBO.
- **f(a)** : Operation mode: (see § 16.5.5)
 - Disable = Non Directional
 - Sup. = Directional Supervision
 - Dir. = Total Directional
- **f(U)** : Voltage restraint (see § 16.5.6)
- **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- **Is** : Minimum operation level
- **a** : Reference phase current displacement angle for Directional operation
- **ts** : Trip time delay
- **tBO** : Time to reset of the Blocking Output after expiring of the Trip time delay. "tBO" is also the trip time delay of the Breaker Failure function. (see § 16.5.7)


16.7 - Function: 3I> (Third Overcurrent Element F50/51)

Status	→ Enab.	No	[No / Yes]
Options	→ tBI	Disable	[Disable / 2tBO]
	→ f(a)	Disable	[Disable / Sup / Dir]
	→ 2xl	Disable	[Disable / Enable]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Is	40.000	In (0.100÷40) step 0.010 In
	→ a	359.000	Dg (0.000÷359) step 1.000 Dg
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s
	→ tBO	0.75	s (0.05÷0.75) step 0.01 s
	→ t2xl	100.00	s (0.02÷100) step 0.01 s
	→ td2I	0.06	s fixed

16.7.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **tBI** : Blocking input reset time (see § 16.6.5)
Disable = Permanent block
2tBO = Set 2xtBO.
- ☐ **f(a)** : Operation mode: (see § 16.6.5)
Disable = Non Directional
Sup. = Directional Supervision
Dir. = Total Directional
- ☐ **2xl** : Automatic doubling of trip level on inrush (see § 16.6.8)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **Is** : Minimum operation level.
- ☐ **a** : Reference phase current displacement angle for Directional operation
- ☐ **ts** : Trip time delay
- ☐ **tBO** : Time to reset of the Blocking Output after expiring of the Trip time delay. "tBO" is also the trip time delay of the Breaker Failure function. (see § 16.6.7)
- ☐ **t2xl** : Maximum time of automatic threshold doubling on inrush (see § 16.6.8)
- ☐ **td2I** : Time for calculation of current rate of rise


16.8 - Function: 4I> (Fourth Overcurrent Element F50/51)

Status	→ Enab.	No	[No / Yes]			
Options	→ tBI	Disable	[Disable / 2tBO]			
	→ f(a)	Disable	[Disable / Sup / Dir]			
	→ 2xl	Disable	[Disable / Enable]			
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]			
Oper. Levels	→ Is	40.000	In	(0.100÷40)	step	0.010 In
	→ a	359.000	Dg	(0.000÷359)	step	1.000 Dg
Timers	→ ts	100.00	s	(0.02÷100)	step	0.01 s
	→ tBO	0.75	s	(0.05÷0.75)	step	0.01 s
	→ t2xl	100.00	s	(0.02÷100)	step	0.01 s
	→ td2I	0.06	s	fixed		

16.8.1 - Description of variables

- ❑ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ❑ **tBI** : Blocking input reset time (see § 16.5.5)
Disable = Permanent block
2tBO = Set 2xtBO.
- ❑ **f(a)** : Operation mode: (see § 16.5.5)
Disable = Non Directional
Sup. = Directional Supervision
Dir. = Total Directional
- ❑ **2xl** : Automatic doubling of trip level on inrush (see § 16.5.8)
- ❑ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ❑ **Is** : Minimum operation level.
- ❑ **a** : Reference phase current displacement angle for Directional operation
- ❑ **ts** : Trip time delay
- ❑ **tBO** : Time to reset of the Blocking Output after expiring of the Trip time delay. "tBO" is also the trip time delay of the Breaker Failure function. (see § 16.5.7)
- ❑ **t2xl** : Maximum time of automatic threshold doubling on inrush (see § 16.5.8)
- ❑ **td2I** : Time for calculation of current rate of rise


16.9 - Function: 5I> (Fifth Overcurrent Element F50/51)

Status	→ Enab.	No	[No / Yes]			
Options	→ tBI	Disable	[Disable / 2tBO]			
	→ f(a)	Disable	[Disable / Sup / Dir]			
	→ 2xl	Disable	[Disable / Enable]			
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]			
Oper. Levels	→ Is	40.000	In	(0.100÷40)	step	0.010 In
	→ a	359.000	Dg	(0.000÷359)	step	1.000 Dg
Timers	→ ts	100.00	s	(0.02÷100)	step	0.01 s
	→ tBO	0.75	s	(0.05÷0.75)	step	0.01 s
	→ t2xl	100.00	s	(0.02÷100)	step	0.01 s
	→ td2I	0.06	s	fixed		

16.9.1 - Description of variables

- ❑ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ❑ **tBI** : Blocking input reset time (see § 16.5.5)
Disable = Permanent block
2tBO = Set 2xtBO.
- ❑ **f(a)** : Operation mode: (see § 16.5.5)
Disable = Non Directional
Sup. = Directional Supervision
Dir. = Total Directional
- ❑ **2xl** : Automatic doubling of trip level on inrush (see § 16.5.8)
- ❑ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ❑ **Is** : Minimum operation level.
- ❑ **a** : Reference phase current displacement angle for Directional operation
- ❑ **ts** : Trip time delay
- ❑ **tBO** : Time to reset of the Blocking Output after expiring of the Trip time delay. "tBO" is also the trip time delay of the Breaker Failure function. (see § 16.5.7)
- ❑ **t2xl** : Maximum time of automatic threshold doubling on inrush (see § 16.5.8)
- ❑ **td2I** : Time for calculation of current rate of rise


16.10 - Function: 6I> (Sixth Overcurrent Element F50/51)

Status	→ Enab.	No	[No / Yes]			
Options	→ tBI	Disable	[Disable / 2tBO]			
	→ f(a)	Disable	[Disable / Sup / Dir]			
	→ 2xl	Disable	[Disable / Enable]			
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]			
Oper. Levels	→ Is	40.000	In	(0.100÷40)	step	0.010 In
	→ a	359.000	Dg	(0.000÷359)	step	1.000 Dg
Timers	→ ts	100.00	s	(0.02÷100)	step	0.01 s
	→ tBO	0.75	s	(0.05÷0.75)	step	0.01 s
	→ t2xl	100.00	s	(0.02÷100)	step	0.01 s
	→ td2I	0.06	s	fixed		

16.10.1 - Description of variables

- ❑ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ❑ **tBI** : Blocking input reset time (see § 16.5.5)
Disable = Permanent block
2tBO = Set 2xtBO.
- ❑ **f(a)** : Operation mode: (see § 16.5.5)
Disable = Non Directional
Sup. = Directional Supervision
Dir. = Total Directional
- ❑ **2xl** : Automatic doubling of trip level on inrush (see § 16.5.8)
- ❑ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ❑ **Is** : Minimum operation level.
- ❑ **a** : Reference phase current displacement angle for Directional operation
- ❑ **ts** : Trip time delay
- ❑ **tBO** : Time to reset of the Blocking Output after expiring of the Trip time delay. "tBO" is also the trip time delay of the Breaker Failure function. (see § 16.5.7)
- ❑ **t2xl** : Maximum time of automatic threshold doubling on inrush (see § 16.5.8)
- ❑ **td2I** : Time for calculation of current rate of rise


16.11 - Function: 1lo> (First Earth Fault Element 50N/51N)

Status	→ Enab.	No	[No / Yes]			
Options	→ f(t)	Tipo - D	[D / I / VI / EI / MI / SI / A / B / C]			
	→ tBI	Disable	[Disable / 2tBO]			
	→ f(a_o)	Disable	[Disable / Dir]			
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]			
Oper. Levels	→ Is	0.400	On	(0.01÷4.00)	step	0.01 On
	→ Vo	0.000	%Un	(0.000÷20)	step	0.100 %Un
	→ a_o	0.000	Dg	(0.000÷359)	step	1.000 Dg
	→ a_z	0.000	Dg	(0.000÷359)	step	1.000 Dg
Timers	→ ts	100.00	s	(0.02÷100)	step	0.01 s
	→ tBO	0.75	s	(0.05÷0.75)	step	0.01 s

16.11.1 - Description of variables


- ❑ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ❑ **f(t)** : Operation characteristic (Time/Current curve): (see § 16.5.2)
 - (D) = Independent definite time
 - (I) = IEEE Inverse Curve
 - (VI) = IEEE Very Inverse Curve
 - (EI) = IEEE Extremely Inverse Curve
 - (MI) = IEEE Moderate Inverse Curve
 - (SI) = IEEE Short Inverse Curve
 - (A) = IEC Inverse Curve type A
 - (B) = IEC Very Inverse Curve type B
 - (C) = IEC Extremely Inverse Curve type C
- ❑ **tBI** : Blocking Input reset time (see § 16.5.7)
 - Disable = Permanent block
 - 2tBO = Set 2xtBO.
- ❑ **f(a_o)** : Operation mode: (see § 16.12.2)
 - Disable = Non Directional
 - Dir. = Total Directional
- ❑ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ❑ **Is** : Minimum operation level
- ❑ **Vo** : Minimum residual voltage level for enabling the directional operation
- ❑ **a_o** : Reference Zero Sequence current displacement angle for Directional operation
- ❑ **a_z** : Trip sector amplitude
- ❑ **ts** : Trip time delay
- ❑ **tBO** : Time to reset of the Blocking Output after expiring of the Trip time delay. "tBO" is also the trip time delay of the Breaker Failure function. (see § 16.5.7)

16.11.2 – Operation mode of the Earth Fault elements programming the variable “f(a_o)”

The relay measures the current “3I_o” and the input voltage “3V_o” of the Earth Fault input and the displacement “φ_o” of the current from the voltage. Different operation modes are programmable by the variable “f(a_o)”.

- **I_s** = Set minimum pick-up residual current “3I_o”.
- **V_o** = Set minimum residual voltage (3V_o) to enable operation.
- **a_o** = Set displacement of the reference current direction.
- **3I_o** = Earth Fault current.
- **3V_o** = Earth Fault voltage.
- **φ_o** = I_o/V_o phase displacement.
- **a_z** = Angle defining the directional operation area around the reference direction.

The Directional Earth Fault element can operate in two different modes:

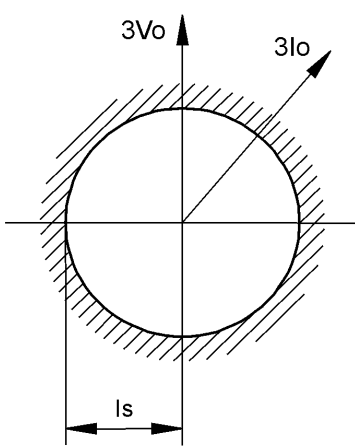

f(a_o) = Dis (Disable)


Operation is Non Directional without any influence by the Zero Sequence Voltage “V_o” and the displacement “φ_o”.

- Operation starts when : 3I_o ≥ [I_s]

f(a_o) = Dir (Directional).

Operation starts when the following 3 conditions are present:

- The Residual Voltage “3V_o” exceeds the set level “V_o” : 3V_o ≥ [V_o]
- The Residual Current “3I_o” exceeds the set level “I_s” : 3I_o ≥ [I_s]
- The angle “φ_o” is within “± a_z” from “a”
(a_o - a_z) ≤ φ_o ≤ (a_o + a_z)

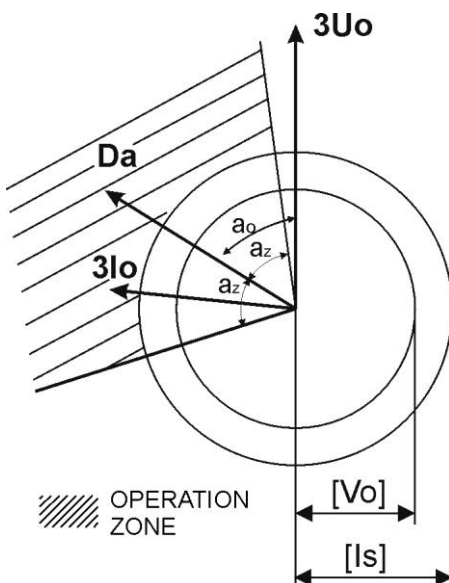

- 3U_o > [V_o]
- 3I_o > [I_s]
- (a_o - a_z) ≤ φ_o ≤ (a_o + a_z)


16.12 - Function: 2Io> (Second Earth Fault Element 50N/51N)

Status	→ Enab.	No	[No / Yes]
Options	→ f(t)	Tipo - D	[D / I / VI / EI / MI / SI / A / B / C]
	→ tBI	Disable	[Disable / 2tBO]
	→ f(a_o)	Disable	[Disable / Dir]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Is	0.400	On (0.01÷4.00) step 0.01 On
	→ Vo	0.000	%Un (0.000÷20) step 0.100 %Un
	→ a_o	0.000	Dg (0.000÷359) step 1.000 Dg
	→ a_z	0.000	Dg (0.000÷359) step 1.000 Dg
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s
	→ tBO	0.75	s (0.05÷0.75) step 0.01 s

16.12.1 - Description of variables

- ❑ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ❑ **f(t)** : Operation characteristic (Time/Current curve): (see § 16.5.2)
 - (D) = Independent definite time
 - (I) = IEEE Inverse Curve
 - (VI) = IEEE Very Inverse Curve
 - (EI) = IEEE Extremely Inverse Curve
 - (MI) = IEEE Moderate Inverse Curve
 - (SI) = IEEE Short Inverse Curve
 - (A) = IEC Inverse Curve type A
 - (B) = IEC Very Inverse Curve type B
 - (C) = IEC Extremely Inverse Curve type C
- ❑ **tBI** : Blocking Input reset time (see § 16.5.7)
 - Disable = Permanent block
 - 2tBO = Set 2xtBO.
- ❑ **f(a_o)** : Operation mode: (see § 16.12.2)
 - Disable = Non Directional
 - Dir. = Total Directional
- ❑ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ❑ **Is** : Minimum operation level
- ❑ **Vo** : Minimum residual voltage level for enabling the directional operation
- ❑ **a_o** : Reference Zero Sequence current displacement angle for Directional operation
- ❑ **a_z** : Trip sector amplitude
- ❑ **ts** : Trip time delay
- ❑ **tBO** : Time to reset of the Blocking Output after expiring of the Trip time delay. "tBO" is also the trip time delay of the Breaker Failure function. (see § 16.5.7)


16.13 - Function: 3lo> (Third Earth Fault Element 50N/51N)

Status	→ Enab.	No	[No / Yes]
Options	→ tBI	Disable	[Disable / 2tBO]
	→ f(a_o)	Disable	[Disable / Dir]
Oper. Levels	→ Is	0.400	On (0.01÷9.99) step 0.01 On
	→ Vo	0.000	%Un (0.000÷20) step 0.100 %Un
	→ a_o	0.000	Dg (0.000÷359) step 1.000 Dg
	→ a_z	0.000	Dg (0.000÷359) step 1.000 Dg
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s
	→ tBO	0.75	s (0.05÷0.75) step 0.01 s

16.13.1 - Description of variables

- ❑ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ❑ **tBI** : Blocking Input reset time (see § 16.5.7)
Disable = Permanent block
2tBO = Set 2xtBO.
- ❑ **f(a_o)** : Operation mode: (see § 16.12.2)
Disable = Non Directional
Dir. = Total Directional
- ❑ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ❑ **Is** : Minimum operation level
- ❑ **Vo** : Minimum residual voltage level for enabling the directional operation
- ❑ **a_o** : Reference Zero Sequence current displacement angle for Directional operation
- ❑ **a_z** : Trip sector amplitude
- ❑ **ts** : Trip time delay
- ❑ **tBO** : Time to reset of the Blocking Output after expiring of the Trip time delay. "tBO" is also the trip time delay of the Breaker Failure function. (see § 16.5.7)


16.14 - Function: 4lo> (Fourth Earth Fault Element 50N/51N)

Status	→ Enab.	No	[No / Yes]
Options	→ tBI	Disable	[Disable / 2tBO]
	→ f(a_o)	Disable	[Disable / Dir]
Oper. Levels	→ Is	0.400	On (0.01÷9.99) step 0.01 On
	→ Vo	0.000	%Un (0.000÷20) step 0.100 %Un
	→ a_o	0.000	Dg (0.000÷359) step 1.000 Dg
	→ a_z	0.000	Dg (0.000÷359) step 1.000 Dg
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s
	→ tBO	0.75	s (0.05÷0.75) step 0.01 s

16.14.1 - Description of variables

- ❑ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ❑ **tBI** : Blocking Input reset time (see § 16.5.7)
Disable = Permanent block
2tBO = Set 2xtBO.
- ❑ **f(a_o)** : Operation mode: (see § 16.12.2)
Disable = Non Directional
Dir. = Total Directional
- ❑ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ❑ **Is** : Minimum operation level
- ❑ **Vo** : Minimum residual voltage level for enabling the directional operation
- ❑ **a_o** : Reference Zero Sequence current displacement angle for Directional operation
- ❑ **a_z** : Trip sector amplitude
- ❑ **ts** : Trip time delay
- ❑ **tBO** : Time to reset of the Blocking Output after expiring of the Trip time delay. "tBO" is also the trip time delay of the Breaker Failure function. (see § 16.5.7)


16.15 - Function: 1Is> (First Negative Sequence Element F46)

Status	→ Enab.	No	[No / Yes]
Options	→ t(t)	Type-D	[D / I / VI / EI / MI / SI / A / B / C]
	→ tBI	Disable	[Disable / 2tBO]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Is	4.000	In (0.1÷4) step 0.01 In
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s
	→ tBO	0.75	s (0.05÷0.75) step 0.01 s

16.15.1 - Description of variables

- ❑ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ❑ **f(t)** : Operation characteristic (Time/Current curve): (see § 16.15.2)
 - (D) = Independent definite time
 - (I) = IEEE Inverse Curve
 - (VI) = IEEE Very Inverse Curve
 - (EI) = IEEE Extremely Inverse Curve
 - (MI) = IEEE Moderate Inverse Curve
 - (SI) = IEEE Short Inverse Curve
 - (A) = IEC Inverse Curve type A
 - (B) = IEC Very Inverse Curve type B
 - (C) = IEC Extremely Inverse Curve type C
- ❑ **tBI** : Blocking Input reset time (see § 16.5.7)
 - Disable = Permanent block
 - 2tBO = Set 2xtBO.
- ❑ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ❑ **Is** : Minimum operation level
- ❑ **ts** : Trip time delay
- ❑ **tBO** : Time to reset of the Blocking Output after expiring of the Trip time delay. “tBO” is also the trip time delay of the Breaker Failure function. (see § 16.5.7)

16.15.2 – Time/Current operation of the first Current Unbalance element “f(t)”

the relay measures the Negative Sequence component “I₂” of the input current.
The Time/Current curves can be selected by programming the variable “f(t)”:

- ❑ f(t) = D Independent definite time operation. (see § 16.5.2)
- ❑ f(t) = I, VI, EI, MI, SI, A, B, C Dependent Inverse time operation (see § 16.5.2)


16.16 - Function: 2Is> (Second Negative Sequence Element F46)

Status	→ Enab.	No	[No / Si]
Options	→ tBI	Disable	[Disable / 2tBO]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Is	4.000	In (0.1÷4) step 0.01 In
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s
	→ tBO	0.75	s (0.05÷0.75) step 0.01 s

16.16.1 - Description of variables

- **Enab.** : Function enabling (No = Disable / Yes = Enable)
- **tBI** : Blocking Input reset time
 Disable = Permanent block
 2tBO = Set 2tBO.
- **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- **Is** : Minimum operation level
- **ts** : Trip time delay
- **tBO** : Time to reset of the Blocking Output after expiring of the Trip time delay. “tBO” is also the trip time delay of the Breaker Failure function. (see § 16.5.7)


16.17 - Function: 1U> (First OverVoltage Element F59)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Us	90.000	%Un (10÷190) step 1 %Un
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s

16.17.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **Us** : Minimum operation level
- ☐ **ts** : Trip time delay

16.18 - Function: 2U> (Second OverVoltage Element F59)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Us	90.000	%Un (10÷190) step 1 %Un
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s

16.18.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **Us** : Minimum operation level
- ☐ **ts** : Trip time delay


16.19 - Function: 3U> (Third OverVoltage Element F59)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Us	90.000	%Un (10÷190) step 1 %Un
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s

16.19.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **Us** : Minimum operation level
- ☐ **ts** : Trip time delay


16.20 - Function: 1U< (First UnderVoltage Element F27)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Us	90.000	%Un (10÷190) step 1 %
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s

16.20.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **Us** : Minimum operation level
- ☐ **ts** : Trip time delay

16.21 - Function: 2U< (Second UnderVoltage Element F27)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Us	90.000	% (10÷190) step 1 %
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s

16.21.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **Us** : Minimum operation level
- ☐ **ts** : Trip time delay


16.22 - Function: 3U< (Third UnderVoltage Element F27)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Us	90.000	% (10÷190) step 1 %
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s

16.22.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **Us** : Minimum operation level
- ☐ **ts** : Trip time delay


16.23 - Function: 1f> (First OverFrequency Element F81>)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ fs	40.000	Hz (40÷70) step 0.01 Hz
Timers	→ ts	100.00	s (0.02÷1000) step 0.01 s

16.23.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **fs** : Minimum operation level
- ☐ **ts** : Trip time delay

16.24 - Function: 2f> (Second OverFrequency Element F81>)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ fs	40.000	Hz (40÷70) step 0.01 Hz
Timers	→ ts	1000.00	s (0.02÷1000) step 0.01 s

16.24.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **fs** : Minimum operation level
- ☐ **ts** : Trip time delay

**16.25 - Function: 3f> (Third OverFrequency Element F81>)**

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ fs	40.000	Hz (40÷70) step 0.01 Hz
Timers	→ ts	100.00	s (0.02÷1000) step 0.01 s

16.25.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **fs** : Minimum operation level
- ☐ **ts** : Trip time delay

16.26 - Function: 4f> (Fourth OverFrequency Element F81>)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ fs	40.000	Hz (40÷70) step 0.01 Hz
Timers	→ ts	1000.00	s (0.02÷1000) step 0.01 s

16.26.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **fs** : Minimum operation level
- ☐ **ts** : Trip time delay


16.27 – Function: 1f< (First UnderFrequency Element F81<)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ fs	40.000	Hz (40÷70) step 0.01 Hz
Timers	→ ts	100.00	s (0.02÷1000) step 0.01 s

16.27.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **fs** : Minimum operation level
- ☐ **ts** : Trip time delay

16.28 - Function: 2f< (Second UnderFrequency Element F81<)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ fs	40.000	Hz (40÷70) step 0.01 Hz
Timers	→ ts	100.00	s (0.02÷1000) step 0.01 s

16.28.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **fs** : Minimum operation level
- ☐ **ts** : Trip time delay

**16.29 – Function: 3f< (Third UnderFrequency Element F81<)**

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ fs	40.000	Hz (40÷70) step 0.01 Hz
Timers	→ ts	100.00	s (0.02÷1000) step 0.01 s

16.29.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **fs** : Minimum operation level
- ☐ **ts** : Trip time delay

16.30 - Function: 4f< (Fourth UnderFrequency Element F81<)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ fs	40.000	Hz (40÷70) step 0.01 Hz
Timers	→ ts	100.00	s (0.02÷1000) step 0.01 s

16.30.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **fs** : Minimum operation level
- ☐ **ts** : Trip time delay

**16.31 - Function: 1Uo> (First Zero Sequence Overvoltage Element F59Uo)**

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Us	1.000	%Un (1÷100) step 1 %Un
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s

16.31.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **Us** : Minimum operation level
- ☐ **ts** : Trip time delay

16.32 - Function: 2Uo> (Second Zero Sequence Overvoltage Element F59Uo)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Us	1.000	%Un (1÷100) step 1 %Un
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s

16.32.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **Us** : Minimum operation level
- ☐ **ts** : Trip time delay


16.33 - Function: I2H (Inrush Detection – 2nd Harm./Fund.)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ I2H	30.00	% (10÷100) step 1 %
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s

16.33.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **I2H** : Minimum operation level
- ☐ **ts** : Trip time delay

16.34 - Function: I2/I1 (Broken Conductor Detection – I2/I1)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ I2/I1	20.00	% (5÷60) step 1 %
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s

16.34.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **I2/I1** : Minimum operation level
- ☐ **ts** : Trip time delay


16.35 - Function: *Wi* (Circuit Breaker maintenance level)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ li	1.000	In (0.1÷99) step 0.1 In
	→ Wi	1.000	(1÷9999) step 1

16.35.1 - Description of variables

- **Enab.** : Function enabling (No = Disable / Yes = Enable)
- **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- **li** : Circuit Breaker Rated Current in multiples of the Relay rated input current In
- **Wi** : Maximum allowed amount of accumulated interruption energy before maintenance as stated by the C/B Manufactured.

16.35.2 - Operation (Accumulation of the interruption Energy)

The relay computes the Arc Energy developed during each interruption of the Circuit Breaker and accumulates these values.

When the amount of the accumulated energy exceeds a settable level the relay gives out an alarm to signalize that maintenance inspection of the Circuit Breaker is needed.

The operation of this function is based on the following parameters:

$$li = li = (0.1-99)In$$

$$Wi = Wi = (1 - 9999)$$

“Wi is set as a multiple of the conventional interruption energy unit.

Any time the Circuit Breaker opens (change of status from closed to open of the digital input connected to the normally open contact 52a of the C/B) the relay decreases the amount of energy corresponding to a number of conventional units:

$$nW_c = \frac{W}{W_c} = \frac{I^2 \cdot t_x}{li^2 \cdot t_i}$$

where:

W = $I^2 \cdot t_x$ Interruption Energy during the interruption time “tx” with interruption current “I”.

Wc = $li^2 \cdot t_i$ Conventional unit of interruption energy corresponding to C/B rated current and rated interruption time “ti”.

When the set Energy level before maintenance is decreased to zero a user programmable output relay is operated.

Reset to Zero of the Energy accumulation is available in the menu “**Local Cmd**” (Reset Term).



16.36 - Function: **TCS** (Trip Circuit Supervision)

Status	→ Enab.	No	[No / Yes]
Timers	→ ts	0.10	s (0.1÷100) step 0.01 s

16.36.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **ts** : Trip time delay

16.36.2 - Operation

The relay includes a complete Circuit Breaker Trip Circuit Supervision unit that is associated to the Contact "15-26" of the "R1" Output Relay.

The contact of "R1" is used to trip the C/B as reported in the drawing here below.

The supervision works when the C/B is closed and recognizes the Trip Circuit as sound as far as the current flowing exceeds "1mA".


In case of Trip Circuit Fault detection, the diagnostic relay is operated and the yellow Led "START INHIBIT" starts flashing.

To have Supervision also with the C/B open one N/C contact (52b) from the C/B and an external resistor "R" are needed.

$$R[k\Omega] \leq \frac{V}{1mA} - R_{52} \quad \text{where} \quad R_{52} = \text{Trip Coil internal resistance [k}\Omega\text{]}$$

V = Trip Circuit Voltage

$$P_R \geq 2 \cdot \frac{V^2}{R} [W] \quad \text{Design power of external resistance "R"}$$

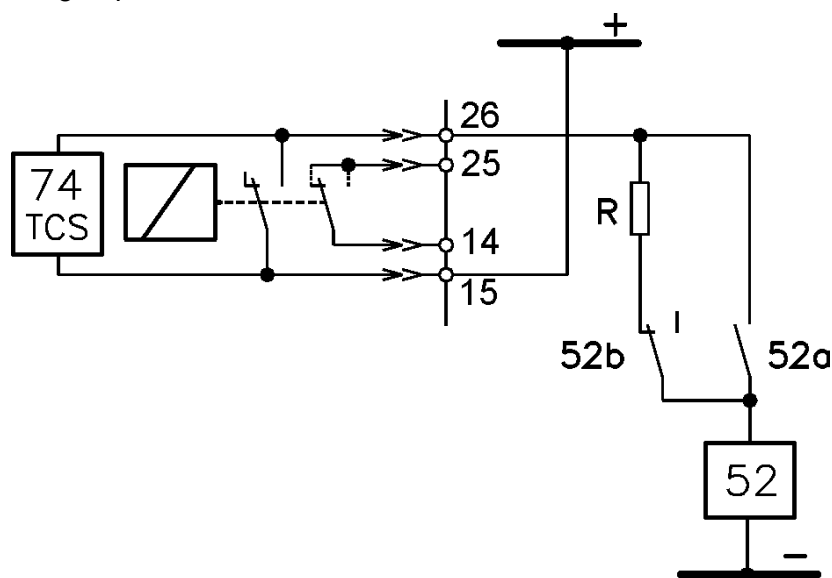

Tripping of the function operates a user programmable output relay.



16.37 - Function: **IRF** (Internal Relay Fault)

In this menu it is possible to configure the operation of the Relay Internal Fault detection element

THIS DOCUMENT IS THE PROPERTY OF MICROELETRONICA SCIENTIFICA. IT IS LOANED TO YOU AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM. WITHOUT PERMISSION IN WRITING FROM MICROELETRONICA SCIENTIFICA.

Status	→ Enab.	No	[No / Yes]
Timers	→ tIRF	5.00 s	(5÷200) step 0.01 s

THIS DOCUMENT IS THE PROPERTY OF MICROELETRONICA SCIENTIFICA. IT IS LOANED TO YOU AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM. WITHOUT PERMISSION IN WRITING FROM MICROELETRONICA SCIENTIFICA.

16.37.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **tIRF** : Trip time delay

THIS DOCUMENT IS THE PROPERTY OF MICROELETRONICA SCIENTIFICA. IT IS LOANED TO YOU AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM. WITHOUT PERMISSION IN WRITING FROM MICROELETRONICA SCIENTIFICA.

16.37.2 - Operation

Tripping of the function operates a user programmable output relay.

16.38 - Function: **BreakerFail** (Breaker Failure)

Status	→ Enab.	No	[No / Yes]
Timers	→ tBF	0.75 s	(0.05÷0.75) step 0.01 s

THIS DOCUMENT IS THE PROPERTY OF MICROELETRONICA SCIENTIFICA. IT IS LOANED TO YOU AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM. WITHOUT PERMISSION IN WRITING FROM MICROELETRONICA SCIENTIFICA.

16.38.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **tBF** : Trip time delay

THIS DOCUMENT IS THE PROPERTY OF MICROELETRONICA SCIENTIFICA. IT IS LOANED TO YOU AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM. WITHOUT PERMISSION IN WRITING FROM MICROELETRONICA SCIENTIFICA.

16.38.2 - Operation

The Breaker Failure detection is started by the operation of the output relay “R1” (programmed to be controlled by the Protection Functions that trip the C/B).
If after [tBF] seconds from operation of the relay “R1”, any input current flow is still detected, the function “BF” trips and operate one user programmable output relay,


16.39 - Function: *Oscillo* (Oscillographic Recording)

Status	→ Enab.	No	[No / Yes]
Options	→ Trig	Disable	[Disable / Start / Trip / ExtInp]
Timers	→ tPre	0.50	s (0.01÷0.50) step 0.01 s
	→ tPost	0.50	s (0.01÷1.50) step 0.01 s

16.39.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **Trig** : Selection of the Trigger command source (start recording):
 - Disable* = Function Disable (no recording)
 - Start* = Trigger on time start of protection functions
 - Trip* = Trigger on trip (time delay end) of protection functions
 - ExtInp* = External Trigger from Digital Input
- ☐ **tPre** : Recording time before Trigger
- ☐ **tPost** : Recording time after Trigger

16.39.2 - Operation

In the options: “Trig = Start” and “Trig = Trip”, the oscillographic recording starts respectively when any protection function starts operating or trip (provided the function was programmed “TrigEnab”).

1l>	1lo>	1U>	1f>	1f<	1Uo>
2l>	2lo>	2U>	2f>	2f<	2Uo>
3l>	3lo>	3U>	3f>	3f<	I2H
4l>	4lo>	1U<	4f>	2f<	I2/I1
5l>	1ls>	2U<			
6l>	2ls>	3U<			

In the option “ExtInp”, the oscillographic record starts when the Digital Input is activated (terminals shorted)

The “Osc” Function includes the wave Form Capture of the input quantities (IA, IB, IC, Io, EA, EB, EC, Eo) and can totally store a record of 3 seconds.

The number of events recorded depends on the duration of each individual recording (tPre + tPost).

In any case the number of event stored can not exceed ten (10 x 0.3 sec).

Any new event beyond the 3 sec capacity of the memory, cancels and overwrites the former records (FIFO Memory).





16.40 – Function: **C/B Command** (Close/Open Breaker Command)

This menu allows to configure the command for C/B operation.

Status	→ Enab.	No	[No / Yes]
Options	→ Key	Enable	[Enable / Disable]

16.40.1 – Description of variables

- ☐ **Enab.** : Enabling Breaker operation by “FMR”.
(No = Disable / Yes = Enable)
- ☐ **Key** : Enable = The C/B can be controlled by the pushbuttons available on Relay's Front Face as well as by commands sent via the serial communication bus.

Disable = The pushbuttons on Front Panel are disabled; the operation of the C/B can be controlled either by the serial bus commands or by the (password protected) commands available in the menu “**Local Cmd**”.

17. INPUT – OUTPUT

The firmware can manage up to 24 digital inputs and 14 output relays; among these, 4 digital inputs and 6 output relays are available on the relay module, the remaining are available on additional expansion modules controlled via the CAN-Bus communication channel.

Any expansion module includes 10 digital inputs and 4 output relays.

1 or 2 additional modules can be controlled.

17.1 – Operation

Each Protection Element operates by means of “Inputs” and “Outputs”:


- ❑ Analogue Inputs : The measured input quantities
- ❑ Functional Inputs : The blocking input
- ❑ Physical Inputs : The Digital Inputs
- ❑ Functional Outputs : The functional elements
- ❑ Physical Outputs : The Output Relays

Any Physical Input can be assigned to the Functional Inputs of one or more elements: in the example the Digital Input “Di1” controls the Functional Inputs of both the elements “1I>” and “1O>”.

Similarly any Physical Output can be controlled by the Functional Outputs of one or more of the FMR elements (see list of elements at §17.3): in the example “R2” is controlled by both “1I>” and “1O>”.

In case more than one Functional Output are programmed to control the same output relay, the setting menu requires to select between two different logic operation modes: “OR” or “AND”:

- ❑ “OR” : Means that the relay is operated if at least one of the associated Functional Outputs is activated.
- ❑ “AND” : Means that the relay is operated only if all the associated Functional Output are activated.

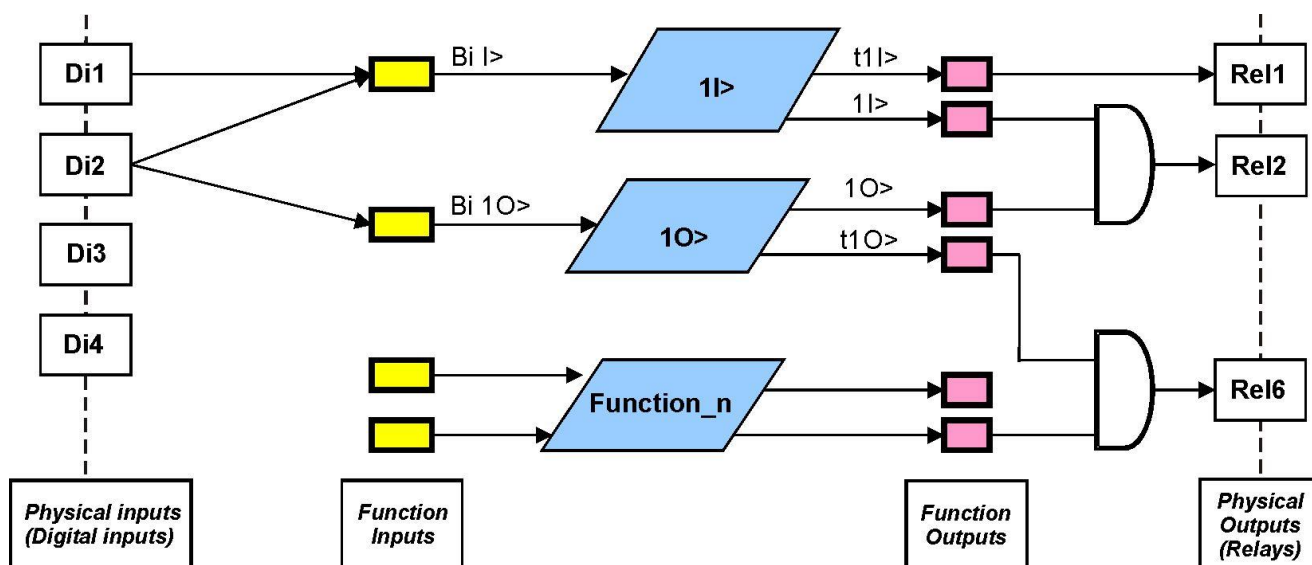

The interfacing software “MSCom II” also allows to program the operation of the output relays (Physical Output), the available operation are:

Output Configuration: “N.D.” or “N.E.”:


- **“N.D.”** : *Normally Deenergized* The output relay is deenergized in normal conditions and gets energized on activation of the controlling Functional Output; reset means deenergizing.
- **“N.E.”** : *Normally Energized* The output relay is energized in normal conditions and gets deenergized on activation of the controlling Functional Output; reset means energizing.

Operation Time: R_Timer:

This timer controls the duration of the activation of the output relay.

Operation Mode: Automatic / Manual / Impulse (see figure):

- **Automatic** : In this mode the output relay is “operated” (energized if “N.D.”, deenergized if “N.E.”) when the controlling Functional Output is activated and it is reset to the “non operated” condition when the Functional Output gets deactivated but, anyhow, not before the time “R_Timer” has elapsed (minimum duration of the operation time)
- **Manual** : In this mode the output relay is “operated” when the controlling Functional Output is activated and remains in the operated condition until a manual reset command is issued by the FMR keyboard (local commands menu) or via the serial communication. In this mode the timer “R_Timer” has no effect.
- **Impulsive** : In this mode the output relay is “operated” when the controlling Functional Output is activated and it remains in the “operated” condition (energized if “N.D.”, deenergized if “N.E.”) for the set time “R_Timer” independently from the status of the controlling Functional Output.

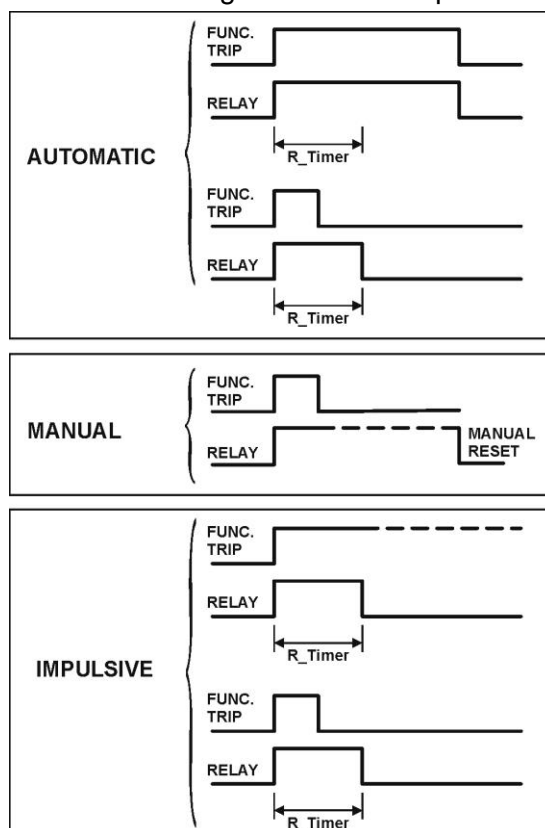







17.2 – Physical Input

Input	→ Di1	OFF(1)	+(2)	Available in the FMR relay
	→ Di2	OFF(1)	+(2)	
	→ Di3	OFF(1)	+(2)	
	→ Di4	OFF(1)	+(2)	
	→ Di5	OFF(1)	+(2)	Available in the first additional expansion module
	→ Di--	OFF(1)	+(2)	
	→ Di14	OFF(1)	+(2)	
	→ Di15	OFF(1)	+(2)	Available in the second additional expansion module
	→ Di--	OFF(1)	+(2)	
	→ Di24	OFF(1)	+(2)	

(1) “ON”, “OFF” : Actual status of the Input.

(2)  ,  :  Indicates that this Input is not yet associated to any function.
 Indicates that this Input is already associated to one or more functions.

Four Digital Input are available on FMR relay:

<input type="checkbox"/>	Di1	(terminals 38 – 28)	: Programmable
<input type="checkbox"/>	Di2	(terminals 38 – 18)	: Programmable
<input type="checkbox"/>	Di3	(terminals 38 – 29)	: Programmable
<input type="checkbox"/>	Di4	(terminals 38 – 19)	: Programmable (PTC)

Three of them (Di1, Di2, Di3) are deactivated, when the relevant terminals are open and get activated when the relevant terminals are shorted by an external cold contact.

The operation of the Input “Di4” is dependent on the value “R” of resistance of the external circuit connected to its terminals (38-19):

- Activated if “ $R < 50\Omega$ ” or “ $R > 3000\Omega$ ”. – Deactivated if “ $50\Omega \leq R \leq 3000\Omega$ ”.

Therefore, if the terminals “38-19” are open-circuited, the input “Di4” is activated; for using “Di4” as A normal Digital Input simply controlled by an external cold contact, it is necessary to permanently connect across the terminal’s “38-19” (in parallel to the external contact) a load resistor of value between 50 and 3000 Ω (example 1000 Ω - 0.5W).

The additional inputs “Di5....Di14” are available when the first expansion module is present.

The additional inputs “Di15..... Di24” are available when the second expansion module is present.

Any digital input of the expansion modules is active when the relevant terminals (see wiring diagram) are shorted.




Any of the Digital Inputs can be programmed to control one or more of the following functions.


Bi1l>	Blocking input to the	1l>
Bi2l>	Blocking input to the	2l>
Bi3l>	Blocking input to the	3l>
Bi4l>	Blocking input to the	4l>
Bi5l>	Blocking input to the	5l>
Bi6l>	Blocking input to the	6l>
Bi1lo>	Blocking input to the	1lo>
Bi2lo>	Blocking input to the	2lo>
Bi3lo>	Blocking input to the	2lo>
Bi4lo>	Blocking input to the	4lo>
Bi1ls>	Blocking input to the	1ls>
Bi2ls>	Blocking input to the	2ls>
Bi1U>	Blocking input to the	1U>
Bi2U>	Blocking input to the	2U>
Bi3U>	Blocking input to the	3U>
Bi1U<	Blocking input to the	1U<
Bi2U<	Blocking input to the	2U<
Bi3U<	Blocking input to the	3U<
B1Uo>	Blocking input to the	1Uo>
B2Uo>	Blocking input to the	2Uo>
Bi2H	Blocking input to the	I2H
Bi2/I1	Blocking input to the	I2/I1
C/B	Indication of the Open/Close status of the C/B	
ExtTrgOsc	External Trigger of the Oscillographic Recording.	
Bank 1-2	Selection of the setting Bank 1 – 2.	


Moreover, any Digital Input can be programmed to control one or more output relays in “AND” or “OR” logic (see §17.3)





17.2.1 – Example


- 

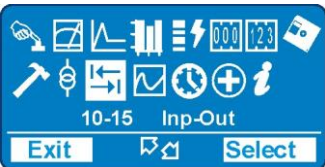
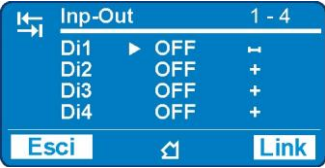
 - Press **Menu** for access to the main menu with icons.
- 

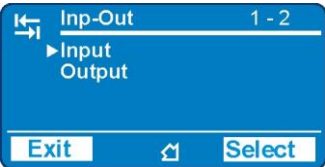
 - Select icon **Inp-Out** by pushbuttons **Increase** or **Decrease**.
 - Press **Select**.
- 

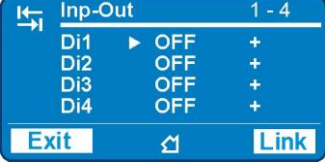 - Select **Input**.
 - Press **Select**.
- 

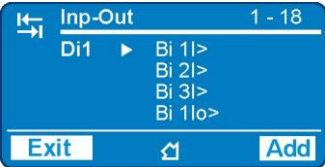 - Select **Di1**.
 - Press **Link** for access to input **1**.
 - Di1** corresponding to physical digital input **Di1**.
 - Di2** corresponding to physical digital input **Di2**.
 - Di3** corresponding to physical digital input **Di3**.
 - Di4** corresponding to physical digital input **Di4**.
 - Di—** corresponding to physical digital input **Di—**. (additional modules)
- 

 - Press **Add** to select and associate the function.
(Digital Input 1 terminals 38-28).
- 

 - When one or more Blocking Input is associated this symbol shows 
 - To remove selection one function:
Select function by pushbuttons **Increase** or **Decrease** and press **Remove**
 - Press **Exit**.
- 

 - Press **Exit** to go back to the previous menu.
- 

 - The display show **Confirm the change?**.
 - Choose **Yes** to convalidate the changes.
 - Choose **No** to not confirm the changes.






17.3 – Physical Outputs

The output relay are fully user programmable and controlled by any protection functions and by any digital inputs.

Output	→ REL 1	OFF(1)	+(2)	Available in the FMR relay
	→ REL 2	OFF(1)	+(2)	
	→ REL 3	OFF(1)	+(2)	
	→ REL 4	OFF(1)	+(2)	
	→ REL 5	OFF(1)	+(2)	
	→ REL 6	OFF(1)	+(2)	
	→ REL 7	OFF(1)	+(2)	Available in the first additional expansion module
	→ REL -	OFF(1)	+(2)	
	→ REL 10	OFF(1)	+(2)	
	→ REL 11	OFF(1)	+(2)	Available in the second additional expansion module
	→ REL -	OFF(1)	+(2)	
	→ REL 14	OFF(1)	+(2)	

(1) “ON”, “OFF” : Actual status of the Output Relay

(2)  ,  :  Indicates that this Relay is not yet associated to any function.

 Indicates that this Relay is already associated to one or more functions.

The relays “Rel1...Rel6” are always present on FMR module.

The additional relays “Rel7.....Rel10” are available when the first expansion module is present.

The additional relays “Rel11.....Rel14” are available when the second expansion module is present.

Any Output Relay can be programmed to be controlled (energized) by one or more of the following functions or Digital Inputs:


1I>	First instantaneous overcurrent element	(Start)
t1I>	First time delayed overcurrent element	(Trip)
2I>	Second instantaneous overcurrent element	(Start)
t2I>	Second time delayed overcurrent element	(Trip)
3I>	Third instantaneous overcurrent element	(Start)
t3I>	Third time delayed overcurrent element	(Trip)
4I>	Fourth instantaneous overcurrent element	(Start)
t4I>	Fourth time delayed overcurrent element	(Trip)
5I>	Fifth instantaneous overcurrent element	(Start)
t5I>	Fifth time delayed overcurrent element	(Trip)
6I>	Sixth instantaneous overcurrent element	(Start)
t6I>	Sixth time delayed overcurrent element	(Trip)
1Io>	First instantaneous earth fault element	(Start)
t1Io>	First time delayed earth fault element	(Trip)
2Io>	Second instantaneous earth fault element	(Start)
t2Io>	Second time delayed earth fault element	(Trip)
3Io>	Third instantaneous earth fault element	(Start)
t3Io>	Third time delayed earth fault element	(Trip)
4Io>	Fourth instantaneous earth fault element	(Start)
t4Io>	Fourth time delayed earth fault element	(Trip)
1Is>	First instantaneous Negative Sequence element	(Start)
t1Is>	First time delayed Negative Sequence element	(Trip)
2Is>	Second instantaneous Negative Sequence element	(Start)
t2Is>	Second time delayed Negative Sequence element	(Trip)
1U>	First instantaneous overvoltage element	(Start)
t1U>	First time delayed overvoltage element	(Trip)
2U>	Second instantaneous overvoltage element	(Start)
t2U>	Second time delayed overvoltage element	(Trip)





3U>	Third instantaneous overvoltage element	(Start)
t3U>	Third time delayed overvoltage element	(Trip)
1U<	First instantaneous undervoltage element	(Start)
t1U<	First time delayed undervoltage element	(Trip)
2U<	Second instantaneous undervoltage element	(Start)
t2U<	Second time delayed undervoltage element	(Trip)
3U<	Third instantaneous undervoltage element	(Start)
t3U<	Third time delayed undervoltage element	(Trip)
1f>	First instantaneous overfrequency element	(Start)
t1f>	First time delayed overfrequency element	(Trip)
2f>	Second instantaneous overfrequency element	(Start)
t2f>	Second time delayed overfrequency element	(Trip)
3f>	Third instantaneous overfrequency element	(Start)
t3f>	Third time delayed overfrequency element	(Trip)
4f>	Fourth instantaneous overfrequency element	(Start)
t4f>	Fourth time delayed overfrequency element	(Trip)
1f<	First instantaneous underfrequency element	(Start)
t1f<	First time delayed underfrequency element	(Trip)
2f<	Second instantaneous underfrequency element	(Start)
t2f<	Second time delayed underfrequency element	(Trip)
3f<	Third instantaneous underfrequency element	(Start)
t3f<	Third time delayed underfrequency element	(Trip)
4f<	Fourth instantaneous underfrequency element	(Start)
t4f<	Fourth time delayed underfrequency element	(Trip)
1Uo>	First instantaneous zero sequence overvoltage element	(Start)
t1Uo>	First time delayed zero sequence overvoltage element	(Trip)
2Uo>	Second instantaneous zero sequence overvoltage element	(Start)
t2Uo>	Second time delayed zero sequence overvoltage element	(Trip)
I2H	Instantaneous Inrush detection element	(Start)
tI2H	Time delayed Inrush detection element	(Trip)
I2/I1	Instantaneous Broken Conductor Detection element	(Start)
tI2/I1	Time delayed Broken Conductor Detection element	(Trip)
tWi>	Circuit breaker maintenance level	
tTCS	Time delayed Trip Circuit Supervision	(Trip)
tIRF	Instantaneous Internal relay Fault	(Trip)
IRF	Time delayed Internal relay Fault	(Start)
BreakerFail	Breaker Failure	
Open C/B	Open C/B command	
Close C/B	Close C/B command	
In 1	Digital Input "Di1" activated	
In 1 (not)	Digital Input "Di1" deactivated	
In 2	Digital Input "Di2" activated	
In 2 (not)	Digital Input "Di2" deactivated	
In 3	Digital Input "Di3" activated	Available in the FMR relay
In 3 (not)	Digital Input "Di3" deactivated	
In 4	Digital Input "Di4" activated	
In 4 (not)	Digital Input "Di4" deactivated	
In 5	Digital Input "Di5" activated	
In 5 (not)	Digital Input "Di5" deactivated	
In --	Digital Input "Di--" activated	Available in the first additional expansion module
In --	Digital Input "Di1--" deactivated	
In 14	Digital Input "Di14" activated	
In 14 (not)	Digital Input "Di14" deactivated	
In 15	Digital Input "Di15" activated	
In 15 (not)	Digital Input "Di15" deactivated	
In --	Digital Input "Di--" activated	Available in the second additional expansion module
In --	Digital Input "Di--" deactivated	
In 24	Digital Input "Di24" activated	
In 24 (not)	Digital Input "Di24" deactivated	




17.3.1 – Example


- 

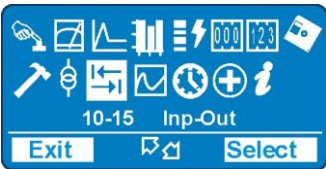
 - Press “**Menu**” for access to the main menu with icons.
- 

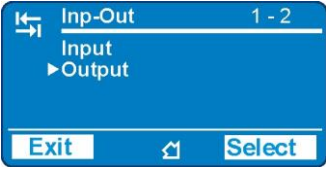
 - Select icon “**Inp-Out**” by pushbuttons “**Increase**” or “**Decrease**”.
 - Press “**Select**”.
- 

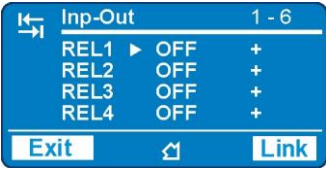 - Select “**Output**”.
 - Press “**Select**”.
- 

 - Select “**REL1**”.
 - Press “**Link**” for access to relay “1”.


“**REL1**” - “**RELx**” corresponding to physical output relay “1” - “x”
(x =available in the additional expansion modules)
- 

 - Press “**Add**” to select and associate the function.
- 


 - When one or more function is associated this symbol shows 
 - To remove selection one function:
Select function by pushbuttons “**Increase**” or “**Decrease**” and press “**Remove**”
 - Press “**Exit**”.




- 7

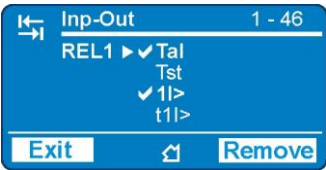


- Press “**Exit**”
- 8



- If more than one function or digital input are associated to one output relay, it is necessary to select the logic operator “AND” or “OR” “**Select the operator**” (see § Operation).
- 9

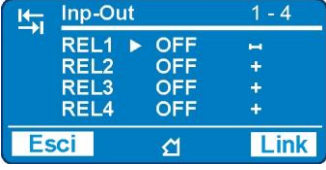

- Press “**Exit**” to go back to the previous menu.
- 10






- The display show “**Confirm the change?**”.
 - Choose “**Yes**” to convalidate the changes.
 - Choose “**No**” to not confirm the changes.



18. OSCILLOGRAPHIC RECORDING

This menu contains the status of the oscillographic recording.

The programming of the variables of the oscillographic recording is possible in the menu “Setting”→”Oscillo”

- 1 
 - Press “**Menu**” for access to the main menu with icons.
- 2 
 - Select icon “**Record**” by pushbuttons “**Increase**” or “**Decrease**”.
 - Press “**Select**”.
- 3 
 - “**Available**” – Indicates the available number of oscillographic records.
 - “**Stored**” – Indicates number of records already stored.
 - “**RecTotalTime**” – Indicates the total available recording time.

The oscillographic recording can be downloaded from the RS232 port on Relay’s front face or from the main RS485 serial port using the communication protocol Modbus RTU and the application software “MCom II”.

Using the protocol “IEC870-5-103” the recording can be downloaded from the RS485 serial port with the relevant procedure of the IEC protocol itself.









19. DATE and TIME

In this menu it is possible to configurate the Date and Time


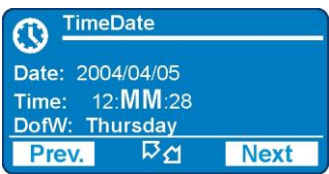

Date: 20YY / MM / DD (2000/01/01 ÷ 2099/12/31)
YY = Year / MM = Month / DD = Day

Time: HH : MM : 00 HH = hour / MM = Minutes / 00

DofW: Day Es: Wednesday

- 1 
 - Press "**Menu**" for access to the main menu with icons.
- 2 
 - Select icon "**TimeDate**" by pushbuttons "**Increase**" or "**Decrease**".
 - Press "**Select**".
- 3 
 - Press "**Modify**".
- 4 
 - The last two figures of the Year will appear in bold character; by pushbuttons "**Increase**" or "**Decrease**" set the new figures.
 - Press "**Next**" to go to the next setting.
- 5 
 - As above for changing the "Month"
 - Press "**Next**" to go to the next setting.
- 6 
 - As above for changing the "Day"
 - Press "**Next**" to go to the next setting.



- 7 
 - As above for changing the “Hours”
 - Press “**Next**” to go to the next setting.
- 8 
 - As above for changing the “Minutes”
 - Press “**Next**” to go to the next setting.
- 9 
 - The **Day of the Week** is calculated and displayed automatically.
 - Press “**Exit**” to go back to the main menu.
 - Press “**Modify**” to go back to the step “3”



Press the button “**Next**” to go back to the previous display.

19.1.1 – Clock synchronization

The internal clock has 1ms resolution and a stability of $\pm 35\text{ppm}$ in the operational temperature range.

It can be synchronized with an external time reference in the following ways:

- ❑ Using the standard “Time Synchronization” procedure of the “IEC870-5-103” protocol.
- ❑ Using the “MCom II” software or from the DCS with the Modbus RTU protocol.

Note: On power supply failure an internal battery supports the internal clock for over two years.



20. HEALTHY (Diagnostic Information)

The relay operates a continuous checking of the vital functionalities and in case an internal failure is detected, the I.R.F. function (see § I.R.F.) is activated and the Power/IRF led is set to flashing.

Device	→	No Fail	→	No Fail	No fault
			→	History Fail	Transient fault
			→	Primary Fail	Fault present

If an internal selfclearing (transient) fault is detected, it is recorded into an historical file without any other action.

21. DEV.INFO (Relay Version)

In this menu it is possible to read the information relevant to relay unit.

SW Version	AcqUnit-I/O	→	####.##.##.##	Firmware version of acquisition unit
	ProtectUnit	→	####.##.##.##	Firmware version of CPU unit
Protect.Model		→	FeederManager	Protection Type
Serial Number		→	###/###/###/####	Relay Serial Number
User Tag		→	FMR	Relay identification label. This information can only be modified by the interface program "MSCom II" and allows the user to give to the relay any suitable denomination.


22. BATTERY

The relay is equipped with a lithium battery type “CR2477N 3V”, to support the internal clock and the oscillographic recording memory in case of programmed lack of power.


The expected minimum duration without power exceed 2 years.

Attention!! Use only battery specified.

Instruction for replacement the battery:

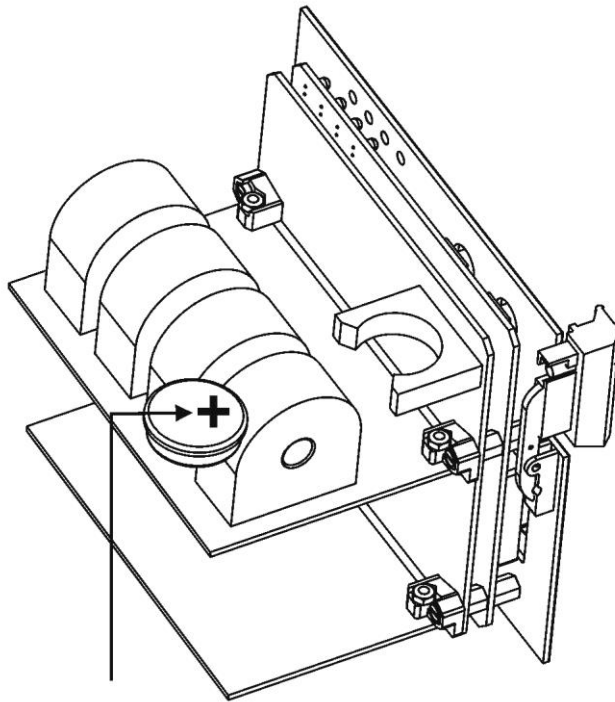

BATTERY

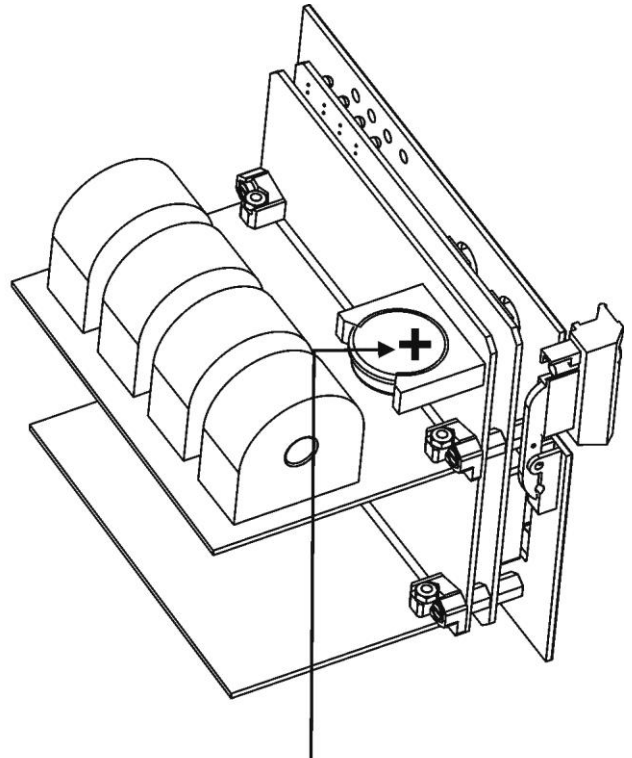

BATTERY

23. MAINTENANCE


No maintenance is required. In case of malfunctioning please contact Microelettrica Scientifica Service or the local Authorized Dealer mentioning the relay's Serial No reported in the label on relays enclosure.

24. POWER FREQUENCY INSULATION TEST


Every relay individually undergoes a factory insulation test according to IEC255-5 standard at 2 kV, 50 Hz 1min. Insulation test should not be repeated as it unusefully stresses the dielectrics. When doing the insulation test, the terminals relevant to serial output, digital inputs and RTD input must always be short circuited to ground. When relays are mounted in switchboards or relay boards that have to undergo the insulation tests, the relay should be isolated. This is extremely important as discharges eventually tacking place in other parts or components of the board can severely damage the relays or cause damages not immediately evident to the electronic components.



25. FMR - WIRING DIAGRAM

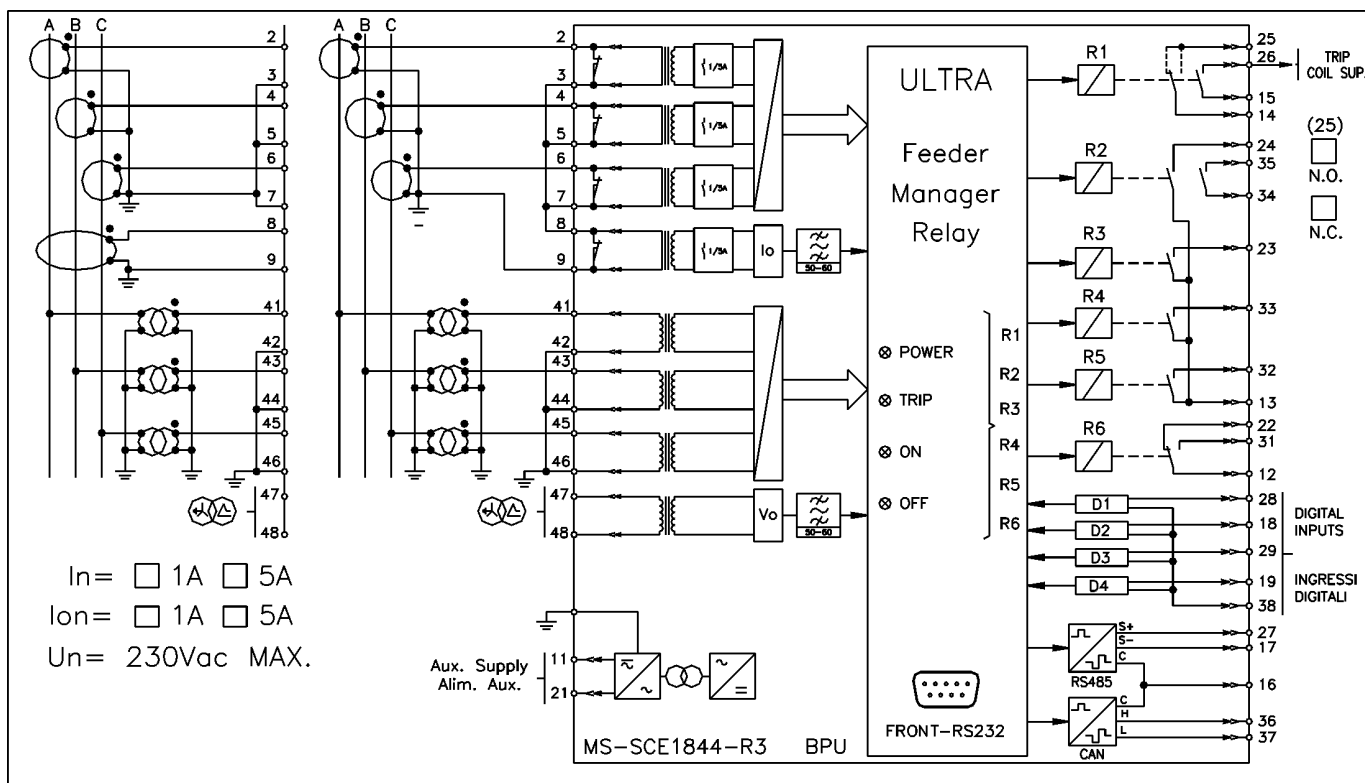


25.1 - FMR/1S - WIRING DIAGRAM + 1 EXPANSION MODULE

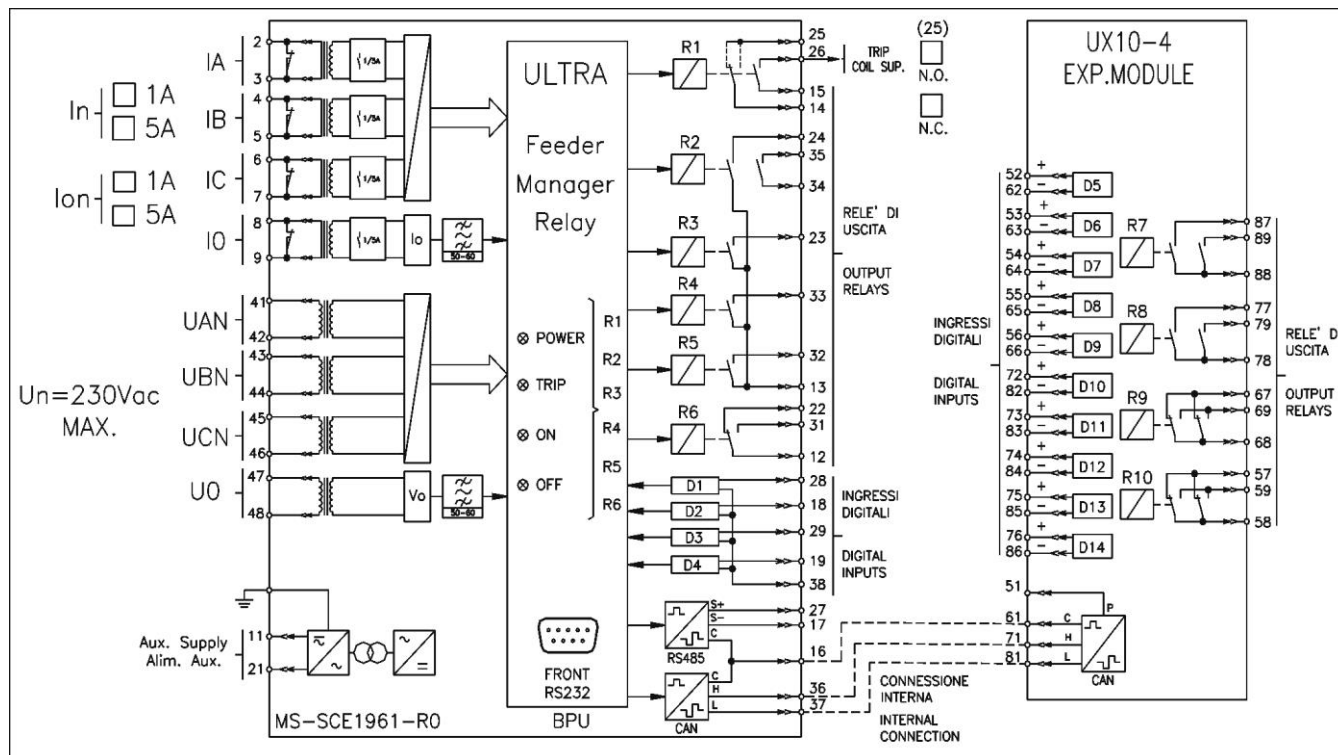




25.2 – FMR/2S - WIRING DIAGRAM + 2 EXPANSION MODULE

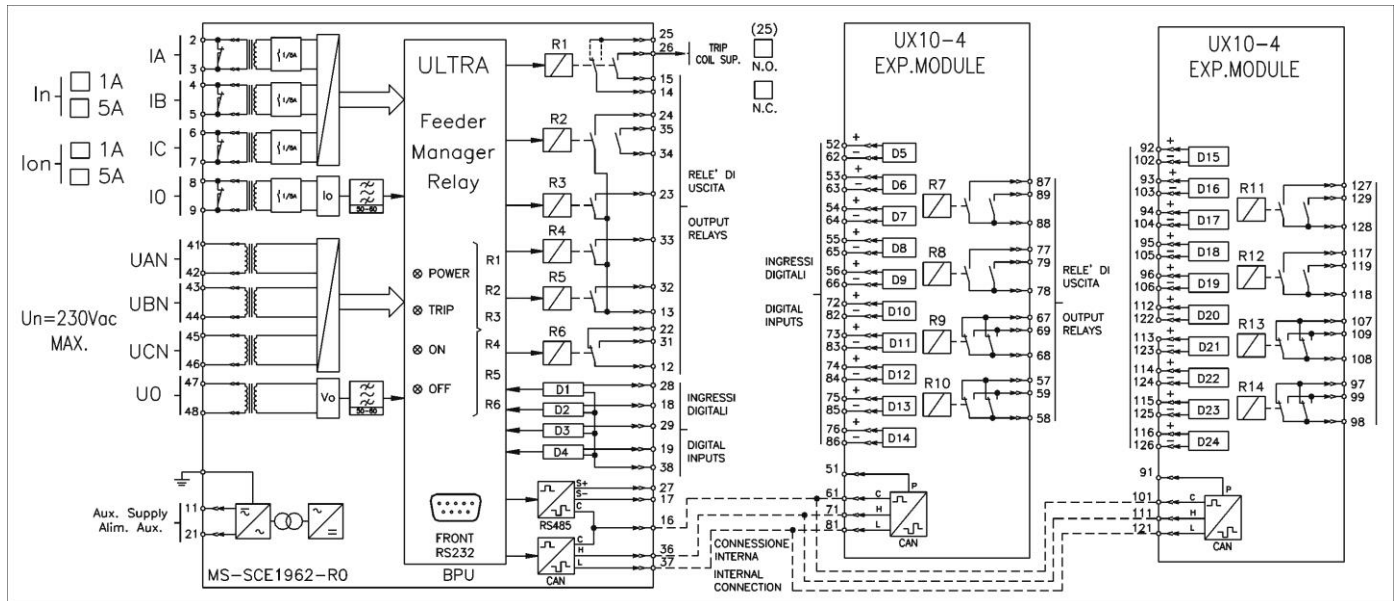


26. WIRING THE SERIAL COMMUNICATION BUS (SCE1309 Rev.0)



CONNECTION TO RS485

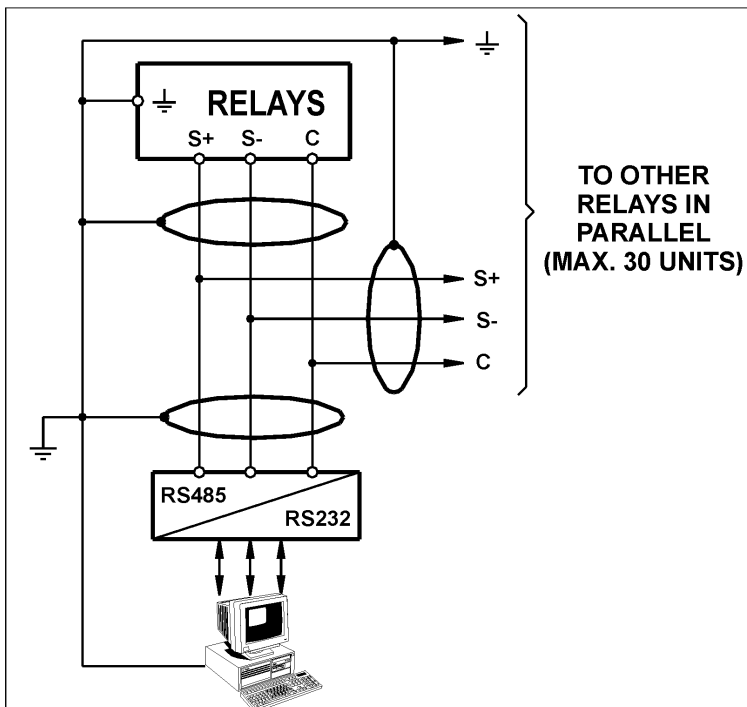



FIBER OPTIC CONNECTION

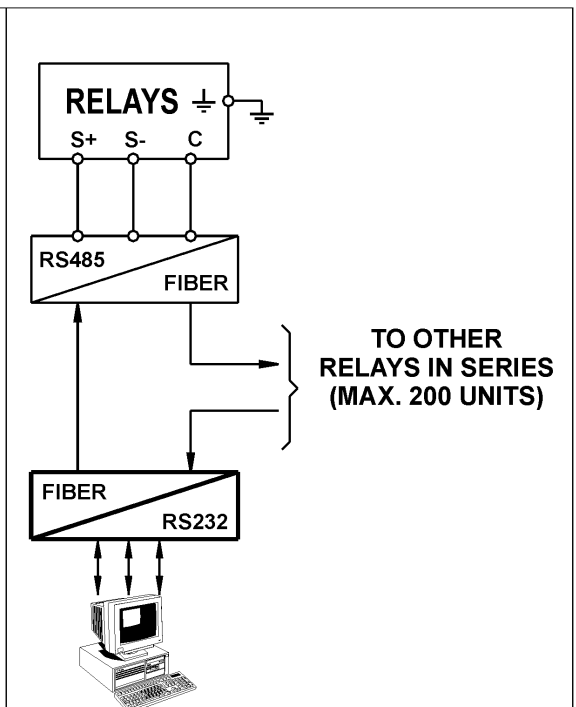

27. FMR - OVERALL DIMENSIONS / MOUNTING

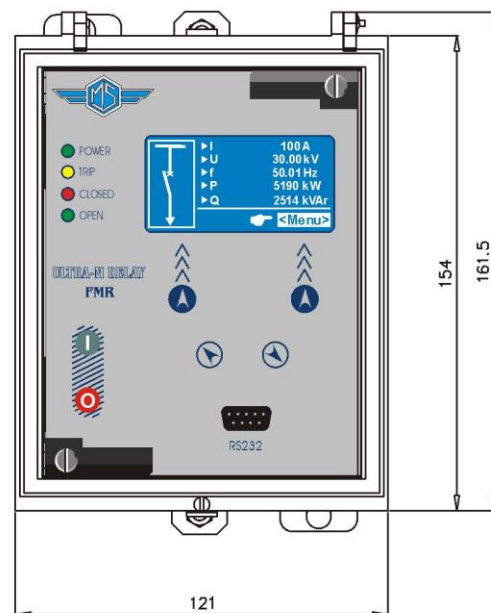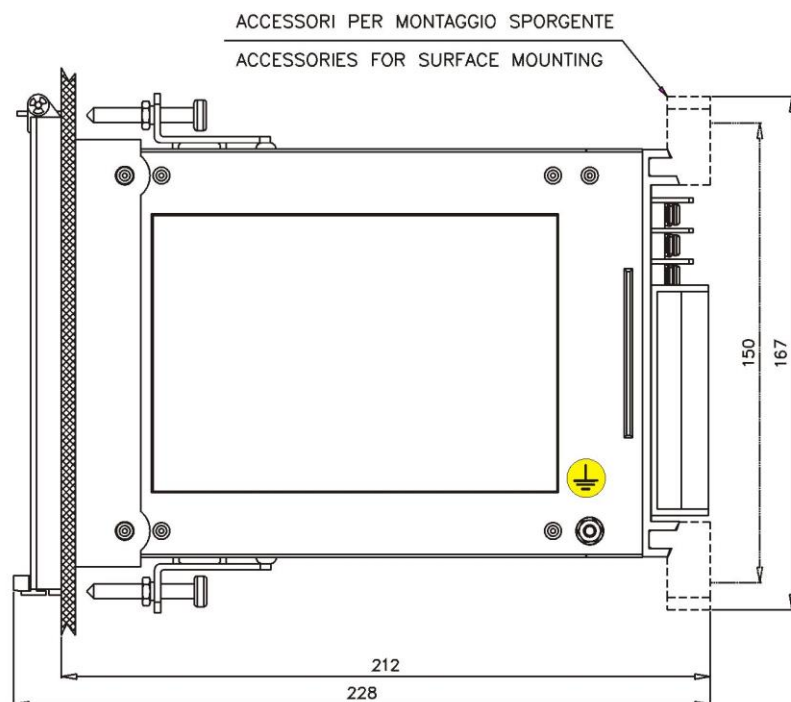


**PANNEL OUT
113x142**

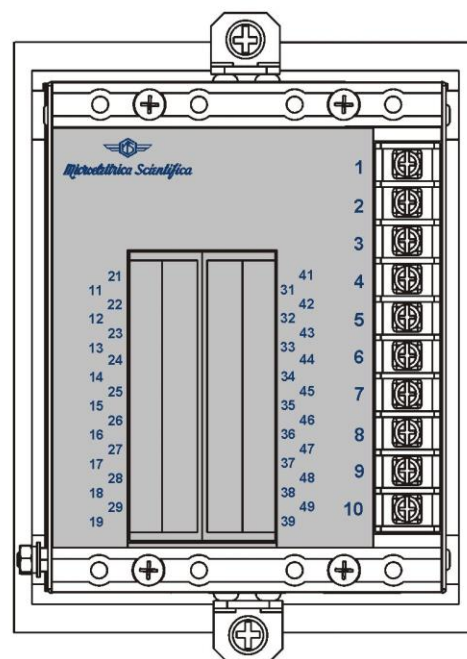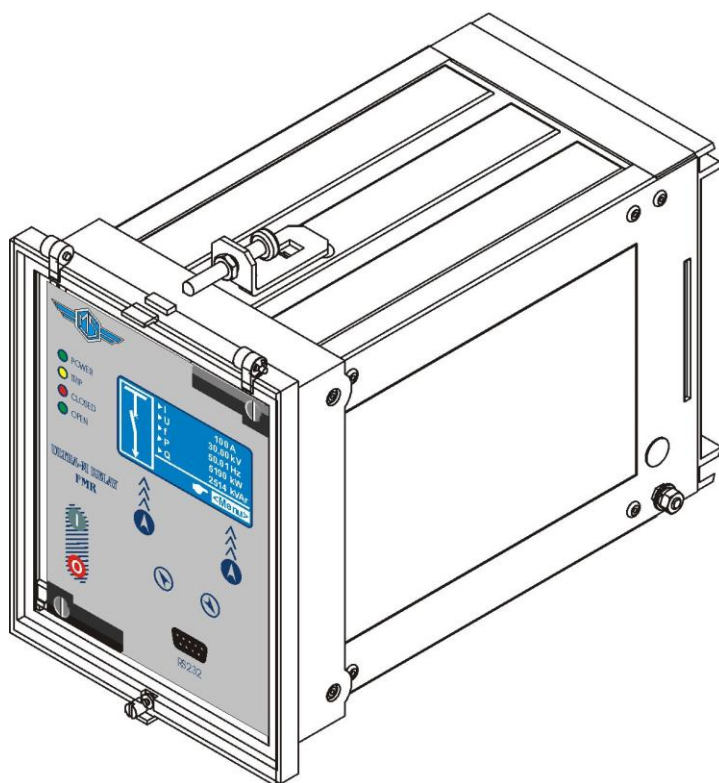


Flush mounting protection degree: IP44 (54 on request).



27.1 – FMR/1S – 3U RACK - OVERALL DIMENSIONS – (FMR + 1 EXPANSION MODULE)

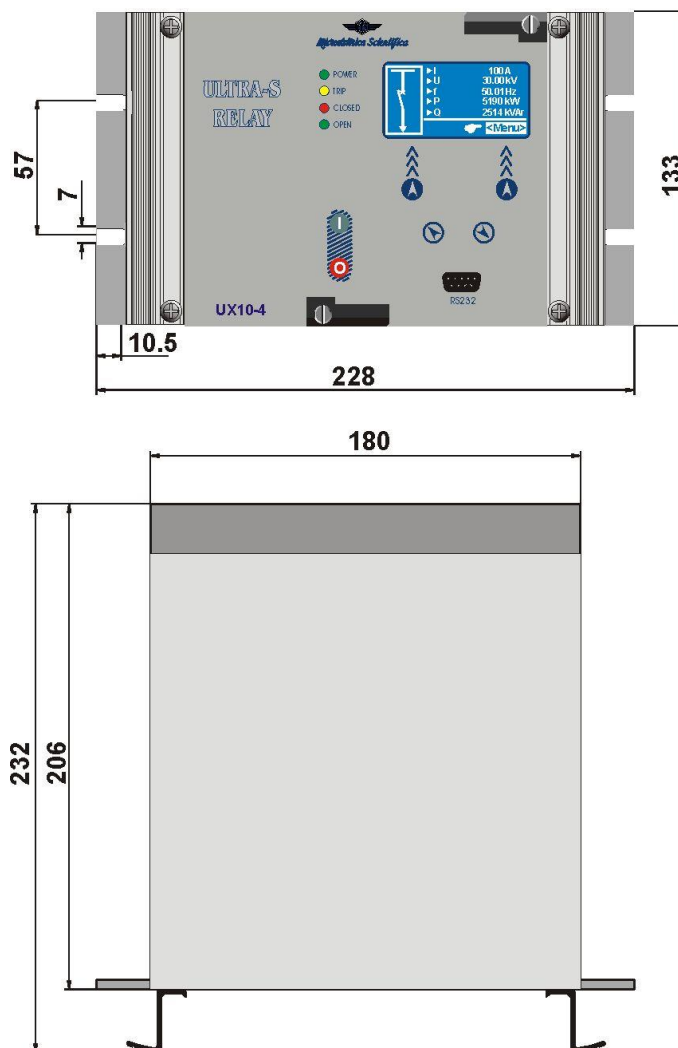


27.2 – FMR/1S – FLUSH MOUNTING - OVERALL DIMENSIONS – (FMR + 1 EXPANSION MODULE)

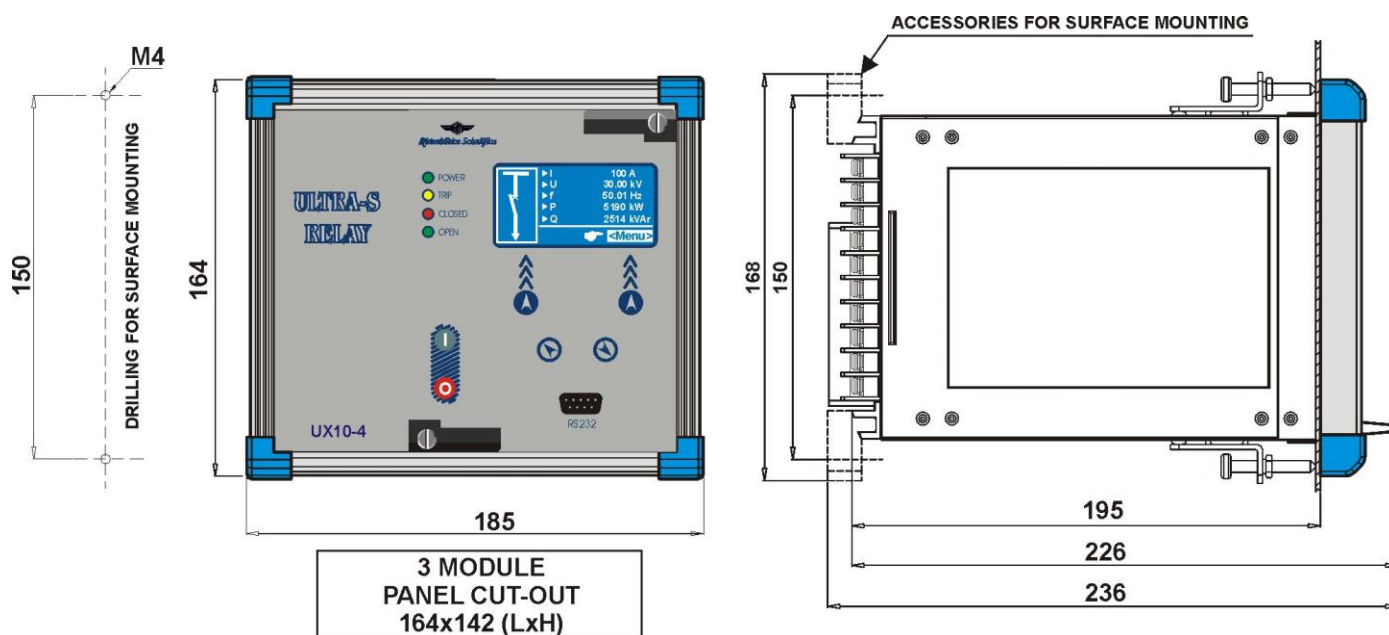




27.1 – FMR/2S – 3U RACK - OVERALL DIMENSIONS – (FMR + 2 EXPANSION MODULE)

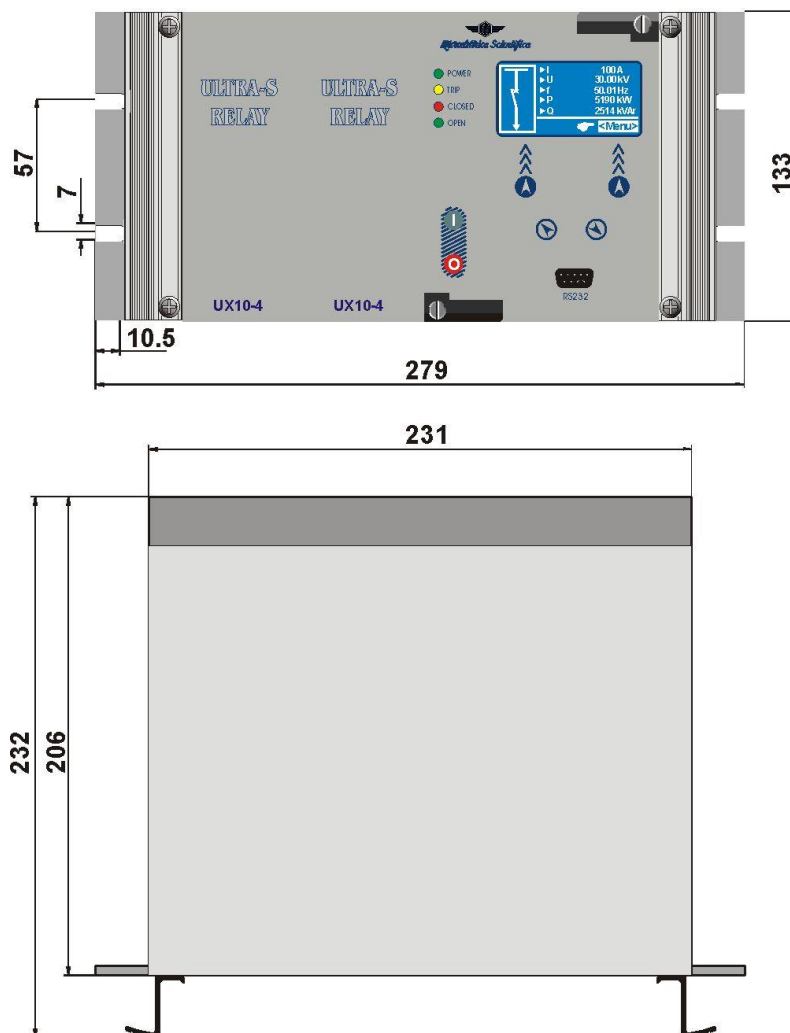

27.2 – FMR/2S - FLUSH MOUNTING - OVERALL DIMENSIONS – (FMR + 2 EXPANSION MODULE)

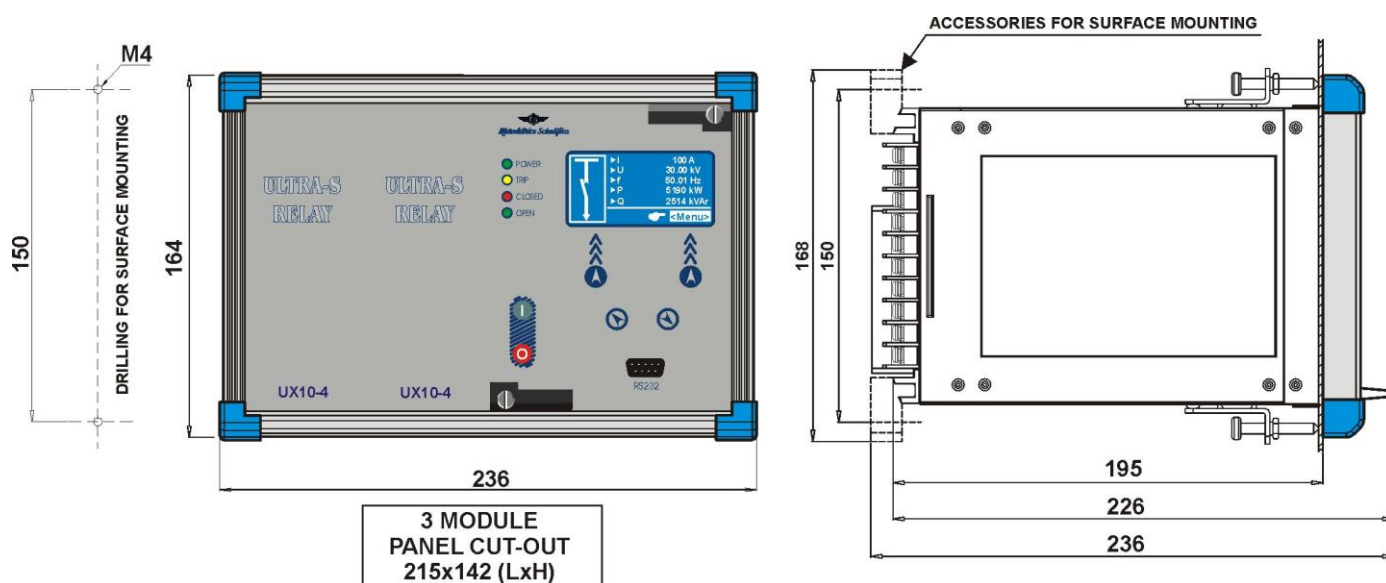


28. DIRECTION FOR PCB'S DRAW-OUT AND PLUG-IN

28.1 - Draw-out

Rotate clockwise the screws ① and ② in the horizontal position of the screw-driver mark.
Draw-out the PCB by pulling on the handles ③

28.2 – Plug-in

Rotate clockwise the screws ① and ② in the horizontal position of the screw-driver mark.
Slide-in the card on the rails provided inside the enclosure.
Plug-in the card completely and press the handle to the closed position.
Rotate anticlockwise the screws ① and ② with the mark in the vertical position (locked).

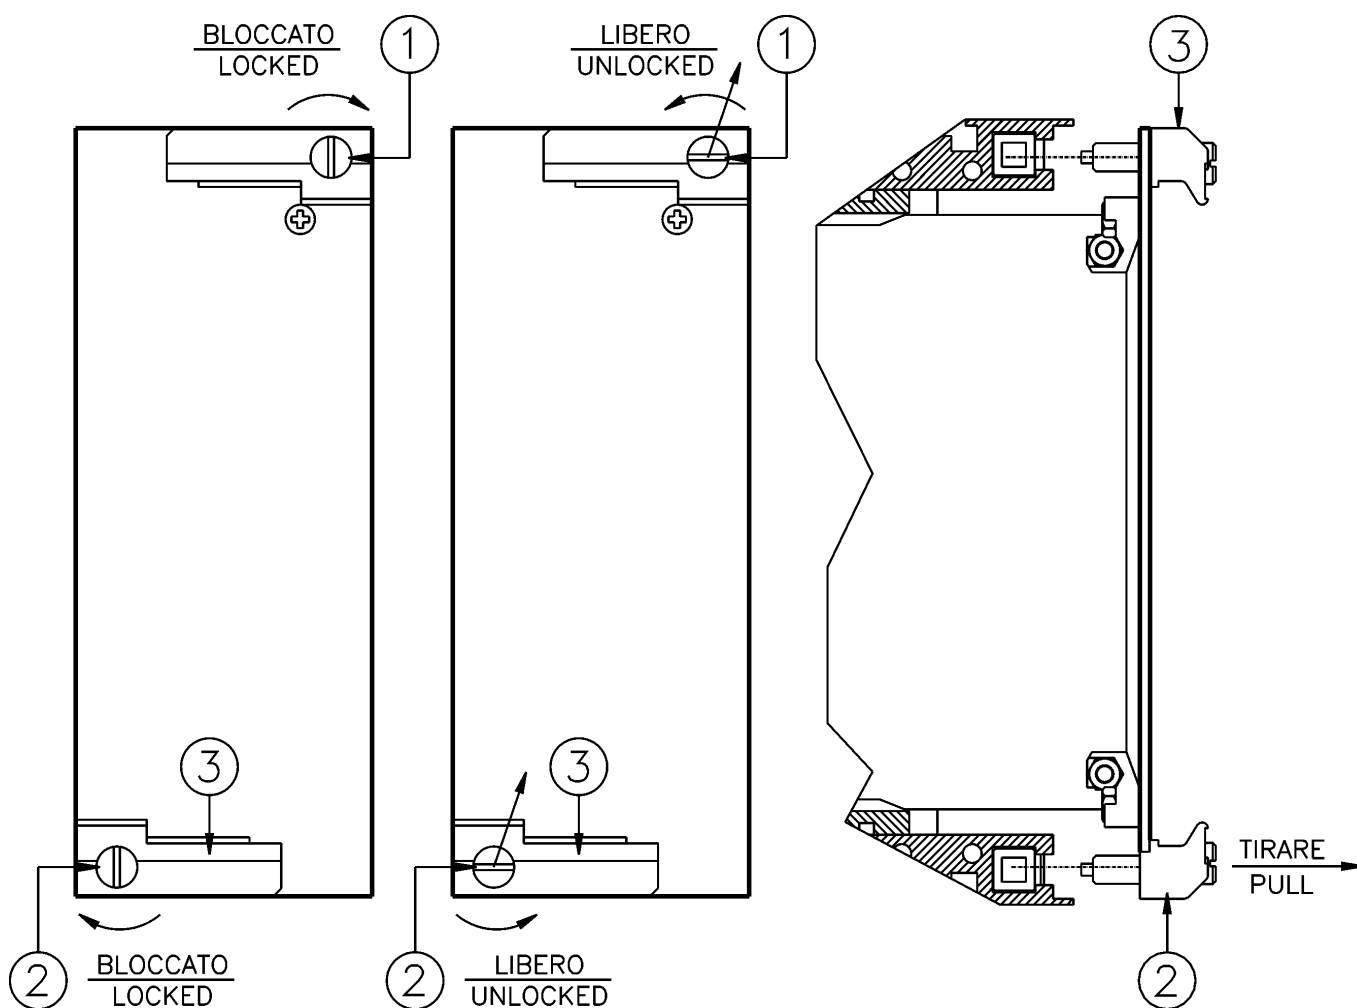



29. ELECTRICAL CHARACTERISTICS

APPROVAL: CE – RINA – UL and CSA approval File : E202083

REFERENCE STANDARDS IEC 60255 - EN50263 - CE Directive - EN/IEC61000 - IEEE C37

<input type="checkbox"/> Dielectric test voltage	IEC 60255-5	2kV, 50/60Hz, 1 min.
<input type="checkbox"/> Impulse test voltage	IEC 60255-5	5kV (c.m.), 2kV (d.m.) – 1,2/50µs
<input type="checkbox"/> Insulation resistance	> 100MΩ	

Environmental Std. Ref. (IEC 68-2-1 - 68-2-2 - 68-2-33)

<input type="checkbox"/> Operation ambient temperature	-10°C / +55°C	
<input type="checkbox"/> Storage temperature	-25°C / +70°C	
<input type="checkbox"/> Humidity	IEC68-2-3 RH 93% Without Condensing AT 40°C	

CE EMC Compatibility (EN50081-2 - EN50082-2 - EN50263)

<input type="checkbox"/> Electromagnetic emission	EN55022 industrial environment				
<input type="checkbox"/> Radiated electromagnetic field immunity test	IEC61000-4-3	level 3	80-1000MHz	10V/m	
	ENV50204		900MHz/200Hz	10V/m	
<input type="checkbox"/> Conducted disturbances immunity test	IEC61000-4-6	level 3	0.15-80MHz	10V	
<input type="checkbox"/> Electrostatic discharge test	IEC61000-4-2	level 4	6kV contact / 8kV air		
<input type="checkbox"/> Power frequency magnetic test	IEC61000-4-8		1000A/m		50/60Hz
<input type="checkbox"/> Pulse magnetic field	IEC61000-4-9		1000A/m, 8/20µs		
<input type="checkbox"/> Damped oscillatory magnetic field	IEC61000-4-10		100A/m, 0.1-1MHz		
<input type="checkbox"/> Electrical fast transient/burst	IEC61000-4-4	level 3	2kV, 5kHz		
<input type="checkbox"/> HF disturbance test with damped oscillatory wave (1MHz burst test)	IEC60255-22-1	class 3	400pps, 2,5kV (m.c.), 1kV (d.m.)		
<input type="checkbox"/> Oscillatory waves (Ring waves)	IEC61000-4-12	level 4	4kV(c.m.), 2kV(d.m.)		
<input type="checkbox"/> Surge immunity test	IEC61000-4-5	level 4	2kV(c.m.), 1kV(d.m.)		
<input type="checkbox"/> Voltage interruptions	IEC60255-4-11				
<input type="checkbox"/> Resistance to vibration and shocks	IEC60255-21-1 - IEC60255-21-2 10-500Hz 1g				

CARATTERISTICHE

<input type="checkbox"/> Accuracy at reference value of influencing factors	1% In – 0.1%On 2% + to (to=20÷30ms @ 2xIs)	for measure for times
<input type="checkbox"/> Rated Current	In = 1 or 5A - On = 1 or 5A	
<input type="checkbox"/> Current overload	80 In for 1 sec; 4 In continuous	
<input type="checkbox"/> Burden on current inputs	Phase : 0.01VA at In = 1A; 0.2VA at In = 5A Neutral : 0.01VA at In = 1A ; 0.2VA at In = 5A	
<input type="checkbox"/> Rated Voltage	Un = (100 ÷ 125)Vac	
<input type="checkbox"/> Voltage Overload	2Un permanent	
<input type="checkbox"/> Burden on voltage inputs	0,1VA at Un	
<input type="checkbox"/> Average power supply consumption	< 10 VA	
<input type="checkbox"/> Output relays	rating 5 A; Vn = 380 V A.C. resistive switching = 1100W (380V max) make = 30 A (peak) 0,5 sec. break = 0.3 A, 110 Vcc, L/R = 40 ms (100.000 op.)	

COMMUNICATION PARAMETER

<input type="checkbox"/> Rear serial port	RS485 – 9600 to 38400 bps – 8,n,1 – Modbus RTU – IEC60870-5-103
<input type="checkbox"/> Front serial port	RS232 – 9600 to 57600 bps – 8,n,1 – Modbus RTU

Microelettrica Scientifica S.p.A. - 20089 Rozzano (MI) - Italy - Via Alberelle, 56/68

Tel. (+39) 02 575731-Fax (+39) 02 57510940

<http://www.microelettrica.com> e-mail : <mailto:sales.relays@microelettrica.com>

The performances and the characteristics reported in this manual are not binding and can modified at any moment without notice