

D.C. FEEDER MANAGER RELAY


TYPE

U-MLEs







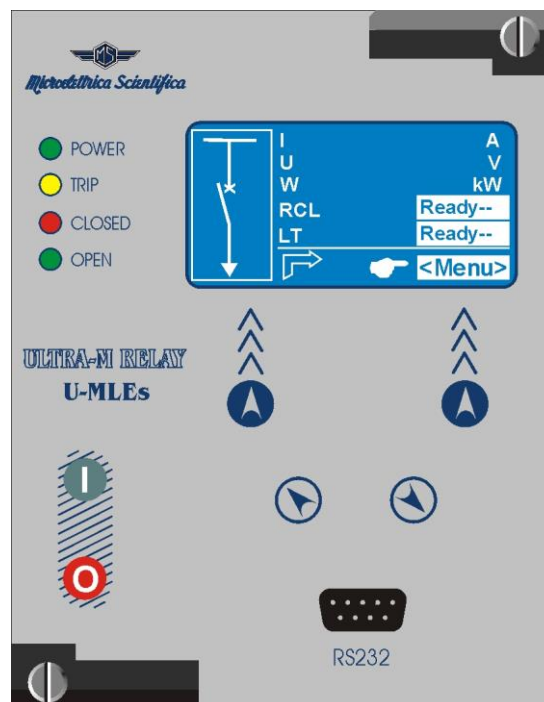



(Multiple I/O Boards)

ULTRA Line

OPERATION MANUAL









INDEX

1. GENERAL UTILIZATION AND COMMISSIONING DIRECTIONS	5
1.1 - Storage and Transportation	5
1.2 - Installation	5
1.3 - Electrical Connection	5
1.4 - Measuring Inputs and Power Supply	5
1.5 - Outputs Loading	5
1.6 - Protection Earthing	5
1.7 - Setting and Calibration	5
1.8 - Safety Protection	5
1.9 - Handling	5
1.10 - Maintenance	5
1.11 - Waste Disposal of Electrical & Electronic Equipment	6
1.12 - Fault Detection and Repair	6
2. GENERAL	6
2.1 - Power Supply	7
3. FRONT PANEL	7
4. KEYBOARD AND DISPLAY	8
4.1 - Display	8
5. ICONS OF DISPLAY	9
6. SIGNALIZATION	10
6.1 - Leds Manual Reset	10
6.2 - Display of the last trip	10
 7. LOCAL COMMANDS	11
 8. MEASURE	12
 9. MAXIMUM VALUES (MAX DEMAND)	13
 10. ENERGY	14
 11. TRIP RECORDING	15
 12. PARTIAL COUNTERS	17
 13. TOTAL COUNTERS	19
 14. EVENTS	20
14.1 - Events on display	21
 15. SYSTEM (System parameters)	22
 16. SETTINGS	23
16.1 - Modifying the setting of variables	24
16.2 - Password	25
16.3 - Menu: Communic. (Communication)	26
16.3.1 - Description of variables	26
16.3.2 - Front Panel serial communication port (RS232)	26
16.3.3 - Cable for direct connection of Relay to Personal Computer	26
16.3.4 - Main serial communication port (RS485)	26
16.4 - Menu: Customise	27
16.4.1 - Description of variables	27
16.5 - Function: T> (Thermal Image F49)	28
16.5.1 - Description of variables	28
16.5.2 - Trip and Alarm	28
16.5.2.1 - Trip time of the Thermal Image Element	28
16.5.2.2 - Thermal Image Curves (TU1024 Rev.1)	29



16.6 - Function: 1l> (First Overcurrent Element F50/51)	30
16.6.1 - Description of variables	30
16.6.2 - Algorithm of the time current curves	31
16.6.3 - IEC Curves	32
16.6.4 - Blocking Logic (BO-BI)	33
16.6.4.1 - Output Blocking signal "BO"	33
16.6.4.2 - Blocking Input "BI"	33
16.6.5 - Automatic doubling of Overcurrent thresholds on current inrush	33
16.7 - Function: 2l> (Second Overcurrent Element F50/51)	34
16.7.1 - Description of variables	34
16.8 - Function: 3l> (Third Overcurrent Element F50/51)	35
16.8.1 - Description of variables	35
16.9 - Function: 4l> (Fourth Overcurrent Element F50/51)	36
16.9.1 - Description of variables	36
16.10 - Function: 1dl (First Current Step Element)	37
16.10.1 - Description of variables	37
16.10.2 - Operation of the Current step monitoring element	38
16.11 - Function: 2dl (Second Current Step Element)	39
16.11.1 - Description of variables	39
16.12 - Function: 1di/dt (First Current Rate of Rise Element)	40
16.12.1 - Description parameters	40
16.12.2 - Operation of the current rate of rise monitoring element	40
16.13 - Function: 2di/dt (Second Current Rate of Rise Element)	41
16.13.1 - Description parameters	41
16.13.2 - Operation of the current rate of rise monitoring element	41
16.14 - Function: Rapp (Impedance monitoring - di/dt dependence)	42
16.14.1 - Description of variables	42
16.14.2 - Operation the Impedance monitoring element	43
16.15 - Function: lapp (Current monitoring with di/dt dependence)	44
16.15.1 - Description of variables	44
16.15.2 - Operation of the "lapp" element	44
16.16 - Function: 1lg (First Frame Fault Element)	45
16.16.1 - Description of variables	45
16.16.2 - Operation	45
16.17 - Function: 2lg (Second Frame Fault Element)	46
16.17.1 - Description of variables	46
16.17.2 - Operation	46
16.18 - Function: RS-G (Cable insulation (Screen-Ground))	47
16.18.1 - Description of variables	47
16.18.2 - Operation	47
16.18.3 - Compensation of the inherent leakage current	48
16.19 - Function: RCL (Automatic Reclosure)	49
16.19.1 - Description of variables	49
16.19.2 - Operation	49
16.19.3 - Display Lock-out indication	50
16.19.4 - Display status indication	50
16.19.4 - Flow chart RCL	51
16.20 - Function: 1U> (First OverVoltage Element F59)	52
16.20.1 - Description of variables	52
16.21 - Function: 2U> (Second OverVoltage Element F59)	52
16.21.1 - Description of variables	52
16.22 - Function: 1U< (First UnderVoltage Element F27)	53
16.22.1 - Description of variables	53
16.23 - Function: 2U< (Second UnderVoltage Element F27)	53
16.23.1 - Description of variables	53
16.24 - Function: Wi (Circuit Breaker maintenance level)	54
16.24.1 - Description of variables	54
16.24.2 - Operation (Accumulation of the interruption Energy)	54
16.25 - Function: TCS (Trip Circuit Supervision)	55
16.25.1 - Description of variables	55
16.25.2 - Operation	55
16.26 - Function: IRF (Internal Relay Fault)	56
16.26.1 - Description of variables	56
16.26.2 - Operation	56
16.27 - Function: RT (First Element Remote Trip)	57
16.27.1 - Description of variables	57
16.27.2 - Operation	57



16.28 - Function: RTX (Second Element Remote Trip)	58
16.28.1 - Description of variables	58
16.28.2 - Operation	58
16.29 - Function: BreakerFail (Breaker Failure)	59
16.28.1 - Description of variables	59
16.29.2 - Operation	59
16.30 - Function: Wh (Energy counter Pulse)	60
16.30.1 - Description of variables	60
16.29.2 - Operation	60
16.31 - Function: Oscillo (Oscillographic Recording)	61
16.31.1 - Description of variables	61
16.31.2 - Operation	61
16.32 - Function: L/R C/B Cmds (Local Remote Close Breaker Command)	62
16.32.1 - Description of variables	62
16.31.2 - Display	62
16.32 - Function: CB-L (CB Lock)	63
16.32.1 - Description of variables	63
16.32.2 - Operation	63
16.33 - Function: LT (Automatic Line Test)	64
16.33.1 - Description of variables	64
16.33.2 - Operation	64
16.33.3 - Visualization on main Display	65
16.33.4 - Display status indication	65
16.33.4 - Flow chart	66
16.34 - Function: ExtResCfg (External Reset Configuration)	67
16.34.1 - Description of variables	67
 17. INPUT - OUTPUT	68
17.1 - Operation	68
17.2 - Input	70
17.2.1 - Physical Input	70
17.2.2 - Logical Input (Functional)	71
17.2.1 - Example	72
17.3 - Physical Outputs	73
17.3.1 - Example	75
 18. InfoStatus	77
 19. OSCILLOGRAPHIC RECORDING	78
 20. DATE and TIME	79
20.1- Clock synchronization	80
 21. HEALTHY (Diagnostic Information)	81
 22. DEV.INFO (Relay Version)	81
23. BATTERY	82
24. MAINTENANCE	82
25. POWER FREQUENCY INSULATION TEST	82
26. BASIC RELAY - U-MLEs - WIRING DIAGRAM	83
26.1 - Options - Wiring Diagram	83
26.2 - UX10-4 - Expansion Module - WIRING DIAGRAM (10 Digital Inputs + 4 Output Relays)	84
26.3 - UX14-DI - Expansion Module - WIRING DIAGRAM (14 Digital Inputs)	84
27. WIRING THE SERIAL COMMUNICATION BUS	85
28. Basic Relay - OVERALL DIMENSIONS	86
28.1 - /1S (1 Expansion Module) & /2S (2 Expansion Module) - Overall Dimensions	87
29.2 - Rack 3U - OVERALL DIMENSIONS	88
30. DIRECTION FOR PCB'S DRAW-OUT AND PLUG-IN	89
30.1 - Draw-out	89
30.2 - Plug-in	89
31. ELECTRICAL CHARACTERISTICS	90
32. SOFTWARE & FIRMWARE VERSION	91



1. GENERAL UTILIZATION AND COMMISSIONING DIRECTIONS

Always make reference to the specific description of the product and to the Manufacturer's instruction. Carefully observe the following warnings.

1.1 - Storage and Transportation

Must comply with the environmental conditions stated in the product's specification or by the applicable IEC standards.

1.2 - Installation

Must be properly made and in compliance with the operational ambient conditions stated by the Manufacturer.

1.3 - Electrical Connection

Must be made strictly according to the wiring diagram supplied with the Product, to its electrical characteristics and in compliance with the applicable standards particularly with reference to human safety.

1.4 - Measuring Inputs and Power Supply

Carefully check that the value of input quantities and power supply voltage are proper and within the permissible variation limits.

1.5 - Outputs Loading

Must be compatible with their declared performance.

1.6 - Protection Earthing

When earthing is required, carefully check its effectiveness.

1.7 - Setting and Calibration

Carefully check the proper setting of the different functions according to the configuration of the protected system, the safety regulations and the co-ordination with other equipment.

1.8 - Safety Protection

Carefully check that all safety means are correctly mounted, apply proper seals where required and periodically check their integrity.

1.9 - Handling

Notwithstanding the highest practicable protection means used in designing M.S. electronic circuits, the electronic components and semiconductor devices mounted on the modules can be seriously damaged by electrostatic voltage discharge which can be experienced when handling the modules. The damage caused by electrostatic discharge may not be immediately apparent but the design reliability and the long life of the product will have been reduced. The electronic circuits produced by M.S. are completely safe from electrostatic discharge (8 KV IEC 255.22.2) when housed in their case; withdrawing the modules without proper cautions expose them to the risk of damage.

1.10 - Maintenance

Make reference to the instruction manual of the Manufacturer; maintenance must be carried-out by specially trained people and in strict conformity with the safety regulations.



1.11 - Waste Disposal of Electrical & Electronic Equipment

(Applicable throughout the European Union and other European countries with separate collection program).

This product should not be treated as household waste when you wish dispose of it. Instead, it should be handed over to an applicable collection point for the recycling of electrical and electronic equipment. By ensuring this product is disposed of correctly, you will help prevent potential negative consequence to the environment and human health, which could otherwise be caused by inappropriate disposal of this product. The recycling of materials will help to conserve natural resource.

1.12 - Fault Detection and Repair

Internal calibrations and components should not be altered or replaced.
For repair please ask the Manufacturer or its authorized Dealers.

Misapplication of the above warnings and instruction relieves the Manufacturer of any liability.

2. GENERAL

Input quantities are supplied via isolated converters with (0 - 20)mA output (overload 25mA).
For best accuracy and reliability we recommend to use MHCO measuring converters for supply of input.

A) Current measurement

- 1 Input 0 - 20mA \equiv 0 - 1In
- 1 Input 0 - 20(25)mA \equiv 0 - 10(12.5)In
- Measuring range 0 - 12,5 times the rated input current (12,5In)
- Resolution 16 bits

B) Line voltage measurement

- 1 Input 0 - 20mA \equiv 0 - 2Un
- Measuring range 0 - 2 times the rated input voltage (2xUn)
- Resolution 12 bits

C) Frame earth fault current measurement

- 1 Input 0 - 20mA \equiv 0 - 1In
- Measuring range 0 - 1 times the rated input current
- Resolution 12 bits

D) Frame voltage measurement

- 1 Input 0 - 20mA \equiv 0 - 2Un
- Measuring range 0 - 2 times the rated input voltage (2xUn)
- Resolution 12 bits

Make electric connection in conformity with the diagram reported on relay's enclosure.
Check that input currents and voltages are same as reported on the diagram and on the test certificate.
The auxiliary power is supplied by a built-in fully isolated and self protected unit.


2.1 - Power Supply

The relay can be fitted with two different types of **power supply**:







Type 1) - { 24V(-20%) / 110V(+15%) a.c. 24V(-20%) / 125V(+20%) d.c.	Type 2) - { 80V(-20%) / 220V(+15%) a.c. 90V(-20%) / 250V(+20%) d.c.
--	--

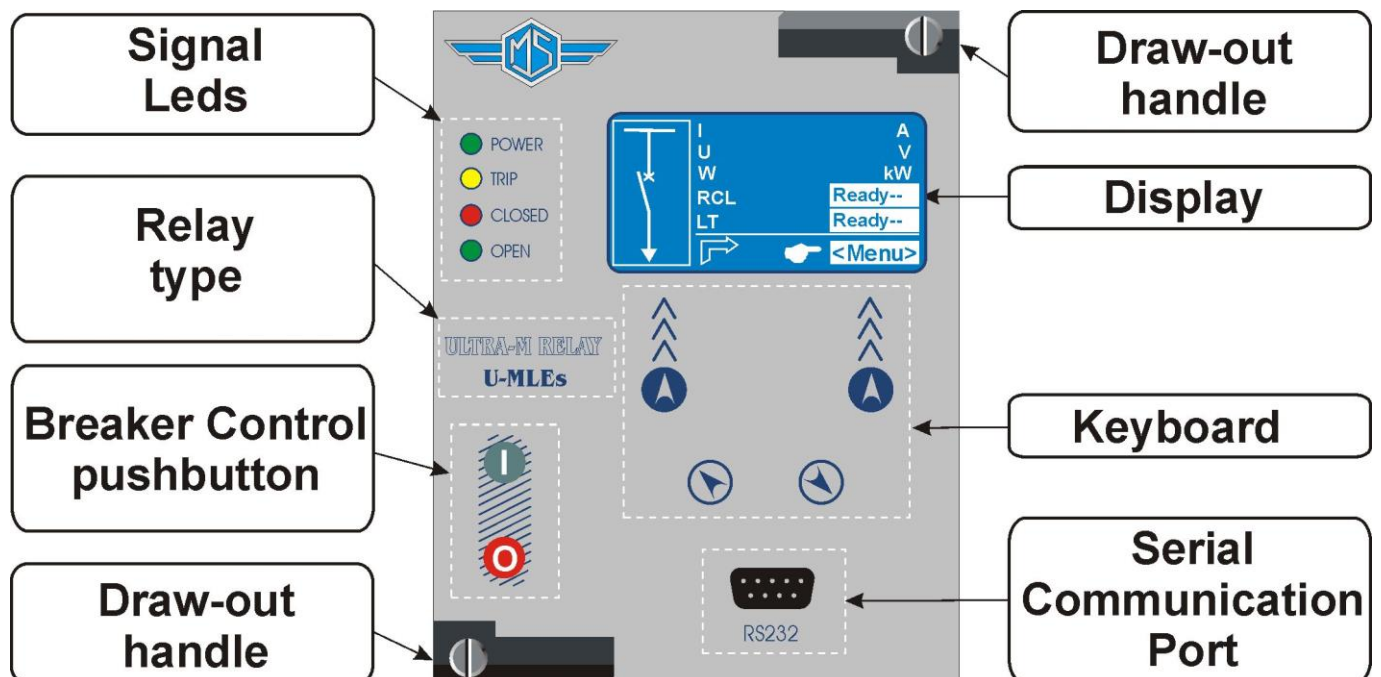Before energizing the unit check that supply voltage is within the allowed limits.

3. FRONT PANEL

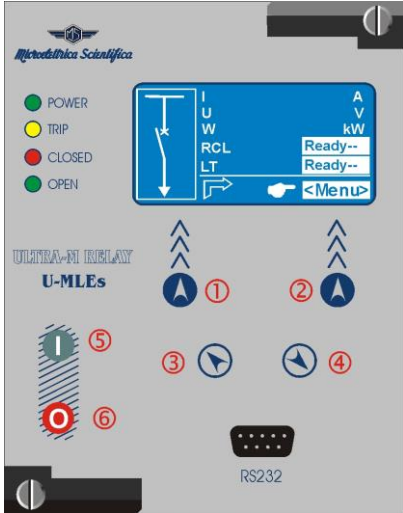

4. KEYBOARD AND DISPLAY

	 Navigation menu	By these buttons the options showed in correspondence on the display are selected.
	 Increase	These buttons are used to scroll the items of the different menus (Local Control, Measurements, Energy metering etc).
	 Decrease	
	 Open	these buttons (when enabled) operate Circuit Breaker Open/Close control (see § L/R C/B Cmds)
	 Close	


□ By the key ② select the windows showing the ICONS of the available menus.

□ By the key ③, ④ select the desired icon and enter by key ①







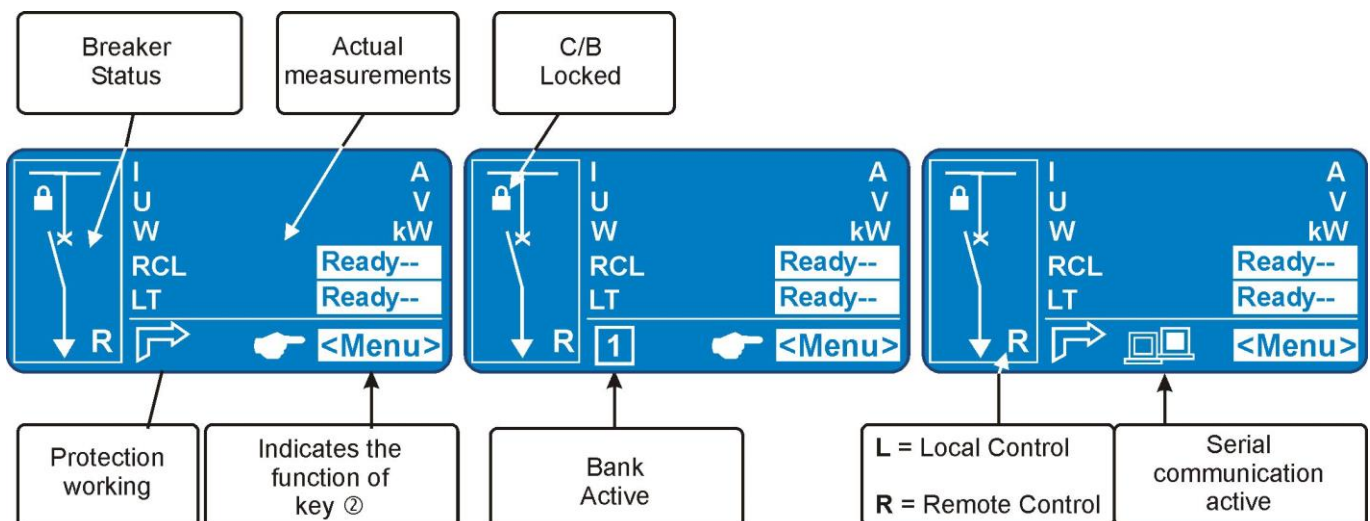









□ The different elements can be selected by the key ③ and ④.
The details of the individual menus are given in the following paragraphs.

4.1 - Display

The 128x64 pixel LCD display the available information (menu, etc.).








5. ICONS OF DISPLAY

	LocalCmd	LOCAL COMMANDS
	Measure	ACTUAL MEASUREMENTS
	MaxVal	MAXIMUM VALUES (MAX DEMAND RECORD)
	Energy	ENERGY MEASUREMANTS
	TripRec.	TRIP RECORDING
	Counter	PARTIAL COUNTERS (RESETTABLE COUNTER)
	ROCnt	TOTAL COUNTER (READ ONLY COUNTER)
	Events	EVENT RECORDING
	Setting	FUNCTION SETTINGS
	System	SYSTEM SETTINGS
	Inp-Out	INPUT - OUTPUT
	InfoStatus	INFORMATION STATUS
	Record	OSCILLOGRAPHIC RECORDING
	TimeDate	TIME AND DATE
	Healthy	DIAGNOSTIC INFORMATION
	Dev.Info	RELAY VERSION

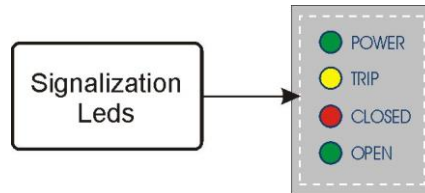6. SIGNALIZATION





Four signal leds are provided:



Green Led	 POWER	<input type="checkbox"/> Illuminated <input type="checkbox"/> Flashing	- Relay working properly. - Internal Relay Fault
Yellow Led	 TRIP	<input type="checkbox"/> Off <input type="checkbox"/> Illuminated <input type="checkbox"/> Flashing	- No Trip - Trip occurred - Function Timing Reset from Illuminated status is manual (see § 6.1)
Red Led	 CLOSED	<input type="checkbox"/> Off <input type="checkbox"/> Illuminated	- C/B Open - C/B Close
Green Led	 OPEN	<input type="checkbox"/> Off <input type="checkbox"/> Illuminated	- C/B Close - C/B Open
Both Flashing Operation of Trip Circuit Supervision element.			
<input type="checkbox"/> In case of auxiliary power supply failure the status of the leds is recorded and reproduced when power supply is restored.			


6.1 - Leds Manual Reset

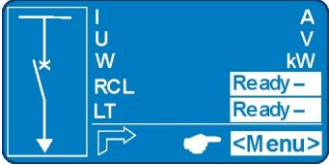For Leds' manual reset operate as follows:

- 
 - Press "**Menu**" for access to the main menu with icons.
- 
 - Select icon "**LocalCmd**".
 - Press "**Select**".
- 
 - Select "**LedClear**".
 - Press "**Select**" to execute the command. (See § Password).
- 
 - When command has been executed the display shows "**! Command Done**";

6.2 – Display of the last trip

Beside the signalization of the yellow led "Trip", indicating a generic function trip, the display shows a window indicating the last function that was tripped and the number of events that are stored in the memory. The display will show this window until the reset button or external reset are operated.



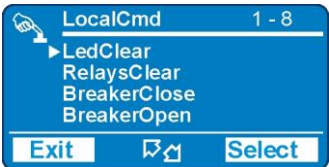

- 
 - Press "**Menu**" to access to the main menu with icons.
 - Press "**Res.**" to erase visualization.
 - Ex. "t1l>" (flashing) is the last trip.

7. LOCAL COMMANDS

“**LOCAL COMMANDS**” allow to operate from relay front face controls like Thermal Memory reset, Leds reset, etc.




Menu	Description	Password
→ Led Clear	Reset of signal Leds	No
→ Relays Clear	Manual reset of output relays	No
→ Breaker Close	Manual C/B closing (conditioned by Password)	Yes
→ Breaker Open	Manual C/B opening (conditioned by Password)	Yes
→ CB Unlock	Unlock the C/B reclosure (see § CB-L)	Yes
→ HistFail Clear	Reset of Internal Failure Historic records	Yes
→ Reset Term	Reset to zero of the accumulations relevant to Thermal Image and Interruption Energy.	Yes
→ Leds Test	Signal Leds test	No

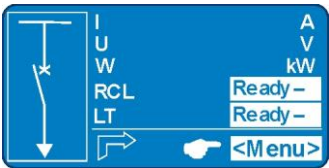To operate one command by the Front Face Keyboard, proceed as follows (Led Reset in the present example).

- 
 - Press “**Menu**” for access to the main menu with icons.
- 
 - Select “**LocalCmd**” icon with pushbutton “**Increase**” or “**Decrease**”.
 - Press “**Select**” for access.
- 
 - Select with pushbutton “**Increase**” or “**Decrease**” the menu “**LedClear**”.
 - Press “**Select**” to execute the command.
(if Password is request, see § Password).
- 
 - When command has been executed the display shows “**! Command Done**”; go to “3”.

8. MEASURE

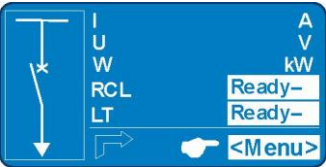Real time values as measured during the normal operation.




- 1 
 - Press "**Menu**" for access to the main menu with icons.
- 2 
 - Select "**Measure**" icon with pushbutton "**Increase**" or "**Decrease**".
 - Press "**Select**" for access.
- 3 
 - Scroll the menu "**Measure**" with pushbutton "**Increase**" or "**Decrease**" to display the measurement.
 - Press "**Exit**" to go to the main menu.

- **I** (0 ± 9999)
- **U** (0 ± 9999)
- **W** (0.00 ÷ 99.99 ÷ 999.9 ÷ 9999999)
- **Tem** (0 ÷ 9999)
- **Ig** (0 ± 9999)
- **Ug** (0 ± 9999)
- **Wir** (100 ÷ 0)
- **RS-G** (0 ÷ 20000)
- **A/ms** (0 ÷ 9999)
- **Rapp** (0 ÷ 1000)

- A** Line current
- V** Line voltage
- kW** Power
- %T** Thermal status as % of the full load continuous operation temperature Tn
- A** Frame to ground fault current
- V** Frame to ground fault voltage
- %W** Amount still remaining of permissible interruption energy before Circuit Breaker maintenance is requested.
- Ω** Cable Insulation resistance Screen/Ground
- Ω** Current rate of raise
- Ω** Impedance monitoring

9. MAXIMUM VALUES (MAX DEMAND)

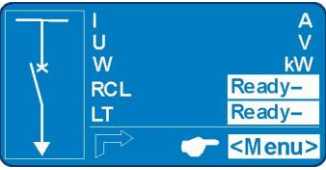Maximum demand values recorded starting from 100ms after closing of main Circuit Breaker (updated any time the breaker closes).

- 1 
 - Press “**Menu**” for access to the main menu with icons.
- 2 
 - Select “**MaxVal**” icon with pushbutton “**Increase**” or “**Decrease**”.
 - Press “**Select**” for access.
- 3 
 - Scroll the menu “**MaxVal**” with pushbutton “**Increase**” or “**Decrease**” to display the measure
 - Press “**Exit**” to go back to the main menu.



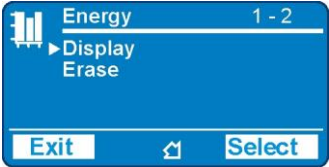

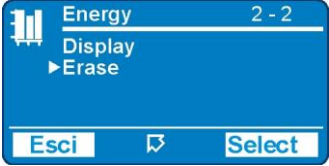

→ I	(0 ± 9999)	A	Line current
→ U	(0 ± 9999)	V	Line voltage
→ W	(0.00 ÷ 99.99 ÷ 999.9 ÷ 9999999)	kW	Power
→ Tem	(0 ÷ 9999)	%T	Thermal status as % of the full load continuous operation temperature Tn
→ Ig	(0 ± 9999)	A	Frame to ground fault current
→ Ug	(0 ± 9999)	V	Frame to ground fault voltage
→ Wir	(100 ÷ 0)	%W	Amount still remaining of permissible interruption energy before Circuit Breaker maintenance is requested.
→ A/ms	(0 ÷ 9999)		Current rate of raise
→ Rapp	(0 ÷ 1000)	Ω	Impedance monitoring

10. ENERGY

Real time energy measurements

Display	→ + kWh	(0 – 9999999)	Exported Energy
	→ - kWh	(0 – 9999999)	Imported Energy
Erase	→ All Energy counters are cleared		

When the measurement exceed “9999999” the counters restart from “0”.

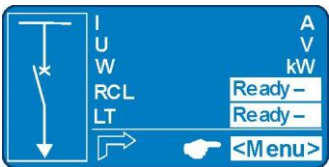- 
 - Press “**Menu**” for access to the main menu with icons.
- 
 - Select “**Energy**” icon with pushbutton “**Increase**” or “**Decrease**”.
 - Press “**Select**” for access.
- 
 - Select “**Display**” with pushbutton “**Increase**” or “**Decrease**”.
 - Press “**Select**” for access.
- 
 - Display of Real time Energy measurements.
 - Press “**Exit**” to go back to the level “3”.
- 
 - Select “**Erase**” with pushbutton “**Decrease**” to clear all reading.
 - Press “**Select**”. (if Password is request, see § Password).
- 
 - When command has been execute the display shows “**! Command Done**”; to go to the level “5”.
 - Press “**Exit**” to go back to the main menu.

11. TRIP RECORDING




Display of the function which caused the tripping of the relay plus values of the measurement at the moment of tripping. The last 10 events are recorded.

The memory buffer is refreshed at each new relay tripping (FIFO logic).

Display	→	Reading of recorded Trips.
Erase	→	Clear all Trip recorded.

- 
 - Press "**Menu**" for access to the main menu with icons.
- 
 - Select "**TripRec.**" icon with pushbutton "**Increase**" or "**Decrease**".
 - Press "**Select**" for access.
- 
 - Select "**Display**" with pushbutton "**Increase**" or "**Decrease**".
 - Press "**Select**" for access.
 - For "**Erase**" go to "8"
- 
 - If no trip is recorded the display shows "**! No Trips**".
- 
 - If any trip was recorded, select "**View**" to display the chronological list of the records.
 - By the keys "**Increase**" or "**Decrease**" select the date of the record to be checked.
- 
 - Will be shown:
 - "**Descr**" the function that caused the event (Example: tWi> = Rise)
 - "**Edge**" if the function was tripped (Rise) or reset (Fall)
 - "**Date**", date of trip, year/month/day, hour:minutes:seconds:milliseconds
 - Press "**Value**", for reading the value of input quantities on tripping.

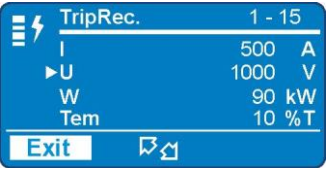

- 7
- 
- Scroll with pushbuttons "**Increase**" or "**Decrease**" the available measurements.
 - Select "**Exit**" to go back to "5" for another selection, or "2" go back to the main menu.
- 8
- 
- Select "**Erase**" with button "**Decrease**".
 - Press "**Select**" to execute the commands; **All** Trips recorded are erased. (if Password is request, see § Password).
- 9
- 
- When command has been executed the display shows "**! Command Done**";
 - Press "**Exit**" to go back to the main menu.



→ I	A	Line current
→ U	V	Line voltage
→ W	kW	Power
→ Tem	%T	Thermal status as % of the full load continuous operation temperature Tn
→ Ig	A	Frame to ground fault current
→ Ug	V	Frame to ground fault voltage
→ Wir	%W	Amount still remaining of permissible interruption energy before Circuit Breaker maintenance is requested.
→ RS-G	Ω	Cable Insulation resistance Screen/Ground
→ A/ms		Current rate of raise
→ Rapp	Ω	Impedance monitoring

12. PARTIAL COUNTERS


Partial counters of the number of operations for each of the relay functions.

Display	→ T>	0	Operations counters	Thermal Image
	→ 1l>	0	Operations counters	First overcurrent element
	→ 2l>	0	Operations counters	Second overcurrent element
	→ 3l>	0	Operations counters	Third overcurrent element
	→ 4l>	0	Operations counters	Fourth overcurrent element
	→ 1dl	0	Operations counters	First current step element
	→ 2dl	0	Operations counters	Second current step element
	→ 1di/dt	0	Operations counters	First current rate of rise element
	→ 2di/dt	0	Operations counters	Second current rate of rise element
	→ Rapp	0	Operations counters	Impedance monitoring (di/dt dependence)
	→ Iapp	0	Operations counters	Current monitoring with di/dt dependence
	→ 1lg	0	Operations counters	First Frame Fault element
	→ 2lg	0	Operations counters	Second Frame Fault element
	→ RS-G	0	Operations counters	Cable insulation (Screen-Ground)
	→ RCL	0	Operations counters	Automatic Reclosure
	→ LT	0	Operations counters	Automatic Line Test
	→ 1U>	0	Operations counters	First Overvoltage element
	→ 2U>	0	Operations counters	Second Overvoltage element
	→ 1U<	0	Operations counters	First Undervoltage element
	→ 2U<	0	Operations counters	Second Undervoltage element
	→ RT	0	Operations counters	First Remote Trip
	→ IRF	0	Operations counters	Internal Relay Fault
	→ TCS	0	Operations counters	Trip Circuit Supervision
	→ BrkF	0	Operations counters	Breaker failure to open
	→ Wi	0	Operations counters	Circuit Breaker maintenance alarm
	→ AutOp	0	Operations counters	Automatic C/B Open
	→ AutCL	0	Operations counters	Automatic C/B Close
	→ ManOp	0	Operations counters	Manual C/B Open
	→ ManCL	0	Operations counters	Manual C/B Close
	→ OvrOp	0	Operations counters	Overall C/B Open (Automatic + Manual)
	→ OvrCL	0	Operations counters	Overall C/B Close (Automatic + Manual)
	→ RTX	0	Operations counters	Second Remote Trip


Erase	→	Reset all Counters (By the interface program "MSCom 2" it is possible to individually reset the counters and set an initial starting number)
--------------	---	---

- 
 - Press "**Menu**" for access to the main menu with icons.
- 
 - Select "**Counter**" icon with pushbutton "**Increase**" or "**Decrease**".
 - Press "**Select**" for access.


- 3**




- Select "**Display**" with pushbutton "**Increase**" or "**Decrease**".
 - Press "**Select**" for access.
 - For "**Erase**" to go to "5"
- 4**

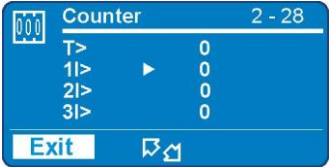

- Display of the number of operations of each individual function.
 - With pushbuttons "**Increase**" or "**Decrease**" scroll the parameters
 - Press "**Exit**" go back to "3".
- 5**



- Select "**Erase**" with pushbutton "**Decrease**".
 - Press "**Select**".
(if Password is request, see § Password).
- 6**

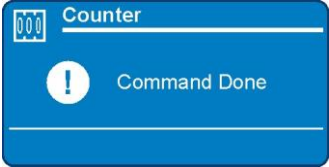
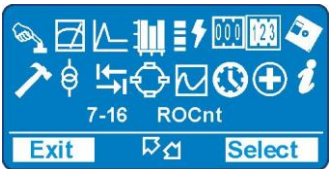
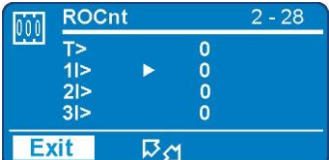


- When command has been executed the display shows "**! Command Done**"; and return to "5".
 - With pushbutton "**Exit**" to go back to the main menu.

13. TOTAL COUNTERS

Counters of the total number of operation of each individual function.
These counters cannot be reset

Display	→ T>	0	Operations counters	Thermal Image
	→ 1l>	0	Operations counters	First overcurrent element
	→ 2l>	0	Operations counters	Second overcurrent element
	→ 3l>	0	Operations counters	Third overcurrent element
	→ 4l>	0	Operations counters	Fourth overcurrent element
	→ 1dl	0	Operations counters	First current step element
	→ 2dl	0	Operations counters	Second current step element
	→ 1di/dt	0	Operations counters	First current rate of rise element
	→ 2di/dt	0	Operations counters	Second current rate of rise element
	→ Rapp	0	Operations counters	Impedance monitoring (di/dt dependence)
	→ lapp	0	Operations counters	Current monitoring with di/dt dependence
	→ 1lg	0	Operations counters	First Frame Fault element
	→ 2lg	0	Operations counters	Second Frame Fault element
	→ RS-G	0	Operations counters	Cable insulation (Screen-Ground)
	→ RCL	0	Operations counters	Automatic Reclosure
	→ LT	0	Operations counters	Automatic Line Test
	→ 1U>	0	Operations counters	First Overvoltage element
	→ 2U>	0	Operations counters	Second Overvoltage element
	→ 1U<	0	Operations counters	First Undervoltage element
	→ 2U<	0	Operations counters	Second Undervoltage element
	→ RT	0	Operations counters	First Remote Trip
	→ IRF	0	Operations counters	Internal Relay Fault
	→ TCS	0	Operations counters	Trip Circuit Supervision
	→ BrkF	0	Operations counters	Breaker failure to open
	→ Wi	0	Operations counters	Circuit Breaker maintenance alarm
	→ AutOp	0	Operations counters	Automatic C/B Open
	→ AutCL	0	Operations counters	Automatic C/B Close
	→ ManOp	0	Operations counters	Manual C/B Open
	→ ManCL	0	Operations counters	Manual C/B Close
	→ OvrOp	0	Operations counters	Overall C/B Open (Automatic + Manual)
	→ OvrCL	0	Operations counters	Overall C/B Close (Automatic + Manual)
	→ RTX	0	Operations counters	Second Remote Trip

- 
 - Press "**Menu**" for access to the main menu with icons.
- 
 - Select "**ROCnt**" icon with pushbutton "**Increase**" or "**Decrease**".
 - Press "**Select**" for access.
- 
 - With pushbuttons "**Increase**" or "**Decrease**" scroll the parameters.
 - With pushbutton "**Exit**" to go back to the main menu.


14. EVENTS


Display of the function which caused any of the following events: - *Status change of digital Inputs/Outputs.* - *Start of protection functions – Trip of protection function – Function reset.*


The last 100 events are recorded at pick-up (rise) or drop-out (fall).


The memory buffer is updated at each new event.


Display	→	Reading events recorded.
Erase	→	Clear all events recorded.

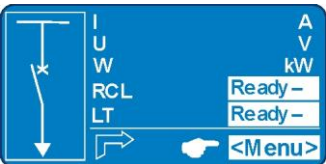
- 


- Press “**Menu**” for access to the main menu with icons.
- 


- Select “**Events**” icon with pushbutton “**Increase**” or “**Decrease**”.
 - Press “**Select**” for access.
- 

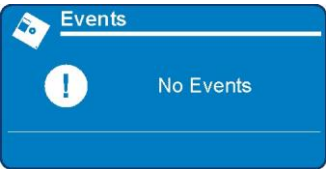- Select “**Display**” with pushbutton “**Increase**” or “**Decrease**”.
 - Press “**Select**” for access.
 - For “**Erase**” go to “7”
- 

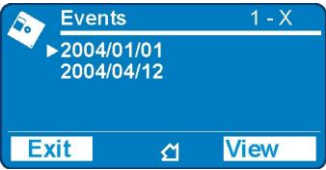- If no event is recorded the display shows message “**! No Events**”.
- 

- If any event was recorded, select “**View**” to display the chronological list of the records.
 - By the keys “**Increase**” or “**Decrease**” select the date of the record to be checked.
- 

- Will be shown:
 - “**Descr**” the function that caused the event (Example: 1I> = Start, t1I> = Trip)
 - “**Edge**” if the function was tripped (Rise) or reset (Fall)
 - “**Date**”, date of trip, year/month/day, hour:minutes:seconds:milliseconds
- 

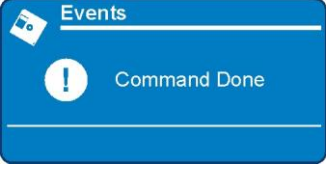- Select “**Erase**” with button “**Decrease**”.
 - Press “**Select**” to execute the commands; **All** Events recorded are erased. (if Password is request, see § Password).
- 

- When command has been execute the display shows “**! Command Done**”;
 - Press “**Exit**” to go back to the main menu.

14.1 – Events on display

Functions	Events Displayed	Events Description MScom2	Status	
T>	Tal	Tal (Alarm – Thermal Image T>)	Rise	
	T>	T> (Trip – Thermal Image T>)	Rise	Fall
1l>	1l>	1l> (Start - First overcurrent element F50-51)	Rise	
	t1l>	1l> (Trip - First overcurrent element F50-51)	Rise	Fall
2l>	2l>	2l> (Start – Second overcurrent element F50-51)	Rise	
	t2l>	2l> (Trip – Second overcurrent element F50-51)	Rise	Fall
3l>	3l>	3l> (Start – Third overcurrent element F50-51)	Rise	
	t3l>	3l> (Trip - Third overcurrent element F50-51)	Rise	Fall
4l>	4l>	4l> (Start - Fourth overcurrent element F50-51)	Rise	
	t4l>	4l> (Trip - Fourth overcurrent element F50-51)	Rise	Fall
1dl	1dl	1dl (Start - First Current Step Element)	Rise	Fall
	t1dl	1dl (Trip - First Current Step Element)	Rise	Fall
2dl	2dl	2dl (Start - Second Current Step Element)	Rise	Fall
	t2dl	2dl (Trip - Second Current. Step Element)	Rise	Fall
1di/dt	1di/dt	1di/dt (Start - First Current Rate of Rise Element)	Rise	Fall
	t1di/dt	1di/dt Trip - (First Current Rate of Rise Element)	Rise	Fall
2di/dt	2di/dt	2di/dt (Start - Second Current Rate of Rise Element)	Rise	Fall
	t2di/dt	2di/dt (Trip - Second Current Rate of Rise Element)	Rise	Fall
Rapp	Rapp	Rapp (Trip - Impedance monitoring-di/dt dependence)	Rise	Fall
lapp	lapp	lapp (Trip - Current monitoring-di/dt dependence)	Rise	Fall
1lg	1lg	1lg (Start - First Frame Fault Element)	Rise	Fall
	t1lg	1lg (Trip - First Frame Fault Element)	Rise	Fall
2lg	2lg	2lg (Start - Second Frame Fault Element)	Rise	Fall
	t2lg	2lg (Trip - Second Frame Fault Element)	Rise	Fall
RS-G	RS-G	RS-G (Start - Cable insulation (Screen-Ground))	Rise	Fall
	tRS-G	RS-G (Trip - Cable insulation (Screen-Ground))	Rise	Fall
RCL	RCL	RCL (Autoreclosure shot)	Rise	
	ARP	ARP (Autoreclosure in Progress)	Rise	
	ARF	ARF (Autoreclosure Failed)	Rise	
	ARL	ARL (Autoreclosure Lockout)	Rise	
LT	LT	LT (Line Test Command)	Rise	
1U>	1U>	1U> (Start - First Overvoltage Element F59)	Rise	
	t1U>	1U> (Trip - First Overvoltage Element F59)	Rise	
2U>	2U>	2U> (Start - Second Overvoltage Element F59)	Rise	
	t2U>	2U> (Trip - Second Overvoltage Element F59)	Rise	
1U<	1U<	1U< (Start - First Undervoltage Element F59)	Rise	
	t1U<	1U< (Trip - First Undervoltage Element F59)	Rise	
2U<	2U<	2U< (Start - Second Undervoltage Element F59)	Rise	
	t2U<	2U< (Trip - Second Undervoltage Element F59)	Rise	
Wi	tWi>	tWi> (Circuit breaker maintenance level)	Rise	
TCS	TCS	TCS (Start - trip coil supervision)	Rise	
	tTCS	tTCS (trip coil supervision)	Rise	Fall
IRF	IRF	IRF (Start - Internal Relay Failure)	Rise	
	tIRF	tIRF (Trip - Internal Relay Failure)	Rise	
RT	Start RT	RT (Start - First element Remote Trip)	Rise	
	Trip RT	tRT (Trip - First element Remote Trip)	Rise	
RTX	Start RTX	RTX (Second element Remote Trip)	Rise	
	Trip RTX	tRTX (Trip - Second element Remote Trip)	Rise	
BF	BF	BF (Breaker Failure)	Rise	Fall
L/R C/B Cmds	CB Open	Circuit Breaker (CB) intentional open	Rise	
	CB Close	Circuit Breaker (CB) intentional close	Rise	
	LocRemInc	Local Remote inconsistent	Rise	
CB-L	CB-L	Breaker close Blocked	Rise	
	CICBLTreq	Required Line Test for Intentional CB Close	Rise	
	CICBLTfail	Line Test for Intentional CB Close Failed	Rise	
	CICBLTok	Line Test for Intentional CB Close Successful	Rise	
	UpDateMon	Update Monitor	Rise	Fall
	IPU boot	IPU boot	Rise	

15. SYSTEM (System parameters)

Setting of system parameters.




CTs&PTs	Current Input	In	→	4000	A	(1 ÷ 9999)	step	1	A
									System Rated Current
	Voltage Input	Un	→	1000	V	(100 ÷ 10000)	step	10	V
									System Rated Voltage
	Ground Current	Ign	→	1000	A	(1 ÷ 9999)	step	1	A
									System Rated Ground Current
	Ground Voltage	Ugn	→	1000	V	(100 ÷ 10000)	step	10	V
									System Rated Ground Voltage

Setting Group	Group	→	1	(1 / 2)
----------------------	--------------	---	---	---------

- 
 - Press "**Menu**" for access to the main menu with icons.
- 
 - Select "**System**" icon with pushbuttons "**Increase**" or "**Decrease**".
 - Press "**Select**" for access.
- 
 - Select "**CTs&PTs**".
 - Press "**Select**" for access.
- 
 - Select "**In**" to modify the value, or press "**Decrease**".
 - Press "**Modify**" to modify the parameter.
(if Password is request, see § Password).
- 
 - The value appear as bold figure.
 - Use pushbuttons "**Increase**" or "**Decrease**" to set the value.
 - Press "**Write**" to confirm the value
- 
 - The value is now set.
 - To set a new value return to the point "4".
 - Press "**Exit**".
- 
 - The display show "**Confirm the change?**".
 - Choose "**Yes**" to convalidate the changes.
 - Choose "**No**" to **not** confirm the changes.
 - After set confirmation (or non confirmation) the display goes back to point "3".

16. SETTINGS

Two complete banks of settings of the programmable variables are available in the “**SETTING**” menu. Both “Group #1” and “Group #2” include the hereunder listed variables.

- 1   Indicates the Setting Group that is actually being modified.
-  This symbol indicates that the function aside is enabled; symbol missing indicates that the function is disabled.











→ Comunic.	Serial communication parameters
→ Customise	Visualization parameters
→ T>	Thermal Image
→ 1l>	First overcurrent Element
→ 2l>	Second overcurrent Element
→ 3l>	Third overcurrent Element
→ 4l>	Fourth overcurrent Element
→ 1dl	First current step element
→ 2dl	Second current step element
→ 1di/dt	First current rate of rise element
→ 2di/dt	Second current rate of rise element
→ Rapp	Impedance monitoring - di/dt dependence
→ lapp	Current monitoring with di/dt dependence
→ 1lg	First Frame Fault element
→ 2lg	Second Frame Fault element
→ RS-G	Cable insulation (Screen-Ground)
→ RCL	Automatic Reclosure
→ LT	Automatic Line Test
→ 1U>	First Overvoltage Element
→ 2U>	Second Overvoltage Element
→ 1U<	First Undervoltage Element
→ 2U<	Second Undervoltage Element
→ Wi	Amount of Energy to reach the C/B maintenance level
→ TCS	Setting variables for Trip Circuit Supervision
→ IRF	Internal Relay Fault
→ RT	First Remote Trip
→ RTX	Second Remote Trip
→ BreakerFail	Setting variables for Breaker Failure detection
→ Wh	Energy counter Pulse
→ Oscillo	Setting variables for Oscillographic recording
→ L/R CB Cmds	C/B command Local / Remote setting
→ CB-L	Locks C/B reclosure
→ LT	Line Test
→ ExtResCfg	Configuration for external reset input

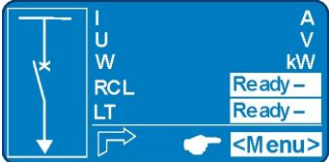

16.1 - Modifying the setting of variables

To modify any variable setting by the keyboard proceed as follows:

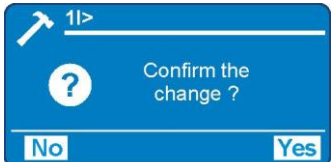(example: change setting of element "1l>", from "Is 4.000 In" to "Is 3.500 In")

- | | | | |
|--|---|--|--|
| <p>1</p>  | <ul style="list-style-type: none"> Press "Menu" for access to the main menu with icons. | <p>6</p>  | <ul style="list-style-type: none"> The value appear as bold figure. |
| <p>2</p>  | <ul style="list-style-type: none"> Select icon "Setting" by pushbuttons "Increase" or "Decrease". Press "Select". | <p>7</p>  | <ul style="list-style-type: none"> Set new values pushbuttons "Increase" or "Decrease" buttons Press "Write". |
| <p>3</p>  | <ul style="list-style-type: none"> Select by pushbuttons "Increase" or "Decrease" the parameter "1l>". Press "Select". | <p>8</p>  | <ul style="list-style-type: none"> If the change of parameters is completed, press "Exit". |
| <p>4</p>  | <ul style="list-style-type: none"> Select by buttons "Increase" or "Decrease" the menu "Oper.Levels". Press "Select". | <p>9</p>  | <ul style="list-style-type: none"> "Yes" confirm all changes. "No" voids all the changes. |
| <p>5</p>  | <ul style="list-style-type: none"> The arrow aside "Is" shows the parameter selected for changing Press "Modify". If Password is request, see § Password | <p>10</p>  | <ul style="list-style-type: none"> The relay returns to point "4". |









16.2 - Password


The password is requested any time the user wishes to modify any password protected parameter (example "1I>" menu "Setting").


The factory default password is "1111".


The password is only modifiable with "MCom II" software (see Manual "MCom II").



When password is requested, proceed as follows:

- | | | | |
|--|--|---|---|
| 1  | <ul style="list-style-type: none"> Use the key "Increase" and "Decrease" and set the first digit of password. | 5  | <ul style="list-style-type: none"> Use the key "Increase" or "Decrease" to set the third digit. |
| 2  | <ul style="list-style-type: none"> Press "Next" to validate and go to the next digit. | 6  | <ul style="list-style-type: none"> Press "Next" to validate and go to the next digit. |
| 3  | <ul style="list-style-type: none"> Use the key "Increase" or "Decrease" to set second digit. | 7  | <ul style="list-style-type: none"> Use the key "Increase" or "Decrease" to set the fourth digit. |
| 4  | <ul style="list-style-type: none"> Press "Next" to validate and go to the next digit. | 8  | <ul style="list-style-type: none"> Press "Next" to validate and go to modify the next parameter. |

 By key "**Prev**" go back to previous digit.

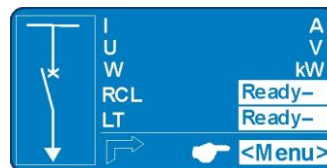 The password validity expires 60 sec after the last setting modification or as soon as you go back to the main menu



- | | | | |
|--|--|---|---|
| 1  | <ul style="list-style-type: none"> If set the incorrect password the display shows "! Wrong code". | 2  | <ul style="list-style-type: none"> The display will repeat the initial interrogation |
|--|--|---|---|



16.3 – Menu: **Communic.** (Communication)

Options	→ BRLoc	38400	[9600 / 19200 / 38400 / 57600]
	→ BRRem	19200	[9600 / 19200 / 38400]
	→ PRRem	Modbus	[Modbus / IEC103]
Node Address	→ Addr.	1	[1 ÷ 255]


16.3.1 – Description of variables

- ❑ **BRLoc** : RS232 local (Front Panel) serial communication speed
- ❑ **BRRem** : RS485 remote (Rear terminal block) serial communication speed
- ❑ **PRRem** : Protocol for remote (Rear terminal block) serial communication RS485
- ❑ **Addr.** : Identification number for the connection on serial communication bus

16.3.2 – Front Panel serial communication port (RS232)

A D-Sub, -pin female socket is available on Relay's front face for connection to the local RS232 serial communication line. Through this port - and by the interface program available from Microelettrica Scientifica S.p.A. (MCom II for Windows 98/ME/2000/XP) – it is possible to connect a Personal Computer to download all available information, operate any control and program the relay; the protocol used is "Modbus RTU".

16.3.3 – Cable for direct connection of Relay to Personal Computer

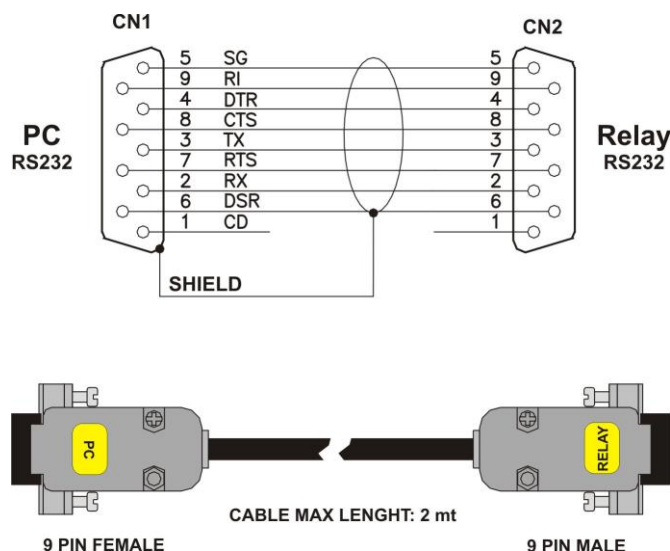

16.3.4 – Main serial communication port (RS485)

From the Relay's back terminal board, a RS485 ports is available for communication with SCADA system with Protocol Modbus RTU or IEC60870-5-103 (selectable).

The communication interface allows to program all settings, operate all commands and download all information and records.

The physical connection can be via a normal pair of wires (RS485) or, on request, via fiber optic.



16.4 - Menu: **Customise**

Options	→ Lang	English	[English / Loc.Lang]
	→ Ligth	On	[Autom. / On]
	→ Menu	Standard	[Standard / Extended]

16.4.1 – Description of variables


- ☐ **Lang** : Set Language
- ☐ **Light** : Set Display backlight
- ☐ **Menu** : Set Menu


This menu allows to customize the Language and the Display's backlight.


The standard languages are English and Italian. On request, other languages can be loaded (French, German, etc.).


The Display backlight can be programmed always on "ON" or switched-on "Automatically" for a few second at any operation of the keyboard "Auto".


Example: set Local Language.

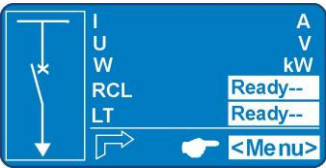
- 


 - Press "**Menu**" for access to the main menu with icons.
- 

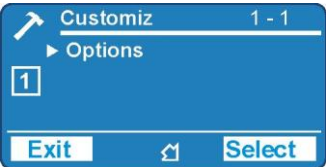
 - Select icon "**Setting**" by pushbuttons "**Increase**" or "**Decrease**".
 - Press "**Select**".
- 

 - Select "**Bank 1**" or "**Bank 2**".
 - Select "**Customize**".
 - Select "**Options**".
 - Press "**Select**".
- 

 - Select "**Lang**".
 - Press "**Modify**".
- 

 - Select "**Loc.Lang**".
 - Press "**Write**".
 - If Password is requested, see § Password
- 

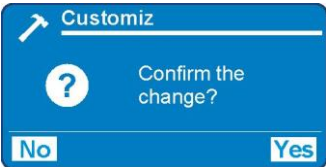 - Press "**Exit**".
- 

 - "**Yes**" confirms all changes.
 - "**No**" void all changes.
- 

 - After set confirmation the display shows "**Please Wait**".



16.5 - Function: **T>** (Thermal Image F49)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper.Levels	→ Tal	50	%Tn [10 ÷ 100] step 1 %Tn
	→ Is	1	In [0.5 ÷ 1.5] step 0.010 In
	→ Kt	300	min [1 ÷ 600] step 0.010 min

16.5.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the “T>” function.
- ☐ **Tal** : Temperature prealarm level
- ☐ **Is** : Continuous admissible current
- ☐ **Kt** : Warming-up Time Constant of the load

16.5.2 - Trip and Alarm

The algorithm compares the amount of heat accumulated “T” ($\equiv i^2 \cdot t$) to the steady state amount of heat “Ts” corresponding to continuous operation at the continuously admissible current “Is”. When the ratio “T/Ts” reaches the level set for Thermal Alarm “Tal” of the max allowed heating, the relay trips accordingly

16.5.2.1 – Trip time of the Thermal Image Element


The trip time of the Thermal Image Element is a function of the current “I” flowing into the load and depends on its warming-up Time Constant “Kt”, on the previous thermal status “Ip” and on the maximum admissible continuous current “Is” according to the equation:

t	=	Time to relay tripping	
Kt	=	Load thermal time constant	
I	=	Actual load current	
In	=	Load rated current	
Is	=	Continuous admissible current	
Ip	=	Steady state current before the overload	
ℓ_n	=	Natural Logarithm	

$$t = Kt \cdot \ell_n \frac{\left(\frac{I}{In}\right)^2 - \left(\frac{Ip}{In}\right)^2}{\left(\frac{I}{In}\right)^2 - \left(\frac{Is}{In}\right)^2}$$

When the heating exceeds the set alarm level “Tal” or the max. allowed level (“I” > “Is” for the time “t”) the output relays programmed for these function will be operated. Reset will take place when the heating will drop below 95% of the trip level.

16.5.2.2 – Thermal Image Curves (TU1024 Rev.1)

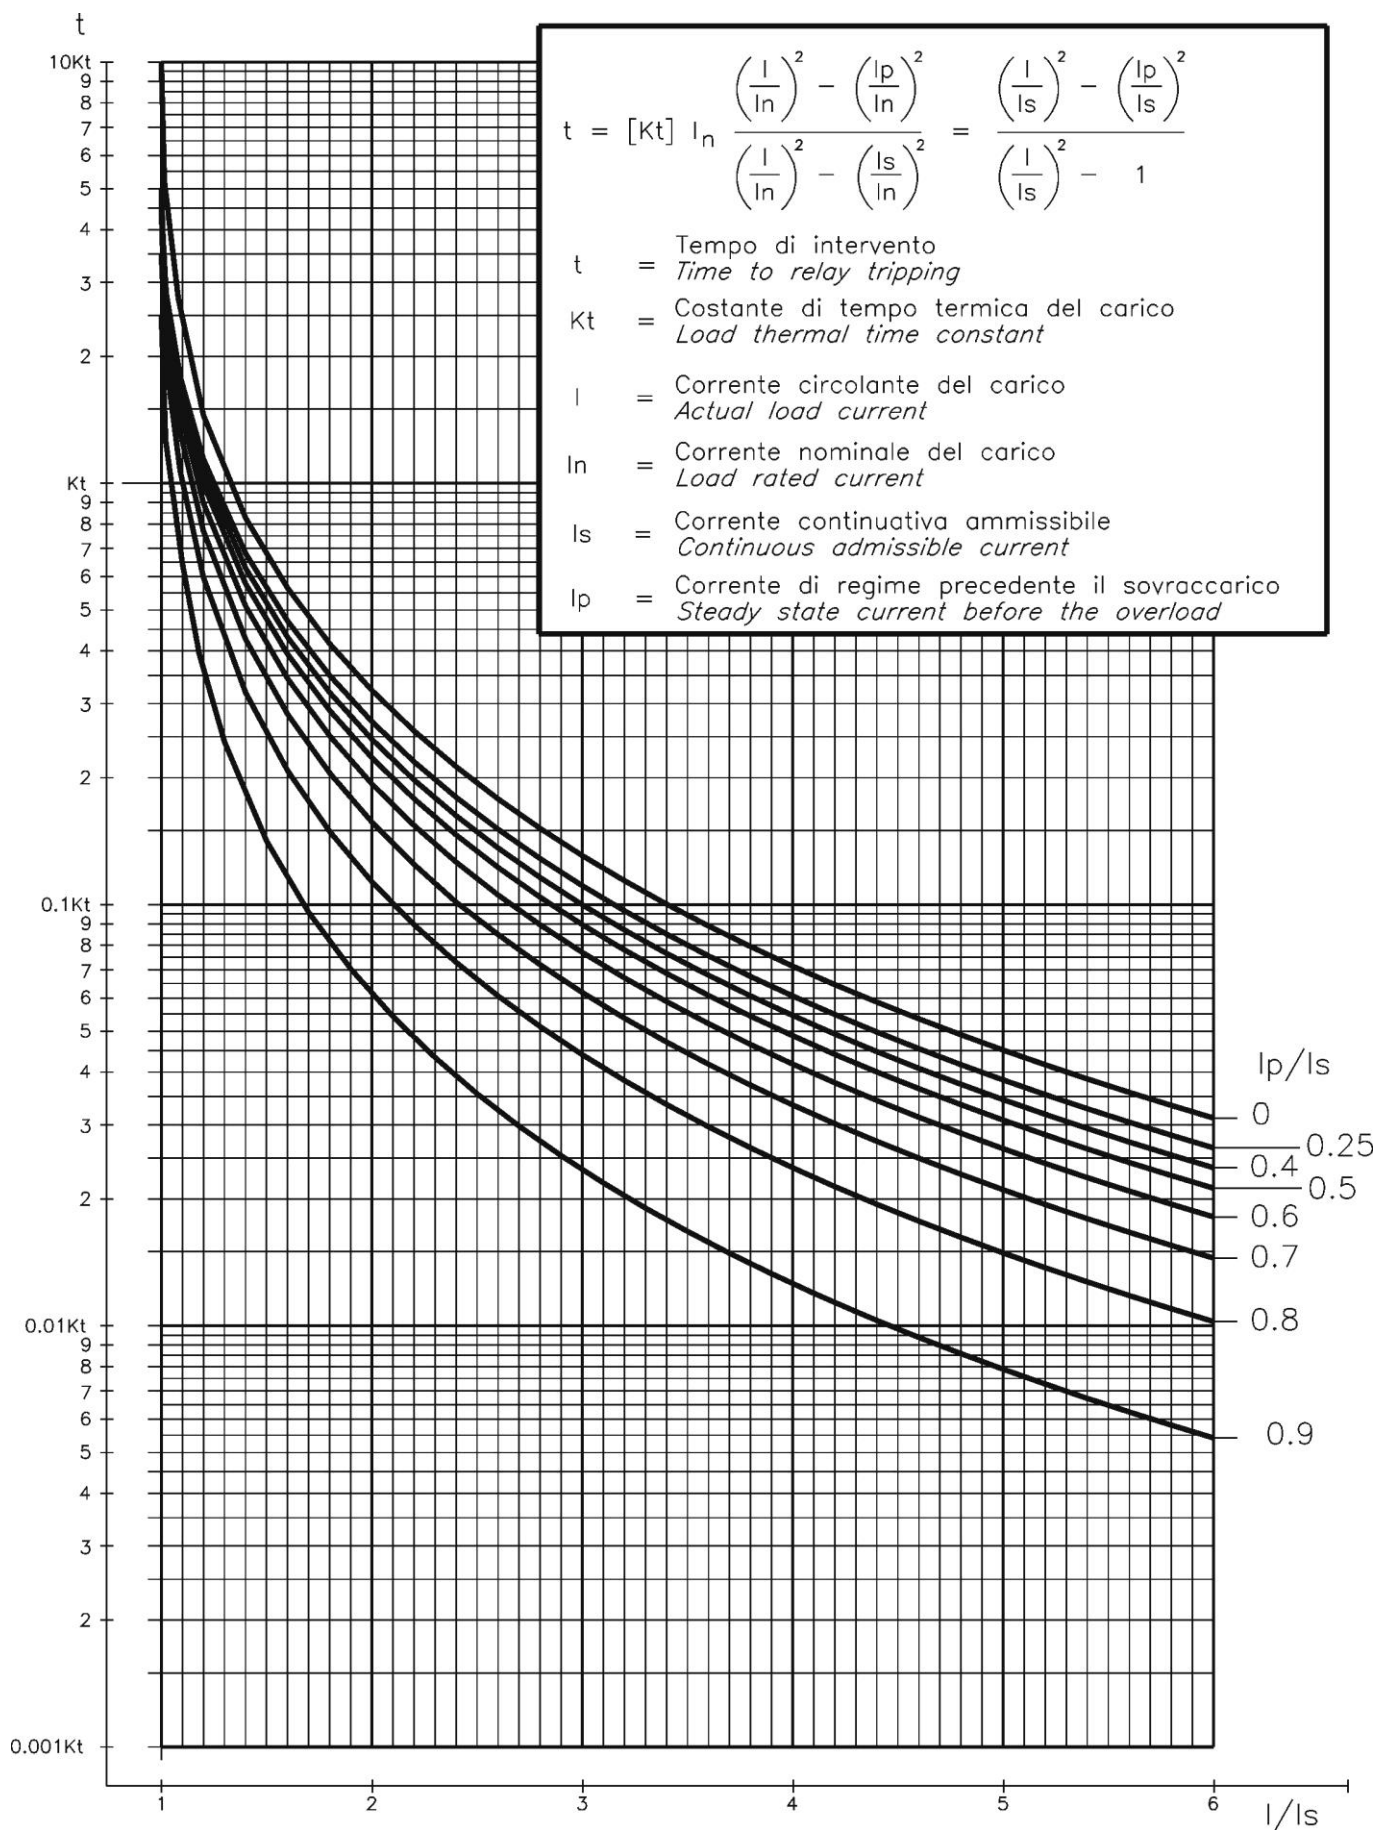


16.6 - Function: 1I> (First Overcurrent Element F50/51)

Status	→ Enab.	No	[No / Yes]	
Options	→ f(t)	Type - D	[D / A / B / C]	
	→ tBI	Disable	[Disable / 2tBO]	(1)
	→ f(a)	Disable	[Disable / Fw / Rev]	
	→ A/T	Trip	[Trip / Alarm]	
	→ RCL	No	[No / Yes]	
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]	
Oper. Levels	→ Is	4	In	(0.100÷4) step 0.01 In
Timers	→ ts	100	s	(0.01÷100) step 0.01 s
	→ tBO	0.75	s	(0.05÷0.75) step 0.01 s (1)

16.6.1 - Description of variables

- ❑ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ❑ **f(t)** : Operation characteristic (Time/Current curve): (see § 16.6.2)
 - (D) = Independent definite time
 - (A) = IEC Inverse Curve type A
 - (B) = IEC Very Inverse Curve type B
 - (C) = IEC Extremely Inverse Curve type C
- ❑ **tBI** : Blocking input reset time (see § 16.6.7)
 - Disable = Permanent block
 - 2tBO = Set 2xtBO.
- ❑ **f(a)** : Operation mode: (see § 16.6.5)
 - Disable = Non Directional
 - Fw = Directional Forward
 - Rev = Directional Reverse
- ❑ **A/T** : If “A/T = Trip” tripping of the function operates the signal led that needs manual reset.
If “A/T = Alarm” the signal led flashes as long as the function is in operation and extinguishes after tripping.
- ❑ **RCL** : If “RCL = Yes”, after tripping of the element “1I>” and Opening of the Circuit Breaker, the relay starts an automatic Line Test and a reclosure cycle.
If “RCL = No” no test and no reclosure is started.
- ❑ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ❑ **Is** : Minimum operation level
- ❑ **ts** : Trip time delay
- ❑ **tBO** : Time to reset of the Blocking Output after expiring of the Trip time delay. “tBO” is also the trip time delay of the Breaker Failure function. (see § 16.6.7)

16.6.2 - Algorithm of the time current curves

The Time Current Curves are generally calculated with the following equation

$$(1) \quad t(I) \left[\frac{A}{\left(\frac{I}{I_s}\right)^a} + B \right] \cdot K \cdot T_s + T_r \quad \text{where}$$

$t(I)$ = Actual trip time delay when the input current equals "I"

I_s = Set minimum pick-up level

$$K = \left(\frac{A}{10^a - 1} + B \right)^{-1}$$

T_s = Set time delay: $t(I) = T_s$ when $\frac{I}{I_s} = 10$

T_r = Operation time of the output relay on pick-up.

The parameters A, B and a have different values for the different Time Current Curves.

Curve Name	Curve Identifier	A	B	a
IEC A Inverse	A	0.14	0	0.02
IEC B Very Inverse	B	13.5	0	1
IEC C Extremely Inverse	C	80	0	2

For the IEC curves, being $B = 0$, the Time/Current equation (1), becomes:

$$(1') \quad t(I) = \frac{(10^a - 1)T_s}{\left(\frac{I}{I_s}\right)^a - 1} + T_r = \frac{Kt}{\left(\frac{I}{I_s}\right)^a - 1} + T_r$$


Where $Kt = (10^a - 1)T_s$ is the time multiplier

When " $f(t) = D$ " is programmed, the trip time delay is Definite and independent from the current: excess " $t = T_s$ ".

The maximum measuring current is "40xIn" for phase elements and "10xOn" for the neutral elements.

Trip takes place when the current measured exceeds (no matter how much) the set level " I_s " for the set time " T_s ".

16.6.3 - IEC Curves

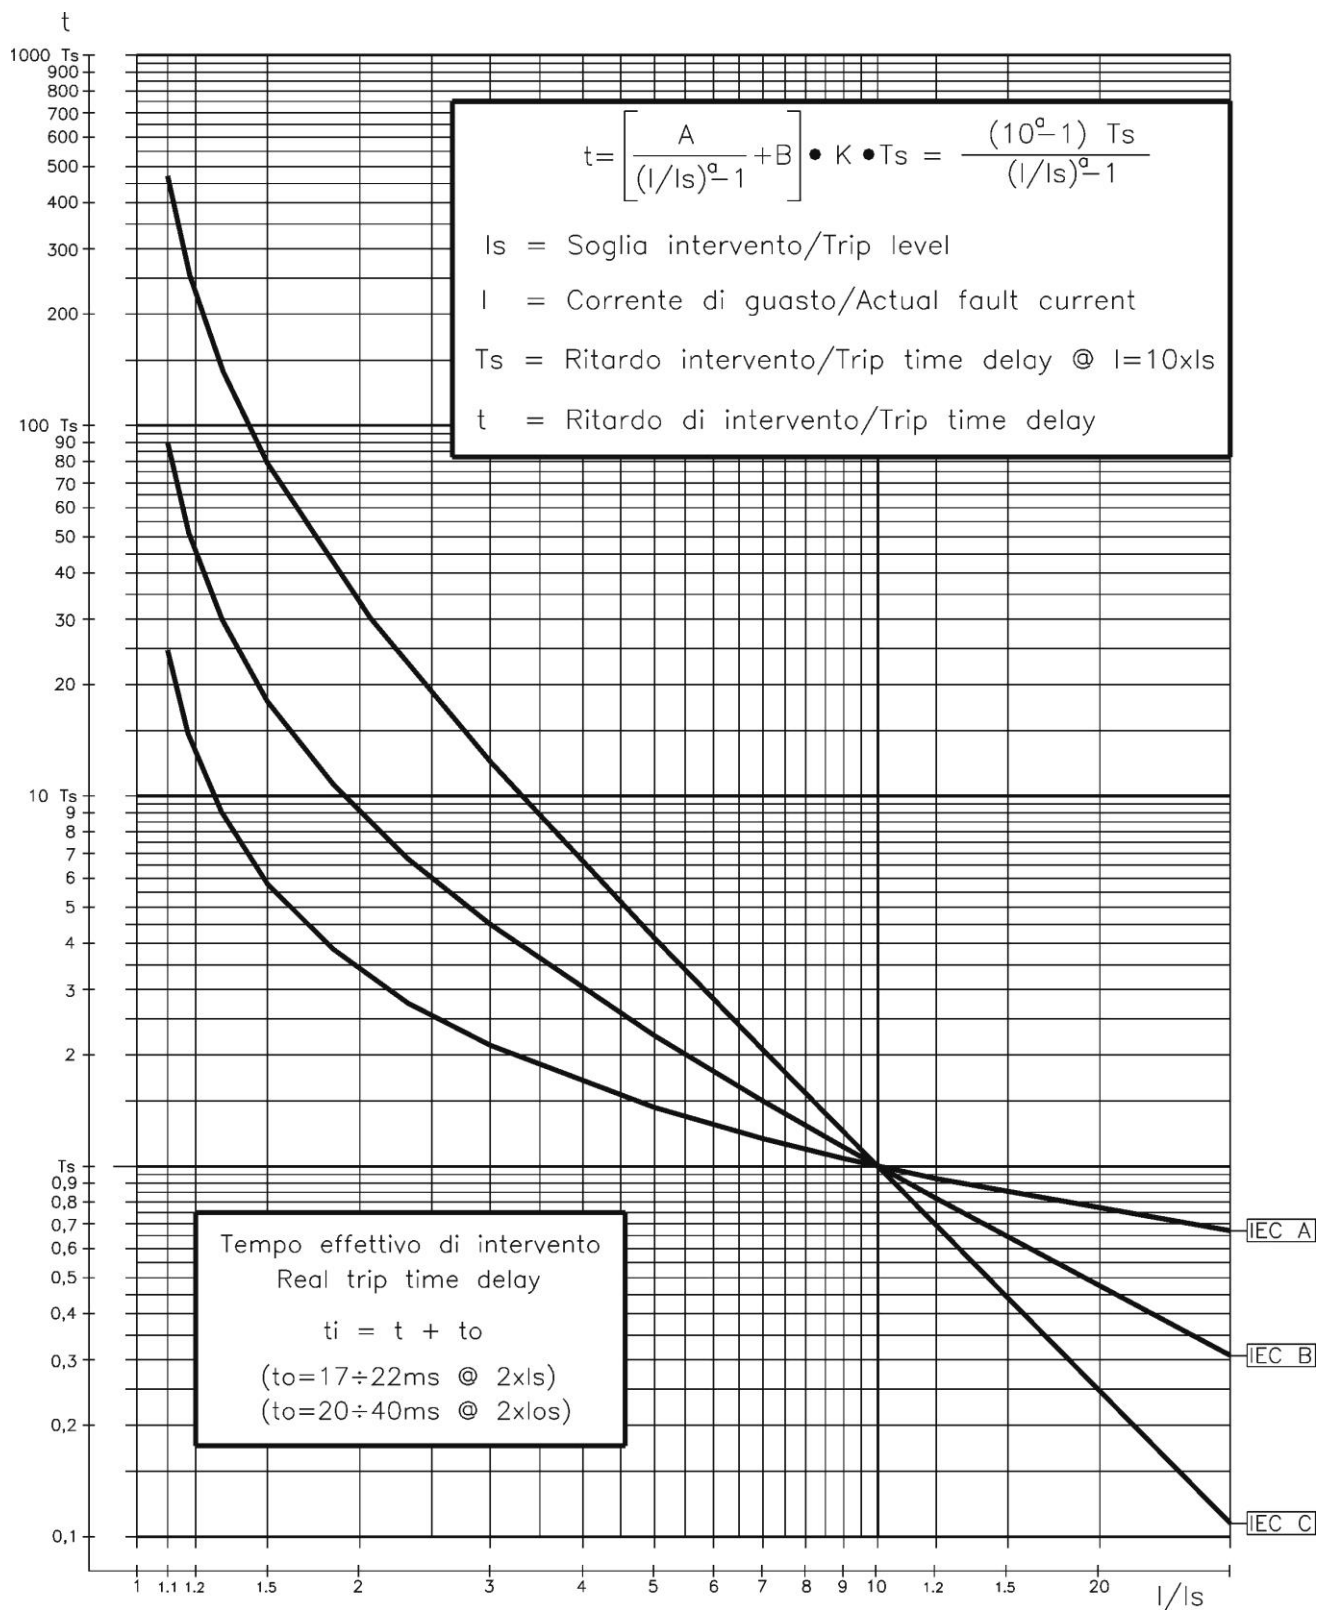

Curve Type	A	B	K	a
IEC A	0.14	0	0.336632	0.02
IEC B	13.5	0	0.666667	1
IEC C	80	0	1.2375	2

Max. "I" Phase = $40 \times I_n$
 Max. "I" Neutral = $10 \times I_n$

16.6.4 – Blocking Logic (BO-BI)

For each Protection Function it is possible to activate a Blocking Logic allowing for inhibiting their operation by external signals supplied to the Digital Input.

16.6.4.1 – Output Blocking signal “BO”

All the protection functions that can be programmed to operate in the blocking logic mode, element, have an instantaneous element (beside the time delayed) which is operated as soon as the controlled quantity exceeds the set trip level ($I > [I_s]$ for current, etc..) and is instantaneously reset when the input quantity drops below the reset level (normally $0.95I_s$).

The instantaneous element can control one of the user programmable output relays that, by its contacts, makes the signal available for blocking an external element (BO = Blocking Output). In case, “tBO” sec after the set trip time “ts” has expired, the Protection function is still in operation (current above trip level), the Blocking Output relay (instantaneous element) is anyhow reset to eventually remove the Blocking signal from a back-up protection.

16.6.4.2 – Blocking Input “BI”

For all the functions controllable by the Blocking Logic, it is possible to inhibit the time delayed tripping by an external signal that activates a Digital Input programmed for this functionality. The programmed Digital Input gets activated by an external cold contact closing across its terminals.

With the variable “tBI” set to “OFF” (tBI=OFF), the tripping of the delayed function is blocked as long as the Blocking Input signal is present at the terminals of the Digital Input.

With the variable “tBI” set to “2xtBI” (tBI=2xtBI), 2xtBI seconds after the set trip time delay of the function has expired the blocking input is anyhow ignored and the function enabled to trip.

16.6.5 - Automatic doubling of Overcurrent thresholds on current inrush

For some of the phase Overcurrent functions it is possible to have the set trip level $[I_s]$ automatically doubled when strong inrush current is detected.

If at circuit Breaker switch-on (i.e. when the input current rises from zero to a minimum measurable value) the current increases from 0 to 1.5 times the rated value $[I_n]$ in less than 60ms, the set minimum pick-up level $[I_s]$ is dynamically doubled ($[I_s] \rightarrow [2I_s]$) and keeps this value until the input current drops below $1.25 \times I_n$ or the set time $[t_{2xI}]$ has elapsed.

This functionality is very useful to avoid spurious tripping of the instantaneous, or short-time delayed Overcurrent elements, that could be experienced at switch-on when energizing the feeder.


16.7 – Function: 2I> (Second Overcurrent Element F50/51)

Status	→ Enab.	No	[No / Yes]	
Options	→ f(t)	Type - D	[D / A / B / C]	
	→ tBI	Disable	[Disable / 2tBO]	(1)
	→ f(a)	Disable	[Disable / Fw / Rev]	
	→ A/T	Trip	[Trip / Alarm]	
	→ RCL	No	[No / Yes]	
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]	
Oper. Levels	→ Is	4	In (0.100÷4)	step 0.010 In
Timers	→ ts	100	s (0.01÷100)	step 0.01 s
	→ tBO	0.75	s (0.05÷0.75)	step 0.01 s (1)

16.7.1 - Description of variables

- **Enab.** : Function enabling (No = Disable / Yes = Enable)
- **f(t)** : Operation characteristic (Time/Current curve): (see § 16.6.2)
 - (D) = Independent definite time
 - (A) = IEC Inverse Curve type A
 - (B) = IEC Very Inverse Curve type B
 - (C) = IEC Extremely Inverse Curve type C
- **tBI** : Blocking input reset time (see § 16.6.7)
 - Disable = Permanent block
 - 2tBO = Set 2xtBO.
- **f(a)** : Operation mode: (see § 16.6.5)
 - Disable = Non Directional
 - Fw = Directional Forward
 - Rev = Directional Reverse
- **A/T** : If “A/T = Trip” tripping of the function operates the signal led that needs manual reset.
If “A/T = Alarm” the signal led flashes as long as the function is in operation and extinguishes after tripping.
- **RCL** : If “RCL = Yes”, after tripping of the element “2I>” and Opening of the Circuit Breaker, the relay starts an automatic Line Test and a reclosure cycle.
If “RCL = No” no test and no reclosure is started.
- **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- **Is** : Minimum operation level
- **ts** : Trip time delay
- **tBO** : Time to reset of the Blocking Output after expiring of the Trip time delay. “tBO” is also the trip time delay of the Breaker Failure function. (see § 16.6.7)


16.8 - Function: 3I> (Third Overcurrent Element F50/51)

Status	→ Enab.	No	[No / Yes]
Options	→ tBI	Disable	[Disable / 2tBO]
	→ f(a)	Disable	[Disable / Fw / Rev]
	→ A/T	Trip	[Trip / Alarm]
	→ CoF	Disable	[Disable / Enable]
	→ RCL	No	[No / Yes]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Is	10	In (0.100÷10) step 0.010 In
Timers	→ ts	100	s (0.01÷100) step 0.01 s
	→ tCoF	0.05	s (0.02÷0.20) step 0.01 s
	→ tBO	0.75	s (0.05÷0.75) step 0.01 s

16.8.1 - Description of variables

- ❑ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ❑ **tBI** : Blocking input reset time (see § 16.6.5)
Disable = Permanent block
2tBO = Set 2xtBO.
- ❑ **f(a)** : Operation mode: (see § 16.6.5)
Disable = Non Directional
Fw = Directional Forward
Rev = Directional Reverse
- ❑ **A/T** : If “A/T = Trip” tripping of the function operates the signal led that needs manual reset.
If “A/T = Alarm” the signal led flashes as long as the function is in operation and extinguishes after tripping.
- ❑ **CoF** : If “CoF = Enable”, any time the circuit breakers status changes from open to close the “3I>” element is enabled to trip instantaneously if the current exceeds the set value “Is” within the time “tCoF”. (Close On Fault Function)
- ❑ **RCL** : If “RCL = Yes”, after tripping of the element “3I>” and Opening of the Circuit Breaker, the relay starts an automatic Line Test and a reclosure cycle.
If “RCL = No” no test and no reclosure is started.
- ❑ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ❑ **Is** : Minimum operation level.
- ❑ **ts** : Trip time delay
- ❑ **tCoF** : Maximum duration of the Close on Fault function.
- ❑ **tBO** : Time to reset of the Blocking Output after expiring of the Trip time delay. “tBO” is also the trip time delay of the Breaker Failure function. (see § 16.6.7)



16.9 - Function: **4I>** (Fourth Overcurrent Element F50/51)

Status	→ Enab.	No	[No / Yes]
Options	→ tBI	Disable	[Disable / 2tBO]
	→ f(a)	Disable	[Disable / Fw / Rev]
	→ A/T	Trip	[Trip / Alarm]
	→ CoF	Disable	[Disable / Enable]
	→ RCL	No	[No / Yes]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Is	10	In (0.100÷10) step 0.010 In
Timers	→ ts	100	s (0.01÷100) step 0.01 s
	→ tCoF	0.05	s (0.02÷0.20) step 0.01 s
	→ tBO	0.75	s (0.05÷0.75) step 0.01 s

16.9.1 - Description of variables

- ❑ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ❑ **tBI** : Blocking input reset time (see § 16.6.5)
Disable = Permanent block
2tBO = Set 2xtBO.
- ❑ **f(a)** : Operation mode: (see § 16.6.5)
Disable = Non Directional
Fw = Directional Forward
Rev = Directional Reverse
- ❑ **A/T** : If “A/T = Trip” tripping of the function operates the signal led that needs manual reset.
If “A/T = Alarm” the signal led flashes as long as the function is in operation and extinguishes after tripping.
- ❑ **CoF** : If “CoF = Enable”, any time the circuit breakers status changes from open to close the “3I>” element is enabled to trip instantaneously if the current exceeds the set value “Is” within the time “tCoF”. (Close On Fault Function)
- ❑ **RCL** : If “RCL = Yes”, after tripping of the element “4I>” and Opening of the Circuit Breaker, the relay starts an automatic Line Test and a reclosure cycle.
If “RCL = No” no test and no reclosure is started.
- ❑ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ❑ **Is** : Minimum operation level.
- ❑ **ts** : Trip time delay
- ❑ **tCoF** : Maximum duration of the Close on Fault function.
- ❑ **tBO** : Time to reset of the Blocking Output after expiring of the Trip time delay. “tBO” is also the trip time delay of the Breaker Failure function. (see § 16.6.7)


16.10 - Function: 1dl (First Current Step Element)

Status	→ Enab.	No	[No / Yes]
Options	→ A/T	Trip	[Trip / Alarm]
	→ RCL	No	[No / Yes]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ DI	1000	A (100÷9990) step 10 A
	→ di	200	A/ms (4÷400) step 1 A/ms
Timers	→ tDI	100	ms (0÷500) step 1 ms
	→ tdi	20	ms (0÷100) step 1 ms

16.10.1 - Description of variables


- ❑ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ❑ **A/T** : If “A/T = Trip” tripping of the function operates the signal led that needs manual reset.
If “A/T = Alarm” the signal led flashes as long as the function is in operation and extinguishes after tripping.
- ❑ **RCL** : If “RCL = Yes”, after tripping of the element “1dl” and Opening of the Circuit Breaker, the relay starts an automatic Line Test and a reclosure cycle.
If “RCL = No” no test and no reclosure is started.
- ❑ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ❑ **DI** : Current step trip level
- ❑ **di** : Minimum di/dt level to start “ΔI” evaluation and detection reset level
- ❑ **tDI** : Trip time delay
- ❑ **tdi** : Detection reset time delay

16.10.2 - Operation of the Current step monitoring element

The timely detection of a current step allow to clear a near short circuit long before the current can reach the prospective peak value.

Protection Function Operation (see Fig. 1):

- Any time a current rate of rise exceeding the set value $[di]$ is detected the value of the current " i_{1b} " is recorded as reference basic value to evaluate the current step " $\Delta I = i - i_{1b}$ " and the timer " tDI " is started.
" di/dt " is evaluated every 1ms.
- If during $[tDI]$ the rate of rise " di/dt " never goes below the set level $[di]$ for a time longer than $[tdi]$, when $[tDI]$ expires, the difference $\Delta I = i - i_{1b}$ is measured and if " $\Delta I \geq [DI]$ " the protection function trips.
- If during $[tDI]$ the rate of rise " di/dt " goes below the set level $[di]$ for a time longer than $[tdi]$ (medium value during $[tdi]$), a new value of the current i_{2b} is recorded and, when $[tDI]$ expires. If the difference $\Delta I = i - i_{2b}$ measured is greater than $[DI]$, the protection function trips.

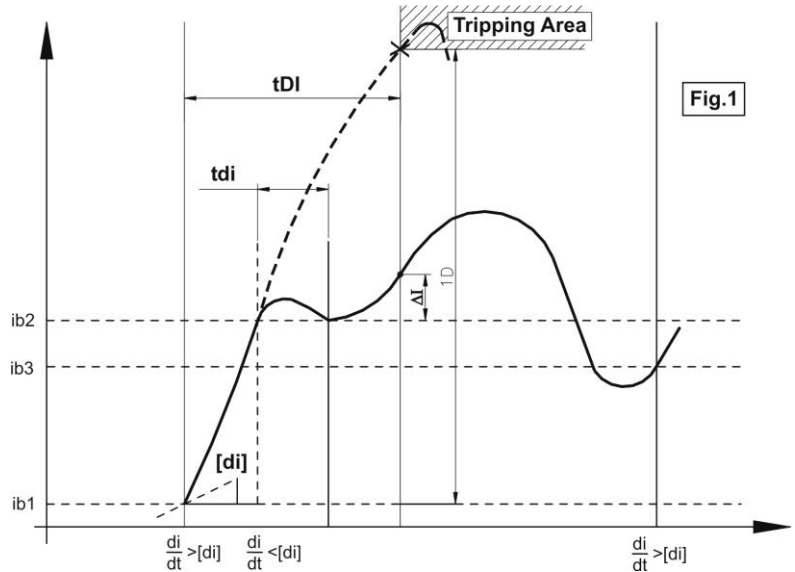

In terms of equation the protection function operation is as follow:

$$\text{If } \frac{di}{dt} \geq [di] \Rightarrow \left\{ \begin{array}{l} \text{Value of Current } i_{1b} \text{ is recorded} \\ \text{Timer } tDI \text{ is Started} \end{array} \right\} \Rightarrow \text{If During } tDI \Rightarrow$$

$$\Rightarrow \left\{ \begin{array}{l} \frac{di}{dt} \geq [di] \text{ during } tdi \Rightarrow \text{Trip if } \Delta = i - i_{1b} \geq [DI] \text{ after } tDI \\ \frac{di}{dt} < [di] \text{ during } tdi \Rightarrow \text{New Value of Current } i_{2b} \text{ is recorded} \Rightarrow \text{Trip if } \Delta = i - i_{2b} \geq [DI] \text{ after } tDI \end{array} \right.$$

If, at the end of $[tDI]$, the $[tdi]$ is not expired $\left(\frac{di}{dt} < [di] \right)$ the trip signal will not generated.

If, at the end of $[tDI]$ no trip occurs " ΔI " evaluation is stopped and will restart when the set " di/dt " level is exceeded.


16.11 - Function: 2dl (Second Current Step Element)

Status	→ Enab.	No	[No / Yes]
Options	→ A/T	Trip	[Trip / Alarm]
	→ RCL	No	[No / Yes]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ DI	1000	A (100÷9990) step 10 A
	→ di	200	A/ms (4÷400) step 1 A/ms
Timers	→ tDI	100	ms (0÷500) step 1 ms
	→ tdi	20	ms (0÷100) step 1 ms

16.11.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **A/T** : If “A/T = Trip” tripping of the function operates the signal led that needs manual reset.
If “A/T = Alarm” the signal led flashes as long as the function is in operation and extinguishes after tripping.
- ☐ **RCL** : If “RCL = Yes”, after tripping of the element “2dl” and Opening of the Circuit Breaker, the relay starts an automatic Line Test and a reclosure cycle.
If “RCL = No” no test and no reclosure is started.
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **DI** : Current step trip level
- ☐ **di** : Minimum di/dt level to start “ΔI” evaluation and detection reset level
- ☐ **tDI** : Trip time delay
- ☐ **tdi** : Detection reset time delay


16.12 - Function: $1di/dt$ (First Current Rate of Rise Element)

Status	→ Enab.	No	[No / Yes]
Options	→ A/T	Trip	[Trip / Alarm]
	→ RCL	No	[No / Yes]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ G	20	A/ms (4÷400) step 1 A/ms
Timers	→ tG	20	ms (2÷500) step 1 ms

16.12.1 - Description parameters

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **A/T** : If “A/T = Trip” tripping of the function operates the signal led that needs manual reset.
If “A/T = Alarm” the signal led flashes as long as the function is in operation and extinguishes after tripping.
- ☐ **RCL** : If “RCL = Yes”, after tripping of the element “ $1di/dt$ ” and Opening of the Circuit Breaker, the relay starts an automatic Line Test and a reclosure cycle.
If “RCL = No” no test and no reclosure is started.
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **G** : di/dt trip level
- ☐ **tG** : Trip time delay

16.12.2 - Operation of the current rate of rise monitoring element

This function is used to detect remote faults

Current is sampled at 1kHz, is measured as the average of 3 samples and stored in a buffer from which every 1ms the relay computes the average rate of rise in the set time delay:

$$\frac{di}{dt} = \sum_{(t-tG)}^t \frac{I_{(t)} - I_{(t-1)}}{tG}$$

if $\frac{di}{dt} \geq [G]$ the relay trip

in “Event Recorder” the pick-up of the function is recorded for “tG = 8” (average of 8 sample).


16.13 - Function: $2di/dt$ (Second Current Rate of Rise Element)

Status	→ Enab.	No	[No / Yes]
Options	→ A/T	Trip	[Trip / Alarm]
	→ RCL	No	[No / Yes]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ G	20	A/ms (4÷400) step 1 A/ms
Timers	→ tG	20	ms (2÷500) step 1 ms

16.13.1 - Description parameters

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **A/T** : If “A/T = Trip” tripping of the function operates the signal led that needs manual reset.
If “A/T = Alarm” the signal led flashes as long as the function is in operation and extinguishes after tripping.
- ☐ **RCL** : If “RCL = Yes”, after tripping of the element “ $1di/dt$ ” and Opening of the Circuit Breaker, the relay starts an automatic Line Test and a reclosure cycle.
If “RCL = No” no test and no reclosure is started.
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **G** : di/dt trip level
- ☐ **tG** : Trip time delay

16.13.2 - Operation of the current rate of rise monitoring element

This function is used to detect remote faults

Current is sampled at 1kHz, is measured as the average of 3 samples and stored in a buffer from which every 1ms the relay computes the average rate of rise in the set time delay:

$$\frac{di}{dt} = \frac{I_{(t+tG)} - I_{(t)}}{tG}$$

if $\frac{di}{dt} \geq [G]$ the relay trip


16.14 - Function: *Rapp* (Impedance monitoring - di/dt dependence)

Status	→ Enab.	No	[No / Yes]
Options	→ A/T	Trip	[Trip / Alarm]
	→ RCL	No	[No / Yes]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Va	400	V (0÷800) step 1 V
	→ Ri	0.100	Ω (0÷0.250) step 0.001 Ω
	→ Rt	1	Ω (0.001÷2.500) step 0.001 Ω
	→ Li	0.005	H (0.001÷0.010) step 0.001 H
	→ Lt	0.010	H (0.002÷0.050) step 0.001 H
	→ R*	50	Ω (0÷100) step 0.01 Ω
	→ g	50	A/ms (10÷500) step 1 A/ms
Timers	→ tr	50	ms (0÷100) step 1 ms

16.14.1 - Description of variables


- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **A/T** : If “A/T = Trip” tripping of the function operates the signal led that needs manual reset.
If “A/T = Alarm” the signal led flashes as long as the function is in operation and extinguishes after tripping.
- ☐ **RCL** : If “RCL = Yes”, after tripping of the element “Rapp” and Opening of the Circuit Breaker, the relay starts an automatic Line Test and a reclosure cycle.
If “RCL = No” no test and no reclosure is started.
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **Va** : Arc voltage.
- ☐ **Ri** : Internal Resistance = Resistance of the circuit upstream the Circuit Breaker.
- ☐ **Rt** : Total resistance of the circuit including the Contact Line.
- ☐ **Li** : Internal Inductance = Inductance of the circuit upstream the Circuit Breaker.
- ☐ **Lt** : Total Inductance of the circuit including the Contact Line.
- ☐ **R*** : Resistance trip level if di/dt ≥ g.
- ☐ **g** : Limit value of di/dt.
- ☐ **tr** : Trip time delay.

16.14.2 - Operation the Impedance monitoring element

The protection element shall trip if the impedance "Rapp" calculated as the ratio of the line voltage to the line current drops below the calculated value with the current rate of rise exceeding the level as reported on the trip characteristics. Trip takes place if the situation lasts longer than the set time delay "tr".

$$R_{app} = \left[V - \frac{R_i(V - V_a)}{R_t} + \left(\frac{L_t}{R_t} \cdot R_i - L_i \right) g \right] : \left(\frac{V - V_a}{R_t} - \frac{L_t}{R_t} \cdot g \right)$$

Reset takes place when "Rapp" is 10% higher than the trip value.

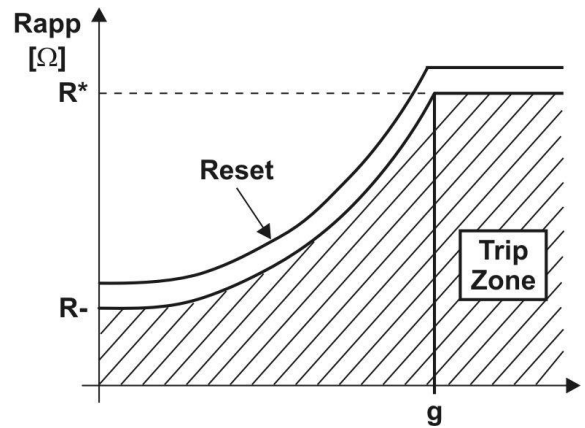

16.15 - Function: *lapp* (Current monitoring with di/dt dependence)

Status	→ Enab.	No	[No / Yes]
Options	→ A/T	Trip	[Trip / Alarm]
	→ RCL	No	[No / Yes]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ IA	1500	A (500÷5000) step 10 A
	→ I*	500	A (400÷1500) step 10 A
	→ g	50	A/ms (30÷500) step 1 A/ms
	→ Res	90	% (80÷100) step 1 %lapp
Timers	→ tr	0.1	s (0÷5.00) step 0.01 s

16.15.1 - Description of variables


- ❑ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ❑ **A/T** : If “A/T = Trip” tripping of the function operates the signal led that needs manual reset.
If “A/T = Alarm” the signal led flashes as long as the function is in operation and extinguishes after tripping.
- ❑ **RCL** : If “RCL = Yes”, after tripping of the element “lapp” and Opening of the Circuit Breaker, the relay starts an automatic Line Test and a reclosure cycle.
If “RCL = No” no test and no reclosure is started.
- ❑ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ❑ **IA** : Current trip level when di/dt = 0
- ❑ **I*** : Current trip level when di/dt ≥ [g]
- ❑ **g** : Limit value of di/dt
- ❑ **Res** : Drop-out percentage (operation reset)
- ❑ **tr** : Trip time delay.

16.15.2 - Operation of the “lapp” element

The protection shall trip if current measured exceeds the value [lapp] calculated as hereunder showed for longer than the set time “tr” reset takes place as soon as the current drops below $[lapp] \cdot \frac{Res}{100}$

$$lapp = - \left[\frac{IA - I^*}{g} \right] \cdot \frac{di}{dt} - [IA] \quad \text{if } 0 \leq \frac{di}{dt} \leq g$$

$$lapp = I^* \quad \text{if } \frac{di}{dt} > g$$

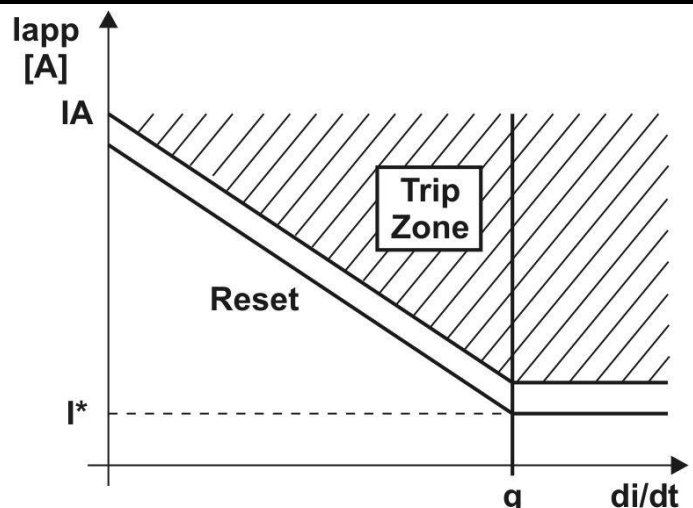

16.16 - Function: 1lg (First Frame Fault Element)

Status	→ Enab.	No	[No / Yes]
Options	→ f(t)	Type - D	[D / A / B / C]
	→ A/T	Trip	[Trip / Alarm]
	→ RCL	No	[No / Yes]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Is	1.00	Ign (0.10÷4.00) step 0.01 Ign
	→ Us	0.20	Ugn (0.01÷1.00) step 0.01 Ugn
Timers	→ ts	20	s (0.02÷100.00) step 0.01 s

16.16.1 - Description of variables

- ❑ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ❑ **f(t)** : Operation characteristic (Time/Current curve): (see § 16.6.2)
 - (D) = Independent definite time
 - (A) = IEC Inverse Curve type A
 - (B) = IEC Very Inverse Curve type B
 - (C) = IEC Extremely Inverse Curve type C
- ❑ **A/T** : If “A/T = Trip” tripping of the function operates the signal led that needs manual reset.
If “A/T = Alarm” the signal led flashes as long as the function is in operation and extinguishes after tripping.
- ❑ **RCL** : If “RCL = Yes”, after tripping of the element “1lg” and Opening of the Circuit Breaker, the relay starts an automatic Line Test and a reclosure cycle.
If “RCL = No” no test and no reclosure is started.
- ❑ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ❑ **Is** : Minimum operation level of frame to earth current.
- ❑ **Us** : Minimum operation level of frame to earth voltage.
- ❑ **ts** : Trip time delay

16.16.2 - Operation

Trip takes places if, for larger than the set time delay [ts], both the ground fault current “Ig” and the Voltage to ground “Ug” exceed the set values [Is] and [Us].

If “Is = 0” the relay shall consider “Ug” only, viceversa if “Ug = 0” the relay shall consider “Ig” only.

Setting		Tripping condition
Is	Us	
≠0	≠0	Ig>[Is] & Ug>[Us]
≠0	=0	Ig>[Is]
=0	≠0	Ug>[Us]

16.17 - Function: 2Ig (Second Frame Fault Element)

Status	→ Enab.	No	[No / Yes]
Options	→ f(t)	Type - D	[D / A / B / C]
	→ A/T	Trip	[Trip / Alarm]
	→ RCL	No	[No / Yes]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Is	1.00	Ign (0.10÷4.00) step 0.01 Ign
	→ Us	0.20	Ugn (0.01÷1.00) step 0.01 Ugn
Timers	→ ts	20	s (0.02÷100.00) step 0.01 s

16.17.1 - Description of variables

- ❑ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ❑ **f(t)** : Operation characteristic (Time/Current curve): (see § 16.6.2)
 - (D) = Independent definite time
 - (A) = IEC Inverse Curve type A
 - (B) = IEC Very Inverse Curve type B
 - (C) = IEC Extremely Inverse Curve type C
- ❑ **A/T** : If “A/T = Trip” tripping of the function operates the signal led that needs manual reset.
If “A/T = Alarm” the signal led flashes as long as the function is in operation and extinguishes after tripping.
- ❑ **RCL** : If “RCL = Yes”, after tripping of the element “2Ig” and Opening of the Circuit Breaker, the relay starts an automatic Line Test and a reclosure cycle.
If “RCL = No” no test and no reclosure is started.
- ❑ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ❑ **Is** : Minimum operation level
- ❑ **Us** : Minimum operation level
- ❑ **ts** : Trip time delay

16.17.2 - Operation

Trip take place if, for larger than the set time delay [ts], both the ground fault current “Ig” and the Voltage to ground “Ug” exceed the set values [Is] and [Us].

If “Is = 0” the relay shall consider “Ug” only viceversa if “Ug = 0” the relay shall consider “Ig” only.

Setting		Tripping condition
Is	Us	
≠0	≠0	Ig>[Is] & Ug>[Us]
≠0	=0	Ig>[Is]
=0	≠0	Ug>[Us]

16.18 - Function: RS-G (Cable insulation (Screen-Ground))


Status	→ Enab.	No	[No / Yes]
Options	→ RCL	No	[No – Yes]
	→ A/T	Trip	[Trip / Alarm]
Oper. Levels	→ RS-G	500 Ω	(100÷5000) step 100 Ω
Timers	→ tRS-G	0.1 s	(0.05÷100) step 0.01 s

16.18.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **A/T** : If “A/T = Trip” tripping of the function operates the signal led that needs manual reset.
If “A/T = Alarm” the signal led flashes as long as the function is in operation and extinguishes after tripping.
- ☐ **RCL** : If “RCL = Yes”, after tripping of the element “RS-G” and Opening of the Circuit Breaker, the relay starts an automatic Line Test and a reclosure cycle.
If “RCL = No” no test and no reclosure is started.
- ☐ **RS-G** : Trip level for Insulation Resistance between Conductor and screen.
- ☐ **tRS-G** : Trip time delay

16.18.2 - Operation

The relay receives from the (optional) external unit “A-MSG-1” the measurement of the leakage current and computes the resultant isolation resistance to ground “RS-G” of the Cable’s Screen. If the value of “RS-G” drops below the set level the relay trips after the set time delay “tRS-G”.

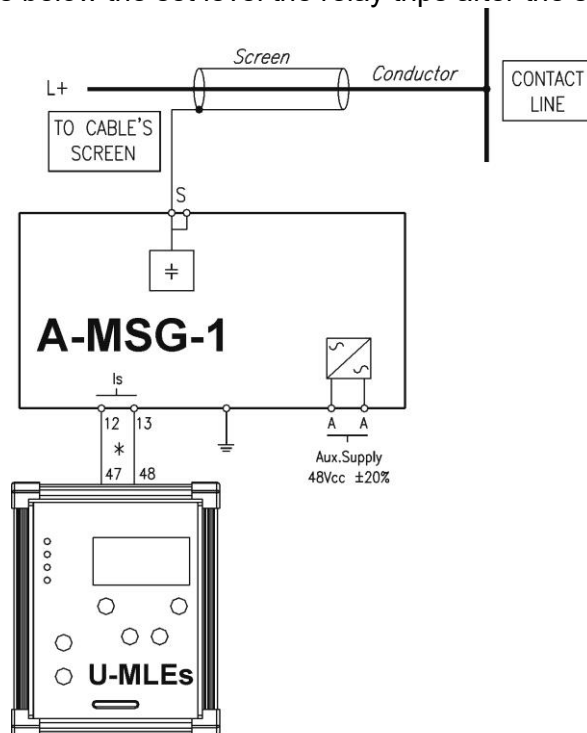

* Maximum connection cable length: <10mt (twisted pair)


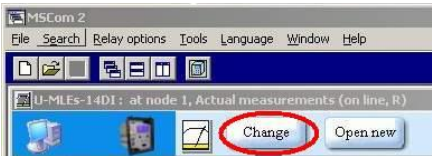





16.18.3 - Compensation of the inherent leakage current

Due to the natural capacitance between the cable's screen and ground, a small leakage current always flows in the monitoring circuit supplied by the A-MSG-1 unit.

To properly monitor the real deterioration of the screen-to-ground insulation and the value of the insulation resistance, the contribution of that inherent leakage current must be compensated when first installing the monitoring apparatus in the field.

The following procedure allows to do the initial compensation:

- ❑ The compensation can only be operated via the application software MCom2 loaded on a P.C. to be connected either via the RS232 port one relays front face or to the RS485 port available on the back side.

- 1  MCom2
 - Open application software MCom2 and connect the relay.
 - The measure window appear,
- 2 
 - Press "**Change**".
- 3 
 - Press "**Commands**"
- 4 
 - Double click on "**RS-G Zero Set**".
- 5 
 - Press "**Yes**"
- 6 
 - Insert the relay password when request.
- 7 
 - The inherent leakage current is set to zero.

16.19 - Function: RCL (Automatic Reclosure)

Status	→ Enab.	No	[No / Yes]
Options	→ ShNum	2	[1 / 2 / 3 / 4]
	→ Test	Yes	[No / Yes]
Timers	→ tr	10	s (1÷200) step 1 s
	→ t1	0.3	s (0.1÷1000) step 0.1 s
	→ t2	1	s (0.1÷1000) step 0.1 s
	→ t3	3	s (0.1÷1000) step 0.1 s
	→ t4	10	s (0.1÷1000) step 0.1 s

16.19.1 - Description of variables

- ❑ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ❑ **ShNum** : Number of reclosure shots to Lock-out
- ❑ **Test** : “Yes” - Before any reclosure the Line Test is started and the reclosure is operated only after a successful Line Test is carried-out.
“No” - Reclosure is operated without Line-Test.
- ❑ **tr** : Reclaim time. Any new trip during “tr” after a successful reclosure shot starts the next shot of the cycle.
Any new trip after “tr” restarts a complete cycle.


16.19.2 - Operation

- ❑ The status of the Circuit Breaker (C/B) is indicated by one normally open contact of the C/B itself and is detected by a digital input of the relay.
- ❑ A reclose shot is started after a C/B's opening operated by one of the relay's protection functions programmed to control this reclose shot; C/B's opening operated by one element not programmed to control the reclosure shot activates the Lock-out status of the Reclosure function.
- ❑ Any time the Circuit Breaker (C/B) is closed either manually or automatically the Reclaim time “tr” is started.
- ❑ After a manual closure of the C/B, operation time start or tripping of any of the relay protection elements during “tr”, makes the relay enter into the Lock-Out status (L.O.). In the L.O. status the relay, after breaker opening, does not produce any command for automatic reclose ; the lock-out status is shows on the display.
Reset from the L.O. status takes place when the C/B is opened and then manually reclosed or by operating the external reset command.
- ❑ If none of the relay protection elements is started during “tr” after a manual closure of the C/B, the relay is ready to start the Automatic Reclose Sequence.
- ❑ If “tr” is started by an automatic reclosure, the operation time start during “tr” and the tripping of any element programmed for the operation of the next reclosure makes the relay proceed with the reclosing cycle.

- ❑ After “tr” is expired the reclosing cycle restarts from the first reclosure (1C).
- ❑ Pick-up of the time start of any protection element, stops the counting down of “tr”; counting is restarted as soon as the element resets.
- ❑ As soon as the C/B is opened due to tripping of one of the relay’s elements programmed to initiate the next automatic reclose shot, the relevant reclose time delay (t1, t2, t3, t4) is started and at the end of this tx time the reclose command is issued by the relay. The C/B is then automatically reclosed and the reclaim time “tr” is started again. If during “tr” the C/B is again opened by a relay’s element programmed to initiate the next automatic reclose, the next reclose takes place after the relevant time tx; the C/B is reclosed and “tr” restarted. When the last Automatic Reclose shot of the sequence has been done, any further tripping during “tr” produces a relay’s lock-out status. If after any reclose shot no tripping takes place during “tr”, the Reclose Sequence is restarted from the beginning (starting from the first reclose shot 1C)

16.19.3 – Display Lock-out indication

If the variable "Lock" (§ CB-L) is set to "Enable", reclosing of the C/B is inhibited after a "Failed reclosure" or after a "Failed Line Test" (the symbol of a Locker appears on the display). The reset from the Lock-out status can be operated either by the keyboard via the "CB Unlock" command available in the menu "Local Commands" (§ Local Commands) or by an external command via the Digital Input programmed for "Ext.Reset".

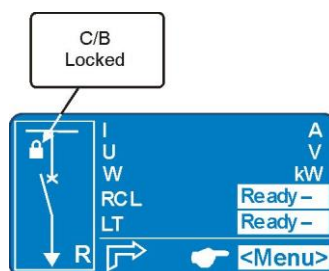


16.19.4 – Display status indication



Display of Reclosure status

- **Ready** Ready to operate
- **Active** Reclosure in progress
- **Fail** Failed Reclosure
- **Wait** Standby
- **ExtFail** Reclosure lock-out due to an External Failure (see flow chart RCL)
- **ManOpen** Manual Opening
- **ExtLock** External reclosure lock-out by digital input

16.19.4 - Flow chart RCL

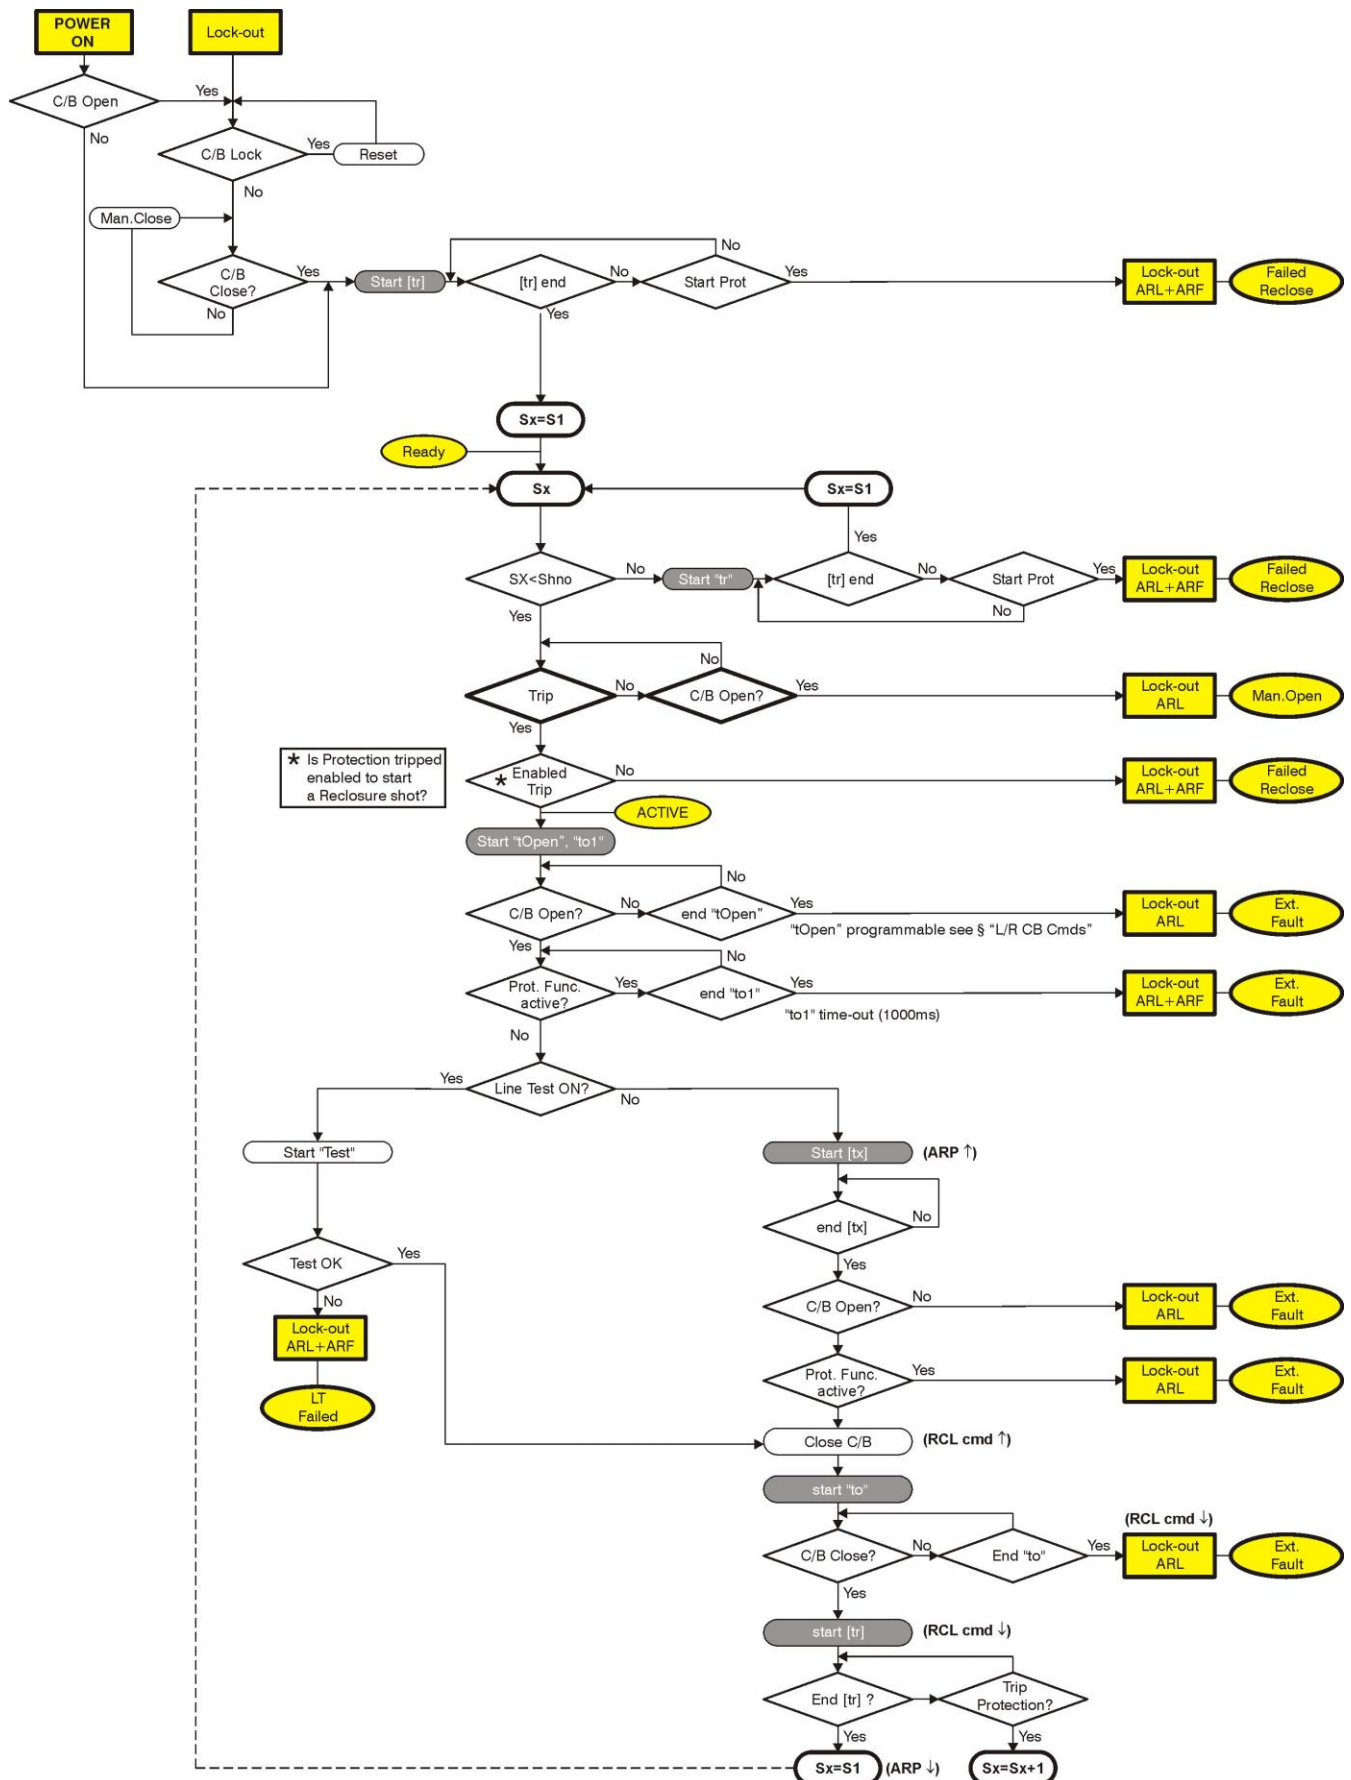


16.20 - Function: 1U> (First OverVoltage Element F59)

Status	→ Enab.	No	[No / Yes]
Options	→ A/T	Trip	[Trip / Alarm]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Us	1.10	Un (0.5÷1.50) step 0.01 Un
Timers	→ ts	10	s (0÷650) step 1 s

16.20.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **A/T** : If “A/T = Trip” tripping of the function operates the signal led that needs manual reset.
If “A/T = Alarm” the signal led flashes as long as the function is in operation and extinguishes after tripping.
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **Us** : Minimum operation level
- ☐ **ts** : Trip time delay

16.21 - Function: 2U> (Second OverVoltage Element F59)

Status	→ Enab.	No	[No / Yes]
Options	→ A/T	Trip	[Trip / Alarm]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Us	1.10	Un (0.5÷1.50) step 0.01 Un
Timers	→ ts	10	s (0÷650) step 1 s

16.21.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **A/T** : If “A/T = Trip” tripping of the function operates the signal led that needs manual reset.
If “A/T = Alarm” the signal led flashes as long as the function is in operation and extinguishes after tripping.
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **Us** : Minimum operation level
- ☐ **ts** : Trip time delay


16.22 - Function: 1U< (First UnderVoltage Element F27)

Status	→ Enab.	No	[No / Yes]
Options	→ A/T	Trip	[Trip / Alarm]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Us	0.70	Un (0.2÷1.00) step 0.01 Un
Timers	→ ts	10	s (0÷650) step 1 s

16.22.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **A/T** : If “A/T = Trip” tripping of the function operates the signal led that needs manual reset.
If “A/T = Alarm” the signal led flashes as long as the function is in operation and extinguishes after tripping.
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **Us** : Minimum operation level
- ☐ **ts** : Trip time delay

16.23 - Function: 2U< (Second UnderVoltage Element F27)

Status	→ Enab.	No	[No / Yes]
Options	→ A/T	Trip	[Trip / Alarm]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Us	0.70	Un (0.2÷1.00) step 0.01 Un
Timers	→ ts	10	s (0÷650) step 1 s

16.23.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **A/T** : If “A/T = Trip” tripping of the function operates the signal led that needs manual reset.
If “A/T = Alarm” the signal led flashes as long as the function is in operation and extinguishes after tripping.
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **Us** : Minimum operation level
- ☐ **ts** : Trip time delay


16.24 - Function: *Wi* (Circuit Breaker maintenance level)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ li	1.000	In (0.1÷99) step 0.1 In
	→ Wi	1.000	(1÷9999) step 1

16.24.1 - Description of variables

- **Enab.** : Function enabling (No = Disable / Yes = Enable)
- **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- **li** : Circuit Breaker Rated Current in multiples of the Relay rated input current In
- **Wi** : Maximum allowed amount of accumulated interruption energy before maintenance as stated by the C/B Manufactured.

16.24.2 - Operation (Accumulation of the interruption Energy)

The relay computes the Arc Energy developed during each interruption of the Circuit Breaker and accumulates these values.

When the amount of the accumulated energy exceeds a settable level the relay gives out an alarm to signalize that maintenance inspection of the Circuit Breaker is needed.

The operation of this function is based on the following parameters:

$$li = li = (0.1-99)In$$

$$Wi = Wi = (1 - 9999)$$

“Wi is set as a multiple of the conventional interruption energy unit.

Any time the Circuit Breaker opens (change of status from closed to open of the digital input connected to the normally open contact 52a of the C/B) the relay decreases the amount of energy corresponding to a number of conventional units:

$$nW_c = \frac{W}{W_c} = \frac{I^2 \cdot t_x}{li^2 \cdot t_i}$$

where:

W = $I^2 \cdot t_x$ Interruption Energy during the interruption time “tx” with interruption current “I”.

Wc = $li^2 \cdot t_i$ Conventional unit of interruption energy corresponding to C/B rated current and rated interruption time “ti”.

When the set Energy level before maintenance is decreased to zero a user programmable output relay is operated.

Reset to Zero of the Energy accumulation is available in the menu “**Local Cmd**” (Reset Term).



16.25 - Function: **TCS** (Trip Circuit Supervision)

Status	→ Enab.	No	[No / Yes]
Timers	→ ts	0.10	s (0.1÷100) step 0.01 s

16.25.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **ts** : Trip time delay

16.25.2 - Operation

The relay includes a complete Circuit Breaker Trip Circuit Supervision unit that is associated to the Contact "15-26" of the "R1" Output Relay.

The contact of "R1" is used to trip the C/B as reported in the drawing here below.

The supervision works when the C/B is closed and recognizes the Trip Circuit as sound as far as the current flowing exceeds "1mA".


In case of Trip Circuit Fault detection, the diagnostic relay is operated and the Led starts flashing (see § Signalization).

To have Supervision also with the C/B open one N/C contact (52b) from the C/B and an external resistor "R" are needed.

$$R[k\Omega] \leq \frac{V}{1mA} - R_{52} \quad \text{where} \quad R_{52} = \text{Trip Coil internal resistance [k}\Omega\text{]}$$

V = Trip Circuit Voltage

$$P_R \geq 2 \cdot \frac{V^2}{R} [W] \quad \text{Designed power of external resistance "R"}$$

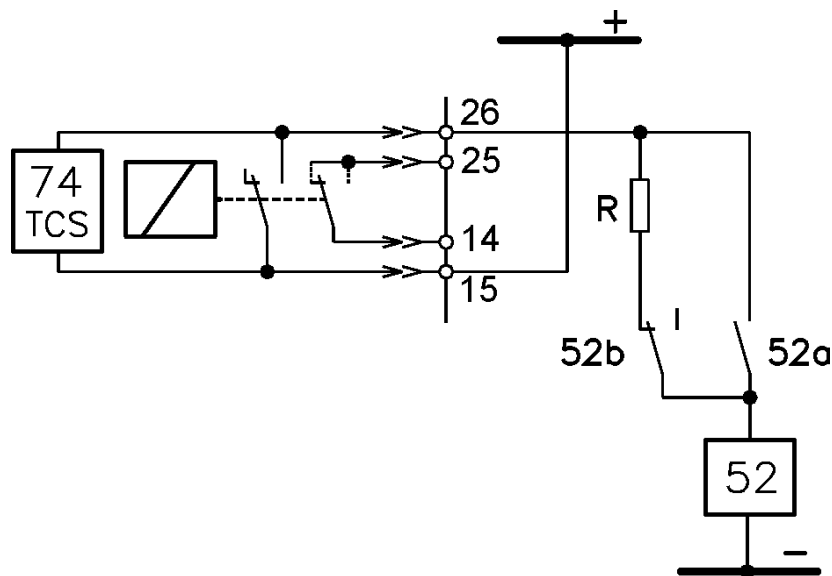

Tripping of the function operates a user programmable output relay.



16.26 - Function: **IRF** (Internal Relay Fault)

In this menu it is possible to configure the operation of the Relay Internal Fault detection element

.....

Status	→ Enab.	No	[No / Yes]
Timers	→ tIRF	5.00	s (5÷200) step 0.01 s

.....

16.26.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **tIRF** : Trip time delay

.....

16.26.2 - Operation

Tripping of the function operates a user programmable output relay.



16.27 - Function: **RT** (First Element Remote Trip)

In this menu it is possible to configure the Remote Trip Element.

Status	→ Enab.	No	[No / Yes]
Options	→ A/T	Trip	[Trip / Alarm]
	→ RCL	No	[No / Yes]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
	→ RTon	FallEdge	[RiseEdge – FallEdge]
Timers	→ ts	5.00	s (0 ÷ 10.00) step 0.01 s

16.27.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **A/T** : If “A/T = Trip” tripping of the function operates the signal led that needs manual reset.
If “A/T = Alarm” the signal led flashes as long as the function is in operation and extinguishes after tripping.
- ☐ **RCL** : If “RCL = Yes”, after tripping of the element “RT” and Opening of the Circuit Breaker, the relay starts an automatic Line Test and a reclosure cycle.
If “RCL = No” no test and no reclosure is started.
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **RTon** : Remote trip Edge selector
- ☐ **ts** : Trip time delay

16.27.2 - Operation

Tripping of the function operates a user programmable output relay.
When Remote Trip is enabled to initiate a reclosure shot, the relevant input signal must be cleared within the time-out “to1” (1000ms); if the signal stays for longer than “to1” the reclosure function goes into the lock-out status giving an External Fail signal.



16.28 - Function: **RTX** (Second Element Remote Trip)

In this menu it is possible to configure the Remote Trip Element.

Status	→ Enab.	No	[No / Yes]
Options	→ A/T	Trip	[Trip / Alarm]
	→ RCL	No	[No / Yes]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
	→ RTon	FallEdge	[RiseEdge – FallEdge]
Timers	→ ts	5.00	s (0 ÷ 10.00) step 0.01 s

16.28.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **A/T** : If “A/T = Trip” tripping of the function operates the signal led that needs manual reset.
If “A/T = Alarm” the signal led flashes as long as the function is in operation and extinguishes after tripping.
- ☐ **RCL** : If “RCL = Yes”, after tripping of the element “RTX” and Opening of the Circuit Breaker, the relay starts an automatic Line Test and a reclosure cycle.
If “RCL = No” no test and no reclosure is started.
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **RTon** : Remote trip Edge selector
- ☐ **ts** : Trip time delay

16.28.2 - Operation

Tripping of the function operates a user programmable output relay.
When Remote Trip is enabled to initiate a reclosure shot, the relevant input signal must be cleared within the time-out “to1” (1000ms); if the signal stays for longer than “to1” the reclosure function goes into the lock-out status giving an External Fail signal.


16.29 - Function: *BreakerFail* (Breaker Failure)

Status	→ Enab.	No	[No / Yes]
Timers	→ tBF	0.75 s	(0.05÷0.75) step 0.01 s

16.28.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **tBF** : Trip time delay

16.29.2 - Operation

The Breaker Failure detection is started by the operation of the output relay “R1” (programmed to be controlled by the Protection Functions that trip the C/B).
If after [tBF] seconds from operation of the relay “R1”, any input current flow is still detected (>10% I_n), the function “BF” trips and operate one user programmable output relay,



16.30 - Function: **Wh** (Energy counter Pulse)

In this menu it is possible to configure the Energy counter Pulse.

Status	→ Enab.	No	[No / Yes]
Oper. Levels	→ WpP	100	kW (10 ÷ 1000) step 10 kWh
Timers	→ Pulse	1.00	s (0.10 ÷ 2.00) step 0.01 s

16.30.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **WpP** : Energy counter Pulse Level
- ☐ **Pulse** : Pulse duration

16.29.2 - Operation

One selected output relay issued a pulse from an external energy counter, each pulse corresponds to the programmed Energy unit "WpP" and its duration is the set time "Pulse".


16.31 - Function: *Oscillo* (Oscillographic Recording)

Status	→ Enab.	No	[No / Yes]
Options	→ Trig	Disable	[Disable / Start / Trip / ExtInp]
Timers	→ tPre	0.50	s (0.01÷0.50) step 0.01 s
	→ tPost	0.50	s (0.01÷1.50) step 0.01 s

16.31.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **Trig** : Selection of the Trigger command source (start recording):
 - Disable* = Function Disable (no recording)
 - Start* = Trigger on time start of protection functions
 - Trip* = Trigger on trip (time delay end) of protection functions
 - ExtInp* = External Trigger from Digital Input
- ☐ **tPre** : Recording time before Trigger
- ☐ **tPost** : Recording time after Trigger

16.31.2 - Operation

In the options: “Trig = Start” and “Trig = Trip”, the oscillographic recording starts respectively when any protection function starts operating or trip (provided the function was programmed “TrigEnab”).

T>	1I>	1dI	Rapp	Wi	1U>
	2I>	2dI	Iapp	RT	2U>
	3I>	1di/dt	1I_g	RTX	1U<
	4I>	2di/dt	2I_g		2U<

In the option “ExtInp”, the oscillographic record starts when the Digital Input is activated (terminals shorted)

The “Osc” Function includes the wave Form Capture of the input quantities (I, U, I_g, U_g) and can totally store a record of 6 seconds.

The number of events recorded depends on the duration of each individual recording (tPre + tPost).

In any case the number of event stored can not exceed ten (10 x 0.6 sec).

Any new event beyond the 6 sec capacity of the memory, cancels and overwrites the former records (FIFO Memory).

Example: “10x0.6s” or “9x0.66” or “8x0.75” etc.



16.32 - Function: L/R C/B Cmds (Local Remote Close Breaker Command)

This menu allows to configure the command for C/B operation.

C/B Local command in Front Face panel



C/B Open control

C/B Close control

Options	→	LocRm	Disable	[Enable / Disable]
	→	LineT	Disable	[Enable / Disable]
	→	Key	Enable	[Enable / Disable]
Timers	→	tLRIn	0.05	s (0.05 ÷ 1.00) step 0.05 s
	→	tOpen	1.00	s (0.05 ÷ 2.00) step 0.01 s

16.32.1 - Description of variables

- ❑ **LocRm** : Enable/Disable [Local/Remote] Digital input.
- ❑ **LineT** : Line Test Enable/Disable
If Enabled = Line Test will be started any time C/B Close control is activated.
- ❑ **Key** : Enable = The C/B can be controlled by the pushbuttons available on Relay's Front Face as well as by commands sent via the serial communication bus.
Disable = The pushbuttons on Front Panel are disabled; the operation of the C/B can be controlled either by the serial bus commands or by (password protected) commands available in the menu "**Local Cmd**".



C/B Open control.

C/B Close control.

- ❑ **tLRIn** : Local/Remote inconsistent time.
- ❑ **tOpen** : C/B operation time-out.

16.31.2 - Display

1

- "**R**" the control of C/B is in "Remote" mode

3

- If the symbol "**R**" or "**L**" don't show up the relay is in discrepancy Local/Remote

2

- "**L**" the control of C/B is in "Local" mode



16.32 - Function: **CB-L** (CB Lock)

This menu allows to configurate the command lock for C/B.


Options → **Lock** **Enable** [Enable / Disable]

16.32.1 - Description of variables

- ☐ **Lock** : Enable = Enabling of the close command lock-out.
Disable = Disabling of the close command lock-out.

16.32.2 - Operation

If the variable "Lock" is set to "Enable", reclosing of the C/B is inhibited after a "Failed reclosure" or after a "Failed Line Test" (the symbol of a Locker appears on the display).
The reset from the Lock-out status can be operated either by the keyboard via the "CB Unlock" command available in the menu "Local Commands" (§ Local Commands) or by an external command via the Digital Input programmed for "Ext.Reset".

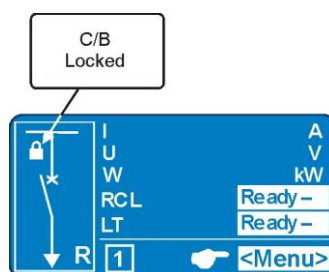


16.33 - Function: LT (Automatic Line Test)

Options	→ TNum	1	[0 / 1 / 2 / 3]			
	→ Fast	No	[No / Yes]			
	→ Rem	No	[No / Yes]			
Oper. Levels	→ Vr<	0.5	Vn	(0÷1.00)	step	0.1 Vn
	→ Rr<	100	Ω	(0÷500)	step	1 Ω
	→ VFast	0.5	Vn	(0.5÷1.00)	step	0.1 Vn
Timers	→ tp	3	s	(0÷30)	step	1 s
	→ tt	3	s	(1÷10)	step	1 s
	→ tcy	10	s	(1÷60)	step	1 s
	→ tw	3	s	(0÷10)	step	1 s

16.33.1 - Description of variables

- ❑ **TNum** : Number of tests after an unsuccessful test.
- ❑ **Fast** : When set to "Yes" if the voltage measured during the set pre-closing time [tp] exceeds the set level [VFast], the C/B is closed immediately without the Line Test.
If set "No" test is normally carried out.
- ❑ **Rem** : Remote line test; if "Yes" Line Test can be started by the logical output RCL (§17.2.2)
- ❑ **Vr<** : Minimum Residual Voltage level to allow C/B closing.
- ❑ **Rr<** : Minimum Residual Resistance level to allow C/B closing.
- ❑ **VFast** : Minimum Line Voltage level to allow C/B closing without Line Test.
- ❑ **tp** : Waiting time after C/B closing command request to start the line test cycle.
- ❑ **tt** : Duration of the Line Test.
- ❑ **tcy** : Wait time between two consecutive tests.
- ❑ **tw** : Wait time to start reclosing after success fine test.

16.33.2 - Operation

The Line Test is started by a request of Automatic Reclosure or Manual Closure of the C/B (see § "RCL" and § "L/R C/B Cmds").

It is also possible to start the Line Test by activating a Digital Input programmed for this purpose (see Remote Line Test control § "17.2.2").

Test is considered successful depending on "Vr<" and "Rr<" measurement according to programming.


Setting		Test condition
Vr<	Rr<	
≠0	≠0	$V_r \geq [Vr<] \text{ \& } R_r \geq [Rr<]$
≠0	=0	$V_r \geq [Vr<]$
=0	≠0	$R_r \geq [Rr<]$

If the test was unsuccessful:


- If "Test N°=0" C/B reclosing blocked
- If "Test N°=1,2,3" The timer "tcy" is started and, at the end of "tcy" the test is repeated only 1 or 2 or three times before the C/B reclosing is blocked (if one of the tests is successful, "tw" is started and then the C/B closed).

16.33.3 - Visualization on main Display

If the variable "Lock" (§ CB-L) is set to "Enable", reclosing of the C/B is inhibited after a "Failed reclosure" or after a "Failed Line Test" (the symbol of a Locker appears on the display).
The reset from the Lock-out status can be operated either by the keyboard via the "CB Unlock" command available in the menu "Local Commands" (§ Local Commands) or by an external command via the Digital Input programmed for "Ext.Reset".

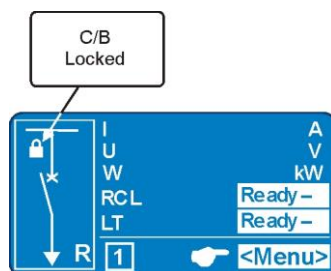


16.33.4 - Display status indication

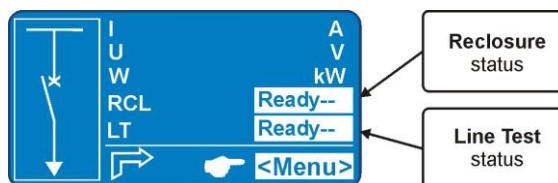

Display of Line Test status

- **Standby** Line Test in standby
- **Ready** Line Test Ready
- **Fail** Line test failure

16.33.4 - Flow chart

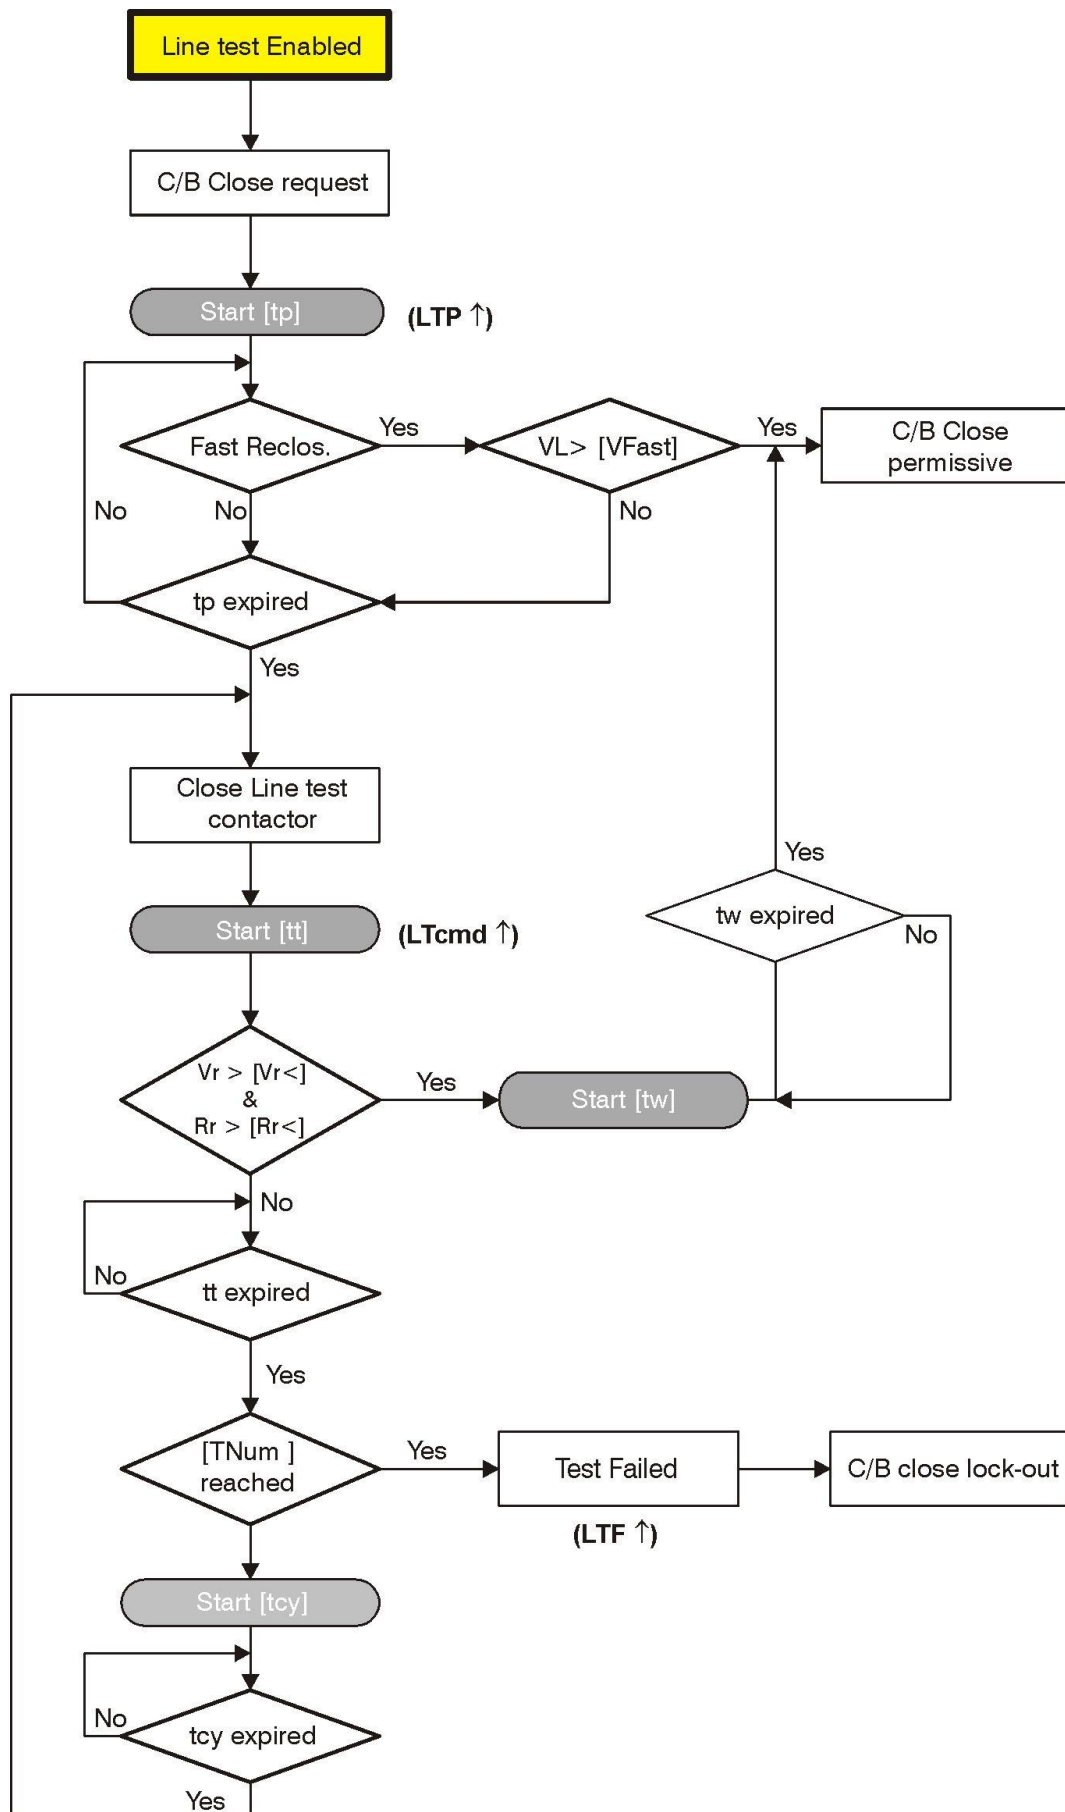



16.34 - Function: **ExtResCfg** (External Reset Configuration)

This menu allows to select the edge polarity of the signal on the digital input configured to reset the relay after a trip (see 17.2 input ExtReset).

The reset input will reset all the output relays configured as manual reset (latched), the signalisation of the trip on the display and the indication of the LED are cleared also.

Options

→ **ActOn**

RiseEdge

[RiseEdge / FallEdge]

16.34.1 - Description of variables

- ☐ **ActOn** : RiseEdge Active on Rise Edge (Digital Input close).
 FallEdge Active on Fall Edge (Digital Input open).

17. INPUT - OUTPUT

The firmware can manage up to 32 digital inputs and 34 output relays; among these, 4 digital inputs and 6 output relays are available on the relay module, the remaining are available on additional expansion modules controlled via the CAN-Bus communication channel:

14DI Module = 14 Digital Inputs

14DO Module = 14 Outputs Relay

10-4 Module = 10 Digital Inputs and 4 Outputs Relay.

1 or 2 additional modules in any combination can be controlled.

17.1 - Operation

Each Protection Element operates by means of “Inputs” and “Outputs”:


- Analogue Inputs : The measured input quantities
- Functional Inputs : The blocking input
- Physical Inputs : The Digital Inputs
- Functional Outputs : The functional elements
- Physical Outputs : The Output Relays

Any Physical Input can be assigned to the Functional Inputs of one or more elements: in the example the Digital Input “0.D1” controls the Functional Inputs of both the elements “1I>” and “1O>”.

Similarly any Physical Output can be controlled by the Functional Outputs of one or more of the relay elements (see list of elements at § Physical Outputs): in the example “0.R2” is controlled by both “1I>” and “1O>”.

In case more than one Functional Output are programmed to control the same output relay, the setting menu requires to select between two different logic operation modes: “OR” or “AND”:

- “OR” : Means that the relay is operated if at least one of the associated Functional Outputs is activated.
- “AND” : Means that the relay is operated only if all the associated Functional Output are activated.

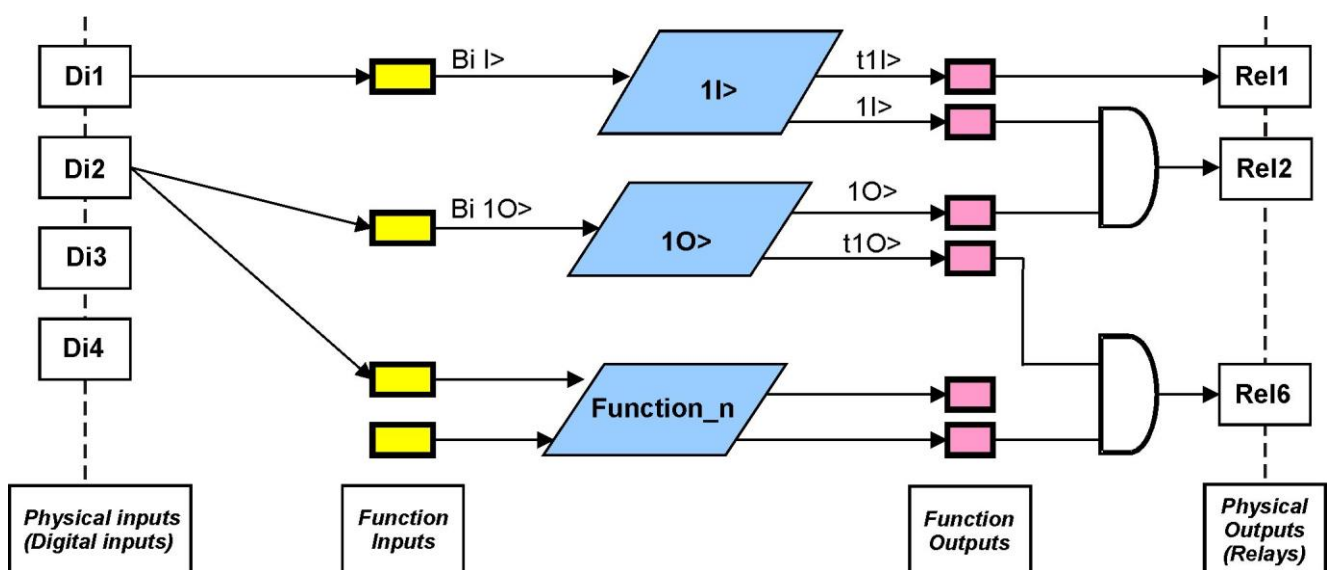

The interfacing software “MCom 2” also allows to program the operation of the output relays (Physical Output), the available operation are:

Output Configuration: “N.D.” or “N.E.”:

- **“N.D.”** : *Normally Deenergized* The output relay is deenergized in normal conditions and gets energized on activation of the controlling Functional Output; reset means deenergizing.
- **“N.E.”** : *Normally Energized* The output relay is energized in normal conditions and gets deenergized on activation of the controlling Functional Output; reset means energizing.


Operation Time: R_Timer:

This timer controls the duration of the activation of the output relay.

- **“R_Timer** : 0 (0-10)s, step 0.01s

Operation Mode: Automatic / Manual / Impulse (see figure):

- **Automatic** : In this mode the output relay is “operated” (energized if “N.D.”, deenergized if “N.E.”) when the controlling Functional Output is activated and it is reset to the “non operated” condition when the Functional Output gets deactivated but, anyhow, not before the time “R_Timer” has elapsed (minimum duration of the operation time)
- **Manual** : In this mode the output relay is “operated” when the controlling Functional Output is activated and remains in the operated condition until a manual reset command is issued by the relay keyboard (local commands menu) or via the serial communication. In this mode the timer “R_Timer” has no effect.
- **Impulsive** : In this mode the output relay is “operated” when the controlling Functional Output is activated and it remains in the “operated” condition (energized if “N.D.”, deenergized if “N.E.”) for the set time “R_Timer” independently from the status of the controlling Functional Output.

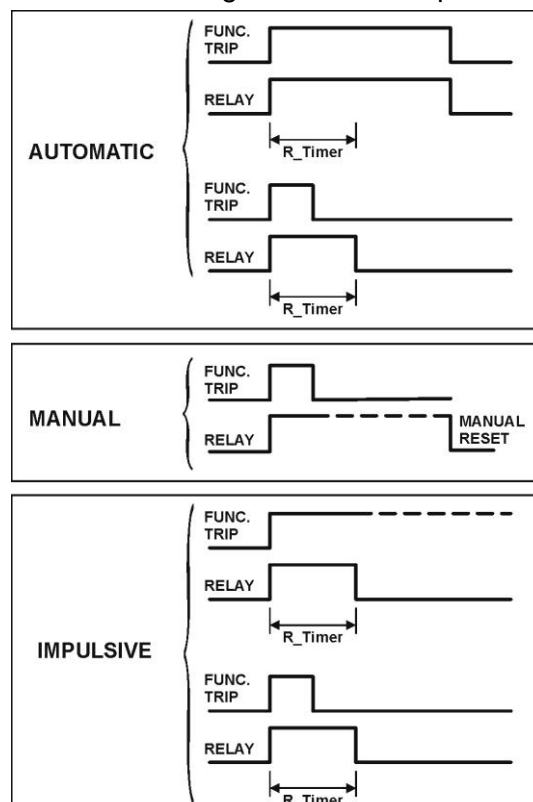

17.2 - Input




17.2.1 – Physical Input

Input	→ 0.D1	OFF(1)	+(2)	Available in the Main relay	Inputs "D8", "D16" not available	By the interface program "MSCom II" it is possible to Activate/Deactivate the modules.
	→ 0.D2	OFF(1)	+(2)			
	→ 0.D3	OFF(1)	+(2)			
	→ 0.D4	OFF(1)	+(2)			
	→ 1.D1	OFF(1)	+(2)	Available in the first additional expansion module (1/S)		
	→ 1.D--	OFF(1)	+(2)			
	→ 1.D15	OFF(1)	+(2)			
	→ 2.D1	OFF(1)	+(2)	Available in the second additional expansion module (/2S)		
	→ 2.D--	OFF(1)	+(2)			
	→ 2.D15	OFF(1)	+(2)			

Inputs
"D8", "D16" not
available

By the interface
program "MSCom
II" it is possible to
Activate/Deactivate
the modules.

(1) "ON", "OFF" : Actual status of the Input.

(2)  ,  :  Indicates that this Input is not yet associated to any function.

 Indicates that this Input is already associated to one or more functions.

0.D1 : "0" = Main Board, "1" = First Board Expansion, "2" = Second Board Expansion

Four Digital Input are available on relay:

<input type="checkbox"/>	D1 (0.D1)	(terminals 38 - 28)	: Programmable
<input type="checkbox"/>	D2 (0.D2)	(terminals 38 - 18)	: Programmable
<input type="checkbox"/>	D3 (0.D3)	(terminals 38 - 29)	: Programmable
<input type="checkbox"/>	D4 (0.D4)	(terminals 38 - 19)	: Programmable (PTC)

Three of them (0.D1, 0.D2, 0.D3) are deactivated, when the relevant terminals are open and get activated when the relevant terminals are shorted by an external cold contact.

The operation of the Input "0.D4" is dependent on the value "R" of resistance of the external circuit connected to its terminals (38-19):

- Activated if " $R < 50\Omega$ " or " $R > 3000\Omega$ ". - Deactivated if " $50\Omega \leq R \leq 3000\Omega$ ".

Therefore, if the terminals "38-19" are open-circuited, the input "0.D4" is activated; for using "0.D4" as A normal Digital Input simply controlled by an external cold contact, it is necessary to permanently connect across the terminal's "38-19" (in parallel to the external contact) a load resistor of value between 50 and 3000 Ω (example 1000 Ω - 0.5W).



17.2.2 – Logical Input (Functional)


The additional inputs “1.D5....1.D15” are available when the first expansion module is present.
The additional inputs “2.D5....2.D15” are available when the second expansion module is present.
Any digital input of the expansion modules is active when the relevant terminals (see wiring diagram) are shorted.


Any of the Digital Inputs can be programmed to control one or more of the following functions.


Bi1I>	Blocking input to the	1I>	RT	First element Remote Trip
Bi2I>	Blocking input to the	2I>	RTX	Second element Remote Trip
Bi3I>	Blocking input to the	3I>	ExtTrgOsc	External Trigger of the Oscillo. Recording.
Bi4I>	Blocking input to the	4I>	Local	Local C/B Command
BiRCL	Reclosure lock-out	RCL	Remote	Remote C/B Command
LT-Disable	Line test disable		OpenCB	Open C/B Command
Bi1U<	Blocking input to the	1U<	CloseCB	Close C/B Command
Bi2U<	Blocking input to the	2U<	R LT	Remote line test request
C/B	Indication of the Open/Close status of the C/B		ExtReset	External Reset
			Group 1-2	Selection of the setting Group 1 or 2.


Moreover, any Digital Input can be programmed to control one or more output relays in “AND” or “OR” logic.

17.2.1 – Example

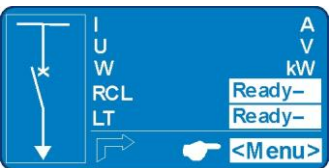
- 

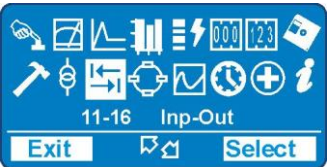
 - Press “**Menu**” for access to the main menu with icons.
- 


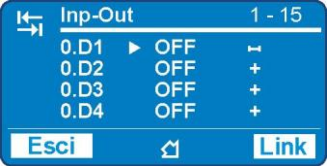
 - Select icon “**Inp-Out**” by pushbuttons “**Increase**” or “**Decrease**”.
 - Press “**Select**”.
- 

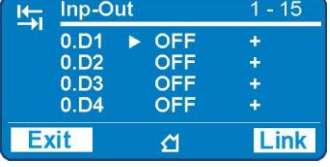
 - Select “**Input**”.
 - Press “**Select**”.
- 

 - Select “**0.D1**”.
 - Press “**Link**” for access to input “**1**”.

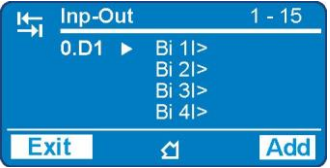“**0.D1**” corresponding to physical digital input “**0.D1**”.
“**0.D1**” corresponding to physical digital input “**0.D2**”.
“**0.D1**” corresponding to physical digital input “**0.D3**”.
“**0.D1**” corresponding to physical digital input “**0.D4**”.
“**1.D--**” corresponding to physical digital input “**1.D--**”. (additional first module)
“**2.D--**” corresponding to physical digital input “**2.D--**”. (additional second module)
- 

 - Press “**Add**” to select and associate the function.
(Digital Input 1 terminals 38-28).
- 

 - When one or more Blocking Input is associated this symbol shows .
 - To remove selection one function:
Select function by pushbuttons “**Increase**” or “**Decrease**” and press “**Remove**”.
 - Press “**Exit**”.
- 

 - Press “**Exit**” to go back to the previous menu.
- 




 - The display show “**Confirm the change?**”.
 - Choose “**Yes**” to convalidate the changes.
 - Choose “**No**” to not confirm the changes.

17.3 – Physical Outputs

The output relay are fully user programmable and controlled by any protection functions and by any digital inputs.

Output	→	0.R1	OFF(1)	+(2)	Available in the main relay	By the interface program “MCom 2” it is possible to Activate/Deactivate the modules.
	→	0.R2	OFF(1)	+(2)		
	→	0.R3	OFF(1)	+(2)		
	→	0.R4	OFF(1)	+(2)		
	→	0.R5	OFF(1)	+(2)		
	→	0.R6	OFF(1)	+(2)		
	→	1.R1	OFF(1)	+(2)	Available in the first additional expansion module (/1S)	
	→	1.R--	OFF(1)	+(2)		
	→	1.R14	OFF(1)	+(2)		
	→	2.R1	OFF(1)	+(2)	Available in the second additional expansion module (/2S)	
	→	2.R--	OFF(1)	+(2)		
	→	2.R14	OFF(1)	+(2)		

(1) "ON", "OFF" : Actual status of the Output Relay

(2)  ,  :  Indicates that this Relay is not yet associated to any function.

 Indicates that this Relay is already associated to one or more functions.

0.R1 : "0" = Main Board, "1" = First Board Expansion, "2" = Second Board Expansion

The relays "0.R1...0.R6" are always present on relay module.

The additional relays "1.R1.....1.R14" are available when the first expansion module is present.


The additional relays "2.R1.....2.R14" are available when the second expansion module is present.


Any Output Relay can be programmed to be controlled (energized) by one or more of the following functions or Digital Inputs:


T>	Tal	Thermal alarm	
T>	T>	Thermal trip	
1l>	1l>	First instantaneous overcurrent element	(Start)
t1l>	t1l>	First time delayed overcurrent element	(Trip)
2l>	2l>	Second instantaneous overcurrent element	(Start)
t2l>	t2l>	Second time delayed overcurrent element	(Trip)
3>	3l>	Third instantaneous overcurrent element	(Start)
t3l>	t3l>	Third time delayed overcurrent element	(Trip)
4l>	4l>	Fourth instantaneous overcurrent element	(Start)
t4l>	t4l>	Fourth time delayed overcurrent element	(Trip)
1dl	1dl	First instantaneous Current step element	(Start)
t1dl	t1dl	First time Current step element	(Trip)
2dl	2dl	Second instantaneous Current step element	(Start)
t2dl	t2dl	Second time Current step element	(Trip)
1di/dt	1di/dt	First instantaneous Current rate of rise element	(Start)
t1di/dt	t1di/dt	First time Current rate of rise element	(Trip)
2di/dt	2di/dt	Second instantaneous Current rate of rise element	(Start)
t2di/dt	t2di/dt	Second time Current rate of rise element	(Trip)
Rapp	Rapp	Impedance monitoring – di/dt dependence	(Trip)
Iapp	Iapp	Current monitoring with di/dt dependence	
1lg	1lg	First instantaneous Frame Fault element	(Start)
t1lg	t1lg	First time delayed Frame Fault element	(Trip)


2lg	2lg t2lg	Second instantaneous Frame Fault element Second time delayed Frame Fault element	(Start) (Trip)			
RS-G	RS-G tRS-G	Cable insulation (Screen-Ground) Cable insulation (Screen-Ground)	(Start) (Trip)			
RCL	RCL cmd ARP ARF ARL	Reclosure Shot command Autoreclosure in progress Autoreclosure Failure Autoreclosure Lock-out	(Trip)			
1U>	1U> t1U>	First instantaneous overvoltage element First time delayed overvoltage element	(Start) (Trip)			
2U>	2U> t2U>	Second instantaneous overvoltage element Second time delayed overvoltage element	(Start) (Trip)			
1U<	1U< t1U<	First instantaneous undervoltage element First time delayed undervoltage element	(Start) (Trip)			
2U<	2U< t2U<	Second instantaneous undervoltage element Second time delayed undervoltage element	(Start) (Trip)			
Wi	tWi>	Circuit breaker maintenance level				
TCS	tTCS	Time delayed Trip Circuit Supervision	(Trip)			
IRF	IRF tIRF	Time delayed Internal relay Fault Instantaneous Internal relay Fault	(Start) (Trip)			
RT	RT tRT	First Instantaneous Remote Trip First Time delayed Remote Trip	(Trip) (Start)			
RTX	RTX tRTX	Second Instantaneous Remote Trip Second Time delayed Remote Trip	(Trip) (Start)			
CB-L	CB-L	C/B reclose Lock-out				
BF	BF	Breaker Failure				
Wh	+ Wh - Wh	Imported Energy counter Pulse Exported Energy counter Pulse				
L/R CB Cmds	Open C/B Close C/B LocRem Inc missCBOpe	Open C/B command Close C/B command Local / Remote Inconsistency Missed C/B opening (Digital input missing)				
LT	LTPb LTP LTF LT cmd	Output to operate an external flashing lamp signalling line test in progress Line Test in progress Line Test Failed Line Test command	(Trip)			
	Gen.Start Gen.Trip	General start General Trip				
0.D1		Digital Input "0.D1"	activated	Available in the Main relay		
0.D1 (not)		Digital Input "0.D1"	deactivated			
0.D2		Digital Input "0.D2"	activated			
0.D2 (not)		Digital Input "0.D2"	deactivated			
0.D3		Digital Input "0.D3"	activated			
0.D3 (not)		Digital Input "0.D3"	deactivated			
0.D4		Digital Input "0.D4"	activated			
0.D4 (not)		Digital Input "0.D4"	deactivated			
1.D1		Digital Input "1.D1"	activated	Available in the first additional expansion module (/1S)	By the interface program "MSCom 2" it is possible to Activate/Deactivate the modules.	
1.D1 (not)		Digital Input "1.D1"	deactivated			
1.D --		Digital Input "1.D--"	activated			
1.D -- (not)		Digital Input "1.D--"	deactivated			
1.D15		Digital Input "1.D15"	activated			
1.D15 (not)		Digital Input "1.D15"	deactivated			
2.D1		Digital Input "2.D1"	activated	Available in the second additional expansion module (/2S)		
2.D1 (not)		Digital Input "2.D1"	deactivated			
2.D --		Digital Input "2.D--"	activated			
2.D -- (not)		Digital Input "2.D--"	deactivated			
2.D15		Digital Input "2.D15"	activated			
2.D15 (not)		Digital Input "2.D15"	deactivated			

17.3.1 – Example

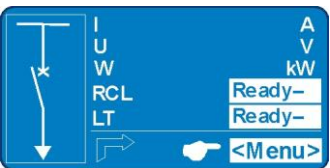
- 

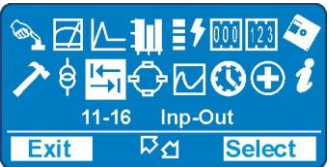
 - Press “**Menu**” for access to the main menu with icons.
- 


 - Select icon “**Inp-Out**” by pushbuttons “**Increase**” or “**Decrease**”.
 - Press “**Select**”.
- 

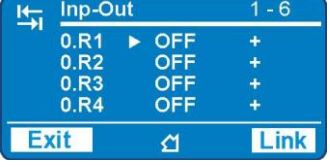 - Select “**Output**”.
 - Press “**Select**”.
- 

 - Select “**0.R1**”.
 - Press “**Link**” for access to relay “**1**”.

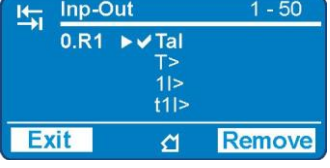
“**0.R1**” - “**0.Rx**” corresponding to physical output relay “**1**” - “**x**”
(**x** =available in the additional expansion modules)
- 

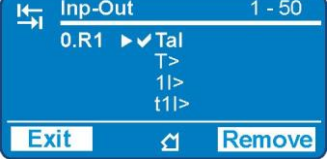
 - Press “**Add**” to select and associate the function.
- 


 - When one or more function is associated this symbol shows 
 - To remove selection one function:
Select function by pushbuttons “**Increase**” or “**Decrease**” and press “**Remove**”
 - Press “**Exit**”.




- 7

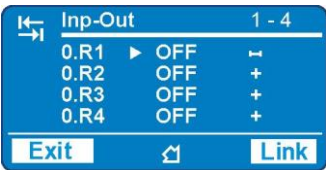
 - Press “**Exit**”
- 8


 - If more than one function or digital input are associated to one output relay, it is necessary to select the logic operator “AND” or “OR” “**Select the operator**” (see § Operation).
- 9

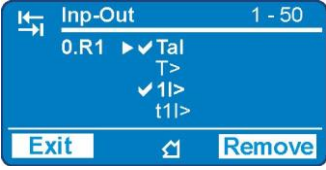
 - Press “**Exit**” to go back to the previous menu.
- 10


 - The display show “**Confirm the change?**”.
 - Choose “**Yes**” to convalidate the changes.
 - Choose “**No**” to **not** confirm the changes.

18. InfoStatus




In this menu is showed the status of relay

Options	→	LocRm	Disable
	→	RCL	Ready
	→	LT	Ready

- ☐ **LocRm** : Local / Remote / Discrepancy Status
- ☐ **RCL** : Reclosure Status
- ☐ **LT** : Automatic Line Test Status

19. OSCILLOGRAPHIC RECORDING

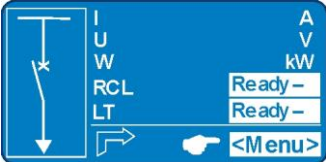This menu contains the status of the oscillographic recording.
The programming of the variables of the oscillographic recording is possible in the menu “Setting”→”Oscillo”.

- 1 
 - Press “**Menu**” for access to the main menu with icons.
- 2 
 - Select icon “**Record**” by pushbuttons “**Increase**” or “**Decrease**”.
 - Press “**Select**”.
- 3 
 - “**Available**” – Indicates the available number of oscillographic records.
 - “**Stored**” – Indicates number of records already stored.
 - “**RecTotalTime**” – Indicates the total available recording time.

The oscillographic recording can be downloaded from the RS232 port on Relay’s front face or from the main RS485 serial port using the communication protocol Modbus RTU and the application software “MCom II”.

Using the protocol “IEC870-5-103” the recording can be downloaded from the RS485 serial port with the relevant procedure of the IEC protocol itself.




20. DATE and TIME


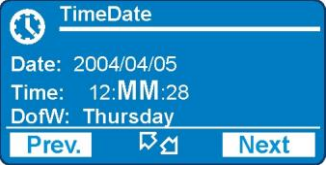

In this menu it is possible to configurate the Date and Time

Date: 20YY / MM / DD (2000/01/01 ÷ 2099/12/31)
YY = Year / MM = Month / DD = Day

Time: HH : MM : 00 HH = hour / MM = Minutes / 00

DofW: Day Es: Wednesday

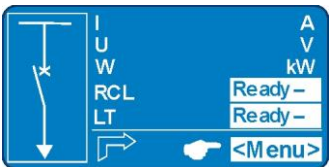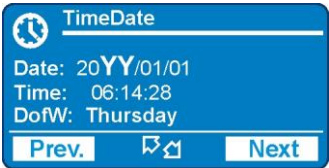- 1 
 - Press "**Menu**" for access to the main menu with icons.
- 2 
 - Select icon "**TimeDate**" by pushbuttons "**Increase**" or "**Decrease**".
 - Press "**Select**".
- 3 
 - Press "**Modify**".
- 4 
 - The last two figures of the Year will appear in bold character; by pushbuttons "**Increase**" or "**Decrease**" set the new figures.
 - Press "**Next**" to go to the next setting.
- 5 
 - As above for changing the "Month"
 - Press "**Next**" to go to the next setting.
- 6 
 - As above for changing the "Day"
 - Press "**Next**" to go to the next setting.

- 7 
 - As above for changing the “Hours”
 - Press “**Next**” to go to the next setting.
- 8 
 - As above for changing the “Minutes”
 - Press “**Next**” to go to the next setting.
- 9 
 - The **Day of the Week** is calculated and displayed automatically.
 - Press “**Exit**” to go back to the main menu.
 - Press “**Modify**” to go back to the step “3”



Press the button “**Next**” to go back to the previous display.

20.1- Clock synchronization

The internal clock has 1ms resolution and a stability of $\pm 35\text{ppm}$ in the operational temperature range.

It can be synchronized with an external time reference in the following ways:

- ☐ Using the standard “Time Synchronization” procedure of the “IEC870-5-103” protocol.
- ☐ Using the “MCom II” software or from the DCS with the Modbus RTU protocol.

Note: On power supply failure an internal battery supports the internal clock for over two years.

21. HEALTHY (Diagnostic Information)

The relay operates a continuous checking of the vital functionalities and in case an internal failure is detected, the I.R.F. function (see § I.R.F.) is activated and the Power/IRF led is set to flashing.

Device	→	No Fail	→	No Fail
		Fail	→	Fail present
		MinorFail	→	Minor Fail
		HisoricalFail	→	Cleared Fail
		FW not comp.	→	Firmware not compatible

If an internal self-clearing (transient) fault is detected, it is recorded into an historical file without any other action.

22. DEV.INFO (Relay Version)

In this menu it is possible to read the information relevant to relay unit.


SW Version	AcqUnit-I/O	→	####.##.##.##	Firmware version of acquisition unit
	ProtectUnit	→	####.##.##.##	Firmware version of CPU unit
Protect.Model		→	#####	Protection Type
Serial Number		→	###/###/###/####	Relay Serial Number
User Tag		→	U-MLEs	Relay identification label. This information can only be modified by the interface program "MSCom II" and allows the user to give to the relay any suitable denomination.
Build		→	#####	Build identification label.
Line		→	#####	Line identification label.

23. BATTERY


The relay is equipped with a lithium battery type “CR2477N 3V”, to support the internal clock and the oscillographic recording memory in case of programmed lack of power.
The expected minimum duration without power exceed 2 years.

Attention!! Use only battery specified.

Instruction for replacement the battery:

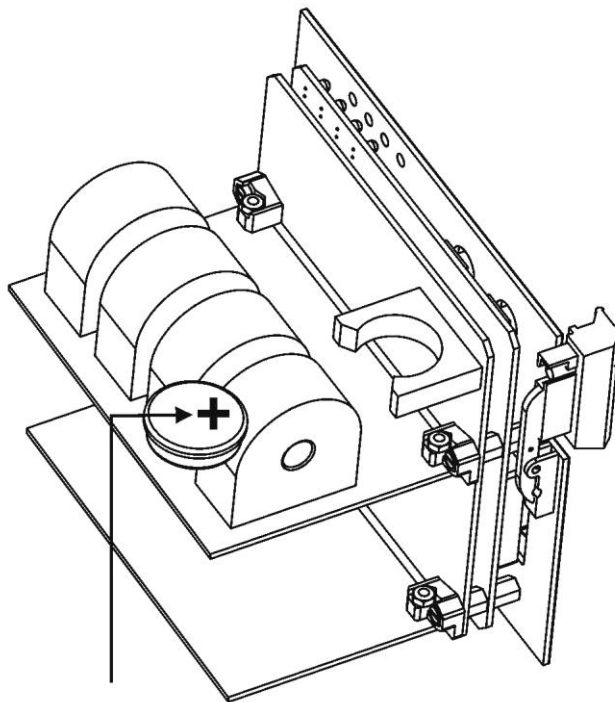

BATTERY

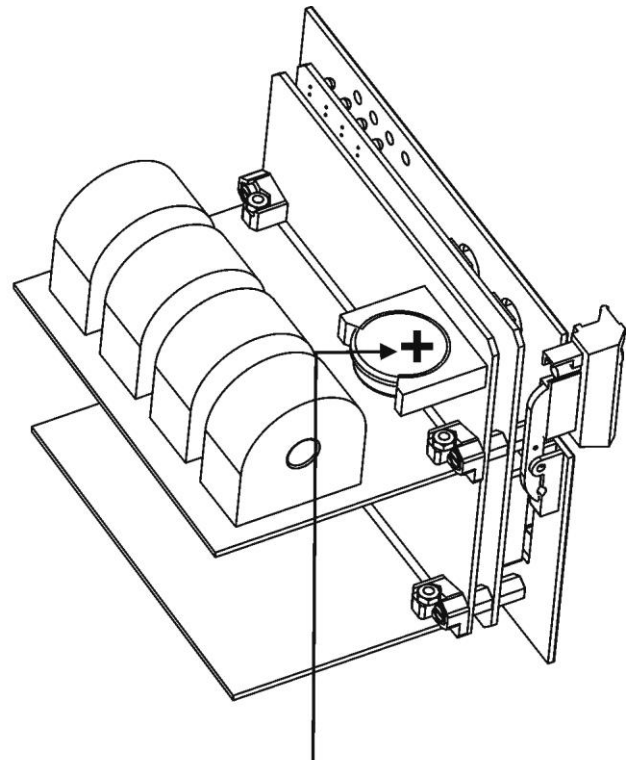

BATTERY


24. MAINTENANCE

No maintenance is required. In case of malfunctioning please contact Microelettrica Scientifica Service or the local Authorized Dealer mentioning the relay's Serial No reported in the label on relays enclosure.


25. POWER FREQUENCY INSULATION TEST

Every relay individually undergoes a factory insulation test according to IEC255-5 standard at 2 kV, 50 Hz 1min. Insulation test should not be repeated as it unusefully stresses the dielectrics.
When doing the insulation test, the terminals relevant to serial output, digital inputs and RTD input must always be short circuited to ground. When relays are mounted in switchboards or relay boards that have to undergo the insulation tests, the relay should be isolated. This is extremely important as discharges eventually taking place in other parts or components of the board can severely damage the relays or cause damages not immediately evident to the electronic components.


26. BASIC RELAY - U-MLEs - WIRING DIAGRAM

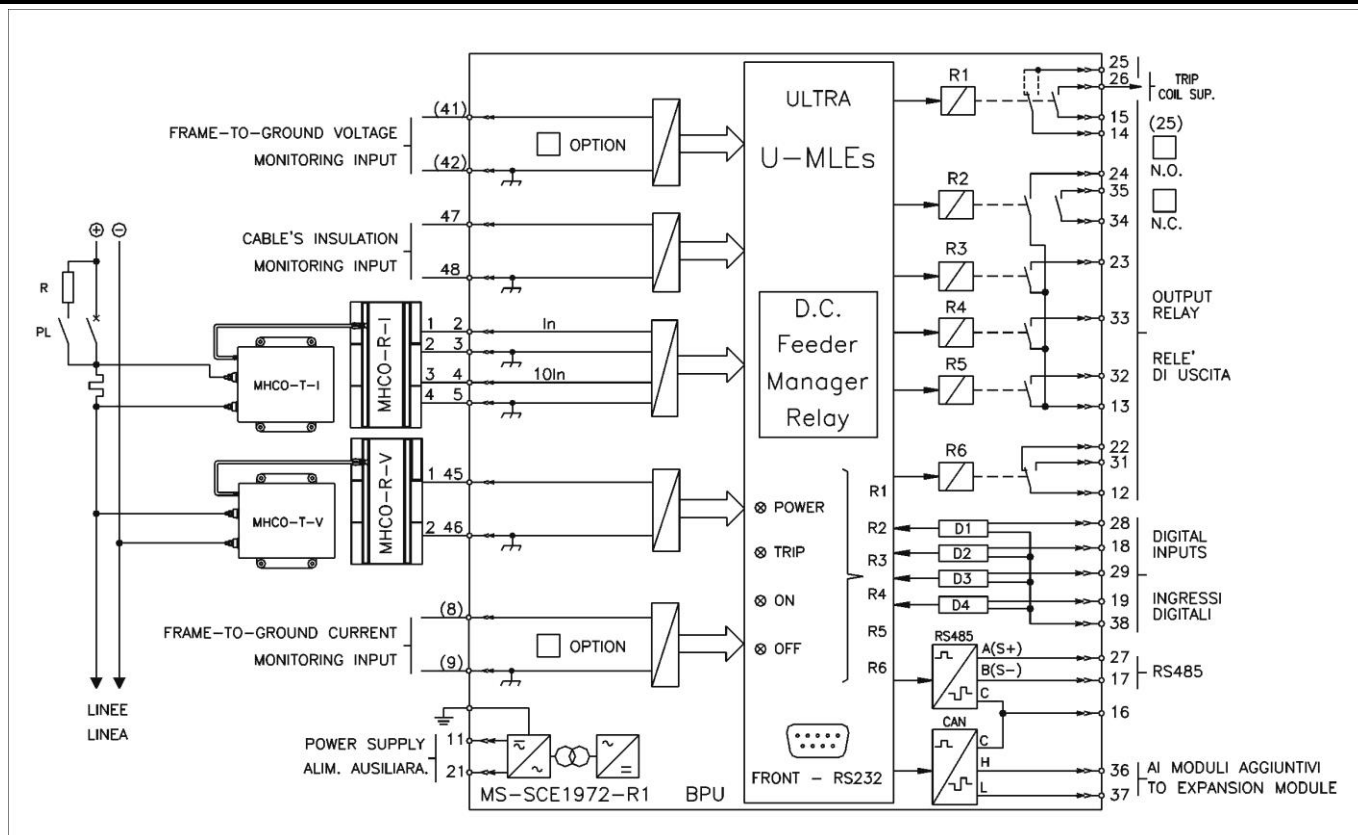


26.1 - Options - Wiring Diagram

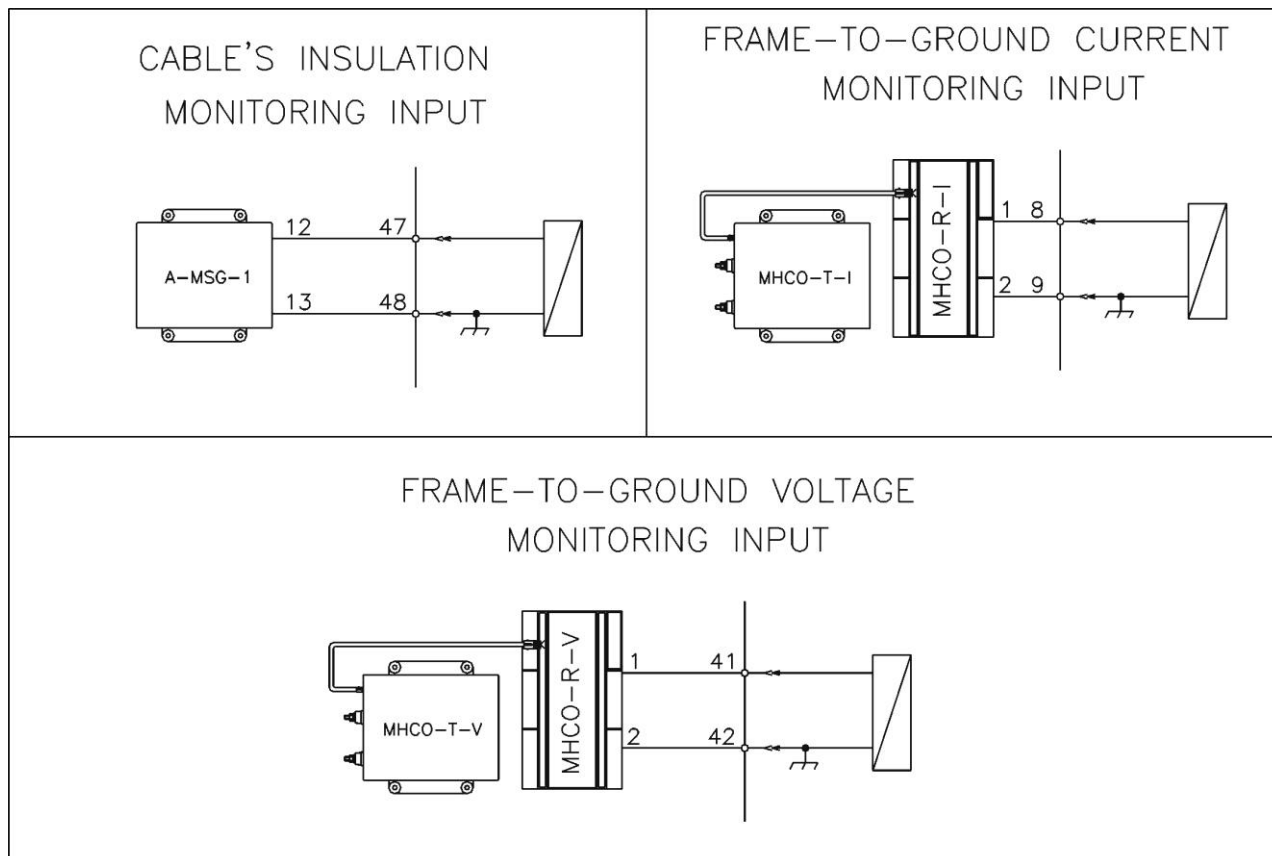

26.2 - UX10-4 - Expansion Module - WIRING DIAGRAM (10 Digital Inputs + 4 Output Relays)

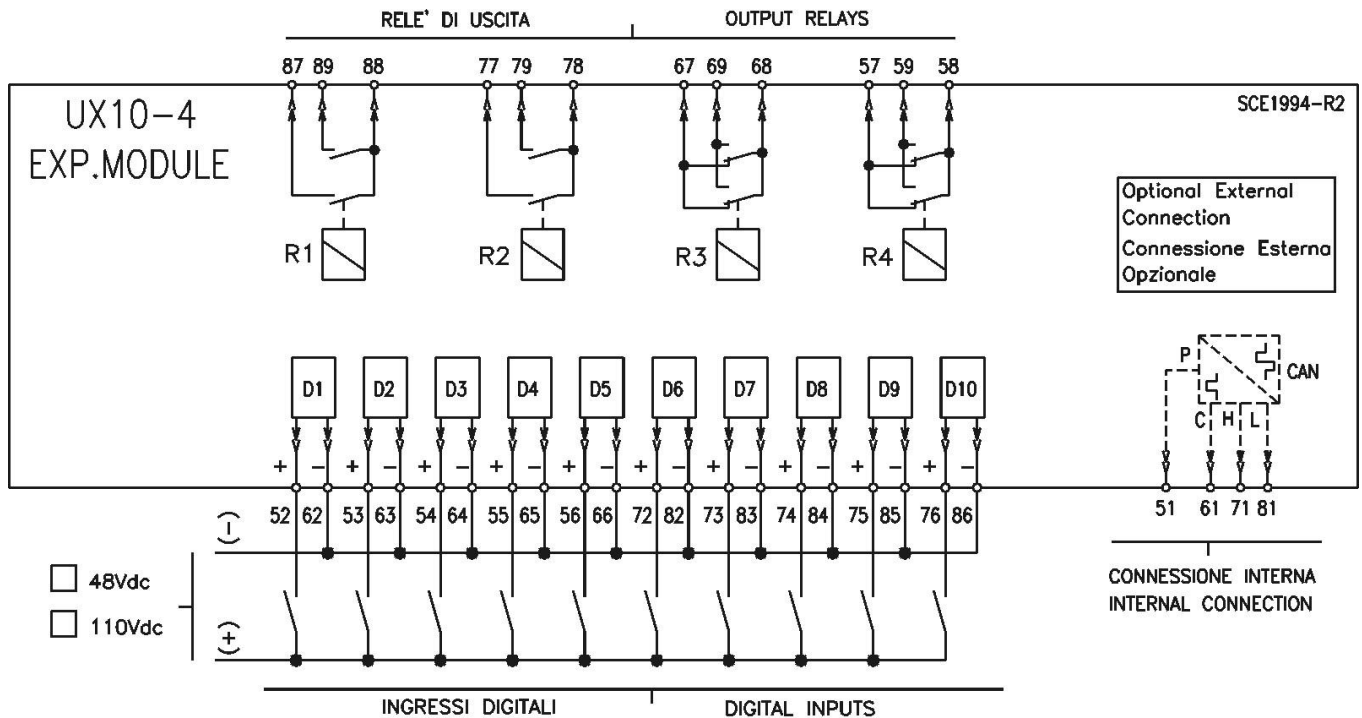


26.3 - UX14-DI - Expansion Module - WIRING DIAGRAM (14 Digital Inputs)

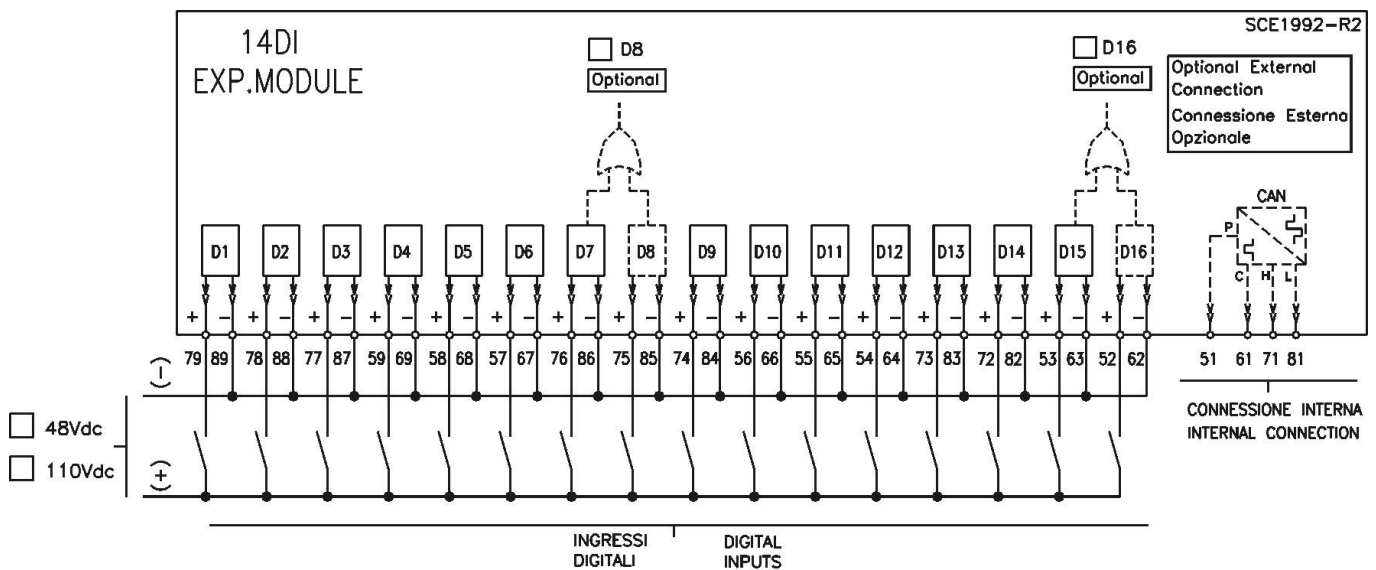


27. WIRING THE SERIAL COMMUNICATION BUS

CONNECTION TO RS485

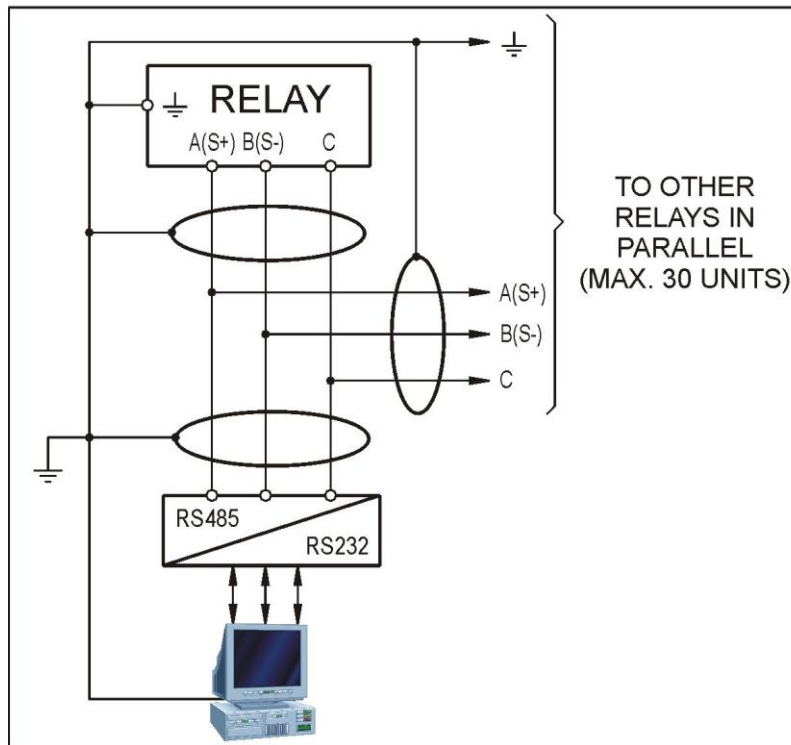


FIBER OPTIC CONNECTION

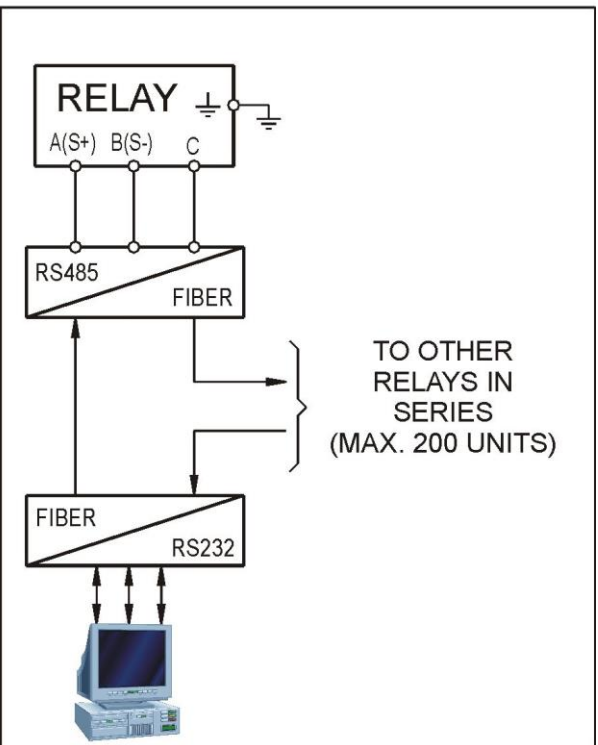



Each relay is identified by its programmable address code (NodeAd) and can be called from the P.C. A dedicated communication software (MSCom2) for Windows 9x/2000/XP (or later) is available. Please refer to the MSCom2 instruction manual for more information.

Maximum length of the serial bus can be up to 200m. For longer distance and for connection of up to 250 Relays, optical interconnection is recommended (please ask Microelettrica for accessories).

28. Basic Relay - OVERALL DIMENSIONS

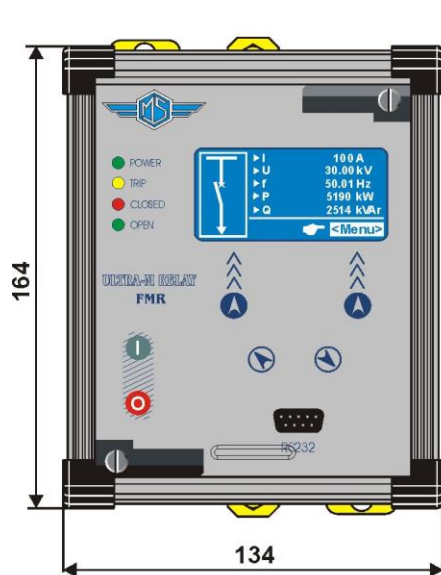


**PANEL CUT-OUT
115x137 (LxH)**

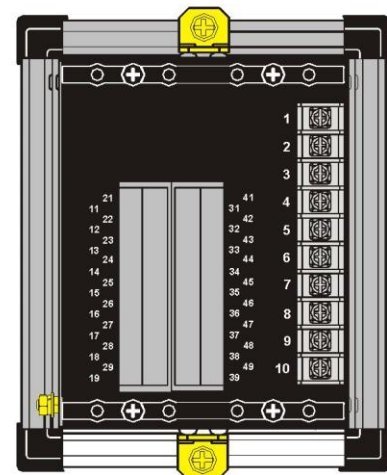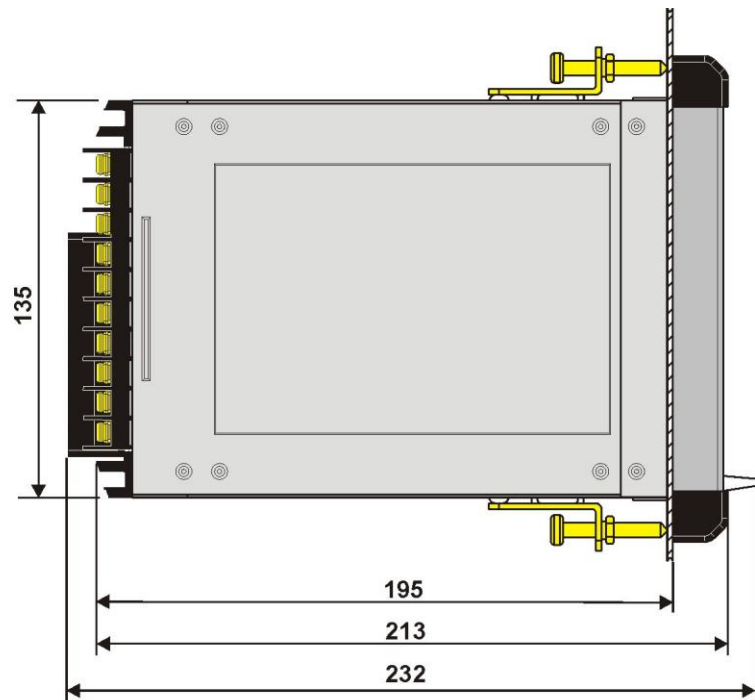


VIEW OR REAR - TERMINAL CONNECTION

Flush mounting protection degree: IP44 (54 on request).



28.1 – /1S (1 Expansion Module) & /2S (2 Expansion Module) - Overall Dimensions

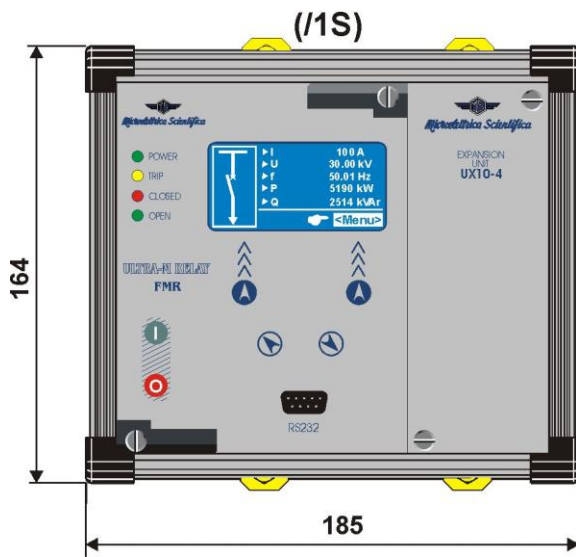


**PANEL
CUT-OUT
165x137 (LxH)**

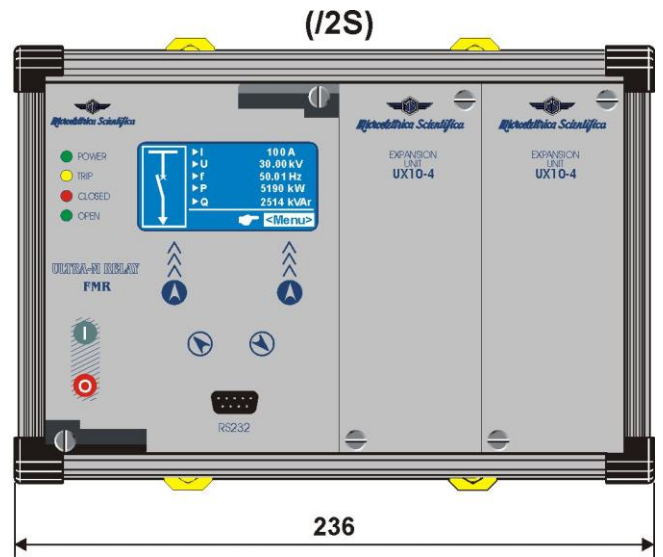

**PANEL
CUT-OUT
217x137 (LxH)**

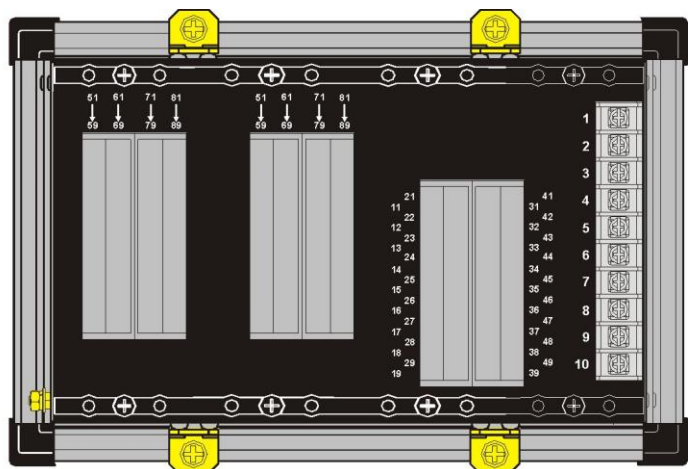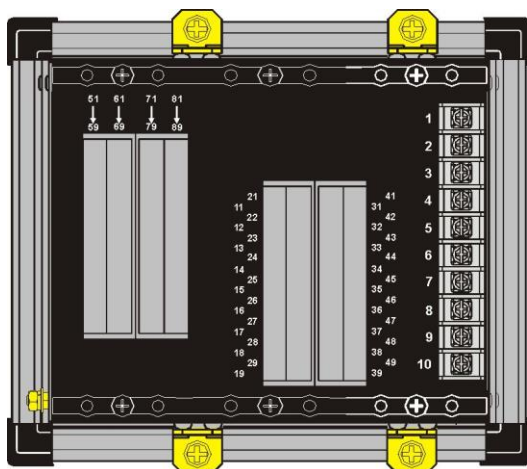

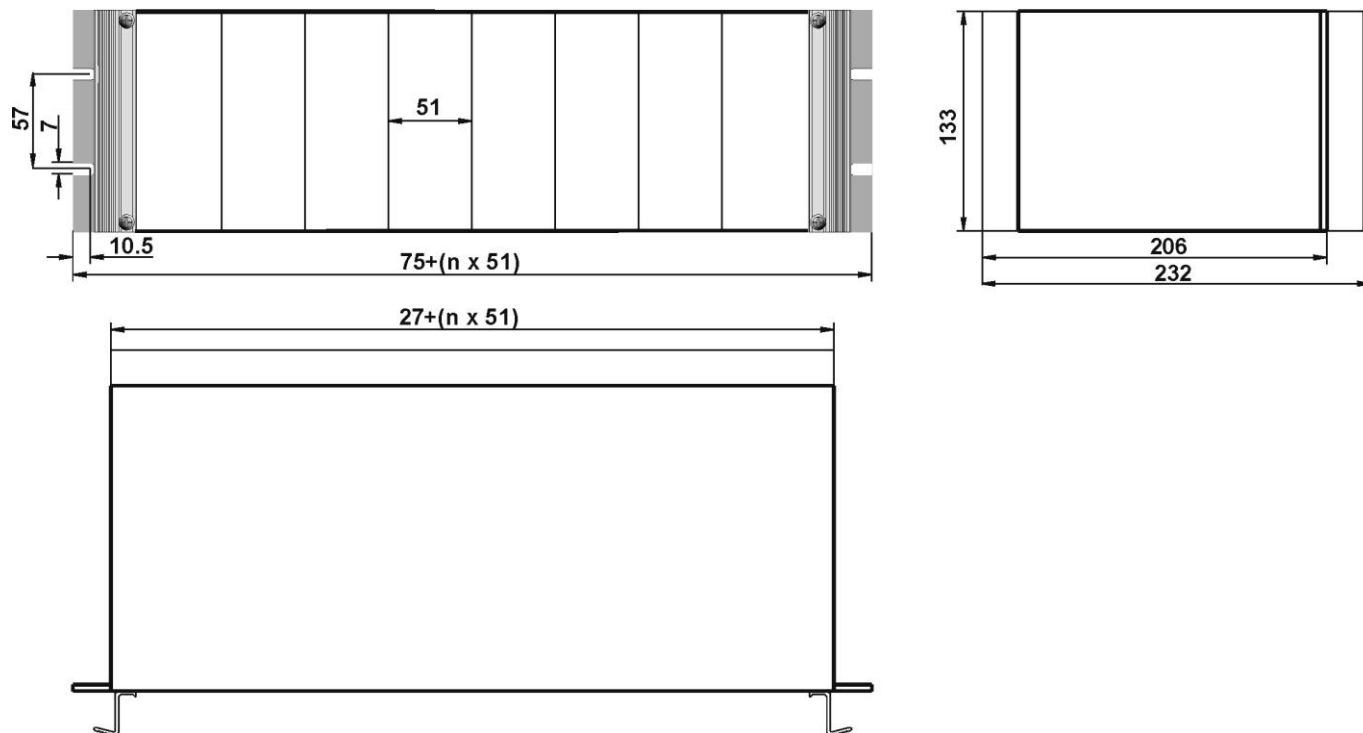29.2 – Rack 3U – OVERALL DIMENSIONS


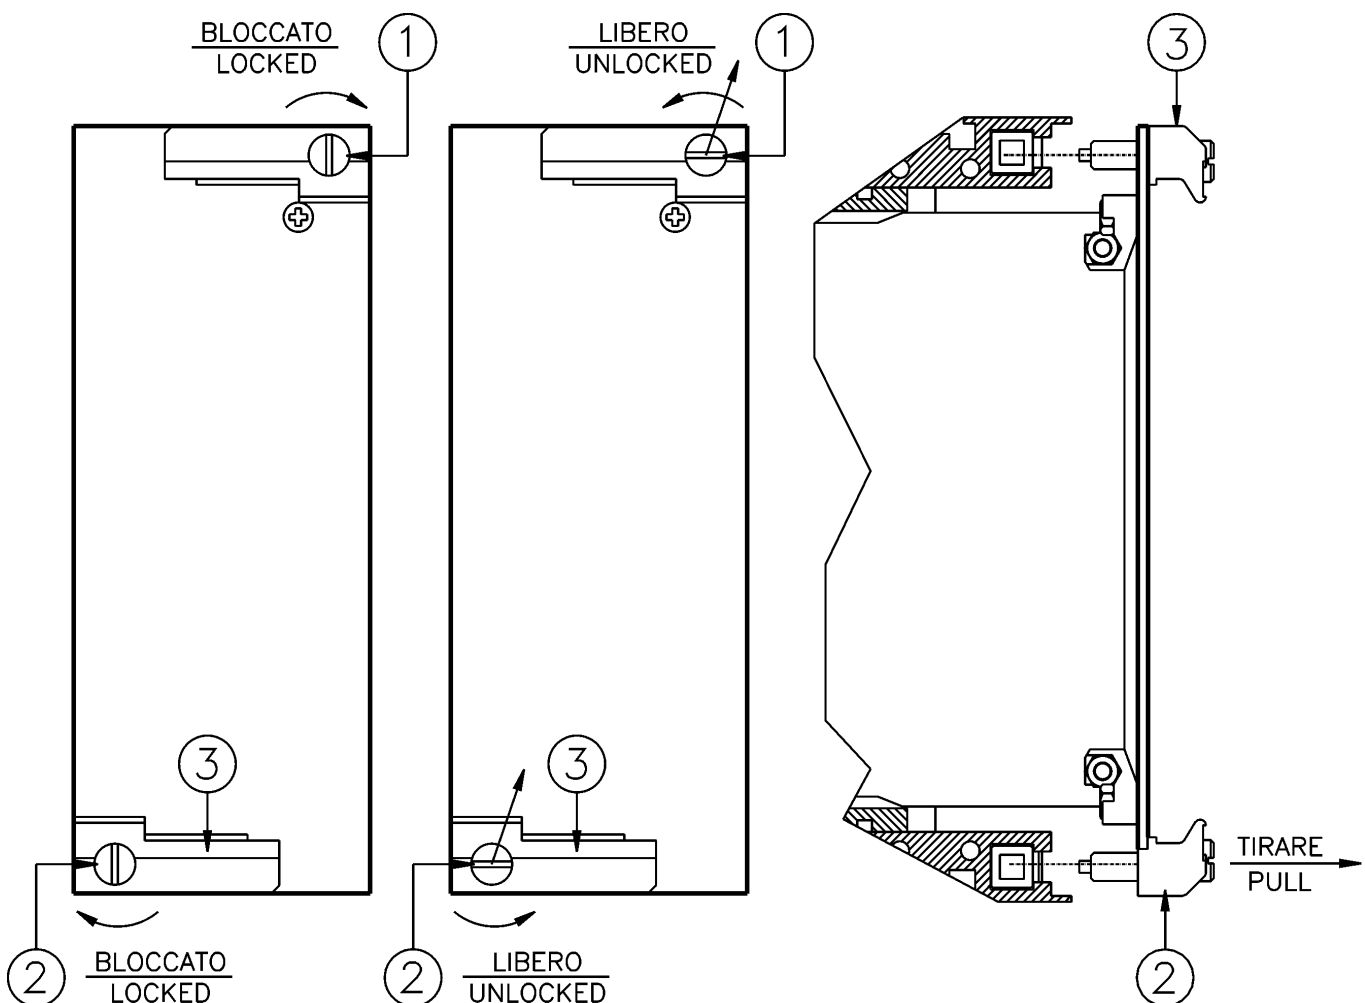
30. DIRECTION FOR PCB'S DRAW-OUT AND PLUG-IN

30.1 - Draw-out

Rotate clockwise the screws ① and ② in the horizontal position of the screw-driver mark.
Draw-out the PCB by pulling on the handles ③

30.2 – Plug-in

Rotate clockwise the screws ① and ② in the horizontal position of the screw-driver mark.
Slide-in the card on the rails provided inside the enclosure.
Plug-in the card completely and press the handle to the closed position.
Rotate anticlockwise the screws ① and ② with the mark in the vertical position (locked).



31. ELECTRICAL CHARACTERISTICS

APPROVAL: CE

REFERENCE STANDARDS IEC 60255 - CE Directive - EN/IEC61000 - IEEE C37

<input type="checkbox"/> Dielectric test voltage	IEC 60255-5	2kV, 50/60Hz, 1 min.
<input type="checkbox"/> Impulse test voltage	IEC 60255-5	5kV (c.m.), 2kV (d.m.) – 1,2/50µs
<input type="checkbox"/> Insulation resistance	> 100MΩ	

Environmental Std. Ref. (IEC 60068)

<input type="checkbox"/> Operation ambient temperature	-10°C / +55°C
<input type="checkbox"/> Storage temperature	-25°C / +70°C
<input type="checkbox"/> Environmental testing	(Cold) IEC60068-2-1
	(Dry heat) IEC60068-2-2
	(Change of temperature) IEC60068-2-14
	(Damp heat, steady state) IEC60068-2-78 RH 93% Without Condensing AT 40°C

CE EMC Compatibility (EN61000-6-2 - EN61000-6-4 - EN50263)

<input type="checkbox"/> Electromagnetic emission	EN55011	industrial environment
<input type="checkbox"/> Radiated electromagnetic field immunity test	IEC61000-4-3 ENV50204	level 3 80-2000MHz 10V/m 900MHz/200Hz 10V/m
<input type="checkbox"/> Conducted disturbances immunity test	IEC61000-4-6	level 3 0.15-80MHz 10V
<input type="checkbox"/> Electrostatic discharge test	IEC61000-4-2	level 3 6kV contact / 8kV air
<input type="checkbox"/> Power frequency magnetic test	IEC61000-4-8	1000A/m 50/60Hz
<input type="checkbox"/> Pulse magnetic field	IEC61000-4-9	1000A/m, 8/20µs
<input type="checkbox"/> Damped oscillatory magnetic field	IEC61000-4-10	100A/m, 0.1-1MHz
<input type="checkbox"/> Immunity to conducted common mode disturbance 0Hz-150KHz	IEC61000-4-16	level 4
<input type="checkbox"/> Electrical fast transient/burst	IEC61000-4-4	level 3 2kV, 5kHz
<input type="checkbox"/> HF disturbance test with damped oscillatory wave (1MHz burst test)	IEC60255-22-1	class 3 400pps, 2,5kV (m.c.), 1kV (d.m.)
<input type="checkbox"/> Oscillatory waves (Ring waves)	IEC61000-4-12	level 4 4kV(c.m.), 2kV(d.m.)
<input type="checkbox"/> Surge immunity test	IEC61000-4-5	level 4 2kV(c.m.), 1kV(d.m.)
<input type="checkbox"/> Voltage interruptions	IEC60255-4-11	
<input type="checkbox"/> Resistance to vibration and shocks	IEC60255-21-1 - IEC60255-21-2	10-500Hz 1g

CARACTERISTICS

<input type="checkbox"/> Accuracy at reference value of influencing factors	1% In 2% + to (to=20÷30ms @ 2xIs)	for measure for times
<input type="checkbox"/> Rated Current	0 - ±20mA (±40) ≡ 0 - In (2In)	
<input type="checkbox"/> Rated Voltage	0 - 20mA (40) ≡ 0 - Vn (2Vn)	
<input type="checkbox"/> Average power supply consumption	< 10 VA	
<input type="checkbox"/> Output relays	rating 5 A; Vn = 380 V A.C. resistive switching = 1100W (380V max) make = 30 A (peak) 0,5 sec. break = 0.3 A, 110 Vcc, L/R = 40 ms (100.000 op.)	

COMMUNICATION PARAMETER

<input type="checkbox"/> Rear serial port	RS485 – 9600 to 38400 bps – 8,n,1 – Modbus RTU – IEC60870-5-103
<input type="checkbox"/> Front serial port	RS232 – 9600 to 57600 bps – 8,n,1 – Modbus RTU



32. SOFTWARE & FIRMWARE VERSION

❑ **Firmware for version U-MLEs X (Multi I/O Boards)**

IAU (Intelligent Acquisition Unit)	010.01.X
IPU (Processor Unit)	0183.20.03.X

❑ **Application Software**

MSCom 2	1.03.06 or later
---------	------------------

Microelettrica Scientifica S.p.A. - 20089 Rozzano (MI) - Italy - Via Alberelle, 56/68
Tel. (+39) 02 575731-Fax (+39) 02 57510940
<http://www.microelettrica.com> e-mail : <mailto:sales.relays@microelettrica.com>

The performances and the characteristics reported in this manual are not binding and can modified at any moment without notice