

FEEDER MANAGER RELAY

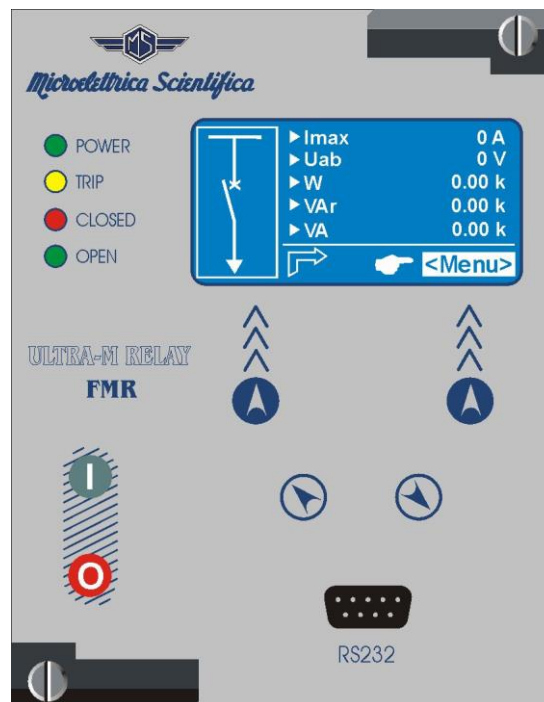
TYPE

FMR

(Multiple I/O Boards)

ULTRA Line

OPERATION MANUAL



CE

1. General Utilization and Commissioning Directions	5
1.1 - Storage and Transportation	5
1.2 - Installation	5
1.3 - Electrical Connection	5
1.4 - Measuring Inputs and Power Supply	5
1.5 - Outputs Loading	5
1.6 - Protection Earthing	5
1.7 - Setting and Calibration	5
1.8 - Safety Protection	5
1.9 - Handling	5
1.10 - Maintenance	5
1.11 - Fault Detection and Repair	6
2. General	6
2.1 - Power Supply	6
3. Front Panel	6
4. Keyboard and Display	7
4.1 - Display	7
5. Icons of Display	8
6. Signalization	9
6.1 - Leds Manual Reset	9
6.2 - Display of the last trip	9
 7. Local Commands	10
 8. Measure	11
 9. Energy	12
 10. Trip Recording	13
 11. Counters	15
 12. Events	17
12.1 - Events on display	18
 13. System (System parameters)	20
 14. Settings	23
14.1 Modifying the setting of variables	24
14.2. Password	25
14.3 - Menu: Communic. (Communication)	26
14.3.1 - Description of variables	26
14.3.2 - Front Panel serial communication port (RS232)	26
14.3.3 - Cable for direct connection of Relay to Personal Computer	26
14.3.4 - Main serial communication port (RS485)	26
14.4 - Menu: Customize	27
14.4.1 - Description of variables	27
14.5 - Function: T> (Thermal Image F49)	28
14.5.1 - Description of variables	28
14.5.2 - Trip and Alarm	28
14.6 - Function: 1I> (First Overcurrent Element F50/51)	31
14.6.1 - Description of variables	31
14.6.2 - Algorithm of the time current curves	32
14.6.3 - IEC Curves	33
14.6.4 - IEEE Curves	34
14.6.5 - Operation of the phase Overcurrent Elements in function of variable "f(a)"	35
14.6.6 - Operation of the Overcurrent Element with Voltage Control f(U)	37
14.6.7 - Blocking Logic (BO-BI)	38
14.6.8 - Automatic doubling of Overcurrent thresholds on current inrush	38
14.7 - Function: 2I> (Second Overcurrent Element F50/51)	39
14.7.1 - Description of variables	39

14.8 - Function: 3I> (Third Overcurrent Element F50/51)	40
14.8.1 - Description of variables	40
14.9 - Function: 1Io> (First Earth Fault Element 50N/51N)	41
14.9.1 - Description of variables	41
14.9.2 - Operation mode of the Earth Fault elements programming the variable "f(a _o)"	42
14.10 - Function: 2Io> (Second Earth Fault Element 50N/51N)	43
14.10.1 - Description of variables	43
14.11 - Function: 3Io> (Second Earth Fault Element 50N/51N)	44
14.11.1 - Description parameters	44
14.12 - Function: 1Is> (First Negative Sequence Element F46)	45
14.12.1 - Description of variables	45
14.12.2 - Time/Current operation of the first Current Unbalance element "f(t)"	45
14.13 - Function: 2Is> (Second Negative Sequence Element F46)	46
14.13.1 - Description of variables	46
14.14 - Function: 1U> (First Overvoltage Element F59)	47
14.14.1 - Description of variables	47
14.15 - Function: 2U> (Second Overvoltage Element F59)	47
14.15.1 - Description of variables	47
14.16 - Function: 1U< (First Undervoltage Element F27)	48
14.16.1 - Description of variables	48
14.17 - Function: 2U< (Second Undervoltage Element F27)	48
14.17.1 - Description of variables	48
14.18 - Function: 1f> (First Overfrequency Element F81>)	49
14.18.1 - Description of variables	49
14.19 - Function: 2f> (Second Overfrequency Element F81>)	49
14.19.1 - Description of variables	49
14.20 - Function: 1f< (First Underfrequency Element F81<)	50
14.20.1 - Description of variables	50
14.21 - Function: 2f< (Second Underfrequency Element F81<)	50
14.21.1 - Description of variables	50
14.22 - Function: 1Uo> (First Zero Sequence Overvoltage Element F59Uo)	51
14.22.1 - Description of variables	51
14.23 - Function: 2Uo> (Second Zero Sequence Overvoltage Element F59Uo)	51
14.23.1 - Description of variables	51
14.24 - Function: U1< (Positive Sequence Undervoltage Element F27U1)	52
14.24.1 - Description of variables	52
14.25 - Function: U2> (Negative sequence Overvoltage Element F59U2 or F47)	52
14.25.1 - Description of variables	52
14.26 - Function: Wi (Circuit Breaker maintenance level)	53
14.26.1 - Description of variables	53
14.26.2 - Operation (Accumulation of the interruption Energy)	53
14.27 - Function: TCS (Trip Circuit Supervision)	54
14.27.1 - Description of variables	54
14.27.2 - Operation	54
14.28 - Function: IRF (Internal Relay Fault)	55
14.28.1 - Description of variables	55
14.28.2 - Operation	55
14.29 - Function: CB Manage (Control C/B)	56
14.29.1 - Description of variables	56
14.29.2 - Display Message	57
14.30 - Function: Oscillo (Oscillographic Recording)	58
16.30.1 - Description of variables	58
14.30.2 - Operation	58
14.31 - Function: BreakerFail (Breaker Failure)	59
16.31.1 - Description of variables	59
14.31.2 - Operation	59
14.32 - Function: ExtResCfg (External Reset Configuration)	60
14.32.1 - Description of variables	60
 15. Input - Output	61
15.1 - Operation	61
15.2 - Physical Input	63
15.2.1 - Example	65
15.3 - Physical Outputs	66
15.3.1 - Example	68

16.	 Date and Time	70
16.1	Clock synchronization	71
17.	 Healthy (Diagnostic Information)	72
18.	 Dev.Info (Relay Version)	72
19.	Battery	73
20.	Maintenance	73
21.	Power Frequency Insulation Test	73
22.	Basic Relay - Wiring Diagram	74
22.1	UX10-4 - Expansion Module - Wiring Diagram (10 Digital Inputs + 4 Output Relays)	74
22.2	14DI - Expansion Module - Wiring Diagram (14 Digital Inputs)	75
22.3	14DO - Expansion Module - Wiring Diagram (14 Output Relays)	75
23.	Wiring the Serial Communication Bus	76
24.	Overall Dimensions	76
24.1	Configuration box	76
24.2	Box "E2"	77
24.3	Box "E3" & Box "E4"	78
24.2	Box "E5"	79
24.2	Rack 3U	79
25.	Direction for Pcb's Draw-Out and Plug-In	80
25.1	Draw-out	80
25.2	Plug-in	80
26.	Electrical Characteristics	81
27.	Software & Firmware Version	82

1. General Utilization and Commissioning Directions

Always make reference to the specific description of the product and to the Manufacturer's instruction. Carefully observe the following warnings.

1.1 - Storage and Transportation

Must comply with the environmental conditions stated in the product's specification or by the applicable IEC standards.

1.2 - Installation

Must be properly made and in compliance with the operational ambient conditions stated by the Manufacturer.

1.3 - Electrical Connection

Must be made strictly according to the wiring diagram supplied with the Product, to its electrical characteristics and in compliance with the applicable standards particularly with reference to human safety.

1.4 - Measuring Inputs and Power Supply

Carefully check that the value of input quantities and power supply voltage are proper and within the permissible variation limits.

1.5 - Outputs Loading

Must be compatible with their declared performance.

1.6 - Protection Earthing

When earthing is required, carefully check its effectiveness.

1.7 - Setting and Calibration

Carefully check the proper setting of the different functions according to the configuration of the protected system, the safety regulations and the co-ordination with other equipment.

1.8 - Safety Protection

Carefully check that all safety means are correctly mounted, apply proper seals where required and periodically check their integrity.

1.9 - Handling

Notwithstanding the highest practicable protection means used in designing M.S. electronic circuits, the electronic components and semiconductor devices mounted on the modules can be seriously damaged by electrostatic voltage discharge which can be experienced when handling the modules.

The damage caused by electrostatic discharge may not be immediately apparent but the design reliability and the long life of the product will have been reduced. The electronic circuits produced by M.S. are completely safe from electrostatic discharge (8 kV IEC 255.22.2) when housed in their case; withdrawing the modules without proper cautions expose them to the risk of damage.

1.10 - Maintenance

Make reference to the instruction manual of the Manufacturer; maintenance must be carried-out by specially trained people and in strict conformity with the safety regulations.

1.11 - Fault Detection and Repair

Internal calibrations and components should not be altered or replaced.
For repair please ask the Manufacturer or its authorized Dealers.

Misapplication of the above warnings and instruction relieves the Manufacturer of any liability.

2. General

Input currents are supplied to 4 current transformers: - three measuring phase current - one measuring the earth fault zero-sequence current.

Current input can be selected 1A or 5A by movable jumpers available on relay cards.

Input voltage are supplied to 4 Potential Transformers: three measuring phase-to-neutral voltage and one measuring the zero sequence voltage supplied by the secondary of three system P.Ts. Y/Open Delta connected.

The Measuring Ranges of the different inputs respectively are:

Phase Currents	: (0.1-40)In	Phase Voltage	: (0.01-2)Un
Neutral Current	: (0.01-10)On	Neutral Voltage	: (0.01-2)Un

Make electric connection in conformity with the diagram reported on relay's enclosure.

Check that input currents and voltages are same as reported on the diagram and on the test certificate.
The auxiliary power is supplied by a built-in interchangeable module fully isolated and self protected.

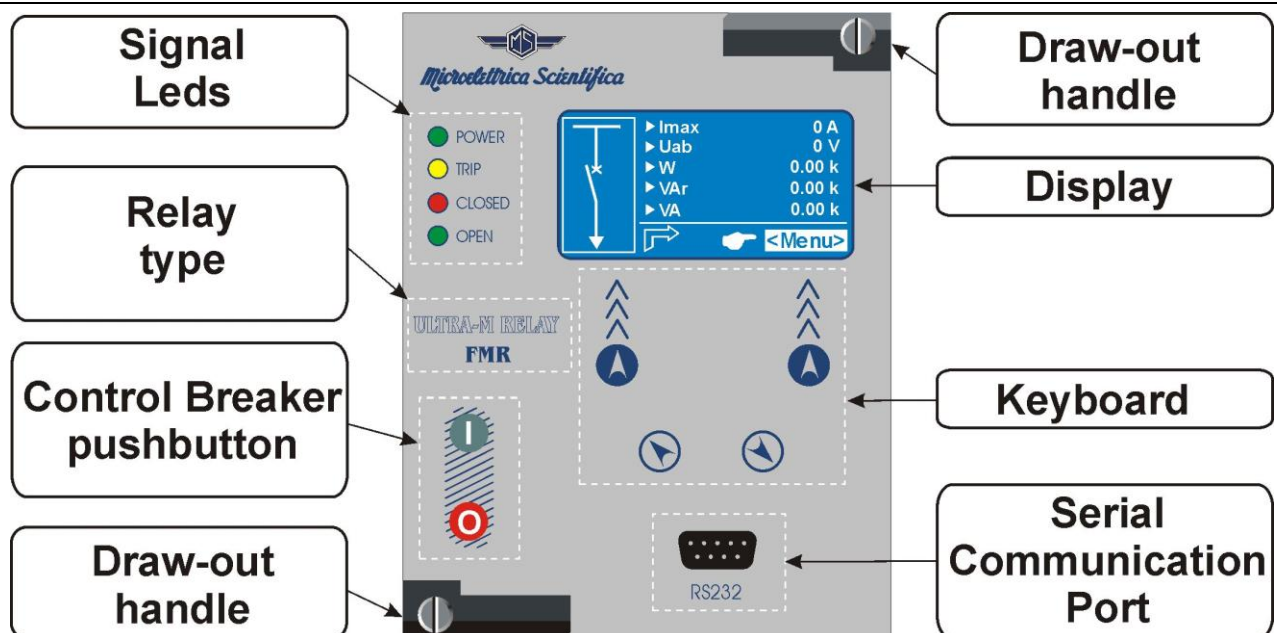
2.1 - Power Supply

The relay can be fitted with two different types of **power supply**:

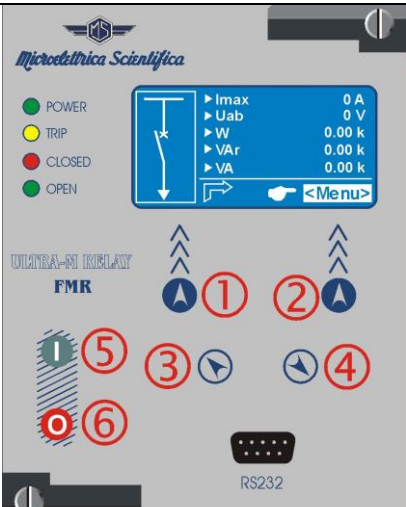
Type 1) - {	24V(-20%) / 110V(+15%) a.c.	Type 2) - {	80V(-20%) / 220V(+15%) a.c.
	24V(-20%) / 125V(+20%) d.c.		90V(-20%) / 250V(+20%) d.c.

Before energizing the unit check that supply voltage is within the allowed limits.

3. Front Panel



4. Keyboard and Display

		Navigation menu	By these buttons the options showed in correspondence on the display are selected.
		Increase	These buttons are used to scroll the items of the different menus (Local Control, Measurements, Energy metering etc).
		Decrease	
		Open	these buttons (when enabled) operate Circuit Breaker Open/Close control (see § C/B manage)
		Close	

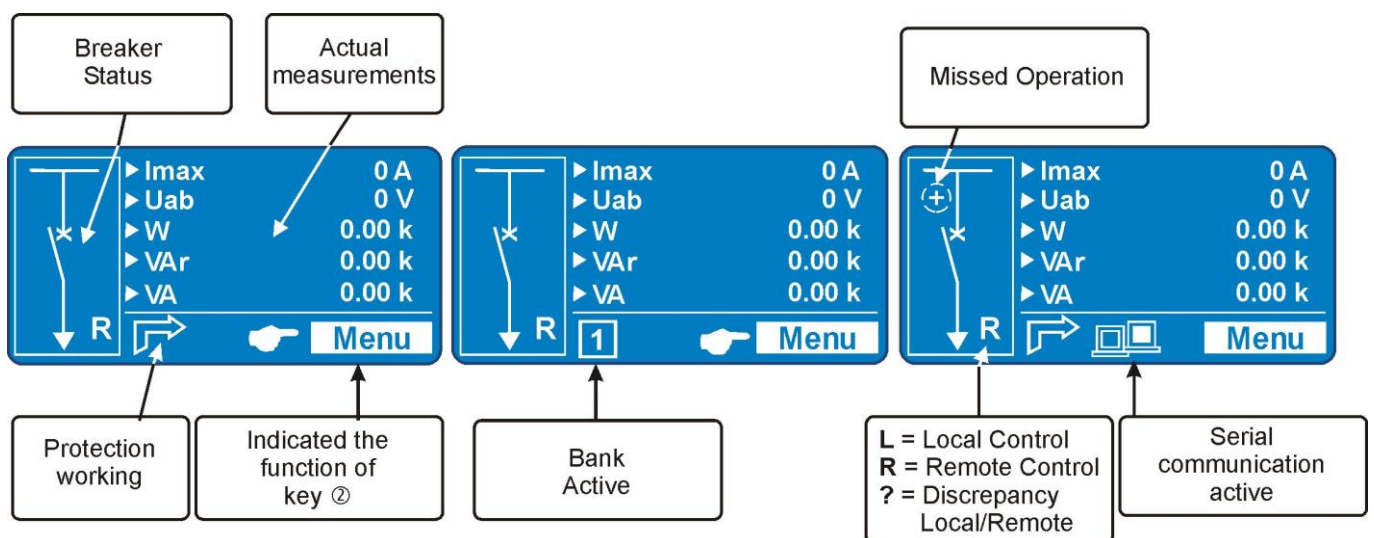
□ By the key ② select the windows showing the ICONS of the available menus.

□ By the key ③, ④ select the desired icon and enter by key ①

□ The different elements can be selected by the key ③ and ④.
The details of the individual menus are given in the following paragraphs.

4.1 - Display

The 128x64 pixel LCD display the available information (menu, etc.).

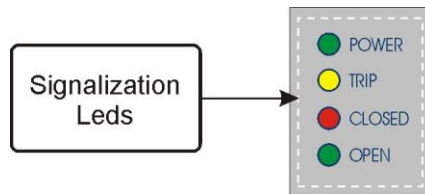


5. Icons of Display

	LocalCmd	Local Commands
	Measure	Actual Measurements
	Energy	Energy Measurements
	TripRec.	Trip Recording
	Counter	Partial Counters (Resettable Counter)
	Events	Event Recording
	Setting	Function Settings
	System	System Settings
	Inp-Out	Input - Output
	TimeDate	Time and Date
	Healthy	Diagnostic Information
	Dev.Info	Relay Version

6. Signalization

Four signal leds are provided:



Green Led	 POWER	☐ Illuminated ☐ Flashing	- Relay working properly. - Internal Relay Fault
Yellow Led	 TRIP	☐ Off ☐ Illuminated ☐ Flashing	- No Trip - Trip occurred - Function Timing Reset from Illuminated status is manual (see § 6.1)
Red Led	 CLOSED	☐ Off ☐ Illuminated	- C/B Open - C/B Close
Green Led	 OPEN	☐ Off ☐ Illuminated	- C/B Close - C/B Open
Both Flashing Operation of Trip Circuit Supervision element.			
☐ In case of auxiliary power supply failure the status of the leds is recorded and reproduced when power supply is restored.			

6.1 - Leds Manual Reset

For Leds' manual reset operate as follows:

- 
 - Press "**Menu**" for access to the main menu with icons.
- 
 - Select icon "**LocalCmd**".
 - Press "**Select**",
- 
 - Select "**LedClear**".
 - Press "**Select**" to execute the command. (See § Password).
- 
 - When command has been executed the display shows "**! Command Done**";

6.2 – Display of the last trip

Beside the signalization of the yellow led "Trip", indicating a generic function trip, the display shows a window indicating the last function that was tripped and the number of events that are stored in the memory. The display will show this window until the reset button or external reset are operated.

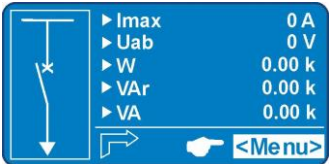
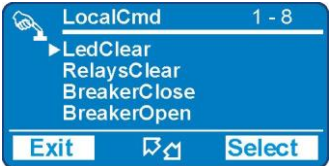
- 
 - Press "**Menu**" to access to the main menu with icons. Press "**Res.**" to erase visualization. Ex. "t1l>" (flashing) is the last trip.

7. Local Commands

“**LOCAL COMMANDS**” allow to operate from relay front face controls like Thermal Memory reset, Leds reset, etc.

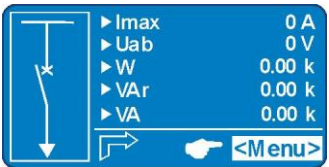
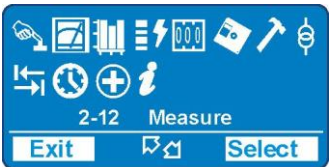
Menu	Description	Password
→ Led Clear	Reset of signal Leds	No
→ Relays Clear	Manual reset of output relays	No
→ Breaker Close	Manual C/B closing (conditioned by Password)	Yes
→ Breaker Open	Manual C/B opening (conditioned by Password)	Yes
→ Event Clear	Reset of all Events recorded	Yes
→ HistFail Clear	Reset of Internal Failure Historic records	Yes
→ Reset Term	Reset to zero of the accumulations relevant to Thermal Image and Interruption Energy.	Yes
→ Leds Test	Signal Leds test	No

To operate one command by the Front Face Keyboard, proceed as follows (Led Reset in the present example).

- 
 - Press “**Menu**” for access to the main menu with icons.
- 
 - Select “**LocalCmd**” icon with pushbutton “**Increase**” or “**Decrease**”.
 - Press “**Select**” for access.
- 
 - Select with pushbutton “**Increase**” or “**Decrease**” the menu “**LedClear**”.
 - Press “**Select**” to execute the command.
(if Password is request, see § Password).
- 
 - When command has been executed the display shows “**! Command Done**”; go to “3”.

8. Measure

Real time values as measured during the normal operation.

- 1 
 - Press “**Menu**” for access to the main menu with icons.
- 2 
 - Select “**Measure**” icon with pushbutton “**Increase**” or “**Decrease**”.
 - Press “**Select**” for access.
- 3 
 - Scroll the menu “**Measure**” with pushbutton “**Increase**” or “**Decrease**” to display the measurement.
 - Press “**Exit**” to go to the main menu.

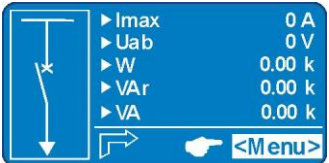
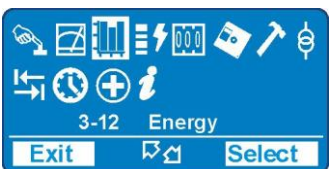
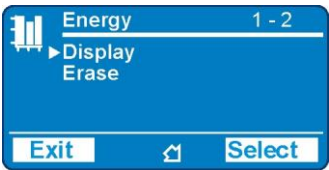
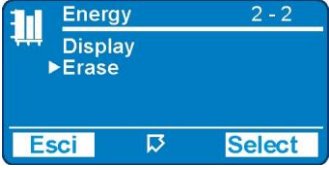
→ Imax	(0 ÷ 9999)	A	Largest phase current (Ia, Ib, Ic).	
→ Ia	(0 ÷ 9999)	A	Phase A current	(R.M.S. ampere)
→ Ib	(0 ÷ 9999)	A	Phase B current	(R.M.S. ampere)
→ Ic	(0 ÷ 9999)	A	Phase C current	(R.M.S. ampere)
→ Io	(0 ÷ 9999)	A	Zero Sequence Current	(fundamental frequency value 3Io)
→ I1	(0.00 ÷ 99.99)	In	Positive sequence current	
→ I2	(0.00 ÷ 99.99)	In	Negative sequence current	
→ Frq	(0.00 ÷ 99.99)	Hz	Frequency	
→ Uan	(0 ÷ 999999)	V	Phase Voltage “A-N”	(R.M.S. value)
→ Ubn	(0 ÷ 999999)	V	Phase Voltage “B-N”	(R.M.S. value)
→ Ucn	(0 ÷ 999999)	V	Phase Voltage “C-N”	(R.M.S. value)
→ Uab	(0 ÷ 999999)	V	Phase-to-phase Voltage “A-B”	(R.M.S. value)
→ Ubc	(0 ÷ 999999)	V	Phase-to-phase Voltage “B-C”	(R.M.S. value)
→ Uca	(0 ÷ 999999)	V	Phase-to-phase Voltage “C-A”	(R.M.S. value)
→ Uo	(0 ÷ 999999)	V	Zero Sequence Voltage	(fundamental frequency value 3Vo)
→ V1	(0.00 ÷ 99.99)	Vn	Positive Sequence Voltage	
→ V2	(0.00 ÷ 99.99)	Vn	Negative Sequence Voltage	
→ PhA	(0 ÷ 359)		° Phase angle “Ia ^ Uan”	
→ PhB	(0 ÷ 359)		° Phase angle “Ib ^ Ubn”	
→ PhC	(0 ÷ 359)		° Phase angle “Ic ^ Ucn”	
→ Ph0	(0 ÷ 359)		° Phase angle “Io ^ Uo”	
→ W	(0.00 ÷ 99.99 ÷ 999.9 ÷ 9999999)	k	Three Phase Active Power	(kW)
→ VAr	(0.00 ÷ 99.99 ÷ 999.9 ÷ 9999999)	k	Three Phase Reactive Power	(kVAr)
→ VA	(0.00 ÷ 99.99 ÷ 999.9 ÷ 9999999)	k	Three Phase Apparent Power	(kVA)
→ Cos	(0.000 ÷ 1.000)	-	Power Factor	
→ Tem	(0 ÷ 9999)	%T	Thermal status as % of the full load continuous operation temperature Tn	
→ Wir	(100 ÷ 0)	%W	Amount still remaining of permissible interruption energy before Circuit Breaker maintenance is requested.	

9. Energy

Real time energy measurements

Display	→ + kWh	(0 – 9999999)	Exported Active Energy
	→ - kWh	(0 – 9999999)	Imported Active Energy
	→ + kRh	(0 – 9999999)	Exported Reactive Energy
	→ - kRh	(0 – 9999999)	Imported Reactive Energy
Erase	→ All Energy counters are cleared		

When the measurement exceed “9999999” the counters restart from “0”.

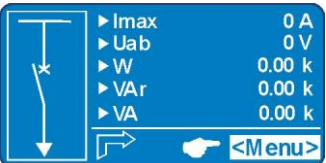
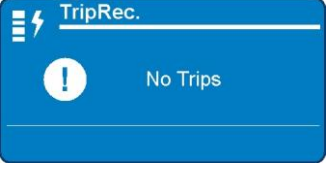
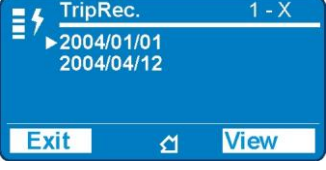
- 
 - Press “**Menu**” for access to the main menu with icons.
- 
 - Select “**Energy**” icon with pushbutton “**Increase**” or “**Decrease**”.
 - Press “**Select**” for access.
- 
 - Select “**Display**” with pushbutton “**Increase**” or “**Decrease**”.
 - Press “**Select**” for access.
- 
 - Display of Real time Energy measurements.
 - Press “**Exit**” to go back to the level “3”.
- 
 - Select “**Erase**” with pushbutton “**Decrease**” to clear all reading.
 - Press “**Select**”. (if Password is request, see § Password).
- 
 - When command has been execute the display shows “**! Command Done**”; to go to the level “5”.
 - Press “**Exit**” to go back to the main menu.

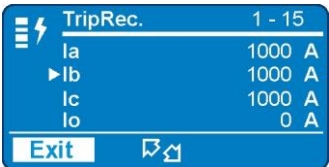
10. Trip Recording

Display of the function which caused the tripping of the relay plus values of the measurement at the moment of tripping. The last 10 events are recorded.

The memory buffer is refreshed at each new relay tripping (FIFO logic).

Display	→	Reading of recorded Trips.
Erase	→	Clear all Trip recorded.

- 
 - Press "**Menu**" for access to the main menu with icons.
- 
 - Select "**TripRec.**" icon with pushbutton "**Increase**" or "**Decrease**".
 - Press "**Select**" for access.
- 
 - Select "**Display**" with pushbutton "**Increase**" or "**Decrease**".
 - Press "**Select**" for access.
 - For "**Erase**" go to "8"
- 
 - If no trip is recorded the display shows "**! No Trips**".
- 
 - If any trip was recorded, select "**View**" to display the chronological list of the records.
 - By the keys "**Increase**" or "**Decrease**" select the date of the record to be checked.
- 
 - Will be shown:
 - "**Descr**" the function that caused the event (Example: t1l> = Trip)
 - "**Edge**" if the function was tripped (Rise) or reset (Fall)
 - "**Date**", date of trip, year/month/day, hour:minutes:seconds:milliseconds
 - Press "**Value**", for reading the value of input quantities on tripping.

- 7
- 
- Scroll with pushbuttons “**Increase**” or “**Decrease**” the available measurements.
 - Select “**Exit**” to go back to “5” for another selection, or “2” go back to the main menu.
- 8
- 
- Select “**Erase**” with button “**Decrease**”.
 - Press “**Select**” to execute the commands; **All** Trips recorded are erased. (if Password is request, see § Password).
- 9
- 
- When command has been executed the display shows “**! Command Done**”;
 - Press “**Exit**” to go back to the main menu.

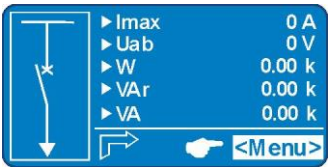
11. Counters

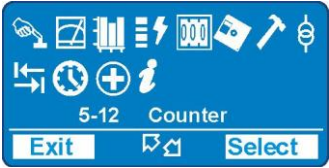
Counters of the number of operations for each of the relay functions.

By the interface program "MCom 2" it is possible to individually reset the counters and set an initial starting number.

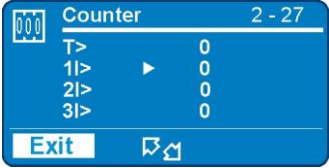
Display	→ T>	0	Operations counters	Thermal Image
	→ 1I>	0	Operations counters	First overcurrent element
	→ 2I>	0	Operations counters	Second overcurrent element
	→ 3I>	0	Operations counters	Third overcurrent element
	→ 1Io>	0	Operations counters	First Earth Fault element
	→ 2Io>	0	Operations counters	Second Earth Fault element
	→ 3Io>	0	Operations counters	Third Earth Fault element
	→ 1Is>	0	Operations counters	First Negative Sequence element
	→ 2Is>	0	Operations counters	Second Negative Sequence element
	→ 1U>	0	Operations counters	First Overvoltage element
	→ 2U>	0	Operations counters	Second Overvoltage element
	→ 1U<	0	Operations counters	First Undervoltage element
	→ 2U<	0	Operations counters	Second Undervoltage element
	→ 1f>	0	Operations counters	First Overfrequency element
	→ 2f>	0	Operations counters	Second Overfrequency element
	→ 1f<	0	Operations counters	First Underfrequency element
	→ 2f<	0	Operations counters	Second Underfrequency element
	→ 1Uo>	0	Operations counters	First Zero Sequence overvoltage element
	→ 2Uo>	0	Operations counters	Second Zero Sequence overvoltage element
	→ IRF	0	Operations counters	Internal Relay Fault
	→ U2>	0	Operations counters	Negative Sequence overvoltage element
	→ U1<	0	Operations counters	Positive Sequence undervoltage element
	→ TCS	0	Operations counters	Trip Circuit Supervision
	→ BrkF	0	Operations counters	Breaker failure to open
	→ Wi	0	Operations counters	Circuit Breaker maintenance alarm
	→ Aut Op	0	Operations counters	Automatic C/B Openings
	→ Aut CL	0	Operations counters	Automatic C/B Closings
	→ Man Op	0	Operations counters	Manual C/B Openings
	→ Man CL	0	Operations counters	Manual C/B Closings
	→ OvrOp	0	Operations counters	Overall C/B Openings total (Man+Aut)
	→ OvrCL	0	Operations counters	Overall C/B Closings total (Man+Aut)

- 1


 - Press “**Menu**” for access to the main menu with icons.
- 2


 - Press “**Counter**” for access.
- 3

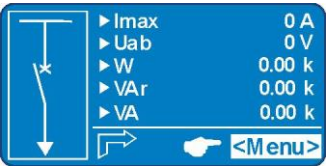
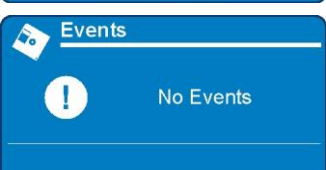
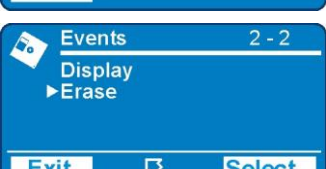
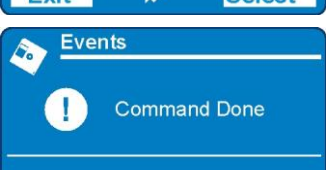

 - Press “**Display**” for access.
- 4


 - Display of the number of operations of each individual function.
 - With pushbuttons “**Increase**” or “**Decrease**” scroll the parameters
 - Press “**Exit**” go back to “3”.

12. Events

Display of the function which caused any of the following events: - *Status change of digital Inputs/Outputs.* - *Start of protection functions – Trip of protection function – Function reset.*
The last 100 events are recorded.
The memory buffer is updated at each new event.

Display	→	Reading events recorded.
Erase	→	Clear all events recorded.

- 1 
 - Press “**Menu**” for access to the main menu with icons.
- 2 
 - Select “**Events**” icon with pushbutton “**Increase**” or “**Decrease**”.
 - Press “**Select**” for access.
- 3 
 - Select “**Display**” with pushbutton “**Increase**” or “**Decrease**”.
 - Press “**Select**” for access.
 - For “**Erase**” go to “7”
- 4 
 - If no event is recorded the display shows message “**! No Events**”.
- 5 
 - If any event was recorded, select “**View**” to display the chronological list of the records.
 - By the keys “**Increase**” or “**Decrease**” select the date of the record to be checked.
- 6 
 - Will be shown:
 - “**Descr**” the function that caused the event
(Example: 1I> = Start, t1I> = Trip)
 - “**Edge**” if the function was tripped (Rise) or reset (Fall)
 - “**Date**”, date of trip, year/month/day, hour:minutes:seconds:milliseconds
- 7 
 - Select “**Erase**” with button “**Decrease**”.
 - Press “**Select**” to execute the commands; **All** Events recorded are erased.
(if Password is request, see § Password).
- 8 
 - When command has been execute the display shows “**! Command Done**”;
 - Press “**Exit**” to go back to the main menu.

12.1 – Events on display

Functions	Events Displayed	Events Description MScom2	Status
T>	Tal	Tal (Alarm – Thermal Image T>)	Rise
	T>	T> (Trip – Thermal Image T>)	Rise Fall
1l>	1l>	1l> (Start - First overcurrent element F50-51)	Rise
	t1l>	t1l> (Trip - First overcurrent element F50-51)	Rise Fall
2l>	2l>	2l> (Start – Second overcurrent element F50-51)	Rise
	t2l>	t2l> (Trip – Second overcurrent element F50-51)	Rise Fall
3l>	3l>	3l> (Start – Third overcurrent element F50-51)	Rise
	t3l>	t3l> (Trip - Third overcurrent element F50-51)	Rise Fall
1lo>	1lo>	1lo> (Start - First earth fault element F50N-51N)	Rise
	t1lo>	t1lo> (Trip - First earth fault element F50N-51N)	Rise Fall
2lo>	2lo>	2lo> (Start - Second earth fault element F50N-51N)	Rise
	t2lo>	t2lo> (Trip - Second earth fault element F50N-51N)	Rise Fall
3lo>	3lo>	3lo> (Start - Third earth fault element F50N-51N)	Rise
	t3lo>	t3lo> (Trip - Third earth fault element F50N-51N)	Rise Fall
1ls>	1ls>	1ls> (Start - First negative sequence current element F46)	Rise
	t1ls>	t1ls> (Trip - First negative sequence current element F46)	Rise Fall
2ls>	2ls>	2ls> (Start – Second negative sequence current element F46)	Rise
	t2ls>	t2ls> (Trip – Second negative sequence current element F46)	Rise Fall
1U>	1U>	1U> (Start - First overvoltage element F59)	Rise
	t1U>	t1U> (Trip - First overvoltage element F59)	Rise Fall
2U>	2U>	2U> (Start – Second overvoltage element F59)	Rise
	t2U>	t2U> (Trip – Second overvoltage element F59)	Rise Fall
1U<	1U<	1U< (Start - First undervoltage element F27)	Rise
	t1U<	t1U< (Trip - First undervoltage element F27)	Rise Fall
2U<	2U<	2U< (Start – Second undervoltage element F27)	Rise
	t2U<	t2U< (Trip – Second undervoltage element F27)	Rise Fall
1f>	1f>	1f> (Start - First overfrequency element F81)	Rise
	t1f>	t1f> (Trip - First overfrequency element F81)	Rise Fall
2f>	2f>	2f> (Start – Second overfrequency element F81)	Rise
	t2f>	t2f> (Trip – Second overfrequency element F81)	Rise Fall
1f<	1f<	1f< (Start - First underfrequency element F81)	Rise
	t1f<	t1f< (Trip - First underfrequency element F81)	Rise Fall
2f<	2f<	2f< (Start – Second underfrequency element F81)	Rise
	t2f<	t2f< (Trip – Second underfrequency element F81)	Rise Fall
1Uo>	1Uo>	1Uo> (Start - First zero sequence voltage element F59Uo)	Rise
	t1Uo>	t1Uo> (Trip - First zero sequence voltage element F59Uo)	Rise Fall
2Uo>	2Uo>	2Uo> (Start – Second zero sequence voltage element F59Uo)	Rise
	t2Uo>	t2Uo> (Trip – Second zero sequence voltage element F59Uo)	Rise Fall
U1<	U1<	U1< (Start - Positive sequence undervoltage element F27U1)	Rise
	tU1<	tU1< (Trip – Positive sequence undervoltage element F27U1)	Rise Fall
U2>	U2>	U2> (Start – Negative sequence overvoltage element F59U2)	Rise
	tU2>	tU2> (Trip – Negative sequence overvoltage element F59U2)	Rise Fall
Wi	tWi>	tWi> (Circuit breaker maintenance level)	Rise
TCS	TCS	TCS (Start - trip coil supervision)	Rise
	tTCS	tTCS (trip coil supervision)	Rise Fall
IRF	IRF	IRF (Start - Internal Relay Failure)	Rise
	tIRF	tIRF (Trip - Internal Relay Failure)	Rise
BF	tBF	tBF (Trip – Breaker Failure)	Rise

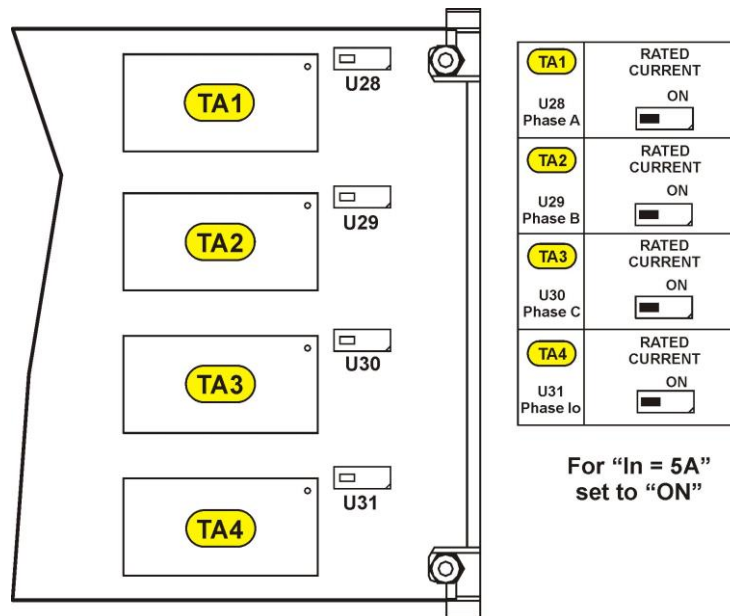
Functions	Events Displayed	Events Description MScom2	Status	
	L/Rdisc.	Local/Remote signal Discrepancy	Rise	
	manOpKey	Circuit Breaker intentional open by Key	Rise	
	manOpLocC	Circuit Breaker intentional open by local command	Rise	
	manOpRemC	Circuit Breaker intentional open by remote command	Rise	
	manOpExtIn	Circuit Breaker intentional open by external input	Rise	
	ExterManOp	Circuit Breaker intentional external open	Rise	
	manCIKey	Circuit Breaker intentional close by Key	Rise	
	manCILocC	Circuit Breaker intentional close by local command	Rise	
	manCIRemC	Circuit Breaker intentional close by remote command	Rise	
	manCIExtIn	Circuit Breaker intentional close by external input	Rise	
	ExterManCh	Circuit Breaker intentional external close	Rise	
	CB-Fail	Circuit Breaker failure	Rise	Fall
	0.D0	Digital Input		
	----		Rise	Fall
	0.D4			
	1.D1	Digital input		
	----		Rise	Fall
	1.D15			
	2.D1	Digital input		
	----		Rise	Fall
	2.D15			
	0.R1	Output relay		
	----		Rise	Fall
	0.R6			
	1.R1	Output relay		
	----		Rise	Fall
	1.R14			
	2.R1	Output relay		
	----		Rise	Fall
	2.R14			
	UpDateMon	Update Monitor	Rise	Fall
	IPU boot	IPU boot	Rise	

13. System (System parameters)

Setting of system parameters.

CT&PTs	Phase CT	Prim.	→	1000	A	(1 ÷ 9999)	step	1	A	(1)
		Sec.	→	1	A	(1 / 5)				
	PT (Ph-Ph)	Prim.	→	10.00	kV	(0.10 ÷ 500.00)	step	0.01	kV	(2)(3)
		Sec.	→	100	V	(50 ÷ 150)	step	1	V	
	Neut. CT	Prim.	→	1000	A	(1÷9999)		1	A	(1)
		Sec.	→	1	A	(1 / 5)				
	Sys.Ratings (System Rated Values)		→	fn	50	Hz	(50 / 60)			
			→	In	500	A	(1÷9999)		1	A
→			Un	10.00	kV	(0.10 ÷ 500.00)		0.01	kV	
Setup Group		→	Group	1		(1 / 2)				

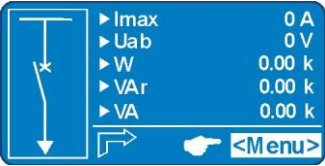
(1) Move the switch in the corresponding founding to the required input current as herebelow shorted.

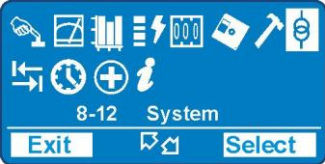


(2) Set the value of the phase-to-phase PT voltage.

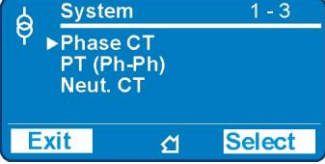
$$\text{Example : TV } \frac{10000 : \sqrt{3}}{100 : \sqrt{3}} \rightarrow \text{set } \frac{\text{Prim.} = 10000}{\text{Sec.} = 100}$$

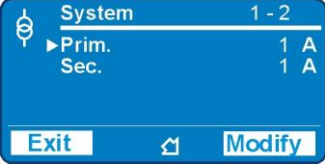
(3) Zero sequence voltage input is to be supplied by three system P.Ts. Y/Open Delta connected; the open delta connected secondary are rated 1/3 of the phase-to-phase secondary voltage (Example: 10000 / 100:√3 / 100:3).

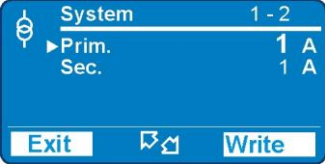
- 

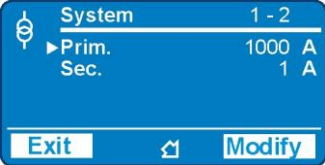
 - Press “**Menu**” for access to the main menu with icons.
- 

 - Select “**System**” icon with pushbuttons “**Increase**” or “**Decrease**”.
 - Press “**Select**” for access.
- 

 - Select “**CT&PTs**”.
 - Press “**Select**” for access.
- 

 - Select “**Phase CT**”.
 - Press “**Select**” for access.
- 

 - Select “**Prim.**” to modify the primary value of Phase CT, or press “**Decrease**” and select “**Sec.**” to modify the secondary value of Phase CT.
 - Press “**Modify**” to modify the parameter.
(if Password is request, see § Password).
- 

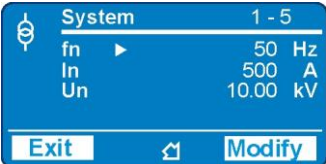
 - The value appear as bold figure.
 - Use pushbuttons “**Increase**” or “**Decrease**” to set the value.
 - Press “**Write**” to confirm the value
- 

 - The value is now set.
 - To set a new value return to the point “5”.
 - Press “**Exit**”.
- 

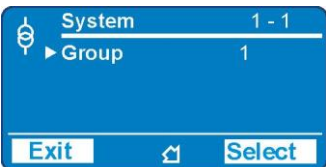
 - The display show “**Confirm the change?**”.
 - Choose “**Yes**” to convalidate the changes.
 - Choose “**No**” to not confirm the changes.
 - After set confirmation (or non confirmation) the display goes back to point “4”.

- 9


 - To modify the input quantities, select with pushbutton “**Decrease**”, “**Sys.Ratings**”.
 - Press “**Select**” for access.
- 10


 - To set the input quantities see points “5-6-7-8” .
- 11


 - To select the Active Bank of setting press “**SetUp Group**”.
- 12


 - Select with pushbuttons “**Increase**” or “**Decrease**”, the Bank to be Active.

14. Settings

Two complete banks of settings of the programmable variables are available in the “**SETTING**” menu. Both “Bank #1” and “Bank #2” include the hereunder listed variables.

- 1   Indicates the Setting Bank that is actually being modified.
-  This symbol indicates that the function is enabled; symbol missing indicates that the function is disabled.

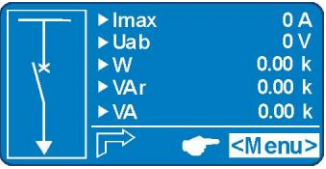
→ Comunic.	Serial communication parameters
→ Customize	Visualization parameters
→ T>	Thermal Image
→ 1I>	First overcurrent Element
→ 2I>	Second overcurrent Element
→ 3I>	Third overcurrent Element
→ 1Io>	First Earth Fault Element
→ 2Io>	Second Earth Fault Element
→ 3Io>	Third Earth Fault Element
→ 1Is>	First Negative Sequence Current Element
→ 2Is>	Second Negative Sequence Current Element
→ 1U>	First Overvoltage Element
→ 2U>	Second Overvoltage Element
→ 1U<	First Undervoltage Element
→ 2U<	Second Undervoltage Element
→ 1f>	First Overfrequency Element
→ 2f>	Second Overfrequency Element
→ 1f<	First Underfrequency Element
→ 2f<	Second Underfrequency Element
→ 1Uo>	First Zero Sequence Voltage Element
→ 2Uo>	Second Zero Sequence Voltage Element
→ U1<	Positive Sequence Undervoltage Element F27U1
→ U2>	Negative sequence Overvoltage Element F59U2 or F47
→ Wi	Amount of Energy to reach the C/B maintenance level
→ TCS	Setting variables for Trip Circuit Supervision
→ IRF	Internal Relay Fault
→ CB Manage	C/B command Local / Remote setting
→ Oscillo	Setting variables for Oscillographic recording
→ BreakerFail	Setting variables for Breaker Failure detection
→ ExtResCfg	Configuration for external reset input

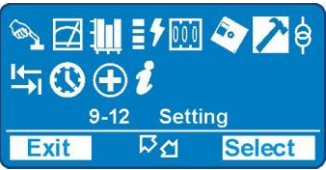


14.1 Modifying the setting of variables

To modify any variable setting by the keyboard proceed as follows:

(example: change setting of element “1I>”, from “Is 4.000 In” to “Is 3.500 In”)

- 

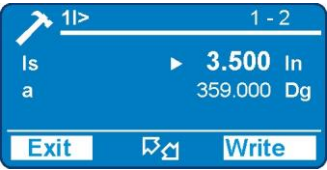
 - Press “Menu” for access to the main menu with icons.
- 

 - Select icon “Setting” by pushbuttons “Increase” or “Decrease”.
 - Press “Select”.
- 

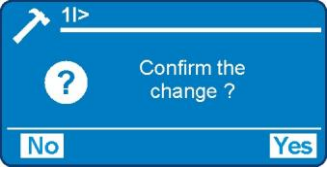
 - Select by pushbuttons “Increase” or “Decrease” the parameter “1I>”.
 - Press “Select”.
- 

 - Select by buttons “Increase” or “Decrease” the menu “Oper.Levels”.
 - Press “Select”.
- 

 - The arrow aside “Is” shows the parameter selected for changing
 - Press “Modify”.
 - If Password is request, see § Password
- 

 - The value appear as bold figure.
- 

 - Set new values pushbuttons “Increase” or “Decrease” buttons
 - Press “Write”.
- 

 - If the change of parameters is completed, press “Exit”.
- 

 - “Yes” confirm all changes.
 - “No” voids all the changes.
- 

 - The relay returns to point “4”.

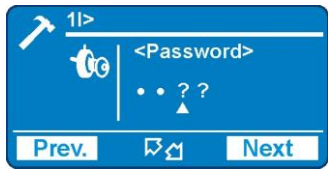
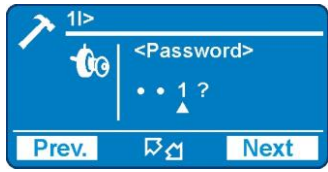
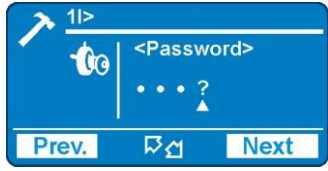
14.2. Password

The password is requested any time the user wishes to modify any password protected parameter (example "1l>" menu "Setting").

The factory default password is "1111".

The password is only modifiable with "MCom 2" software (see Manual "MCom 2").

When password is requested, proceed as follows:

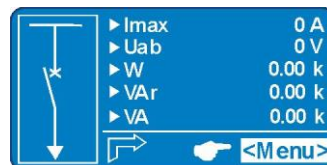
- | | | | |
|--|--|---|---|
| 1  | <ul style="list-style-type: none"> Use the key "Increase" and "Decrease" and set the first digit of password. | 5  | <ul style="list-style-type: none"> Use the key "Increase" or "Decrease" to set the third digit. |
| 2  | <ul style="list-style-type: none"> Press "Next" to validate and go to the next digit. | 6  | <ul style="list-style-type: none"> Press "Next" to validate and go to the next digit. |
| 3  | <ul style="list-style-type: none"> Use the key "Increase" or "Decrease" to set second digit. | 7  | <ul style="list-style-type: none"> Use the key "Increase" or "Decrease" to set the fourth digit. |
| 4  | <ul style="list-style-type: none"> Press "Next" to validate and go to the next digit. | 8  | <ul style="list-style-type: none"> Press "Next" to validate and go to modify the next parameter. |



By key "**Prev**" go back to previous digit.



The password validity expires 60 sec after the last setting modification or as soon as you go back to the main menu



- | | | | |
|--|--|---|---|
| 1  | <ul style="list-style-type: none"> If set the incorrect password the display shows "! Wrong code". | 2  | <ul style="list-style-type: none"> The display will repeat the initial interrogation |
|--|--|---|---|



14.3 – Menu: **Communic.** (Communication)

Options	→ BRLoc	38400	[9600 / 19200 / 38400 / 57600]
	→ BRRem	19200	[9600 / 19200 / 38400]
	→ PRRem	Modbus	[Modbus / IEC103]
Node Address	→ Indir.	1	[1 ÷ 255]

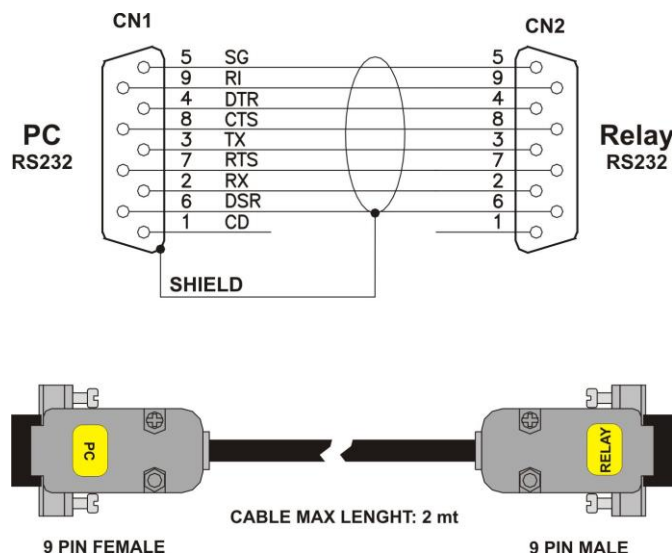
14.3.1 – Description of variables

- ❑ **BRLoc** : RS232 local (Front Panel) serial communication speed
- ❑ **BRRem** : RS485 remote (Rear terminal block) serial communication speed
- ❑ **PRRem** : Protocol for remote (Rear terminal block) serial communication RS485
- ❑ **Indir.** : Identification number for the connection on serial communication bus

14.3.2 – Front Panel serial communication port (RS232)

A D-Sub, -pin female socket is available on Relay's front face for connection to the local RS232 serial communication line. Through this port - and by the interface program available from Microelettrica Scientifica S.p.A. (MSCom 2 for Windows 98/ME/2000/XP) – it is possible to connect a Personal Computer to download all available information, operate any control and program the relay; the protocol used is "Modbus RTU".

14.3.3 – Cable for direct connection of Relay to Personal Computer



14.3.4 – Main serial communication port (RS485)

From the Relay's back terminal board, a RS485 ports is available for communication with SCADA system with Protocol Modbus RTU or IEC60870-5-103 (selectable).

The communication interface allows to program all settings, operate all commands and download all information and records.

The physical connection can be via a normal pair of wires (RS485) or, on request, via fiber optic.



14.4 - Menu: **Customize**

Options	→ Lang	English	[English / Loc.Lang]
	→ Light	On	[Autom. / On]

14.4.1 – Description of variables

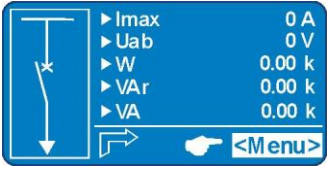
- ❑ **Lang** : Set Language
- ❑ **Light** : Set Display backlight

This menu allows to customize the Language and the Display's backlight.

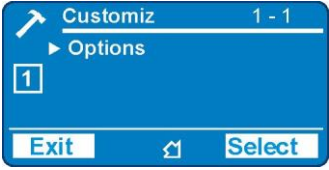
The standard languages are English and Italian. On request, other languages can be loaded (French, German, etc..).

The Display backlight can be programmed always on "ON" or switched-on "Automatically" for a few second at any operation of the keyboard "Auto".

Example: set Local Language.

- 

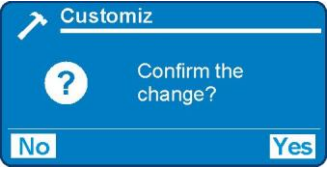
- Press "**Menu**" for access to the main menu with icons.
- 

- Select icon "**Setting**" by pushbuttons "**Increase**" or "**Decrease**".
 - Press "**Select**".
- 

- Select "**Bank 1**" or "**Bank 2**".
 - Select "**Customize**".
 - Select "**Options**".
 - Press "**Select**".
- 

- Select "**Lang**".
 - Press "**Modify**".
- 

- Select "**Loc.Lang**".
 - Press "**Write**".
 - If Password is requested, see § Password
- 

- Press "**Exit**".
- 

- "**Yes**" confirms all changes.
 - "**No**" void all changes.
- 

- After set confirmation the display shows "**Please Wait**".



14.5 - Function: T> (Thermal Image F49)

Status	→ Enab.	No	[No / Yes]
Options	→ OPMOD	I1 I2	[I1 I2 – I _{max}]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper.Levels	→ Tal	10.000	%Tn [10 ÷ 100] step 1.000 %Tn
	→ Is	0.500	[0.5 ÷ 1.5] step 0.010
	→ Kt	1.000	min [1 ÷ 600] step 0.010 min

14.5.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **OPMOD** : Operation Mode
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the “T>” function.
- ☐ **Tal** : Temperature prealarm level
- ☐ **Is** : Continuous admissible current
- ☐ **Kt** : Warming-up Time Constant of the load

14.5.2 - Trip and Alarm

The algorithm compares the amount of heat accumulated “T” ($\equiv i^2 \cdot t$) to the steady state amount of heat “T_n” corresponding to continuous operation of the rated current “I_n”.

When the ratio “T/T_n” reaches the level set for Thermal Alarm “Tal” or the max allowed heating, the relay trips accordingly

14.5.2.1 – Operation mode “I_{max}”

With this option, the largest of the three phase currents measured is used to compute the Thermal Image:

$$I = \text{MAX}(I_a, I_b, I_c)$$

14.5.2.2 – Operation mode “I₁-I₂”

With this option, a composition of Positive and Negative Sequence components of the current measured is used to compute the Thermal Image:

$$I = \sqrt{(I_1)^2 + 3(I_2)^2}$$

14.5.2.3 – Trip time of the Thermal Image Element

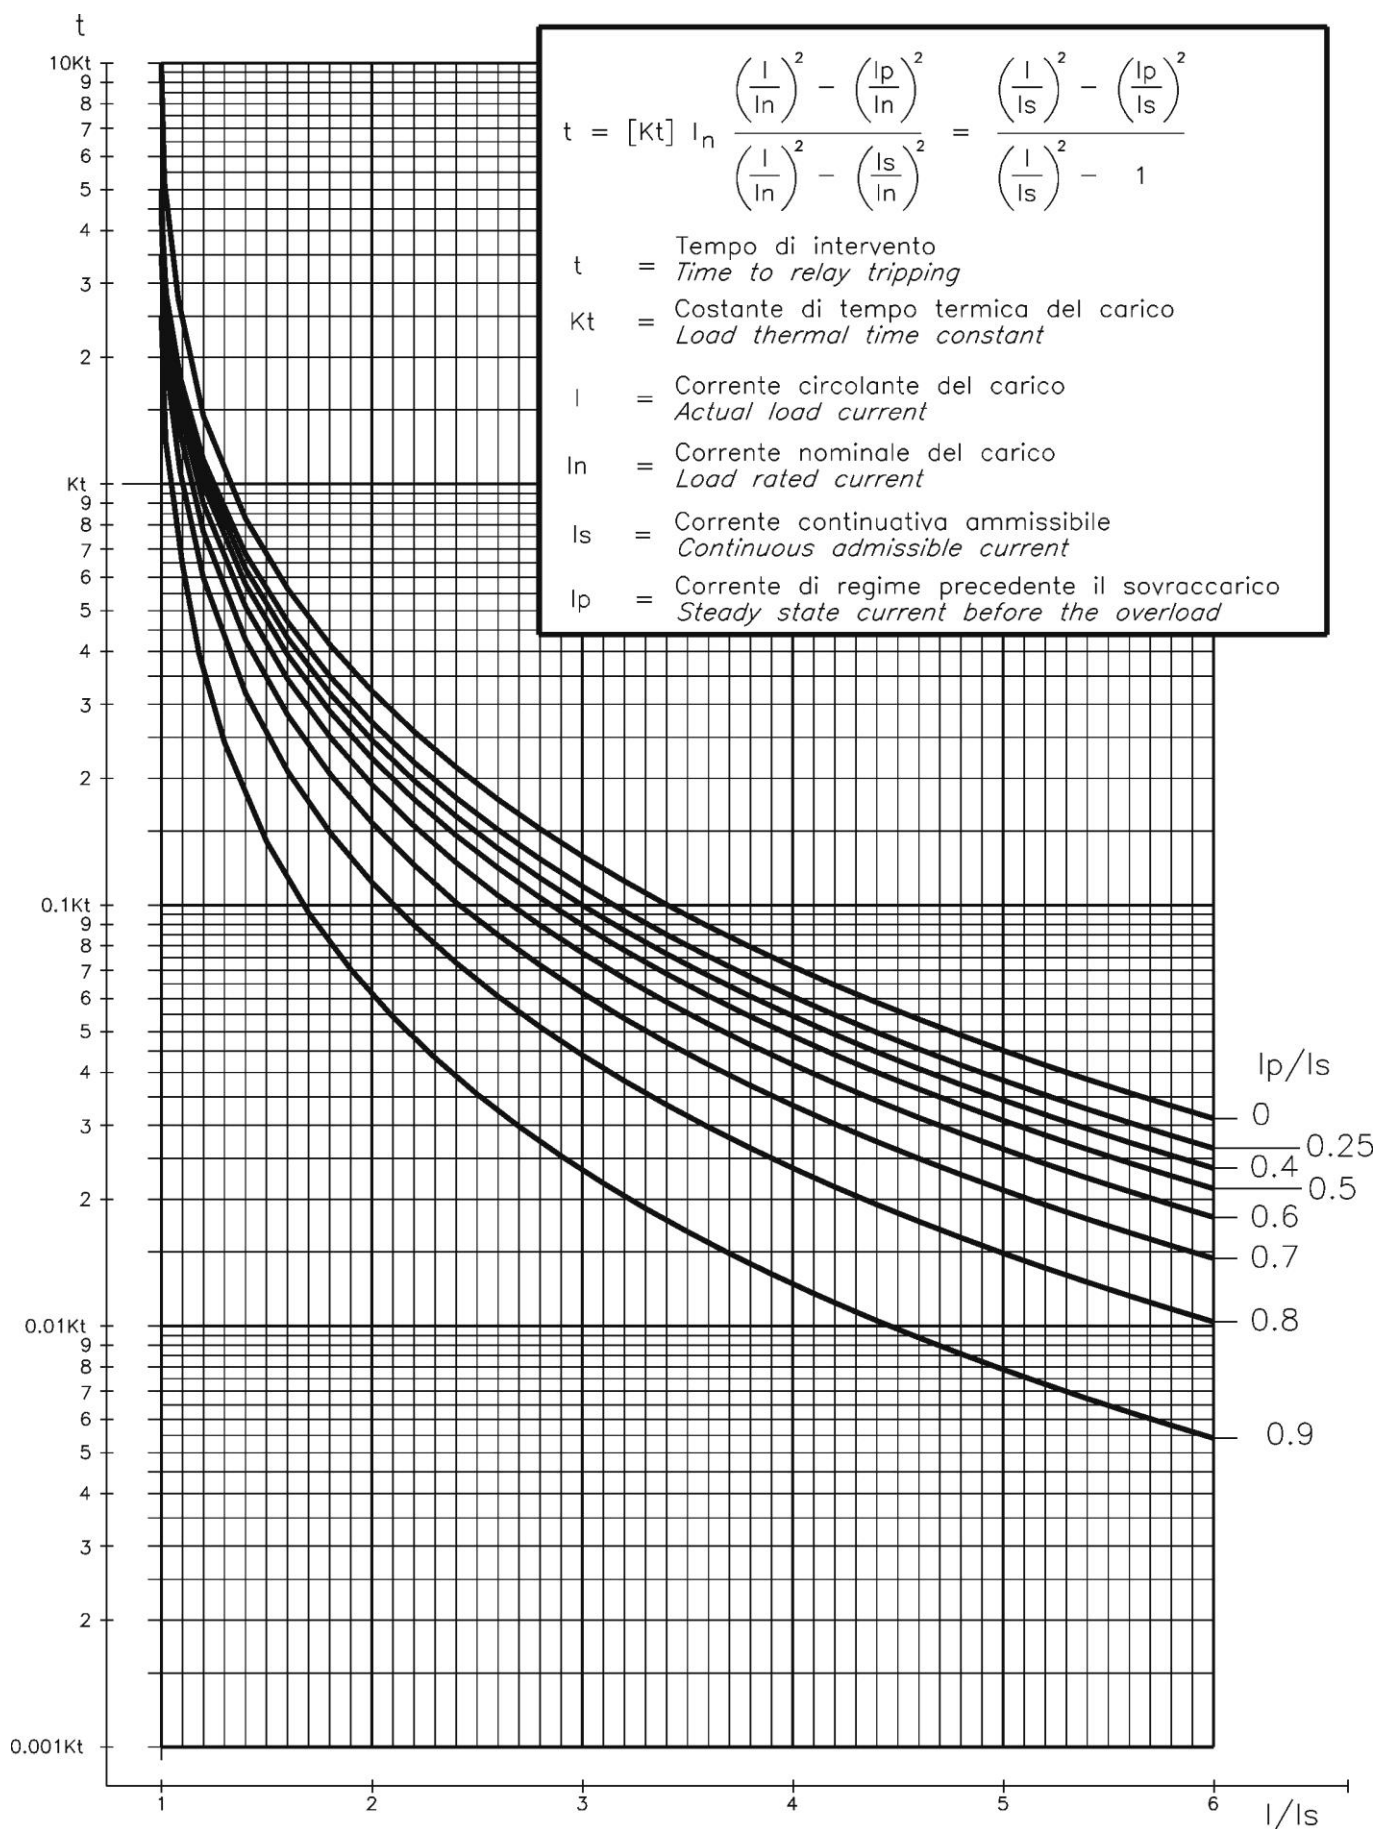
The trip time of the Thermal Image Element is a function of the current “I” flowing into the load and depends on its warming-up Time Constant “Kt”, on the previous thermal status “Ip” and on the maximum admissible continuous current “Is” according to the equation:

$$t = Kt \cdot \ell_n \frac{\left(\frac{I}{I_n}\right)^2 - \left(\frac{I_p}{I_n}\right)^2}{\left(\frac{I}{I_n}\right)^2 - \left(\frac{I_s}{I_n}\right)^2}$$

t	=	Time to relay tripping
Kt	=	Load thermal time constant
I	=	Actual load current
I_n	=	Load rated current
I_s	=	Continuous admissible current
I_p	=	Steady state current before the overload
ℓ_n	=	Natural Logarithm

When the heating exceeds the set alarm level “Tal” or the max. allowed level (“I” > “Is” for the time “t”) the output relays programmed for these function will be operated. Reset will take place when the heating will drop below 99% of the trip level.

14.5.2.4 – Thermal Image Curves (TU1024 Rev.1)





14.6 - Function: 1I> (First Overcurrent Element F50/51)

Status	→ Enab.	No	[No / Yes]
Options	→ f(t)	Type - D	[D / A / B / C / I / VI / EI / MI / SI]
	→ tBI	Off	[Off / 2tBO]
	→ f(a)	Disable	[Disable / Sup / Dir]
	→ f(U)	Disable	[Disable / Enable]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Is	4.000	In (0.100÷4) step 0.010 In
	→ a	359.000	° (0.000÷359) step 1.000 °
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s
	→ tBO	0.75	s (0.05÷0.75) step 0.01 s (1)

14.6.1 - Description of variables

- **Enab.** : Function enabling (No = Disable / Yes = Enable)
- **f(t)** : Operation characteristic (Time/Current curve): (see § 14.6.2)
 - (D) = Independent definite time
 - (A) = IEC Inverse Curve type A
 - (B) = IEC Very Inverse Curve type B
 - (C) = IEC Extremely Inverse Curve type C
 - (I) = IEEE Inverse Curve
 - (VI) = IEEE Very Inverse Curve
 - (EI) = IEEE Extremely Inverse Curve
 - (MI) = IEEE Moderate Inverse Curve
 - (SI) = IEEE Short Inverse Curve
- **tBI** : Blocking input reset time (see § 14.6.7)
 - Off = Permanent block
 - 2tBO = Set 2xtBO.
- **f(a)** : Operation mode: (see § 14.6.5)
 - Disable = Non Directional
 - Sup. = Directional Supervision
 - Dir. = Total Directional
- **f(U)** : Voltage restraint (see § 14.6.6)
- **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- **Is** : Minimum operation level
- **a** : Reference phase current displacement angle for Directional operation
- **ts** : Trip time delay
- **tBO** : Time to reset of the Blocking Output after expiring of the Trip time delay. “tBO” is also the trip time delay of the Breaker Failure function. (see § 14.6.7)

14.6.2 - Algorithm of the time current curves

The Time Current Curves are generally calculated with the following equation

$$(1) \quad t(I) = \left[\frac{A}{\left(\frac{I}{I_s}\right)^a - 1} + B \right] \cdot K \cdot T_s + T_r \quad \text{where}$$

$t(I)$ = Actual trip time delay when the input current equals "I"

I_s = Set minimum pick-up level

$$K = \left(\frac{A}{10^a - 1} + B \right)^{-1}$$

T_s = Set time delay: $t(I) = T_s$ when $\frac{I}{I_s} = 10$

t_r = Operation time of the output relay on pick-up.

The parameters A, B and a have different values for the different Time Current Curves.

Curve Name	Curve Identifier	A	B	a
IEC A Inverse	A	0.14	0	0.02
IEC B Very Inverse	B	13.5	0	1
IEC C Extremely Inverse	C	80	0	2
IEEE Moderate Inverse	MI	0.0104	0.0226	0.02
IEEE Short Inverse	SI	0.00342	0.00262	0.02
IEEE Very Inverse	VI	3.88	0.0963	2
IEEE Inverse	I	5.95	0.18	2
IEEE Extremely Inverse	EI	5.67	0.0352	2

For the IEC curves, being $B = 0$, the Time/Current equation (1), becomes:

$$(1') \quad t(I) = \frac{(10^a - 1)T_s}{\left(\frac{I}{I_s}\right)^a - 1} + t_r = \frac{Kt}{\left(\frac{I}{I_s}\right)^a - 1} + t_r$$

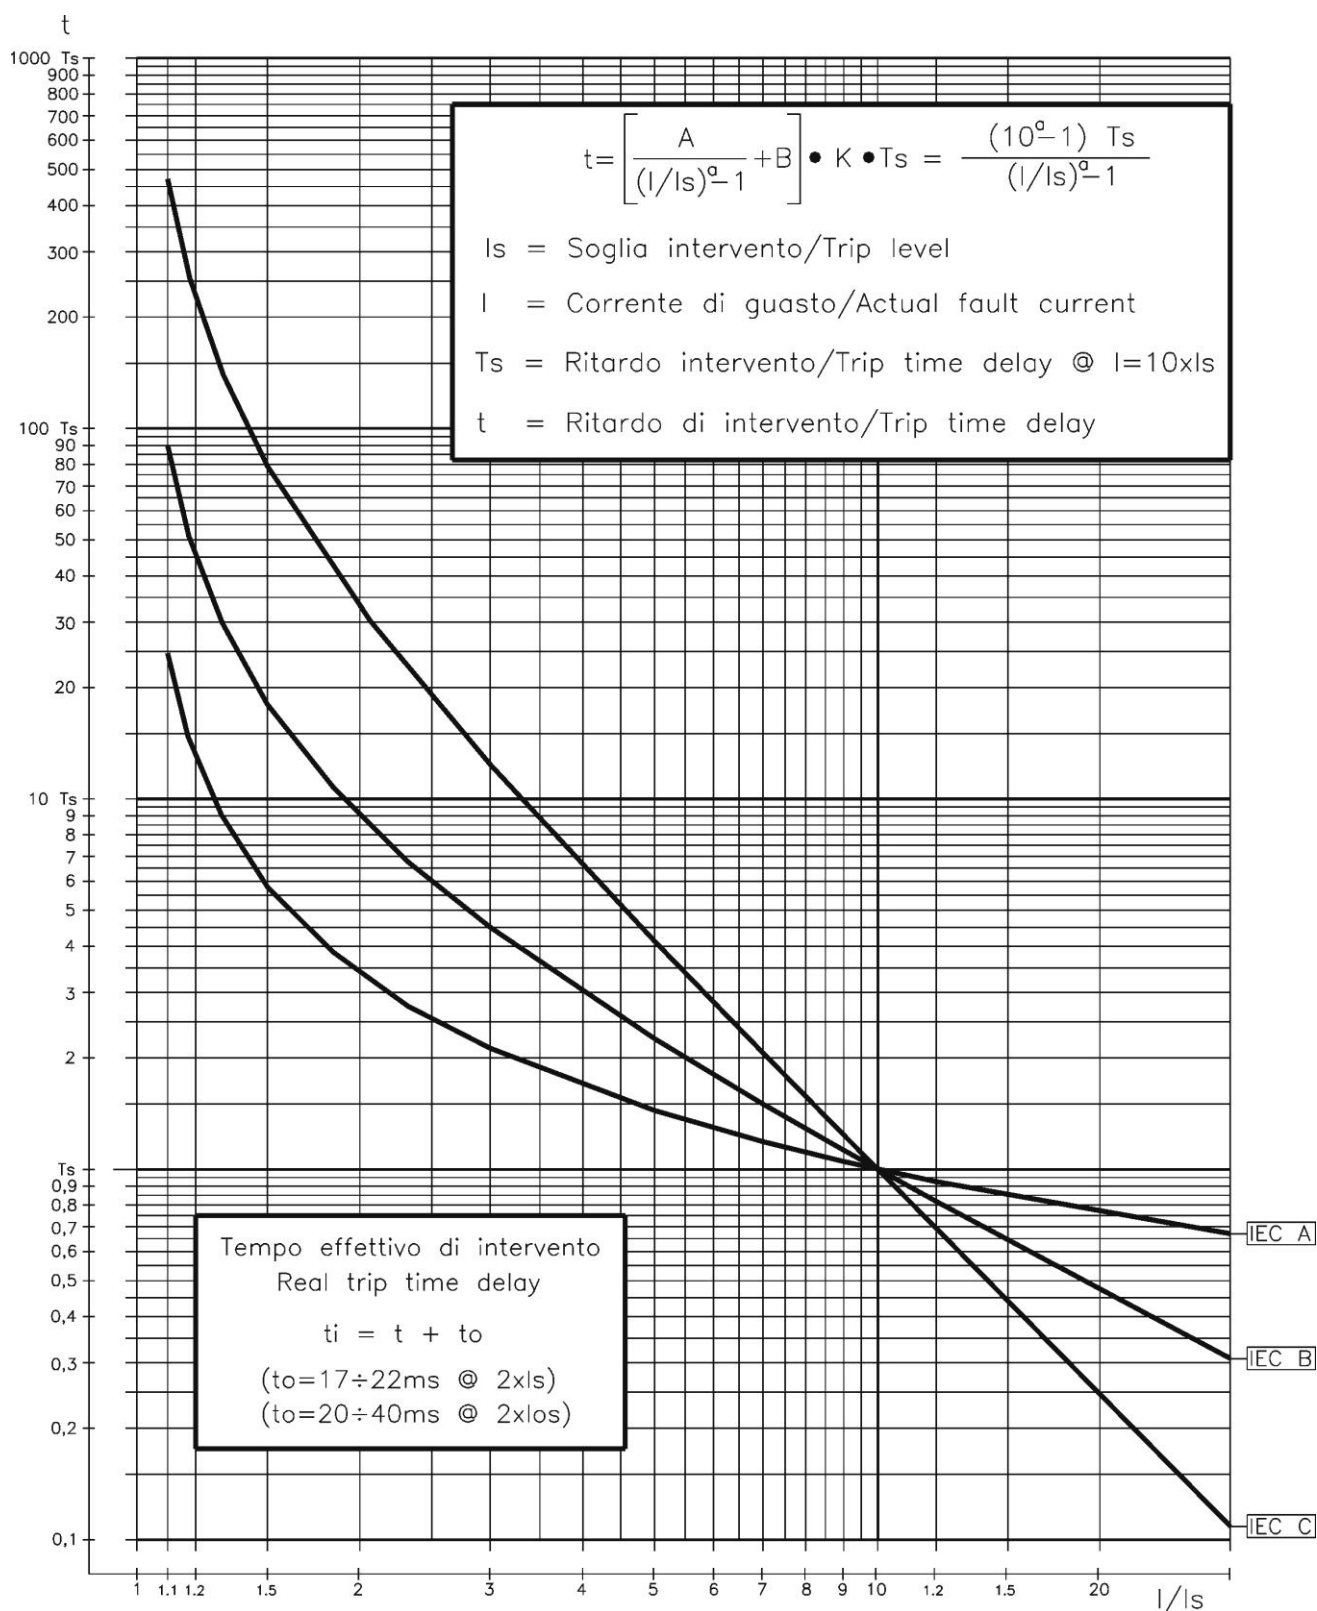
Where $Kt = (10^a - 1)T_s$ is the time multiplier

When "f(t) = D" is programmed, the trip time delay is Definite and independent from the current: excess "t = ts".

The maximum measuring current is "40xIn" for phase elements and "10xOn" for the neutral elements.

Trip takes place when the current measured exceeds (no matter how much) the set level "Is" for the set time "ts".

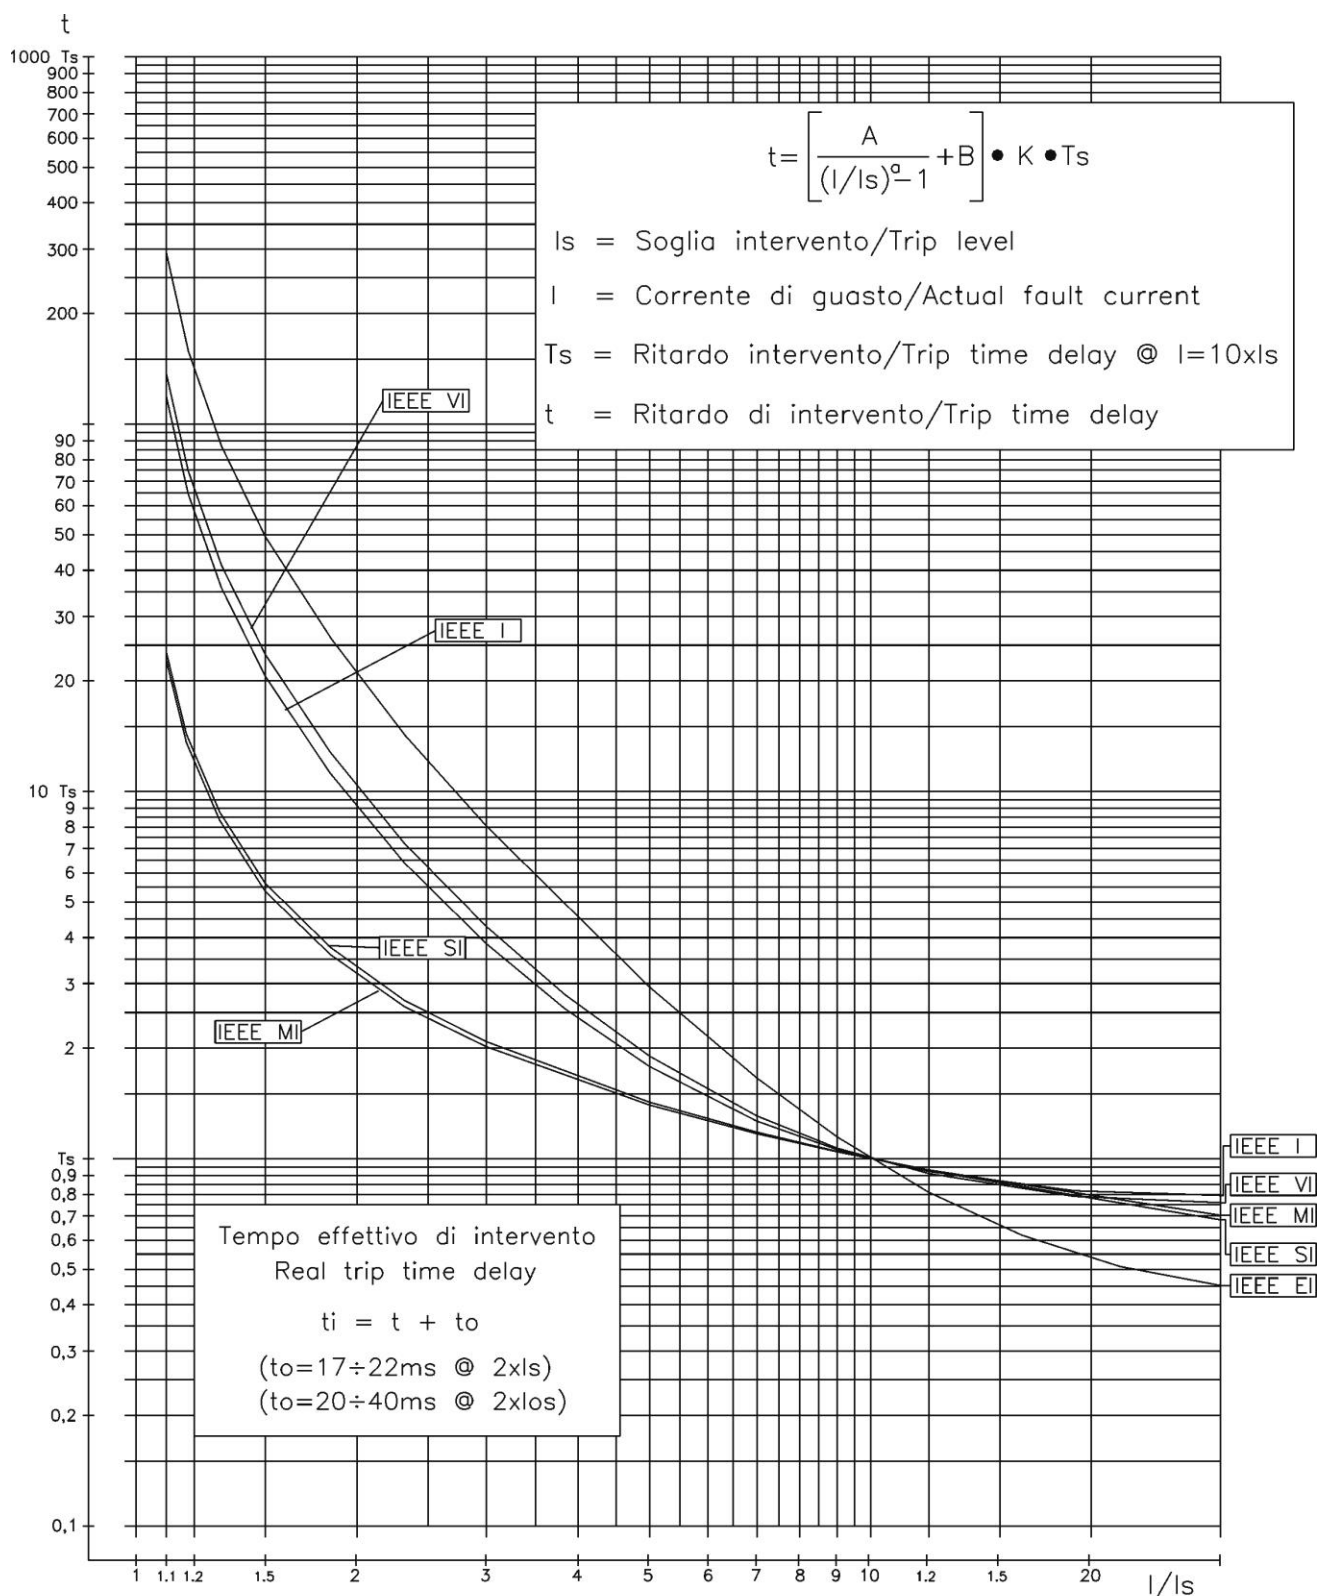
14.6.3 - IEC Curves



Curve Type	A	B	K	α
IEC A	0.14	0	0.336632	0.02
IEC B	13.5	0	0.666667	1
IEC C	80	0	1.2375	2

Max. "I" Phase = $40 \times I_n$
 Max. "I" Neutral = $10 \times I_n$

14.6.4 – IEEE Curves



Curve Type	A	B	K	a
MI= IEEE Moderate Inv.	0.0104	0.0226	4.110608	0.02
SI= IEEE Short Inv.	0.00342	0.00262	13.30009	0.02
VI= IEEE Very Inv.	3.88	0.0963	7.380514	2
I= IEEE Inverse	5.95	0.18	4.164914	2
EI= IEEE Extremely Inv.	5.67	0.0352	10.814	2

Max. "I" Phase = $40 \times I_n$
 Max. "I" Neutral = $10 \times I_n$

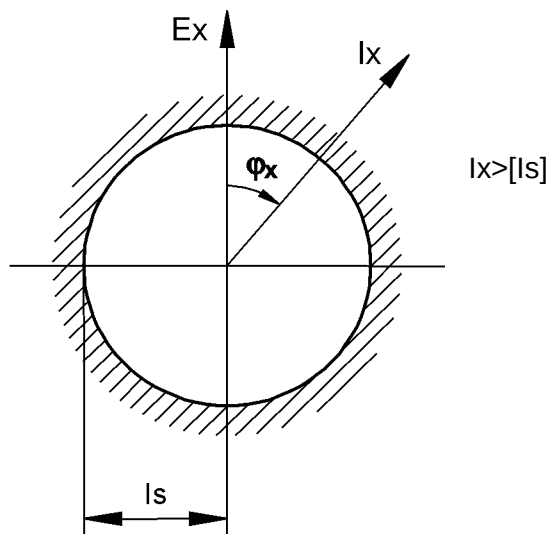
14.6.5 – Operation of the phase Overcurrent Elements in function of variable “f(a)”

On each phase the relay measures the current “I_x” and its displacement “φ_x” from the relevant phase-to-neutral voltage “E_x”.

Different operation modes are possible according to the programming of the variable “f(a)”.

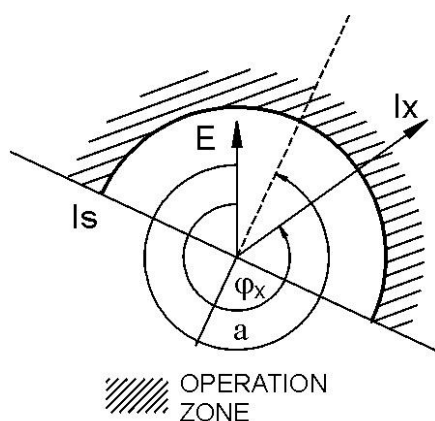
- I_s = Minimum operation current level.
- a = Operation reference angle (phase x; x = A, B, C).
- I_x = Measured input current (largest among the three phase currents I_A, I_B, I_C).
- φ_x = Phase displacement of current “I_x” from phase-to-neutral “E_x” (X = A, B, C).
- I_{dx} = Component of “I_x” on the direction “a”.

A) Set f(a) = Disab.



The overcurrent element operates independently from the current direction.

B) Set f(a) = Sup.



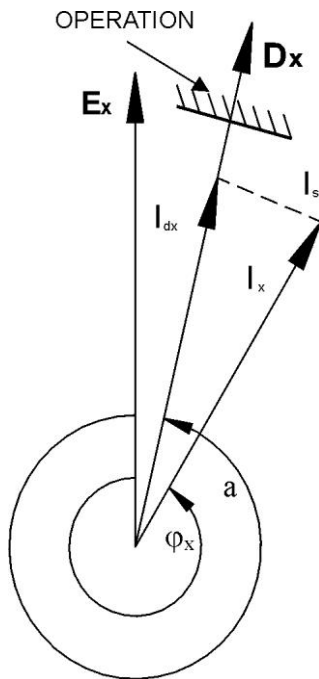
The Overcurrent element only supervises the direction of the current:

the operation conditions are:

- Input voltage above 1-2% of the rated input value.
- Input current above the set level: I_x > [I_s]
- Phase displacement “φ_x” within ±90° from the reference direction “a”.

$$(a - 90^\circ) < \varphi_x < (a + 90^\circ)$$

C) Set $f(a) = \text{Dir.}$



The overcurrent element operates in a real directional mode measuring the component “ I_{dx} ” of the input current in the reference direction “ a ” ($x = A, B, C$).

$$I_{dA} = I_A \cos(\varphi_A - a) \quad I_{dB} = I_B \cos(\varphi_B - a) \quad I_{dC} = I_C \cos(\varphi_C - a)$$

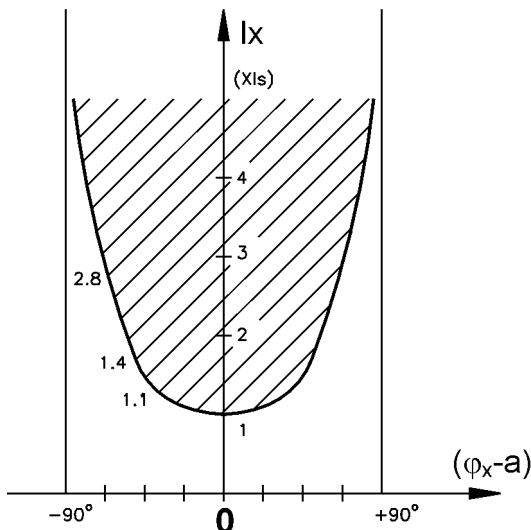
The overcurrent starts to operate when the component “ I_{dx} ” of the input current in the direction “ D_x ” (versor displaced of “ a ” from the phase-to-neutral voltage “ E_x ”) exceeds the set level “ I_s ”.

$$I_{dx} = I_x \cos(\varphi_x - a) \geq I_s$$

In details:

- When $\varphi_x = a$: $I_{dx} = I_x \rightarrow$ operation if $I_x > I_s$
- When $(\varphi_x - a) = 90^\circ$: $I_{dx} = 0 \rightarrow$ no operation
- When $(\varphi_x - a) > 90^\circ$: I_{dx} opposite to $D_x \rightarrow$ no operation

The operation is practically independent from the voltage as low as 1-2% of rated value.

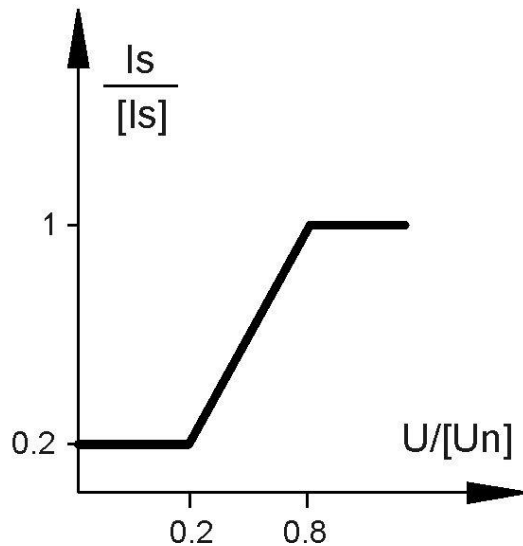


Recommended Reference angles for different applications:

- Measurement of resistive component of current (active power) :
Direct : $a = 0^\circ$ - Reverse : $a = 180^\circ$
- Directional phase fault detection:
Direct : $a = 300^\circ (60^\circ \text{ lag})$ - Reverse : $a = 120^\circ$
- Measurement of inductive reactive component:
Direct : $a = 270^\circ (90^\circ \text{ lag})$ - Reverse : $a = 90^\circ$
- Measurement of capacitive reactive component:
Direct : $a = 90^\circ (90^\circ \text{ lead})$ - Reverse : $a = 270^\circ$

14.6.6 – Operation of the Overcurrent Element with Voltage Control f(U)

When the “Voltage Restraint” function is enabled (F(U)=Enable), the set minimum pick-up level “Is” of the overcurrent elements, changes proportionally to the smallest of the input phase-to-phase voltages: $I_s = F(U)$.



$$\frac{I_s}{[I_s]} = \frac{\text{Actual pick - up level}}{[\text{Set pick - up level}]}$$

$$\frac{U}{[U_{ns}]} = \frac{\text{Actual input voltage}}{[\text{Set rated input voltage}]}$$

the algorithm uses the smallest among the ratios $\frac{E_x \cdot \sqrt{3}}{[U_{ns}]}$ (x = A, B, C)

Practically, between 0.2 U_{ns} and 0.8 U_{ns} , the trip level of the Overcurrent element varies according to the equation:

$$\frac{I_s}{[I_s]} = \frac{0.8}{0.6} \cdot \left(\frac{U}{[U_{ns}]} - 0.8 \right) + 1$$

Below 0.2 $[U_n]$ $\frac{I_s}{[I_s]} = 0.2$

Above 0.8 $[U_n]$ $\frac{I_s}{[I_s]} = 1$

14.6.7 – Blocking Logic (BO-BI)

For each Protection Function it is possible to activate a Blocking Logic allowing for inhibiting their operation by external signals supplied to the Digital Input.

14.6.7.1 – Output Blocking signal “BO”

All the protection functions that can be programmed to operate in the blocking logic mode, element, have an instantaneous element (beside the time delayed) which is operated as soon as the controlled quantity exceeds the set trip level ($I > [Is]$ for current, etc..) and is instantaneously reset when the input quantity drops below the reset level (normally $0.95Is$).

The instantaneous element can control one of the user programmable output relays that, by its contacts, makes the signal available for blocking an external element (BO = Blocking Output). In case, “tBO” sec after the set trip time “ts” has expired, the Protection function is still in operation (current above trip level), the Blocking Output relay (instantaneous element) is anyhow reset to eventually remove the Blocking signal from a back-up protection.

14.6.7.2 – Blocking Input “BI”

For all the functions controllable by the Blocking Logic, it is possible to inhibit the time delayed tripping by an external signal that activates a Digital Input programmed for this functionality. The programmed Digital Input gets activated by an external cold contact closing across its terminals.

With the variable “tBI” set to “OFF” (tBI=OFF), the tripping of the delayed function is blocked as long as the Blocking Input signal is present at the terminals of the Digital Input.

With the variable “tBI” set to “2xtBI” (tBI=2xtBI), 2xtBI seconds after the set trip time delay of the function has expired the blocking input is anyhow ignored and the function enabled to trip.

14.6.8 - Automatic doubling of Overcurrent thresholds on current inrush

For some of the phase Overcurrent functions it is possible to have the set trip level $[Is]$ automatically doubled when strong inrush current is detected.

If at circuit Breaker switch-on (i.e. when the input current rises from zero to a minimum measurable value) the current increases from 0 to 1.5 times the rated value $[In]$ in less than 60ms, the set minimum pick-up level $[Is]$ is dynamically doubled ($[Is] \rightarrow [2Is]$) and keeps this value until the input current drops below $1.25 \times In$ or the set time $[t2xI]$ has elapsed.

This functionality is very useful to avoid spurious tripping of the instantaneous, or short-time delayed Overcurrent elements, that could be experienced at switch-on of reactive loads like Transformer or Capacitors.



14.7 – Function: 2I> (Second Overcurrent Element F50/51)

Stats	→ Enab.	No	[No / Yes]
Options	→ tBI	Off	[Off / 2tBO]
	→ f(a)	Disable	[Disable / Sup / Dir]
	→ 2xl	Disable	[Disable / Enable]
	→ f(U)	Disable	[Disable / Enable]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Is	40.000	In (0.100÷40) step 0.010 In
	→ a	359.000	° (0.000÷359) step 1.000 °
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s
	→ tBO	0.75	s (0.05÷0.75) step 0.01 s
	→ t2xl	100.00	s (0.02÷100) step 0.01 s
	→ td2xl	0.06	s fixed

14.7.1 – Description of variables

- ❑ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ❑ **tBI** : Blocking input reset time (see § 14.6.2)
 - Off = Permanent block
 - 2tBO = Set 2xtBO.
- ❑ **f(a)** : Operation mode: (see § 14.6.5)
 - Disable = Non Directional
 - Sup. = Directional Supervision
 - Dir. = Total Directional
- ❑ **2xl** : Automatic doubling of trip level on inrush (see § 14.6.8)
- ❑ **f(U)** : Voltage restraint (see § 14.6.6)
- ❑ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ❑ **Is** : Minimum operation level
- ❑ **a** : Reference phase current displacement angle for Directional operation
- ❑ **ts** : Trip time delay
- ❑ **tBO** : Time to reset of the Blocking Output after expiring of the Trip time delay. “tBO” is also the trip time delay of the Breaker Failure function. (see § 14.6.7)
- ❑ **t2xl** : Maximum time of automatic threshold doubling on inrush (see § 14.6.8)
- ❑ **td2xl** : Time for calculation of current rate of rise.



14.8 - Function: 3I> (Third Overcurrent Element F50/51)

Status	→ Enab.	No	[No / Yes]
Options	→ tBI	Off	[Off / 2tBO]
	→ f(a)	Disable	[Disable / Sup / Dir]
	→ 2xl	Disable	[Disable / Enable]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Is	40.000	In (0.100÷40) step 0.010 In
	→ a	359.000	° (0.000÷359) step 1.000 °
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s
	→ tBO	0.75	s (0.05÷0.75) step 0.01 s
	→ t2xl	100.00	s (0.02÷100) step 0.01 s
	→ td2xl	0.06	s fixed

14.8.1 - Description of variables

- ❑ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ❑ **tBI** : Blocking input reset time (see § 14.6.5)
Off = Permanent block
2tBO = Set 2xtBO.
- ❑ **f(a)** : Operation mode: (see § 14.6.5)
Disable = Non Directional
Sup. = Directional Supervision
Dir. = Total Directional
- ❑ **2xl** : Automatic doubling of trip level on inrush (see § 14.6.8)
- ❑ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ❑ **Is** : Minimum operation level.
- ❑ **a** : Reference phase current displacement angle for Directional operation
- ❑ **ts** : Trip time delay
- ❑ **tBO** : Time to reset of the Blocking Output after expiring of the Trip time delay. “tBO” is also the trip time delay of the Breaker Failure function. (see § 14.6.7)
- ❑ **t2xl** : Maximum time of automatic threshold doubling on inrush (see § 14.6.8)
- ❑ **td2xl** : Time for calculation of current rate of rise



14.9 - Function: *1lo>* (First Earth Fault Element 50N/51N)

Status	→ Enab.	No	[No / Yes]				
Options	→ f(t)	Type - D	[D / A / B / C / I / VI / EI / MI / SI]				
	→ tBI	Off	[Off / 2tBO]				
	→ f(a_o)	Disable	[Disable / Dir]				
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]				
Oper. Levels	→ Is	0.010	On	(0.01÷4.00)	step	0.01	On
	→ Vo	0.000	%Un	(0.000÷20)	step	0.100	%Un
	→ a_o	0.000	°	(0.000÷359)	step	1.000	°
	→ a_z	0.000	°	(0.000÷359)	step	1.000	°
Timers	→ ts	100.00	s	(0.02÷100)	step	0.01	s
	→ tBO	0.75	s	(0.05÷0.75)	step	0.01	s

On = Rated primary current of CTs or of the current Tore CT.

14.9.1 - Description of variables

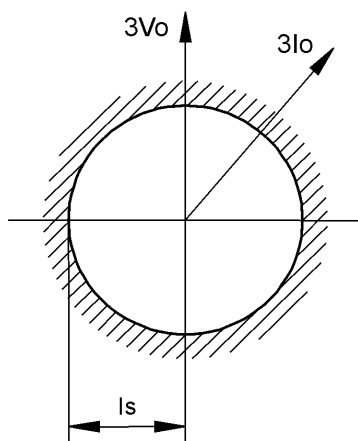
□	Enab.	:	Function enabling (No = Disable / Yes = Enable)	
□	f(t)	:	Operation characteristic (Time/Current curve): (D) = Independent definite time (A) = IEC Inverse Curve type A (B) = IEC Very Inverse Curve type B (C) = IEC Extremely Inverse Curve type C (I) = IEEE Inverse Curve (VI) = IEEE Very Inverse Curve (EI) = IEEE Extremely Inverse Curve (MI) = IEEE Moderate Inverse Curve (SI) = IEEE Short Inverse Curve	(see § 14.6.2)
□	tBI	:	Blocking Input reset time <i>Off</i> = Permanent block <i>2tBO</i> = Set 2xtBO.	(see § 14.6.7)
□	f(a₀)	:	Operation mode: <i>Disable</i> = Non Directional <i>Dir.</i> = Total Directional	(see § 14.9.2)
□	TrOsc	:	Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.	
□	Is	:	Minimum operation level	
□	Vo	:	Minimum residual voltage level for enabling the directional operation	
□	a₀	:	Reference Zero Sequence current displacement angle for Directional operation	
□	a_z	:	Trip sector amplitude	
□	ts	:	Trip time delay	
□	tBO	:	Time to reset of the Blocking Output after expiring of the Trip time delay. "tBO" is also the trip time delay of the Breaker Failure function.	(see § 14.6.7)

14.9.2 – Operation mode of the Earth Fault elements programming the variable “f(a_o)”

The relay measures the current “3I_o” and the input voltage “3V_o” of the Earth Fault input and the displacement “φ_o” of the current from the voltage. Different operation modes are programmable by the variable “f(a_o)”.

- **I_s** = Set minimum pick-up residual current “3I_o”.
- **V_o** = Set minimum residual voltage (3V_o) to enable operation.
- **a_o** = Set displacement of the reference current direction.
- **3I_o** = Earth Fault current.
- **3V_o** = Earth Fault voltage.
- **φ_o** = I_o/V_o phase displacement.
- **a_z** = Angle defining the directional operation area around the reference direction.

The Directional Earth Fault element can operate in two different modes:



f(a_o) = Dis (Disable)

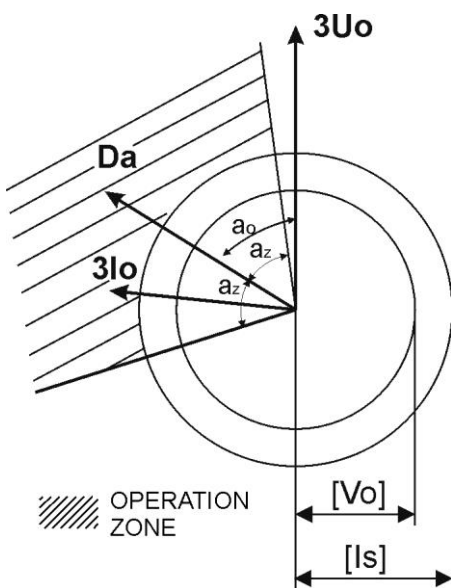
Operation is Non Directional without any influence by the Zero Sequence Voltage “V_o” and the displacement “φ_o”.

- Operation starts when : 3I_o ≥ [I_s]

f(a_o) = Dir (Directional).

Operation starts when the following 3 conditions are present:

- The Residual Voltage “3V_o” exceeds the set level “V_o” : 3V_o ≥ [V_o]
- The Residual Current “3I_o” exceeds the set level “I_s” : 3I_o ≥ [I_s]
- The angle “φ_o” is within “± a_z” from “a”
(a_o - a_z) ≤ φ_o ≤ (a_o + a_z)



- 3U_o > [V_o]
- 3I_o > [I_s]
- (a_o - a_z) ≤ φ_o ≤ (a_o + a_z)



14.10 - Function: **2lo>** (Second Earth Fault Element 50N/51N)

Status	→	Enab.	No	[No / Yes]				
Options	→	tBI	Off	[Off / 2tBO]				
	→	f(a₀)	Disable	[Disable / Dir]				
	→	TrOsc	TrigDisab	[TrigDisab – TrigEnab]				
Oper. Levels	→	Is	0.010	On	(0.01÷9.99)	step	0.01	On
	→	Vo	0.000	%Un	(0.000÷20)	step	0.100	%Un
	→	a₀	0.000	°	(0.000÷359)	step	1.000	°
	→	a_z	0.000	°	(0.000÷359)	step	1.000	°
Timers	→	ts	100.00	s	(0.02÷100)	step	0.01	s
	→	tBO	0.75	s	(0.05÷0.75)	step	0.01	s

On = Rated primary current of CTs or of the current Tore CT.

14.10.1 - Description of variables

- | | | | | |
|---|-------------------------|---|--|----------------|
| □ | Enab. | : | Function enabling (No = Disable / Yes = Enable) | |
| □ | tBI | : | Blocking Input reset time
<i>Off</i> = Permanent block
<i>2tBO</i> = Set 2xtBO. | (see § 14.6.7) |
| □ | f(a_o) | : | Operation mode:
<i>Disable</i> = Non Directional
<i>Dir.</i> = Total Directional | (see § 14.9.2) |
| □ | TrOsc | : | Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function. | |
| □ | Is | : | Minimum operation level | |
| □ | Vo | : | Minimum residual voltage level for enabling the directional operation | |
| □ | a_o | : | Reference Zero Sequence current displacement angle for Directional operation | |
| □ | a_z | : | Trip sector amplitude | |
| □ | ts | : | Trip time delay | |
| □ | tBO | : | Time to reset of the Blocking Output after expiring of the Trip time delay. "tBO" is also the trip time delay of the Breaker Failure function. | (see § 14.6.7) |



14.11 - Function: **3lo>** (Second Earth Fault Element 50N/51N)

Status	→	Enab.	No	[No / Yes]				
Options	→	tBI	Off	[Off / 2tBO]				
	→	f(a₀)	Disable	[Disable / Dir]				
	→	TrgOsc	TrigDisab	[TrigDisab – TrigEnab]				
Oper. Levels	→	Is	0.010	On	(0.01÷9.99)	step	0.01	On
	→	Vo	0.000	%Un	(0.000÷20)	step	0.100	%Un
	→	a₀	0.000	°	(0.000÷359)	step	1.000	°
	→	a_z	0.000	°	(0.000÷359)	step	1.000	°
Timers	→	ts	100.00	s	(0.02÷100)	step	0.01	s
	→	tBO	0.75	s	(0.05÷0.75)	step	0.01	s

On = Rated primary current of CTs or of the current Tore CT.

14.11.1 - Description parameters

- | | | | | |
|---|-------------------------|---|--|----------------|
| □ | Enab. | : | Function enabling (No = Disable / Yes = Enable) | |
| □ | tBI | : | Blocking Input reset time
<i>Off</i> = Permanent block
<i>2tBO</i> = Set 2xtBO. | (see § 14.6.7) |
| □ | f(a_o) | : | Operation mode:
<i>Disable</i> = Non Directional
<i>Dir.</i> = Total Directional | (see § 14.9.2) |
| □ | TrOsc | : | Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function. | |
| □ | Is | : | Minimum operation level | |
| □ | Vo | : | Minimum residual voltage level for enabling the directional operation | |
| □ | a_o | : | Reference Zero Sequence current displacement angle for Directional operation | |
| □ | a_z | : | Trip sector amplitude | |
| □ | ts | : | Trip time delay | |
| □ | tBO | : | Time to reset of the Blocking Output after expiring of the Trip time delay. "tBO" is also the trip time delay of the Breaker Failure function. | (see § 14.6.7) |



14.12 - Function: **1Is**> (First Negative Sequence Element F46)

Status	→ Enab.	No	[No / Yes]
Options	→ t(t)	Type-D	[D / A / B / C / I / VI / EI / MI / SI /]
	→ tBI	Off	[Off / 2tBO]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Is	4.000	In (0.1÷4) step 0.01 In
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s
	→ tBO	0.75	s (0.05÷0.75) step 0.01 s

14.12.1 - Description of variables

- ❑ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ❑ **f(t)** : Operation characteristic (Time/Current curve): (see § 14.12.2)
 - (D) = Independent definite time
 - (A) = IEC Inverse Curve type A
 - (B) = IEC Very Inverse Curve type B
 - (C) = IEC Extremely Inverse Curve type C
 - (I) = IEEE Inverse Curve
 - (VI) = IEEE Very Inverse Curve
 - (EI) = IEEE Extremely Inverse Curve
 - (MI) = IEEE Moderate Inverse Curve
 - (SI) = IEEE Short Inverse Curve
- ❑ **tBI** : Blocking Input reset time (see § 14.6.7)
 - Off = Permanent block
 - 2tBO = Set 2xtBO.
- ❑ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ❑ **Is** : Minimum operation level
- ❑ **ts** : Trip time delay
- ❑ **tBO** : Time to reset of the Blocking Output after expiring of the Trip time delay. “tBO” is also the trip time delay of the Breaker Failure function. (see § 14.6.7)

14.12.2 – Time/Current operation of the first Current Unbalance element “f(t)”

the relay measures the Negative Sequence component “I₂” of the input current.
The Time/Current curves can be selected by programming the variable “f(t)”:

- ❑ f(t) = D Independent definite time operation. (see § 14.6.2)
- ❑ f(t) = I, VI, EI, MI, SI, A, B, C Dependent Inverse time operation (see § 14.6.2)



14.13 - Function: **2Is** (Second Negative Sequence Element F46)

Status	→ Enab.	No	[No / Si]
Options	→ tBI	Off	[Off / 2tBO]
	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Is	4.000	In (0.1÷4) step 0.01 In
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s
	→ tBO	0.75	s (0.05÷0.75) step 0.01 s

14.13.1 - Description of variables

- **Enab.** : Function enabling (No = Disable / Yes = Enable)
- **tBI** : Blocking Input reset time
Off = Permanent block
2tBO = Set 2tBO.
- **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- **Is** : Minimum operation level
- **ts** : Trip time delay
- **tBO** : Time to reset of the Blocking Output after expiring of the Trip time delay. “tBO” is also the trip time delay of the Breaker Failure function. (see § 14.6.7)



14.14 - Function: **1U**> (First Overvoltage Element F59)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Us	90.000	%Un (10÷190) step 1 %Un
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s

14.14.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **Us** : Minimum operation level
- ☐ **ts** : Trip time delay

14.15 - Function: **2U**> (Second Overvoltage Element F59)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Us	90.000	%Un (10÷190) step 1 %Un
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s

14.15.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **Us** : Minimum operation level
- ☐ **ts** : Trip time delay



14.16 - Function: 1U< (First Undervoltage Element F27)

Status	→	Enab.	No	[No / Yes]				
Options	→	TrOsc	TrigDisab	[TrigDisab – TrigEnab]				
Oper. Levels	→	Us	90.000	%Un	(10÷190)	step	1	%
Timers	→	ts	100.00	s	(0.02÷100)	step	0.01	s

14.16.1 - Description of variables

- | | | | |
|---|--------------|---|---|
| □ | Enab. | : | Function enabling (No = Disable / Yes = Enable) |
| □ | TrOsc | : | Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function. |
| □ | Us | : | Minimum operation level |
| □ | ts | : | Trip time delay |

14.17 - Function: **2U<** (Second Undervoltage Element F27)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Us	90.000	% (10÷190) step 1 %
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s

14.17.1 - Description of variables

- | | | | |
|---|--------------|---|---|
| □ | Enab. | : | Function enabling (No = Disable / Yes = Enable) |
| □ | TrOsc | : | Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function. |
| □ | Us | : | Minimum operation level |
| □ | ts | : | Trip time delay |



14.18 - Function: **1f>** (First Overfrequency Element F81>)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ fs	40.000	Hz (40÷70) step 0.01 Hz
Timers	→ ts	10.00	s (0.02÷1000) step 0.01 s

14.18.1 - Description of variables

- | | | |
|----------------|---|---|
| □ Enab. | : | Function enabling (No = Disable / Yes = Enable) |
| □ TrOsc | : | Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function. |
| □ fs | : | Minimum operation level |
| □ ts | : | Trip time delay |

14.19 - Function: **2f** (Second Overfrequency Element F81)

Status	→ Enab.	No	[No / Yes]			
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]			
Oper. Levels	→ fs	40.000	Hz	(40÷70)	step	0.01 Hz
Timers	→ ts	10.00	s	(0.02÷1000)	step	0.01 s

14.19.1 - Description of variables

- | | |
|----------------|---|
| □ Enab. | : Function enabling (No = Disable / Yes = Enable) |
| □ TrOsc | : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function. |
| □ fs | : Minimum operation level |
| □ ts | : Trip time delay |



14.20 – Function: **1f< (First Underfrequency Element F81<)**

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ fs	40.000	Hz (40÷70) step 0.01 Hz
Timers	→ ts	10.00	s (0.02÷1000) step 0.01 s

14.20.1 - Description of variables

- | | | |
|----------------|---|---|
| □ Enab. | : | Function enabling (No = Disable / Yes = Enable) |
| □ TrOsc | : | Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function. |
| □ fs | : | Minimum operation level |
| □ ts | : | Trip time delay |

14.21 - Function: **2f<** (Second Underfrequency Element F81<)

Status	→ Enab.	No	[No / Yes]			
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]			
Oper. Levels	→ fs	40.000	Hz	(40÷70)	step	0.01 Hz
Timers	→ ts	10.00	s	(0.02÷1000)	step	0.01 s

14.21.1 - Description of variables

- | | | |
|---------------------------------------|---|---|
| ☐ Enab. | : | Function enabling (No = Disable / Yes = Enable) |
| ☐ TrOsc | : | Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function. |
| ☐ fs | : | Minimum operation level |
| ☐ ts | : | Trip time delay |



14.22 - Function: **1Uo**> (First Zero Sequence Overvoltage Element F59Uo)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Us	1.000	%Un (1÷100) step 1 %Un
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s

14.22.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **Us** : Minimum operation level
- ☐ **ts** : Trip time delay

14.23 - Function: **2Uo**> (Second Zero Sequence Overvoltage Element F59Uo)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Us	1.000	%Un (1÷100) step 1 %Un
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s

14.23.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **Us** : Minimum operation level
- ☐ **ts** : Trip time delay



14.24 - Function: **U1<** (Positive Sequence Undervoltage Element F27U1)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Us	90.000	%Un (10÷190) step 1 %Un
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s

14.24.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **Us** : Minimum operation level
- ☐ **ts** : Trip time delay

14.25 - Function: **U2>** (Negative sequence Overvoltage Element F59U2 or F47)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ Us	90.000	%Un (10÷190) step 1 %Un
Timers	→ ts	100.00	s (0.02÷100) step 0.01 s

14.25.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ☐ **Us** : Minimum operation level
- ☐ **ts** : Trip time delay



14.26 - Function: **Wi** (Circuit Breaker maintenance level)

Status	→ Enab.	No	[No / Yes]
Options	→ TrOsc	TrigDisab	[TrigDisab – TrigEnab]
Oper. Levels	→ li	1.000	In (0.1÷99) step 0.1 In
	→ Wi	1.000	(1÷9999) step 1

14.26.1 - Description of variables

- ❑ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ❑ **TrOsc** : Oscillographic Recording triggered (TrigEnab) or not triggered (TrigDisab) on tripping of the function.
- ❑ **li** : Circuit Breaker Rated Current in multiples of the Relay rated input current In
- ❑ **Wi** : Maximum allowed amount of accumulated interruption energy before maintenance as stated by the C/B Manufactured.

14.26.2 - Operation (Accumulation of the interruption Energy)

The relay computes the Arc Energy developed during each interruption of the Circuit Breaker and accumulates these values.

When the amount of the accumulated energy exceeds a settable level the relay gives out an alarm to signalize that maintenance inspection of the Circuit Breaker is needed.

The operation of this function is based on the following parameters:

$$li = li = (0.1-99)In$$

$$Wi = Wi = (1 - 9999)$$

"Wi" is set as a multiple of the conventional interruption energy unit.

Any time the Circuit Breaker opens (change of status from closed to open of the digital input connected to the normally open contact 52a of the C/B) the relay decreases the amount of energy corresponding to a number of conventional units:

$$nW_c = \frac{W}{W_c} = \frac{I^2 \cdot t_x}{li^2 \cdot t_i}$$

where:

W = $I^2 \cdot t_x$ Interruption Energy during the interruption time "tx" with interruption current "I".

Wc = $li^2 \cdot t_i$ Conventional unit of interruption energy corresponding to C/B rated current and rated interruption time "ti".

When the set Energy level before maintenance is decreased to zero a user programmable output relay is operated.

Reset to Zero of the Energy accumulation is available in the menu "**Local Cmd**" (Reset Term).



14.27 - Function: **TCS** (Trip Circuit Supervision)

Status	→ Enab.	No	[No / Yes]
Timers	→ ts	0.10	s (0.1÷100) step 0.01 s

14.27.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **ts** : Trip time delay

14.27.2 - Operation

The relay includes a complete Circuit Breaker Trip Circuit Supervision unit that is associated to the Contact "15-26" of the "R1" Output Relay.

The contact of "R1" is used to trip the C/B as reported in the drawing here below.

The supervision works when the C/B is closed and recognizes the Trip Circuit as sound as far as the current flowing exceeds "1mA".

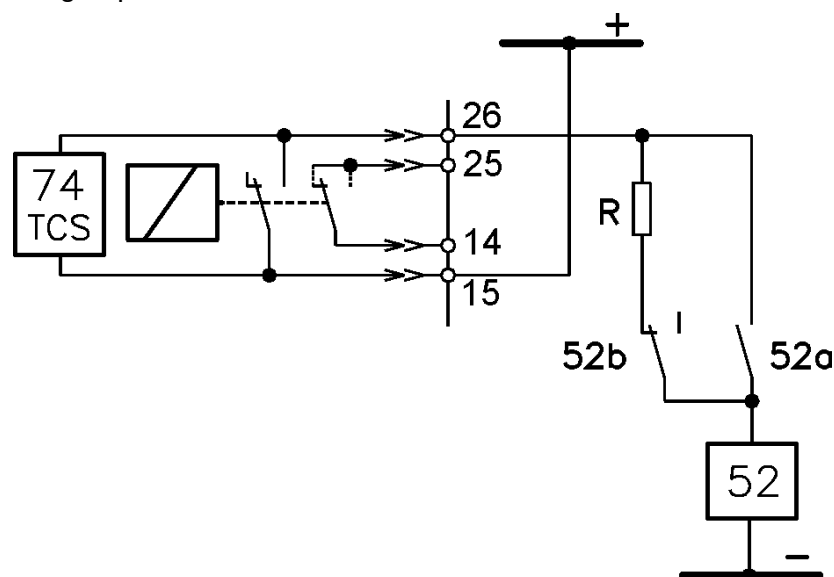
In case of Trip Circuit Fault detection, the diagnostic relay is operated and the Led starts flashing (see § Signalization).

To have Supervision also with the C/B open one N/C contact (52b) from the C/B and an external resistor "R" are needed.

$$R[k\Omega] \leq \frac{V}{1mA} - R_{52} \quad \text{where} \quad R_{52} = \text{Trip Coil internal resistance [k}\Omega\text{]}$$

V = Trip Circuit Voltage

$$P_R \geq 2 \cdot \frac{V^2}{R} [W] \quad \text{Design power of external resistance "R"}$$



Tripping of the function operates a user programmable output relay.



14.28 - Function: **IRF** (Internal Relay Fault)

In this menu it is possible to configure the operation of the Relay Internal Fault detection element

.....

Status	→ Enab.	No	[No / Yes]
Timers	→ tIRF	5.00 s	(5÷200) step 0.01 s

.....

14.28.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **tIRF** : Trip time delay

.....

14.28.2 - Operation

Tripping of the function operates a user programmable output relay.



14.29 - Function: **CB Manage** (Control C/B)

This menu allows to configure the command for C/B operation.

.....

Options	→ L/R	Ignored	[Ignored – Active]			
	→ Key	Enable	[Disable – Enable]			
Timers	→ tL/R	0.05	s	(0.05 ÷ 1.00)	step 0.05	s
	→ tC/Bs	0.50	s	(0.05 ÷ 1.00)	step 0.05	s

.....

14.29.1 - Description of variables

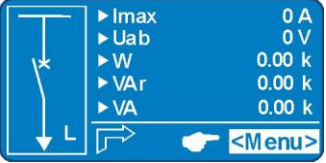
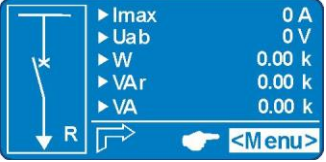
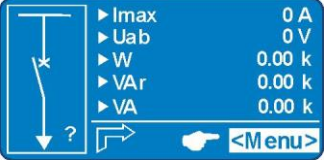
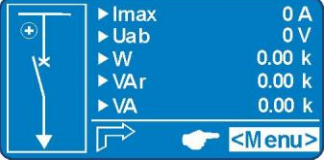
- ☐ **L/R** : Selection of Local/Remote C/B operation mode Ignored or Active
- ☐ **Key** : Disable = The pushbuttons on Front Panel are disabled;
the operation of the C/B can be controlled by;




1 - serial bus commands
2 - commands available in the menu "**Local Cmd**"
(Password protected).
3 - Digital Inputs.

 Enable = The C/B can be controlled also by the pushbuttons available
on Relay's Front Face.
- ☐ **tL/R** : Admissible time before detection of the Local/Remote discrepancy alarm.
- ☐ **tC/Bs** : Maximum admissible delay for detection of status signal after C/B operation.

14.29.2 - Display Message

- 1  •  • “**L**” the control of C/B is in “Local” mode
- 2  •  • “**R**” the control of C/B is in “Remote” mode
- 3  •  If the symbol “?” show up the relay is in discrepancy Local/Remote.
The commands can be send from “Local” or “Remote”.
- 4  •  This symbol indicates the CB breaker failure (example: C/B closing failure)



14.30 - Function: **Oscillo** (Oscillographic Recording)

Status	→ Enab.	No	[No / Yes]
Options	→ Trig	Disable	[Disable / Start / Trip / ExtInp]
Timers	→ tPre	0.50	s (0.01÷0.50) step 0.01 s
	→ tPost	0.50	s (0.01÷1.50) step 0.01 s

16.30.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **Trig** : Selection of the Trigger command source (start recording):
 - Disable* = Function Disable (no recording)
 - Start* = Trigger on time start of protection functions
 - Trip* = Trigger on trip (time delay end) of protection functions
 - ExtInp* = External Trigger from Digital Input
- ☐ **tPre** : Recording time before Trigger
- ☐ **tPost** : Recording time after Trigger

14.30.2 - Operation

In the options: “Trig = Start” and “Trig = Trip”, the oscillographic recording starts respectively when any protection function starts operating or trip (provided the function was programmed “TrigEnab”).

T>	1lo>	2Is>	2U<	2f<	U1<
1l>	2lo>	1U>	1f>	1Uo>	U2>
2l>	3lo>	2U>	2f>	2Uo>	Wi
3l>	1Is>	1U<	1f<		

In the option “ExtInp”, the oscillographic record starts when the Digital Input is activated (terminals shorted)

The “Osc” Function includes the wave Form Capture of the input quantities (IA, IB, IC, Io, EA, EB, EC, Eo) and can totally store a record of 3 seconds.

The number of events recorded depends on the duration of each individual recording (tPre + tPost).

In any case the number of event stored can not exceed ten (10 x 0.3 sec).

Any new event beyond the 3 sec capacity of the memory, cancels and overwrites the former records (FIFO Memory).



14.31 - Function: **BreakerFail** (Breaker Failure)

Status	→ Enab.	No	[No / Yes]
Timers	→ tBF	0.75 s	(0.05÷0.75) step 0.01 s

16.31.1 - Description of variables

- ☐ **Enab.** : Function enabling (No = Disable / Yes = Enable)
- ☐ **tBF** : Trip time delay

14.31.2 - Operation

The Breaker Failure detection is started by the operation of the output relay “R1” (programmed to be controlled by the Protection Functions that trip the C/B).

If after [tBF] seconds from operation of the relay “R1”, any input current flow is still detected (>10% I_n) , the function “BF” trips and operate one user programmable output relay,



14.32 - Function: **ExtResCfg** (External Reset Configuration)

This menu allows to configure the edge polarity of the digital input associated to the trip reset function.

.....

Options	→ ActOn	RiseEdge	[RiseEdge / FallEdge]
----------------	----------------	----------	-----------------------

.....

14.32.1 - Description of variables

- **ActOn** : RiseEdge Active on Rise Edge (Digital Input close).
FallEdge Active on Fall Edge (Digital Input open).

15. Input - Output

The firmware can manage up to 32 digital inputs and 34 output relays; among these, 4 digital inputs and 6 output relays are available on the relay module, the remaining are available on additional expansion modules controlled via the CAN-Bus communication channel:

14DI Module = 14 Digital Inputs

14DO Module = 14 Outputs Relay

10-4 Module = 10 Digital Inputs and 4 Outputs Relay.

1 or 2 additional modules in any combination can be controlled.

15.1 - Operation

Each Protection Element operates by means of “Inputs” and “Outputs”:

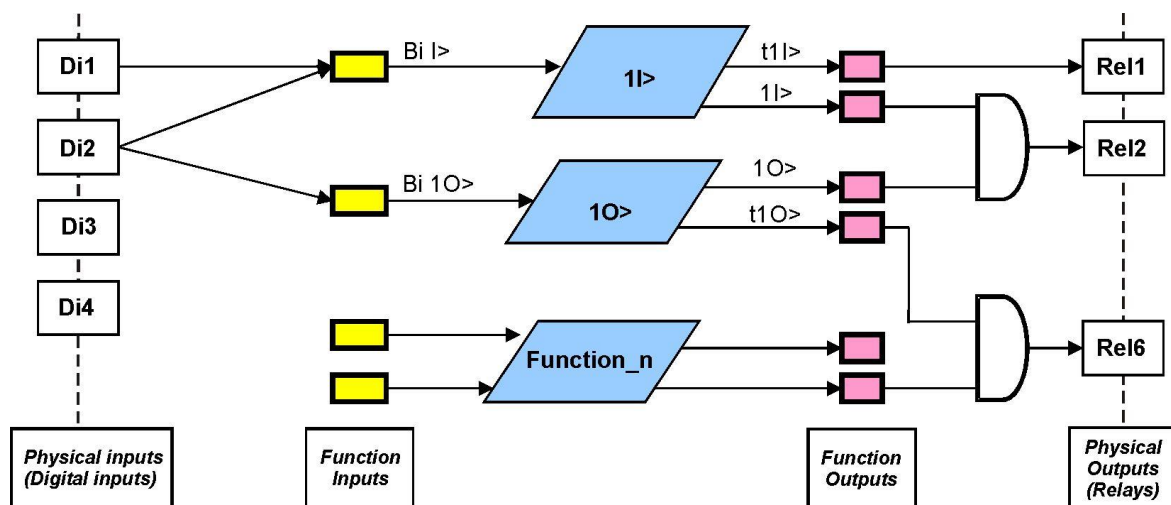
- ❑ Analogue Inputs : The measured input quantities
- ❑ Functional Inputs : The blocking input
- ❑ Physical Inputs : The Digital Inputs
- ❑ Functional Outputs : The functional elements
- ❑ Physical Outputs : The Output Relays

Any Physical Input can be assigned to the Functional Inputs of one or more elements: in the example the Digital Input “0.D1” controls the Functional Inputs of both the elements “1I>” and “1Io>”

Similarly any Physical Output can be controlled by the Functional Outputs of one or more of the FMR elements (see list of elements at § Physical Outputs): in the example “0.R2” is controlled by both “1I>” and “1Io>”.

In case more than one Functional Output are programmed to control the same output relay, the setting menu requires to select between two different logic operation modes: “OR” or “AND” and “XOR”:

- ❑ “OR” : Means that the relay is operated if at least one of the associated Functional Outputs is activated.
- ❑ “AND” : Means that the relay is operated only if all the associated Functional Output are activated.
- ❑ “XOR” : Means that the relay is operated only if one and only one of the associated Functional Output are activated.



The interfacing software “MSCom 2” also allows to program the operation of the output relays (Physical Output), the available operation are:

Output Configuration: “N.D.” or “N.E.”:

- **“N.D.”** : *Normally Deenergized* The output relay is deenergized in normal conditions and gets energized on activation of the controlling Functional Output; reset means deenergizing.
- **“N.E.”** : *Normally Energized* The output relay is energized in normal conditions and gets deenergized on activation of the controlling Functional Output; reset means energizing.

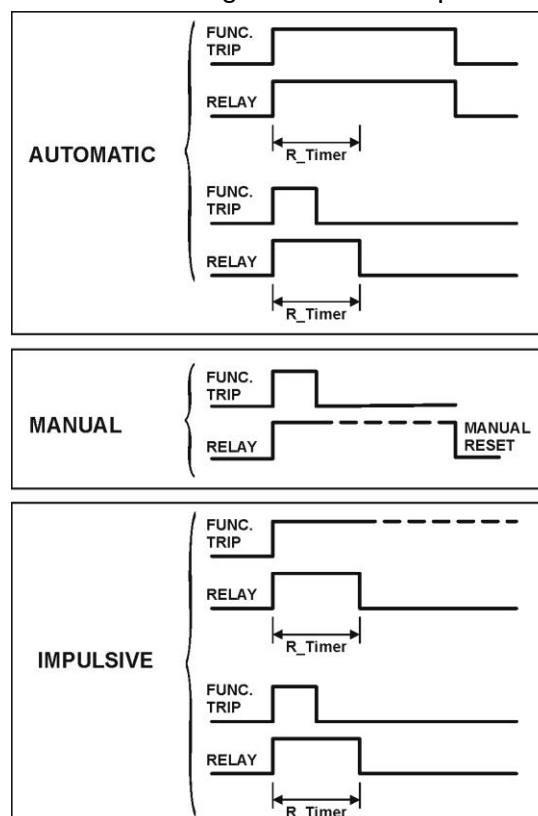
Operation Time: R_Timer:

This timer controls the duration of the activation of the output relay.

- **“R_Timer** : 0 (0-10)s, step 0.01s

Operation Mode: Automatic / Manual / Impulse (see figure):

- **Automatic** : In this mode the output relay is “operated” (energized if “N.D.”, deenergized if “N.E.”) when the controlling Functional Output is activated and it is reset to the “non operated” condition when the Functional Output gets deactivated but, anyhow, not before the time “R_Timer” has elapsed (minimum duration of the operation time)
- **Manual** : In this mode the output relay is “operated” when the controlling Functional Output is activated and remains in the operated condition until a manual reset command is issued by the FMR keyboard (local commands menu) or via the serial communication. In this mode the timer “R_Timer” has no effect.
- **Impulsive** : In this mode the output relay is “operated” when the controlling Functional Output is activated and it remains in the “operated” condition (energized if “N.D.”, deenergized if “N.E.”) for the set time “R_Timer” independently from the status of the controlling Functional Output.



15.2 - Physical Input

Input	→ 0.D1	OFF(1)	+(2)	Available in the FMR relay	Inputs "D8", "D16" not available	By the interface program "MSCom 2" it is possible to Activate/Deactivate the modules.
	→ 0.D2	OFF(1)	+(2)			
	→ 0.D3	OFF(1)	+(2)			
	→ 0.D4	OFF(1)	+(2)			
	→ 1.D1	OFF(1)	+(2)	Available in the first additional expansion module		
	→ 1.D--	OFF(1)	+(2)			
	→ 1.D15	OFF(1)	+(2)			
	→ 2.D1	OFF(1)	+(2)	Available in the second additional expansion module		
	→ 2.D--	OFF(1)	+(2)			
	→ 2.D15	OFF(1)	+(2)			

(1) "ON", "OFF" : Actual status of the Input.

(2)  ,  :  Indicates that this Input is not yet associated to any function.

 Indicates that this Input is already associated to one or more functions.

0.D1 : "0" = Main Board, "1" = First Board Expansion, "2" = Second Board Expansion

Four Digital Input are available on FMR relay:

☐	D1 (0.D1)	(terminals 38 - 28)	: Programmable
☐	D2 (0.D2)	(terminals 38 - 18)	: Programmable
☐	D3 (0.D3)	(terminals 38 - 29)	: Programmable
☐	D4 (0.D4)	(terminals 38 - 19)	: Programmable (PTC)

Three of them (0.D1, 0.D2, 0.D3) are disactivated, when the relevant terminals are open and get activated when the relevant terminals are shorted by an external cold contact.

The operation of the Input "0.D4" is dependent on the value "R" of resistance of the external circuit connected to its terminals (38-19):

- Activated if " $R < 50\Omega$ " or " $R > 3000\Omega$ ". - Disactivated if " $50\Omega \leq R \leq 3000\Omega$ ".

Therefore, if the terminals "38-19" are open-circuited, the input "0.D4" is activated; for using "0.D4" as a normal Digital Input simply controlled by an external cold contact, it is necessary to permanently connect across the terminal's "38-19" (in parallel to the external contact) a load resistor of value between 50 and 3000 Ω (example 1000 Ω - 0.5W).

The additional inputs "1.D1....1.D15" are available when the first expansion module is present.

The additional inputs "2.D1....2.D15" are available when the second expansion module is present.

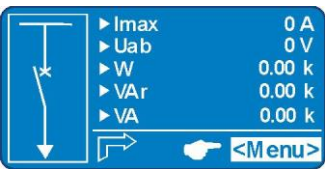
Any digital input of the expansion modules is active when the relevant terminals (see wiring diagram) are shorted.

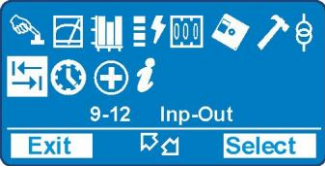
Any of the Digital Inputs can be programmed to control one or more of the following functions.

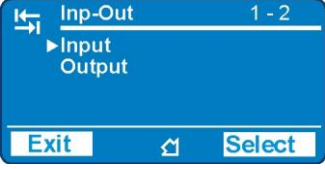
Bi1I>	Blocking input to the	1I>
Bi2I>	Blocking input to the	2I>
Bi3I>	Blocking input to the	3I>
Bi1Io>	Blocking input to the	1Io>
Bi2Io>	Blocking input to the	2Io>
Bi3Io>	Blocking input to the	3Io>
Bi1Is>	Blocking input to the	1Is>
Bi2Is>	Blocking input to the	2Is>
Bi1U>	Blocking input to the	1U>
Bi2U>	Blocking input to the	2U>
Bi1U<	Blocking input to the	1U<
Bi2U<	Blocking input to the	2U<
B1Uo>	Blocking input to the	1Uo>
B2Uo>	Blocking input to the	2Uo>
BiU1<	Blocking input to the	U1<
BiU2>	Blocking input to the	U2>
C/B	Indication of the Open/Close status of the C/B	
Local	Local mode operation	
Remote	Remote mode operation	
OpenCB	C/B open command	
CloseCB	C/B close command	
ExtTrgOsc	External Trigger of the Oscillographic Recording.	
ExtReset	External Reset	
Group 1-2	Selection of the setting Group 1 or 2.	

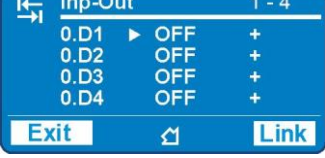
Moreover, any Digital Input can be programmed to control one or more output relays in “AND” or “OR” or “XOR” logic (see § Digital Input)

15.2.1 – Example

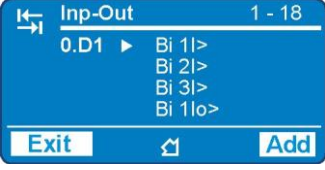
- 

 - Press “**Menu**” for access to the main menu with icons.
- 

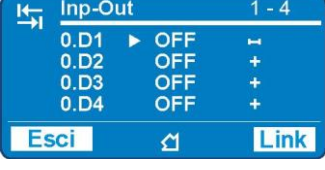
 - Select icon “**Inp-Out**” by pushbuttons “**Increase**” or “**Decrease**”.
 - Press “**Select**”.
- 

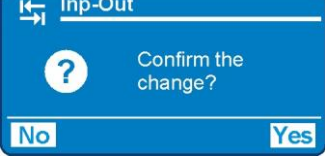
 - Select “**Input**”.
 - Press “**Select**”.
- 

 - Select “**0.D1**”.
 - Press “**Link**” for access to input “**1**”.

“**0.D1**” corresponding to physical digital input “**0.D1**”.
“**0.D1**” corresponding to physical digital input “**0.D2**”.
“**0.D1**” corresponding to physical digital input “**0.D3**”.
“**0.D1**” corresponding to physical digital input “**0.D4**”.
“**1.D--**” corresponding to physical digital input “**1.D--**”. (additional first module)
“**2.D--**” corresponding to physical digital input “**2.D--**”. (additional second module)
- 

 - Press “**Add**” to select and associate the function.
(Digital Input 1 terminals 38-28).
- 

 - When one or more Blocking Input is associated this symbol shows 
 - To remove selection one function:
Select function by pushbuttons “**Increase**” or “**Decrease**” and press “**Remove**”
 - Press “**Exit**”.
- 

 - Press “**Exit**” to go back to the previous menu.
- 

 - The display show “**Confirm the change?**”.
 - Choose “**Yes**” to convalidate the changes.
 - Choose “**No**” to not confirm the changes.

15.3 – Physical Outputs

The output relay are fully user programmable and controlled by any protection functions and by any digital inputs.

Output	→ 0.R1	OFF(1)	+(2)	Available in the FMR relay	By the interface program “MSCom II” it is possible to Activate/Deactivate the modules.
	→ 0.R2	OFF(1)	+(2)		
	→ 0.R3	OFF(1)	+(2)		
	→ 0.R4	OFF(1)	+(2)		
	→ 0.R5	OFF(1)	+(2)		
	→ 0.R6	OFF(1)	+(2)		
	→ 1.R1	OFF(1)	+(2)	Available in the first additional expansion module	
	→ 1.R--	OFF(1)	+(2)		
	→ 1.R14	OFF(1)	+(2)		
	→ 2.R1	OFF(1)	+(2)	Available in the second additional expansion module	
	→ 2.R--	OFF(1)	+(2)		
	→ 2.R14	OFF(1)	+(2)		

(1) "ON", "OFF" : Actual status of the Output Relay

(2)  ,  :  Indicates that this Relay is not yet associated to any function.

 Indicates that this Relay is already associated to one or more functions.

0.R1 : "0" = Main Board, "1" = First Board Expansion, "2" = Second Board Expansion

The relays "Rel1...Rel6" are always present on FMR module.

The additional relays "1.R1.....1.R14" are available when the first expansion module is present.

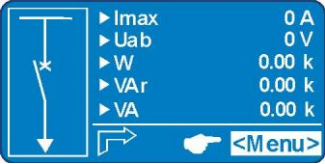
The additional relays "2.R1.....2.R14" are available when the second expansion module is present.

Any Output Relay can be programmed to be controlled (energized) by one or more of the following functions or Digital Inputs:

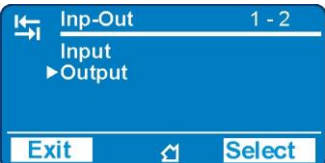
Tal	Thermal alarm	
T>	Thermal trip	
1I>	First instantaneous overcurrent element	(Start)
t1I>	First time delayed overcurrent element	(Trip)
2I>	Second instantaneous overcurrent element	(Start)
t2I>	Second time delayed overcurrent element	(Trip)
3I>	Third instantaneous overcurrent element	(Start)
t3I>	Third time delayed overcurrent element	(Trip)
1Io>	First instantaneous earth fault element	(Start)
t1Io>	First time delayed earth fault element	(Trip)
2Io>	Second instantaneous earth fault element	(Start)
t2Io>	Second time delayed earth fault element	(Trip)
3Io>	Third instantaneous earth fault element	(Start)
t3Io>	Third time delayed earth fault element	(Trip)
1Is>	First instantaneous Negative Sequence element	(Start)
t1Is>	First time delayed Negative Sequence element	(Trip)
2Is>	Second instantaneous Negative Sequence element	(Start)
t2Is>	Second time delayed Negative Sequence element	(Trip)
1U>	First instantaneous overvoltage element	(Start)
t1U>	First time delayed overvoltage element	(Trip)
2U>	Second instantaneous overvoltage element	(Start)
t2U>	Second time delayed overvoltage element	(Trip)
1U<	First instantaneous undervoltage element	(Start)
t1U<	First time delayed undervoltage element	(Trip)
2U<	Second instantaneous undervoltage element	(Start)
t2U<	Second time delayed undervoltage element	(Trip)

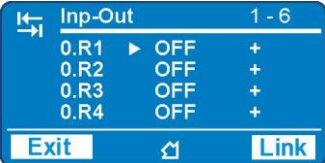
1f>	First instantaneous overfrequency element	(Start)			
t1f>	First time delayed overfrequency element	(Trip)			
2f>	Second instantaneous overfrequency element	(Start)			
t2f>	Second time delayed overfrequency element	(Trip)			
1f<	First instantaneous underfrequency element	(Start)			
t1f<	First time delayed underfrequency element	(Trip)			
2f<	Second instantaneous underfrequency element	(Start)			
t2f<	Second time delayed underfrequency element	(Trip)			
1Uo>	First instantaneous zero sequence overvoltage element	(Start)			
t1Uo>	First time delayed zero sequence overvoltage element	(Trip)			
2Uo>	Second instantaneous zero sequence overvoltage element	(Start)			
t2Uo>	Second time delayed zero sequence overvoltage element	(Trip)			
U1<	Instantaneous positive sequence undervoltage element	(Start)			
tU1<	Time delayed positive sequence undervoltage element	(Trip)			
U2>	Instantaneous negative sequence overvoltage element	(Start)			
tU2>	Time delayed negative sequence overvoltage element	(Trip)			
tWi>	Circuit breaker maintenance level				
tTCS	Time delayed Trip Circuit Supervision	(Trip)			
IRF	Time delayed Internal relay Fault	(Start)			
tIRF	Instantaneous Internal relay Fault	(Trip)			
manOpCmd	Manual opening command				
CL-Cmd	Closing command				
C/BFail	C/B Failure				
L/Rdisc	Local/Remote Discrepancy				
BF	Breaker Failure				
Gen.Start	General Start (pick-up of a protection function)				
Gen.Trip	General Trip (trip of a protection function)				
0.D1	Digital Input “0.D1”	activated	Available in the Main relay		
0.D1 (not)	Digital Input “0.D1”	deactivated			
0.D2	Digital Input “0.D2”	activated			
0.D2 (not)	Digital Input “0.D2”	deactivated			
0.D3	Digital Input “0.D3”	activated			
0.D3 (not)	Digital Input “0.D3”	deactivated			
0.D4	Digital Input “0.D4”	activated			
0.D4 (not)	Digital Input “0.D4”	deactivated			
1.D1	Digital Input “1.D1”	activated	Available in the first additional expansion module	Inputs "D8", "D16" not available By the interface program “MSCom 2” it is possible to Activate/Deactivate the modules.	
1.D1 (not)	Digital Input “1.D1”	deactivated			
1.D --	Digital Input “1.D--”	activated			
1.D -- (not)	Digital Input “1.D--”	deactivated			
1.D15	Digital Input “1.D15”	activated			
1.D15 (not)	Digital Input “1.D15”	deactivated			
2.D1	Digital Input “2.D1”	activated	Available in the second additional expansion module		
2.D1 (not)	Digital Input “2.D1”	deactivated			
2.D --	Digital Input “2.D--”	activated			
2.D -- (not)	Digital Input “2.D--”	deactivated			
2.D15	Digital Input “2.D15”	activated			
2.D15 (not)	Digital Input “2.D15”	deactivated			

15.3.1 – Example

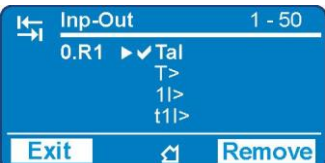
- 

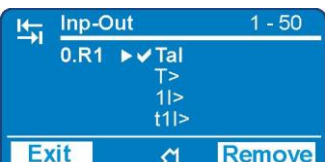
 - Press “**Menu**” for access to the main menu with icons.
- 

 - Select icon “**Inp-Out**” by pushbuttons “**Increase**” or “**Decrease**”.
 - Press “**Select**”.
- 

 - Select “**Output**”.
 - Press “**Select**”.
- 

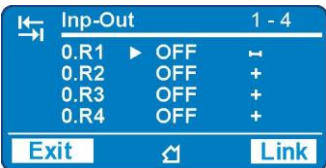
 - Select “**0.R1**”.
 - Press “**Link**” for access to relay “**1**”.

“**0.R1**” - “**0.Rx**” corresponding to physical output relay “**1**” - “**x**”
(**x** =available in the additional expansion modules)
- 

 - Press “**Add**” to select and associate the function.
- 

 - When one or more function is associated this symbol shows 
 - To remove selection one function:
Select function by pushbuttons “**Increase**” or “**Decrease**” and press “**Remove**”
 - Press “**Exit**”.

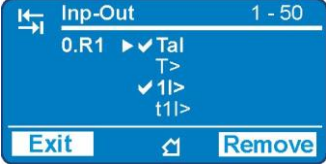
- 7



- Press “**Exit**”
- 8



- If more than one function or digital input are associated to one output relay, it is necessary to select the logic operator “AND” or “OR” “**Select the operator**” (see § Operation).
- 9



- Press “**Exit**” to go back to the previous menu.
- 10

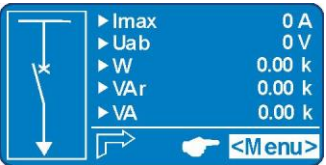


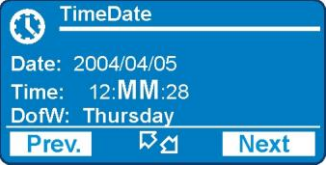
- The display show “**Confirm the change?**”.
 - Choose “**Yes**” to convalidate the changes.
 - Choose “**No**” to not confirm the changes.

16. Date and Time

In this menu it is possible to configurate the Date and Time

Date:	20YY	/	MM	/	DD	(2000/01/01 ÷ 2099/12/31) YY = Year / MM = Month / DD = Day
Time:	HH	:	MM	:	00	HH = hour / MM = Minutes / 00
DofW:	Day					Es: Wednesday

- 1 
 - Press "**Menu**" for access to the main menu with icons.
- 2 
 - Select icon "**TimeDate**" by pushbuttons "**Increase**" or "**Decrease**".
 - Press "**Select**".
- 3 
 - Press "**Modify**".
- 4 
 - The last two figures of the Year will appear in bold character; by pushbuttons "**Increase**" or "**Decrease**" set the new figures.
 - Press "**Next**" to go to the next setting.
- 5 
 - As above for changing the "Month"
 - Press "**Next**" to go to the next setting.
- 6 
 - As above for changing the "Day"
 - Press "**Next**" to go to the next setting.

- 7 
 - As above for changing the “Hours”
 - Press “**Next**” to go to the next setting.
- 8 
 - As above for changing the “Minutes”
 - Press “**Next**” to go to the next setting.
- 9 
 - The **Day of the Week** is calculated and displayed automatically.
 - Press “**Exit**” to go back to the main menu.
 - Press “**Modify**” to go back to the step “3”



Press the button “**Next**” to go back to the previous display.

16.1 – Clock synchronization

The internal clock has 1ms resolution and a stability of $\pm 35\text{ppm}$ in the operational temperature range.

It can be synchronized with an external time reference in the following ways:

- ❑ Using the standard “Time Synchronization” procedure of the “IEC870-5-103” protocol.
- ❑ Using the “MCom 2” software or from the DCS with the Modbus RTU protocol.

Note: On power supply failure an internal battery supports the internal clock for over two years.

17. Healthy (Diagnostic Information)

The relay operates a continuous checking of the vital functionalities and in case an internal failure is detected, the I.R.F. function (see § I.R.F.) is activated and the Power/IRF led is set to flashing.

Device	→	No Fail	→	No Fail
		Fail	→	Fail present
		MinorFail	→	Minor Fail
		HisoricalFail	→	Cleared Fail
		FW not comp.	→	Firmware not compatible

If an internal self-clearing (transient) fault is detected, it is recorded into an historical file without any other action.

18. Dev.Info (Relay Version)

In this menu it is possible to read the information relevant to relay unit.

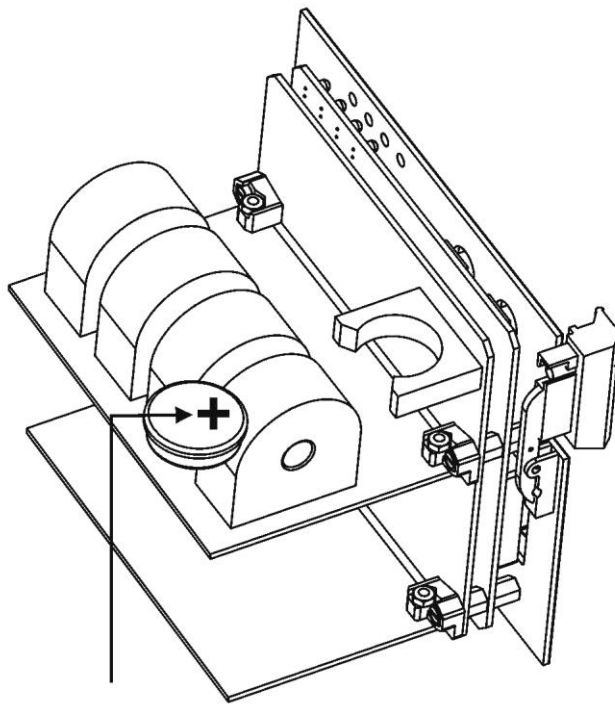
SW Version	AcqUnit-I/O	→	#####.###.###.#	Firmware version of acquisition unit	This information can only be modified by the interface program "MSCom II" and allows the user to give to the relay any suitable denomination.
	ProtectUnit	→	#####.###.###.#	Firmware version of CPU unit	
Protect.Model		→	FeederManager	Protection Type	
Serial Number		→	####I####I#####	Relay Serial Number	
User Tag		→	FMR	Relay identification label.	
Build		→	#####	Build identification label.	
Line		→	#####	Line identification label.	

19. Battery

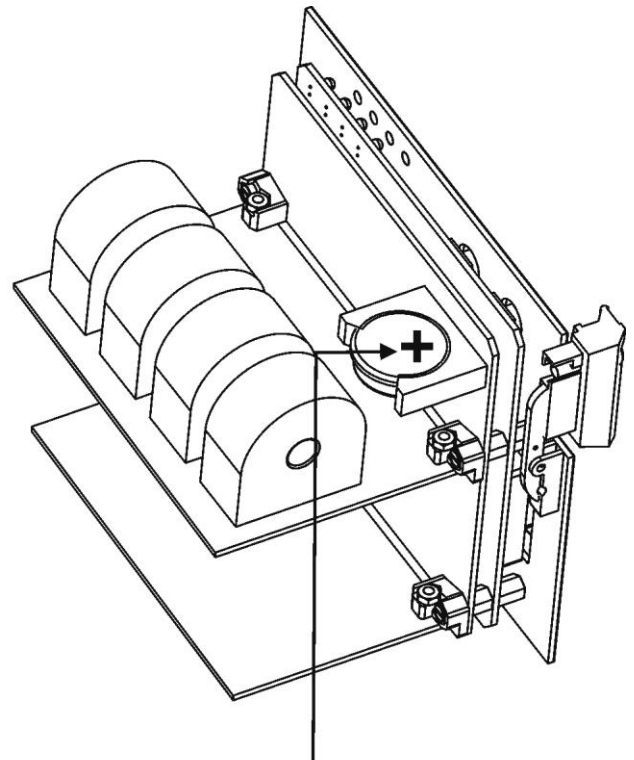
The relay is equipped with a lithium battery type “CR2477N 3V”, to support the internal clock and the oscillographic recording memory in case of programmed lack of power.
The expected minimum duration without power exceed 2 years.

Attention!! Use only battery specified.

Instruction for replacement the battery:



BATTERY



BATTERY

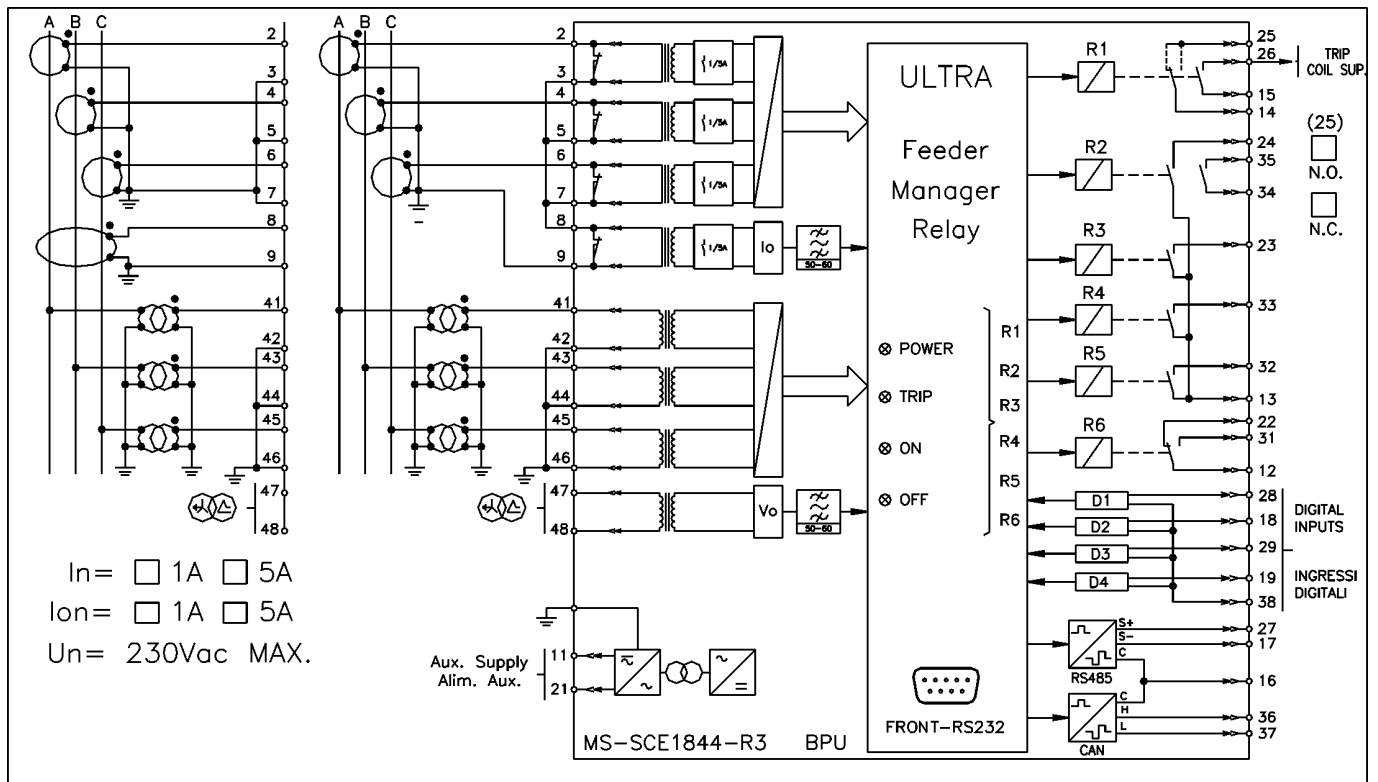
20. Maintenance

No maintenance is required. In case of malfunctioning please contact Microelettrica Scientifica Service or the local Authorized Dealer mentioning the relay's Serial No reported in the label on relays enclosure.

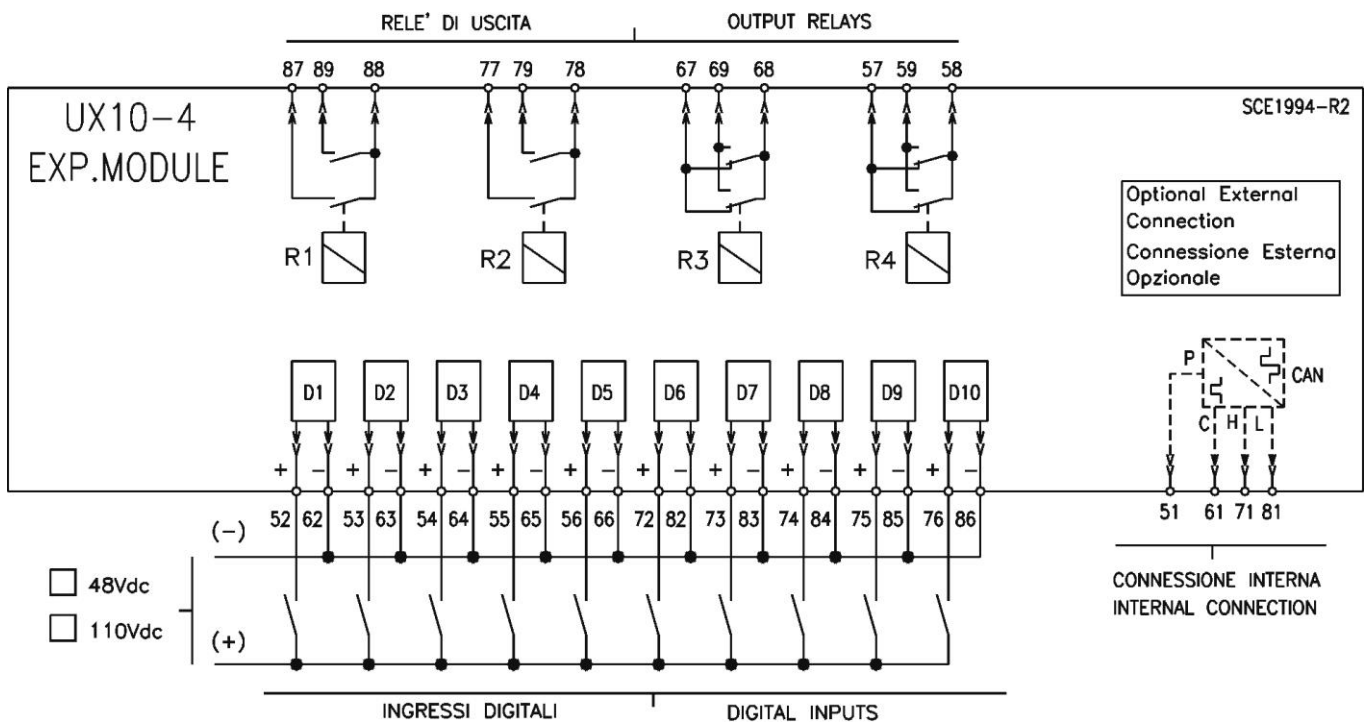
21. Power Frequency Insulation Test

Every relay individually undergoes a factory insulation test according to IEC255-5 standard at 2 kV, 50 Hz 1min. Insulation test should not be repeated as it unusefully stresses the dielectrics.
When doing the insulation test, the terminals relevant to serial output, digital inputs and RTD input must always be short circuited to ground. When relays are mounted in switchboards or relay boards that have to undergo the insulation tests, the relay should be isolated. This is extremely important as discharges eventually tacking place in other parts or components of the board can severely damage the relays or cause damages not immediately evident to the electronic components.

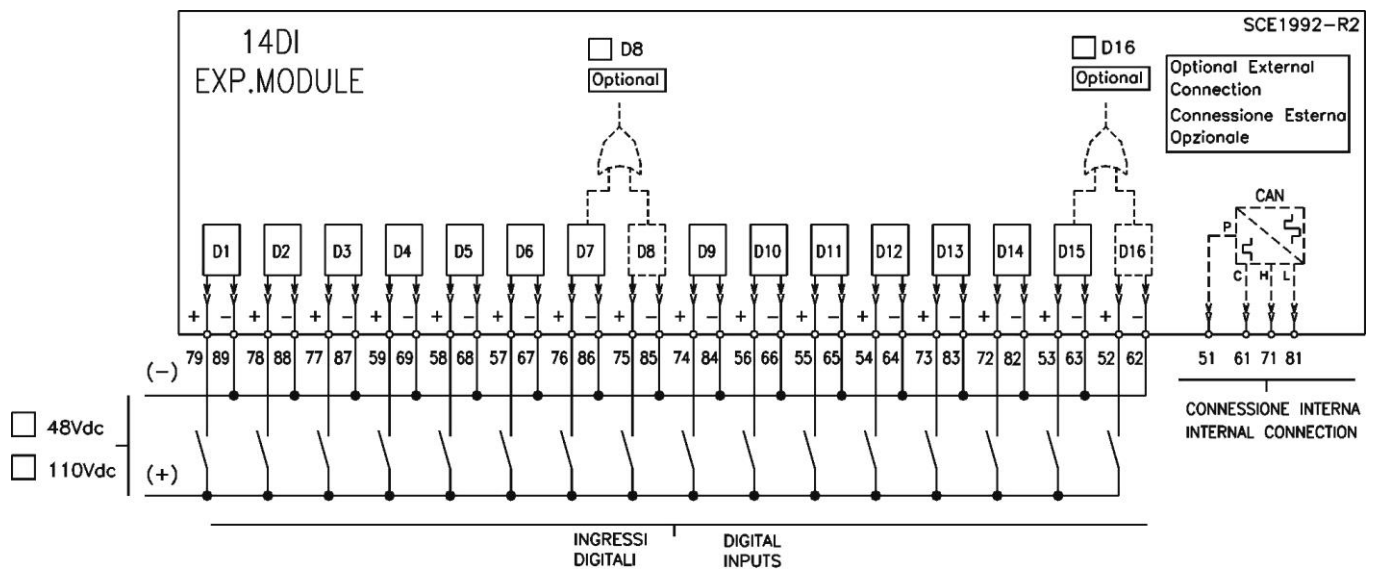
22. Basic Relay - Wiring Diagram



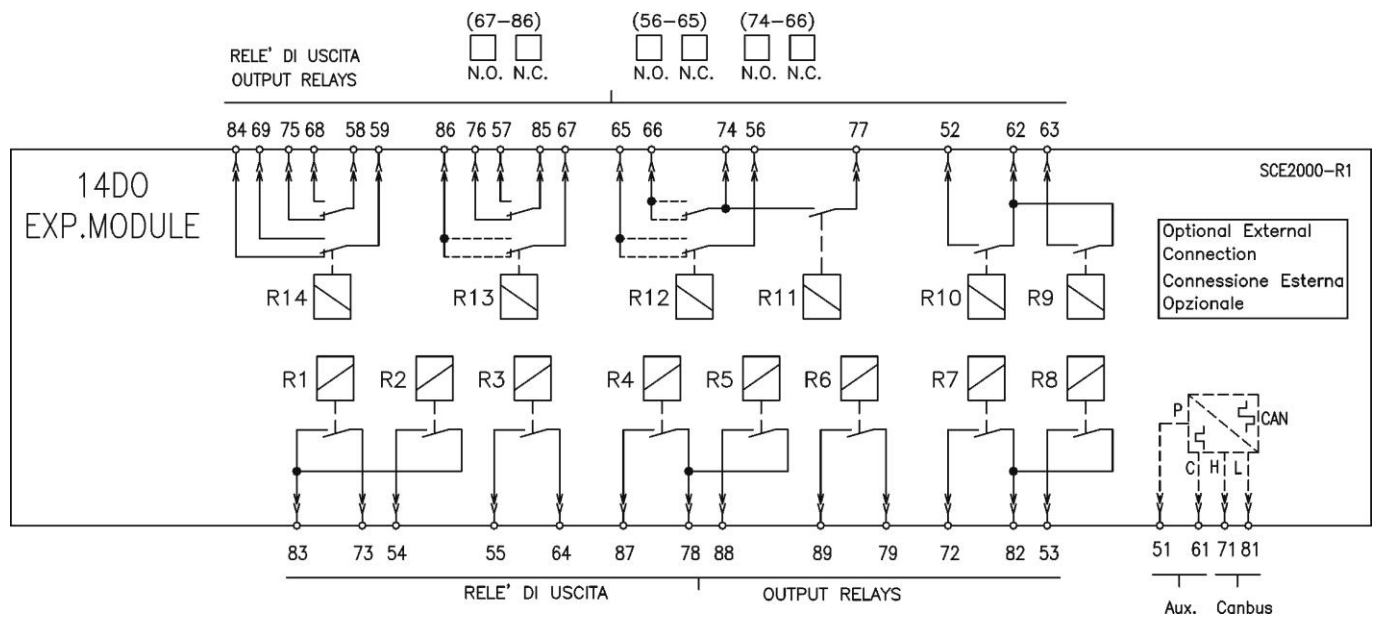
22.1 – UX10-4 - Expansion Module - Wiring Diagram (10 Digital Inputs + 4 Output Relays)



22.2 – **14DI** - Expansion Module - Wiring Diagram (14 Digital Inputs)



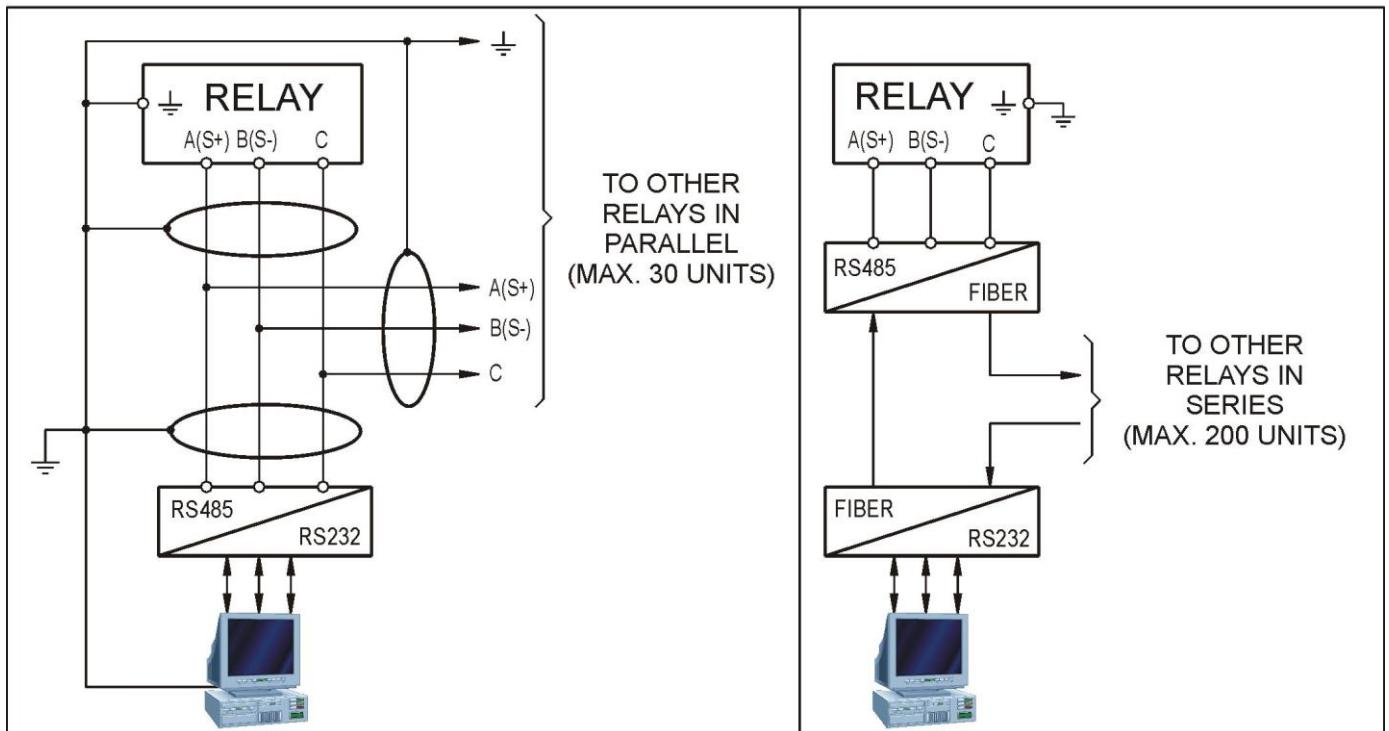
22.3 – 14DO - Expansion Module - Wiring Diagram (14 Output Relays)



23. Wiring the Serial Communication Bus

CONNECTION TO RS485

FIBER OPTIC CONNECTION



Each relay is identified by its programmable address code (NodeAd) and can be called from the P.C. A dedicated communication software (MCom2) for Windows 9x/2000/XP (or later) is available. Please refer to the MCom2 instruction manual for more information.

Maximum length of the serial bus can be up to 200m. For longer distance and for connection of up to 250 Relays, optical interconnection is recommended (please ask Microelettrica for accessories).

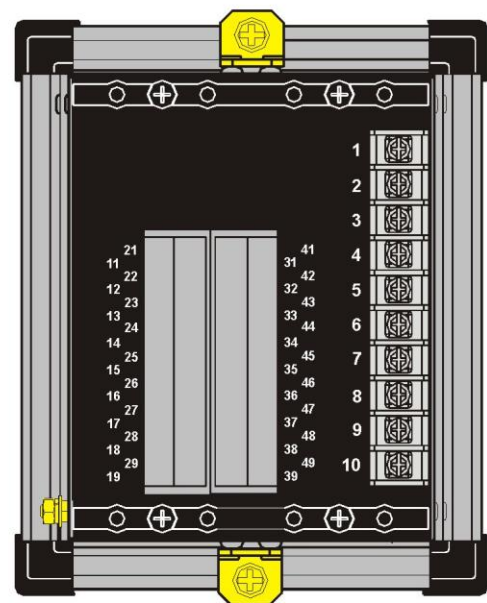
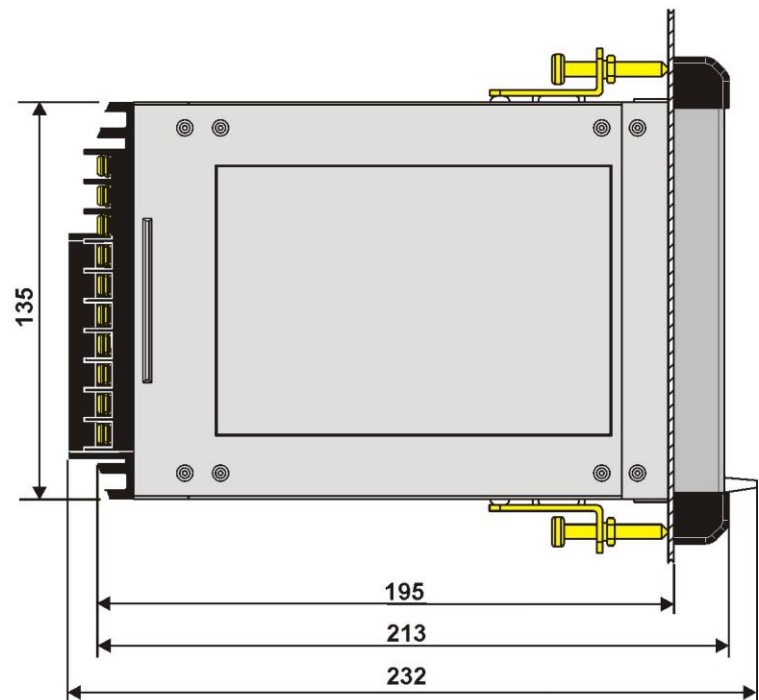
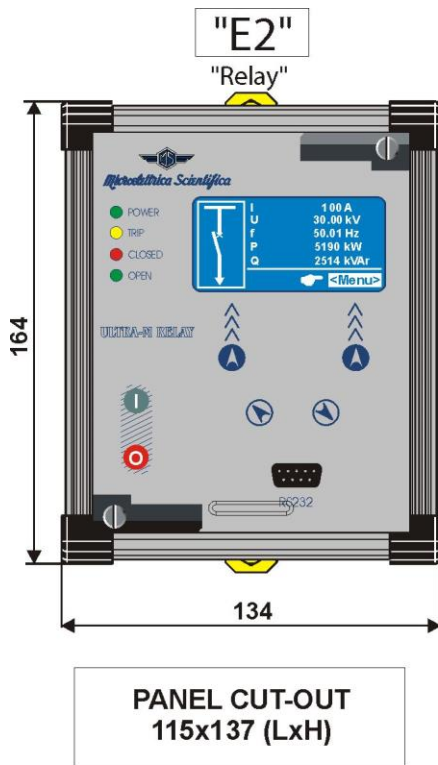
24. Overall Dimensions

Flush mounting protection degree: IP44 (54 on request).

24.1 - Configuration box

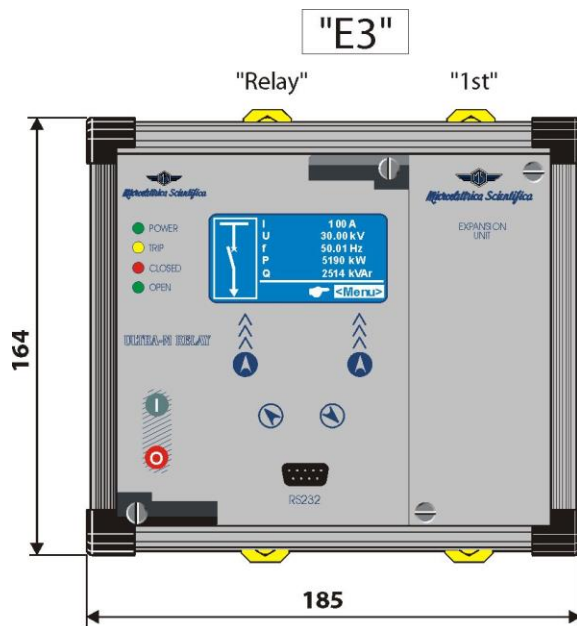
Relay	Expansions							Box
	1st			2nd			Aux.Supply	
	UX10-4	14DI	14DO	UX10-4	14DI	14DO	PSU	
☐	☐	☐	☐	☐	☐	☐	☐	E2
☒	☒	☐	☐	☐	☐	☐	☐	E3
☒	☐	☒	☐	☐	☐	☐	☐	E3
☒	☐	☐	☒	☐	☐	☐	☒	E4
☒	☒	☐	☐	☒	☐	☐	☒	E5
☒	☒	☐	☐	☐	☒	☐	☐	E4
☒	☒	☐	☐	☐	☐	☒	☒	E5
☒	☐	☒	☐	☒	☐	☐	☐	E4
☒	☐	☒	☐	☐	☐	☒	☒	E5
☒	☐	☒	☐	☐	☒	☐	☐	E4
☒	☐	☐	☒	☒	☐	☐	☒	E5
☒	☐	☐	☒	☐	☒	☐	☒	E5
☒	☐	☐	☒	☐	☐	☒	☒	E5

24.2 – Box "E2"

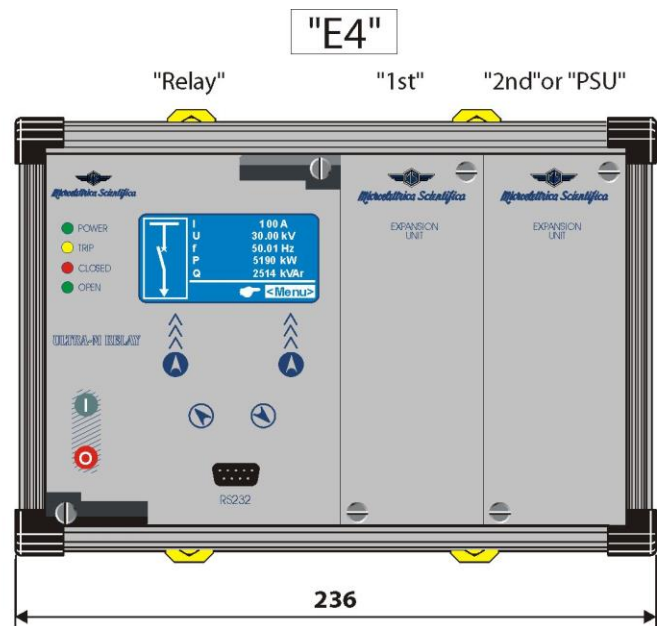


TERMINAL CONNECTION

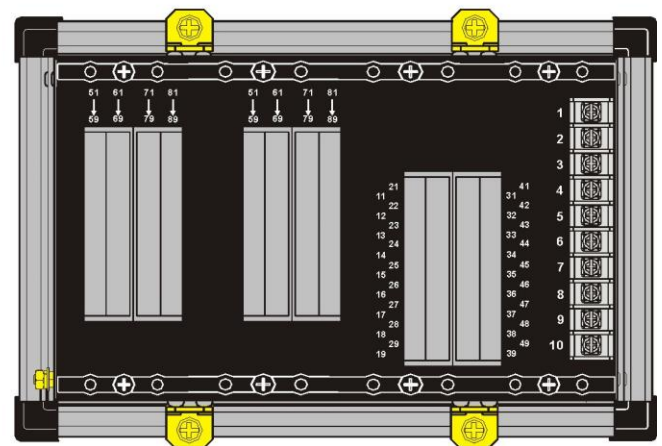
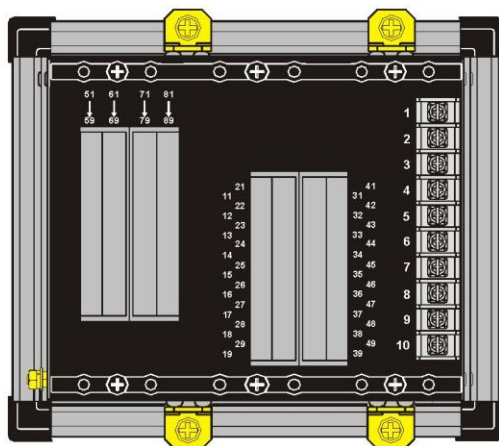
24.3 – Box “E3” & Box “E4”



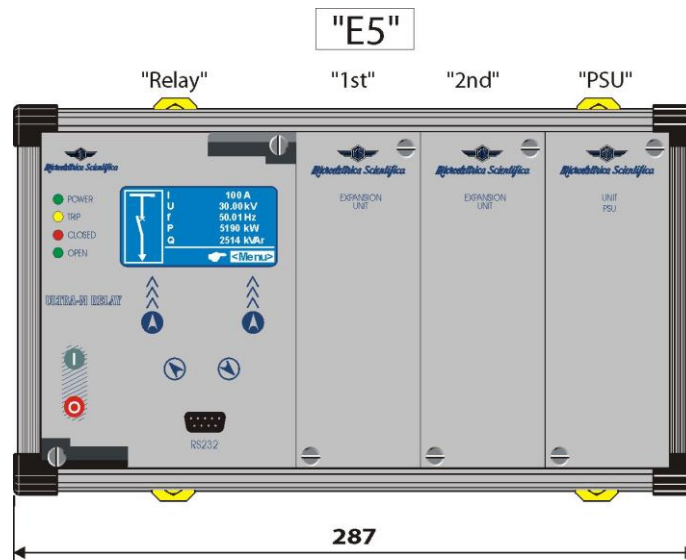
**PANEL
CUT-OUT
165x137 (LxH)**



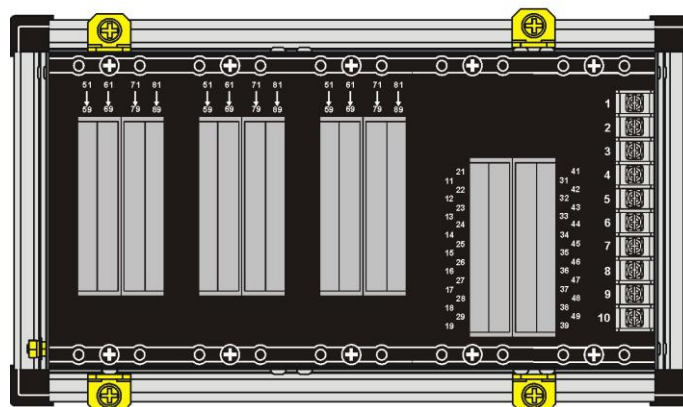
**PANEL
CUT-OUT
217x137 (LxH)**



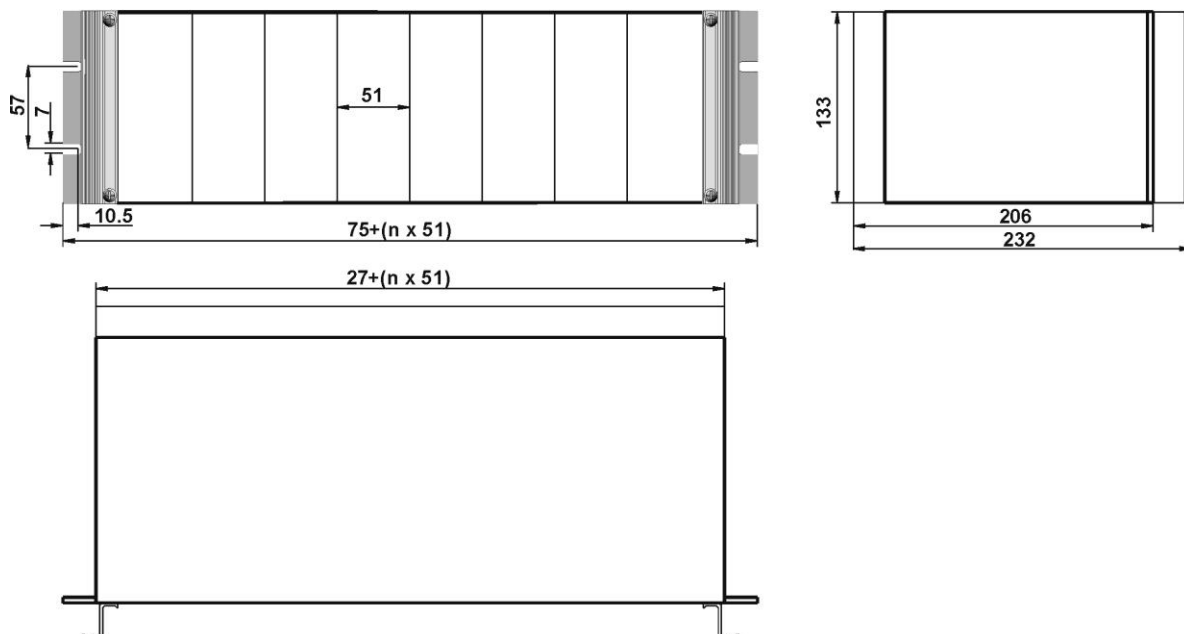
24.2 – Box “E5”



**PANEL
CUT-OUT
268x137 (LxH)**



24.2 – Rack 3U



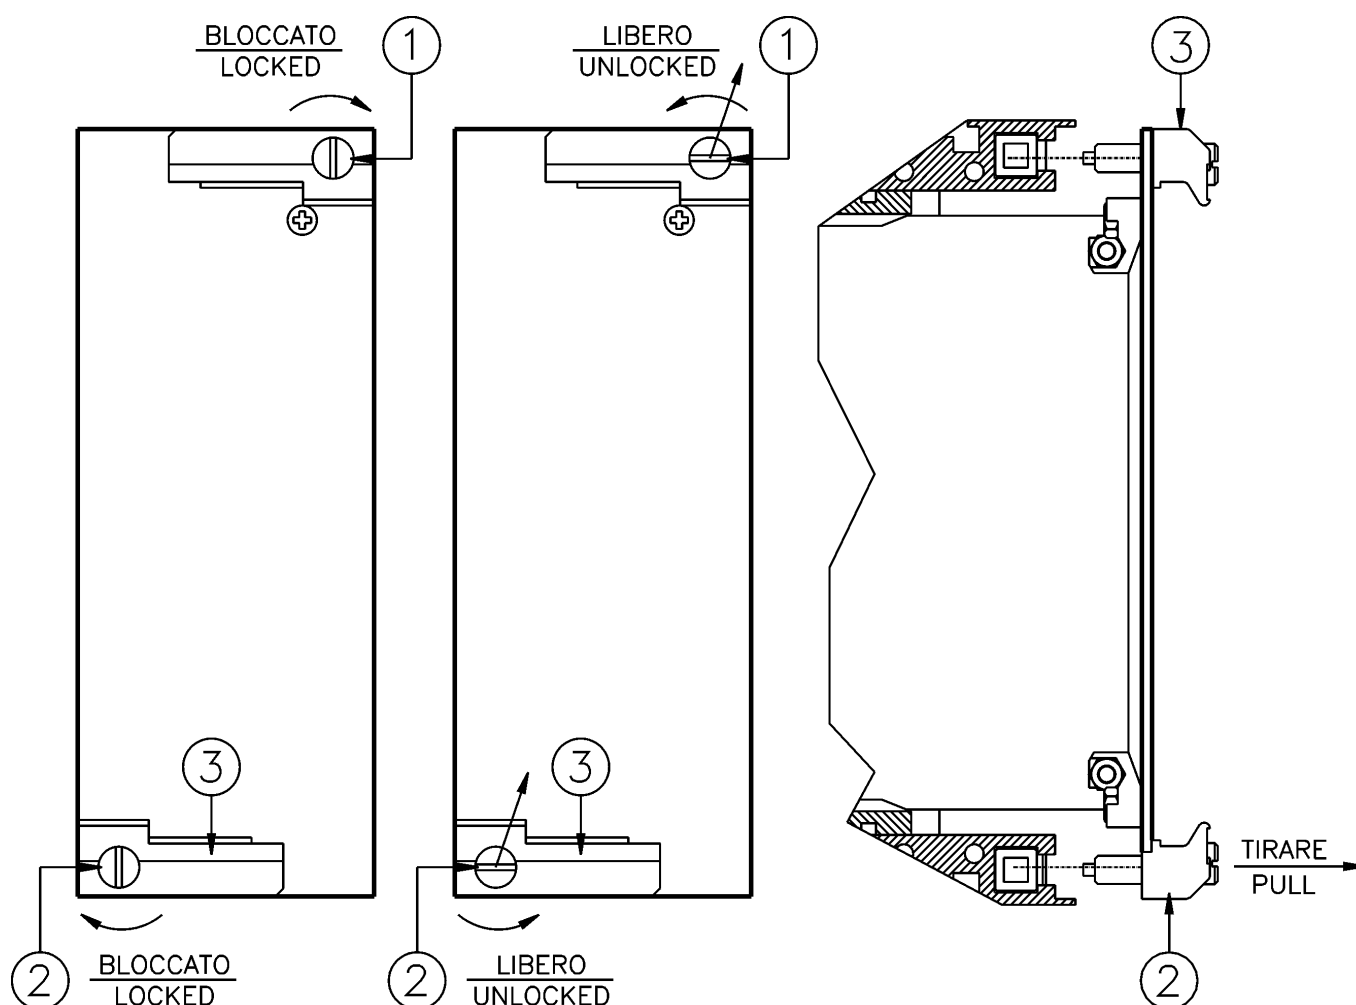
25. Direction for Pcb's Draw-Out and Plug-In

25.1 - Draw-out

Rotate clockwise the screws ① and ② in the horizontal position of the screw-driver mark.
Draw-out the PCB by pulling on the handles ③

25.2 – Plug-in

Rotate clockwise the screws ① and ② in the horizontal position of the screw-driver mark.
Slide-in the card on the rails provided inside the enclosure.
Plug-in the card completely and press the handle to the closed position.
Rotate anticlockwise the screws ① and ② with the mark in the vertical position (locked).



26. Electrical Characteristics

APPROVAL: CE

REFERENCE STANDARDS IEC 60255 - CE Directive - EN/IEC61000 - IEEE C37

☐ Dielectric test voltage	IEC 60255-5	2kV, 50/60Hz, 1 min.
☐ Impulse test voltage	IEC 60255-5	5kV (c.m.), 2kV (d.m.) – 1,2/50µs
☐ Insulation resistance	> 100MΩ	

Environmental Std. Ref. (IEC 60068)

☐ Operation ambient temperature	-10°C / +55°C	
☐ Storage temperature	-25°C / +70°C	
☐ Environmental testing	(Cold) IEC60068-2-1 (Dry heat) IEC60068-2-2 (Change of temperature) IEC60068-2-14 (Damp heat, steady state) IEC60068-2-78	RH 93% Without Condensing AT 40°C

CE EMC Compatibility (EN61000-6-2 - EN61000-6-4 - EN50263)

☐ Electromagnetic emission	EN55011	industrial environment		
☐ Radiated electromagnetic field immunity test	IEC61000-4-3 ENV50204	level 3	80-2000MHz 900MHz/200Hz	10V/m 10V/m
☐ Conducted disturbances immunity test	IEC61000-4-6	level 3	0.15-80MHz	10V
☐ Electrostatic discharge test	IEC61000-4-2	level 3	6kV contact / 8kV air	
☐ Power frequency magnetic test	IEC61000-4-8		1000A/m	50/60Hz
☐ Pulse magnetic field	IEC61000-4-9		1000A/m, 8/20µs	
☐ Damped oscillatory magnetic field	IEC61000-4-10		100A/m, 0.1-1MHz	
☐ Immunity to conducted common mode disturbance 0Hz-150KHz	IEC61000-4-16	level 4		
☐ Electrical fast transient/burst	IEC61000-4-4	level 3	2kV, 5kHz	
☐ HF disturbance test with damped oscillatory wave (1MHz burst test)	IEC60255-22-1	class 3	400pps, 2,5kV (m.c.), 1kV (d.m.)	
☐ Oscillatory waves (Ring waves)	IEC61000-4-12	level 4	4kV(c.m.), 2kV(d.m.)	
☐ Surge immunity test	IEC61000-4-5	level 4	2kV(c.m.), 1kV(d.m.)	
☐ Voltage interruptions	IEC60255-4-11			
☐ Resistance to vibration and shocks	IEC60255-21-1 - IEC60255-21-2		10-500Hz	1g

CARATTERISTICHE

☐ Accuracy at reference value of influencing factors	1% In – 0.1%On 2% + to (to=20÷30ms @ 2xIs)	for measure for times
☐ Rated Current	In = 1 or 5A - On = 1 or 5A	
☐ Current overload	80 In for 1 sec; 4 In continuous	
☐ Burden on current inputs	Phase : 0.01VA at In = 1A; 0.2VA at In = 5A Neutral : 0.01VA at In = 1A ; 0.2VA at In = 5A	
☐ Rated Voltage	Un = (100 ÷125)Vac	
☐ Voltage Overload	2Un permanent	
☐ Burden on voltage inputs	0,1VA at Un	
☐ Average power supply consumption	< 10 VA	
☐ Output relays	rating 5 A; Vn = 380 V A.C. resistive switching = 1100W (380V max) make = 30 A (peak) 0,5 sec. break = 0.3 A, 110 Vcc, L/R = 40 ms (100.000 op.)	

COMMUNICATION PARAMETER

☐ Rear serial port	RS485 – 9600 to 38400 bps – 8,n,1 – Modbus RTU – IEC60870-5-103
☐ Front serial port	RS232 – 9600 to 57600 bps – 8,n,1 – Modbus RTU



27. Software & Firmware Version

☐ **Firmware for version**

IAU (Intelligent Acquisition Unit)	0.14.01.X
IPU (Processor Unit)	0220.20.01.X

☐ **Application Software**

MSCom 2

Microelettrica Scientifica S.p.A. - 20089 Rozzano (MI) - Italy - Via Alberelle, 56/68
Tel. (+39) 02 575731-Fax (+39) 02 57510940
<http://www.microelettrica.com> e-mail : sales.relays@microelettrica.com

The performances and the characteristics reported in this manual are not binding and can modified at any moment without notice