

THREE PHASE  
Over/Under VOLTAGE  
Over/Under FREQUENCY  
MICROPROCESSOR  
RELAY

TYPE

**MC3V-X/10-4**

(I/O Boards)

OPERATION MANUAL



|                                                                                                                             |           |
|-----------------------------------------------------------------------------------------------------------------------------|-----------|
| <b>1. GENERAL UTILIZATION AND COMMISSIONING DIRECTIONS</b>                                                                  | <b>3</b>  |
| 1.1 - Storage and Transportation                                                                                            | 3         |
| 1.2 - Installation                                                                                                          | 3         |
| 1.3 - Electrical Connection                                                                                                 | 3         |
| 1.4 - Measuring Inputs and Power Supply                                                                                     | 3         |
| 1.5 - Outputs Loading                                                                                                       | 3         |
| 1.6 - Protection Earthing                                                                                                   | 3         |
| 1.7 - Setting and Calibration                                                                                               | 3         |
| 1.8 - Safety Protection                                                                                                     | 3         |
| 1.9 - Handling                                                                                                              | 3         |
| 1.10 - Maintenance                                                                                                          | 4         |
| 1.11 - Waste Disposal of Electrical & Electronic Equipment                                                                  | 4         |
| 1.12 - Fault detection and repair                                                                                           | 4         |
| <b>2. GENERAL CHARACTERISTICS</b>                                                                                           | <b>5</b>  |
| 2.1 - Power Supply                                                                                                          | 5         |
| 2.2 - Operation and Algorithms                                                                                              | 6         |
| 2.2.1 - Reference Input Values                                                                                              | 6         |
| 2.2.2 - Input quantities                                                                                                    | 6         |
| 2.2.2.1 - Mains Frequency (Freq)                                                                                            | 6         |
| 2.2.2.2 - Phase Voltage inputs                                                                                              | 6         |
| 2.2.3 - Functions and Settings (Function)                                                                                   | 7         |
| 2.2.3.1 - <b>V&gt; (1F59)</b> - First overvoltage protection level (smallest of 3 phase-to-neutral voltages)                | 7         |
| 2.2.3.2 - <b>V&gt;&gt; (2F59)</b> - Second overvoltage protection level (largest of 3 phase-to-neutral voltages)            | 7         |
| 2.2.3.3 - <b>V&lt; (1F27)</b> - First undervoltage protection level (smallest of 3 phase-to-neutral voltages)               | 8         |
| 2.2.3.4 - <b>V&lt;&lt; (2F27)</b> - Second undervoltage protection level (smallest of 3 phase-to-neutral voltages)          | 8         |
| 2.2.3.5 - <b>f&gt; (F81)</b> - Overfrequency protection level                                                               | 9         |
| 2.2.3.6 - <b>f&lt; (F81)</b> - Underfrequency protection level                                                              | 9         |
| 2.2.3.7 - <b>Vo&gt; (F59o)</b> - Zero sequence overvoltage protection level ( $V_o=3U_o$ )                                  | 9         |
| 2.2.3.8 - <b>V1&lt; (F27V1)</b> - Positive sequence undervoltage protection level (Positive sequence symmetrical component) | 10        |
| 2.2.3.9 - <b>V2&gt; (F59V2)</b> - Negative sequence overvoltage protection level (Negative sequence symmetrical component)  | 10        |
| 2.2.3.10 - <b>RTD</b> - Remote Trip                                                                                         | 11        |
| 2.2.3.11 - <b>I.R.F.</b> - Internal Relay Failure                                                                           | 11        |
| 2.2.3.9 - <b>Osc</b> - Oscillographic Recording                                                                             | 12        |
| 2.2.3.10 - <b>Comm</b> - Communication Parameters                                                                           | 13        |
| 2.2.3.11 - <b>LCD</b> - Display and Buzzer operation                                                                        | 13        |
| <b>3. INSTANTANEOUS OUTPUT AND BLOCKING INPUT</b>                                                                           | <b>14</b> |
| 3.1 - Instantaneous Output                                                                                                  | 14        |
| 3.2 - Blocking Input                                                                                                        | 14        |
| <b>4. OUTPUT RELAYS</b>                                                                                                     | <b>14</b> |
| <b>5. DIGITAL INPUTS</b>                                                                                                    | <b>15</b> |
| <b>6. SELF DIAGNOSTIC</b>                                                                                                   | <b>15</b> |
| <b>7. RELAY MANAGEMENT</b>                                                                                                  | <b>16</b> |
| <b>8. SIGNALIZATIONS</b>                                                                                                    | <b>17</b> |
| <b>9. KEYBOARD BUTTONS</b>                                                                                                  | <b>17</b> |
| <b>10. Serial Communication Port</b>                                                                                        | <b>18</b> |
| 10.1 - Main RS485 Serial Communication Port                                                                                 | 18        |
| 10.2 - Communication Port on Front Face Panel                                                                               | 19        |
| <b>11. MENU AND VARIABLES</b>                                                                                               | <b>20</b> |
| 11.1 - Real Time Measurements                                                                                               | 20        |
| 11.2 - Meas (Instantaneous Measurements)                                                                                    | 20        |
| 11.3 - Counter (Operation Counters)                                                                                         | 20        |
| 11.4 - LastTrip (Event Recording)                                                                                           | 21        |
| 11.5 - R/W Set (Programming / Reading the Relay Settings)                                                                   | 22        |
| 11.5.1 - CommAdd (Communication Address)                                                                                    | 22        |
| 11.5.2 - Time/Date (Time/Date)                                                                                              | 22        |
| 11.5.3 - RatedVal (Rated Input Values)                                                                                      | 22        |
| 11.5.4 - Function (Functions)                                                                                               | 23        |
| 11.6 - RelayCfg (Relay Configuration)                                                                                       | 25        |
| 11.7 - Commands                                                                                                             | 26        |
| 11.8 - Info&Ver (Firmware - Info&Version)                                                                                   | 26        |
| <b>12. KEYBOARD OPERATIONAL DIAGRAM</b>                                                                                     | <b>27</b> |
| <b>13. PASSWORD</b>                                                                                                         | <b>28</b> |
| 13.1 - MS-Com Password                                                                                                      | 28        |
| <b>14. MAINTENANCE</b>                                                                                                      | <b>28</b> |
| <b>15. POWER FREQUENCY INSULATION TEST</b>                                                                                  | <b>28</b> |
| <b>16. CONNECTION DIAGRAM</b>                                                                                               | <b>29</b> |
| <b>17. OVERALL DIMENSIONS</b>                                                                                               | <b>30</b> |
| <b>18. DIRECTION FOR PCB'S DRAW-OUT AND PLUG-IN</b>                                                                         | <b>31</b> |
| 18.1 - Draw-Out                                                                                                             | 31        |
| 18.2 - Plug-In                                                                                                              | 31        |
| <b>19. ELECTRICAL CHARACTERISTICS</b>                                                                                       | <b>32</b> |

---

**1. GENERAL UTILIZATION AND COMMISSIONING DIRECTIONS**

---

Always make reference to the specific description of the product and to the Manufacturer's instruction. Carefully observe the following warnings.

---

**1.1 - Storage and Transportation**

---

must comply with the environmental conditions stated on the product's instruction or by the applicable IEC standards.

---

**1.2 - Installation**

---

must be properly made and in compliance with the operational ambient conditions stated by the Manufacturer.

---

**1.3 - Electrical Connection**

---

must be made strictly according to the wiring diagram supplied with the Product, to its electrical characteristics and in compliance with the applicable standards particularly with reference to human safety.

---

**1.4 - Measuring Inputs and Power Supply**

---

carefully check that the value of input quantities and power supply voltage are proper and within the permissible variation limits.

---

**1.5 - Outputs Loading**

---

must be compatible with their declared performance.

---

**1.6 - Protection Earthing**

---

When earthing is required, carefully check its effectiveness.

---

**1.7 - Setting and Calibration**

---

Carefully check the proper setting of the different functions according to the configuration of the protected system, the safety regulations and the co-ordination with other equipment.

---

**1.8 - Safety Protection**

---

Carefully check that all safety means are correctly mounted, apply proper seals where required and periodically check their integrity.

---

**1.9 - Handling**

---

Notwithstanding the highest practicable protection means used in designing M.S. electronic circuits, the electronic components and semiconductor devices mounted on the modules can be seriously damaged by electrostatic voltage discharge which can be experienced when handling the modules.

The damage caused by electrostatic discharge may not be immediately apparent but the design reliability and the long life of the product will have been reduced. The electronic circuits reduced by M.S. are completely safe from electrostatic discharge (8 KV IEC 255.22.2) when housed in their case; withdrawing the modules without proper cautions expose them to the risk of damage.

- a. Before removing a module, make sure you are at the same electrostatic potential as the equipment by touching the case.
- b. Handle the module by its front-plate, frame, or edges of the printed circuit board. Avoid touching the electronic components, printed circuit tracks or connectors.
- c. Do not pass the module to any person without first ensuring that you are both at the same electrostatic potential. Shaking hands achieves equipotential.
- d. Place the module on an antistatic surface, or on a conducting surface which is at the same potential as yourself.
- e. Store or transport the module in a conductive bag.

More information on safe working procedures for all electronic equipment can be found in BS5783 and IEC 147-OF.

### **1.10 - Maintenance**

---

Make reference to the instruction manual of the Manufacturer ; maintenance must be carried-out by specially trained people and in strict conformity with the safety regulations.

### **1.11 - Waste Disposal of Electrical & Electronic Equipment**

---

(Applicable throughout the European Union and other European countries with separate collection program).

This product should not be treated as household waste when you wish dispose of it. Instead, it should be handed over to an applicable collection point for the recycling of electrical and electronic equipment. By ensuring this product is disposed of correctly, you will help prevent potential negative consequence to the environment and human health, which could otherwise be caused by inappropriate disposal of this product. The recycling of materials will help to conserve natural resource.

### **1.12 - Fault detection and repair**

---

Internal calibrations and components should not be altered or replaced.  
For repair please ask the Manufacturer or its authorised Dealers.

Misapplication of the above warnings and instruction relieves the Manufacturer of any liability.

---

## 2. General Characteristics

---

The MC is a very innovative and versatile line of Protective Relays which takes advantage of the long and successful experience coming from the M-Line.

The main features of the MC-Line relays are:

Compact draw-out execution for Flush Mounting or for assembly in 19" 3U chassis for 19" Rack systems.

User friendly front face with 2x8 characters LCD Display, four signal Leds, four keys for complete local management and 9-pin socket for local RS232 serial communication.

Four user programmable Output Relays. On request one of the Output Relays can be replaced by a Can Bus port for control of additional I/O modules.

Three optoisolated, self-powered Digital Inputs.

RS485 communication port (independent from the RS232 port on front panel)

Totally draw-out execution.

Input voltage is supplied to 3 internal isolated transformers.

### ***The Measuring Ranges are:***

Phase Voltage : (0.1 - 2)Un

Frequency : (40.00 - 70.00)Hz

Make electric connection in conformity with the diagram reported on relay's enclosure.

Check that input quantities are same as reported on the diagram and on the test certificate.

---

### **2.1 - Power Supply**

---

The auxiliary power is supplied by a built-in module fully isolated and self protected.

Two options are available:

a) - { 24V(-20%) / 110V(+15%) a.c.  
24V(-20%) / 125V(+20%) d.c.

b) - { 80V(-20%) / 220V(+15%) a.c.  
90V(-20%) / 250V(+20%) d.c.

Before energising the unit check that supply voltage is within the allowed limits.

## 2.2 - Operation and Algorithms

### 2.2.1 - Reference Input Values

| Display           | Description                           | Setting Range | Step | Unit |
|-------------------|---------------------------------------|---------------|------|------|
| <b>V1</b> 10 kV   | Rated Primary voltage of phase V.T.   | 0.05 - 500    | 0.01 | kV   |
| <b>V2</b> 100 V   | Rated Secondary voltage of phase V.T. | 50 - 400      | 0.01 | V    |
| <b>Freq</b> 50 Hz | System rated frequency                | 50 - 60       | 10   | Hz   |

### 2.2.2 - Input quantities

#### 2.2.2.1 - Mains Frequency (Freq)

The relay can operate either in 50Hz or 60Hz systems.  
The rated Mains Frequency “ Freq ” must be set accordingly.

#### 2.2.2.2 - Phase Voltage inputs

Input voltages are supplied to 3 internal adapting transformers; the rated input voltage (phase-to-phase) can be programmed in the range (50 - 400)V.  
The display shows the measurement of the phase-to-neutral voltages in primary volt according to the programmed reference input values.

## 2.2.3 - Functions and Settings (Function)

### 2.2.3.1 - V> (1F59) - First overvoltage protection level (smallest of 3 phase-to-neutral voltages)

|                 |   |                    |                                      |
|-----------------|---|--------------------|--------------------------------------|
| <b>FuncEnab</b> | → | Enable             | [Disable / Enable]                   |
| <b>Options</b>  | → | <b>BI</b> Disable  | [Disable / Enable]                   |
|                 | → | <b>Trg</b> Enable  | [Disable / Enable]                   |
| <b>TripLev</b>  | → | <b>V&gt;</b> 1.10  | <b>Vn</b> (0.50 ÷ 1.50) step 0.01 Vn |
| <b>Timers</b>   | → | <b>tV&gt;</b> 1.00 | <b>s</b> (0.05 ÷ 60.00) step 0.01 s  |

- ☐ **FuncEnab** : If disable the function is disactivated
- ☐ **BI** : Operation controlled by Blocking Digital Input
- ☐ **Trg** : Function operation triggers the oscillographic wave form capture (see § Oscillographic)
- ☐ **V>** : Trip level of overvoltage protection
- ☐ **tV>** : Trip time delay

### 2.2.3.2 - V>> (2F59) - Second overvoltage protection level (largest of 3 phase-to-neutral voltages)

|                 |   |                        |                                      |
|-----------------|---|------------------------|--------------------------------------|
| <b>FuncEnab</b> | → | Enable                 | [Disable / Enable]                   |
| <b>Options</b>  | → | <b>BI</b> Disable      | [Disable / Enable]                   |
|                 | → | <b>Trg</b> Enable      | [Disable / Enable]                   |
| <b>TripLev</b>  | → | <b>V&gt;&gt;</b> 1.30  | <b>Vn</b> (0.50 ÷ 1.50) step 0.01 Vn |
| <b>Timers</b>   | → | <b>tV&gt;&gt;</b> 0.30 | <b>s</b> (0.05 ÷ 60.00) step 0.01 s  |

- ☐ **FuncEnab** : If disable the function is disactivated
- ☐ **BI** : Operation controlled by Blocking Digital Input
- ☐ **Trg** : Function operation triggers the oscillographic wave form capture (see § Oscillographic)
- ☐ **V>>** : Trip level of overvoltage protection
- ☐ **tV>>** : Trip time delay

**2.2.3.3 - V< (1F27) - First undervoltage protection level (smallest of 3 phase-to-neutral voltages)**

|                 |   |                    |                                      |
|-----------------|---|--------------------|--------------------------------------|
| <b>FuncEnab</b> | → | Enable             | [Disable / Enable]                   |
| <b>Options</b>  | → | <b>BI</b> Disable  | [Disable / Enable]                   |
|                 | → | <b>Trg</b> Disable | [Disable / Enable]                   |
| <b>TripLev</b>  | → | <b>V&lt;</b> 0.90  | <b>Vn</b> (0.20 ÷ 1.20) step 0.01 Vn |
| <b>Timers</b>   | → | <b>tV&lt;</b> 1.00 | <b>s</b> (0.05 ÷ 60.00) step 0.01 s  |

- ☐ **FuncEnab** : If disable the function is deactivated
- ☐ **BI** : Operation controlled by Blocking Digital Input
- ☐ **Trg** : Function operation triggers the oscillographic wave form capture (see § Oscillographic)
- ☐ **V<** : Trip level of undervoltage protection
- ☐ **tV<** : Trip time delay

**2.2.3.4 - V<< (2F27) - Second undervoltage protection level (smallest of 3 phase-to-neutral voltages)**

|                 |   |                        |                                      |
|-----------------|---|------------------------|--------------------------------------|
| <b>FuncEnab</b> | → | Enable                 | [Disable / Enable]                   |
| <b>Options</b>  | → | <b>BI</b> Disable      | [Disable / Enable]                   |
|                 | → | <b>Trg</b> Disable     | [Disable / Enable]                   |
| <b>TripLev</b>  | → | <b>V&lt;&lt;</b> 0.70  | <b>Vn</b> (0.20 ÷ 1.20) step 0.01 Vn |
| <b>Timers</b>   | → | <b>tV&lt;&lt;</b> 0.30 | <b>s</b> (0.05 ÷ 60.00) step 0.01 s  |

- ☐ **FuncEnab** : If disable the function is deactivated
- ☐ **BI** : Operation controlled by Blocking Digital Input
- ☐ **Trg** : Function operation triggers the oscillographic wave form capture (see § Oscillographic)
- ☐ **V<<** : Trip level of undervoltage protection
- ☐ **tV<<** : Trip time delay

**2.2.3.5 -  $f>$  (F81) - Overfrequency protection level**

|                 |                              |         |                                 |
|-----------------|------------------------------|---------|---------------------------------|
| <b>FuncEnab</b> | →                            | Enable  | [Disable / Enable]              |
| <b>Options</b>  | → <b>BI</b>                  | Disable | [Disable / Enable]              |
|                 | → <b>Trg</b>                 | Enable  | [Disable / Enable]              |
| <b>TripLev</b>  | → <b><math>f&gt;</math></b>  | 50.50   | Hz (40.00 ÷ 70.00) step 0.01 Hz |
| <b>Timers</b>   | → <b><math>tf&gt;</math></b> | 1.00    | s (0.05 ÷ 60.00) step 0.01 s    |

- ☐ **FuncEnab** : If disable the function is deactivated
- ☐ **BI** : Operation controlled by Blocking Digital Input
- ☐ **Trg** : Function operation triggers the oscillographic wave form capture (see § Oscillographic)
- ☐  **$f>$**  : Trip level of overfrequency protection
- ☐  **$tf>$**  : Trip time delay

**2.2.3.6 -  $f<$  (F81) - Underfrequency protection level**

|                 |                              |         |                                 |
|-----------------|------------------------------|---------|---------------------------------|
| <b>FuncEnab</b> | →                            | Enable  | [Disable / Enable]              |
| <b>Options</b>  | → <b>BI</b>                  | Disable | [Disable / Enable]              |
|                 | → <b>Trg</b>                 | Enable  | [Disable / Enable]              |
| <b>TripLev</b>  | → <b><math>f&lt;</math></b>  | 49.50   | Hz (40.00 ÷ 70.00) step 0.01 Hz |
| <b>Timers</b>   | → <b><math>tf&lt;</math></b> | 1.00    | s (0.05 ÷ 60.00) step 0.01 s    |

- ☐ **FuncEnab** : If disable the function is deactivated
- ☐ **BI** : Operation controlled by Blocking Digital Input
- ☐ **Trg** : Function operation triggers the oscillographic wave form capture (see § Oscillographic)
- ☐  **$f<$**  : Trip level of underfrequency protection
- ☐  **$tf<$**  : Trip time delay

**2.2.3.7 -  $Vo>$  (F59o) – Zero sequence overvoltage protection level ( $Vo=3U_0$ )**

|                 |                               |         |                              |
|-----------------|-------------------------------|---------|------------------------------|
| <b>FuncEnab</b> | →                             | Enable  | [Disable / Enable]           |
| <b>Options</b>  | → <b>BI</b>                   | Disable | [Disable / Enable]           |
|                 | → <b>Trg</b>                  | Enable  | [Disable / Enable]           |
| <b>TripLev</b>  | → <b><math>Vo&gt;</math></b>  | 1.10    | Vn (0.10 ÷ 2.00) step 0.1 Vn |
| <b>Timers</b>   | → <b><math>tVo&gt;</math></b> | 0.30    | s (0.05 ÷ 60.00) step 0.01 s |

- ☐ **FuncEnab** : If disable the function is deactivated
- ☐ **BI** : Operation controlled by Blocking Digital Input
- ☐ **Trg** : Function operation triggers the oscillographic wave form capture (see § Oscillographic)
- ☐  **$Vo>$**  : Trip level of zero sequence overvoltage protection
- ☐  **$tVo>$**  : Trip time delay

### 2.2.3.8 – **V1< (F27V1)** – Positive sequence undervoltage protection level (Positive sequence symmetrical component)

|                 |   |                |                                   |
|-----------------|---|----------------|-----------------------------------|
| <b>FuncEnab</b> | → | Enable         | [Disable / Enable]                |
| <b>Options</b>  | → | <b>BI</b>      | Disable                           |
|                 | → | <b>Trg</b>     | Enable                            |
| <b>TripLev</b>  | → | <b>V1&lt;</b>  | 0.8 Vn (0.10 ÷ 1.50) step 0.01 Vn |
| <b>Timers</b>   | → | <b>tV1&lt;</b> | 5.00 s (0.05 ÷ 60.00) step 0.01 s |

- ☐ **FuncEnab** : If disable the function is deactivated
- ☐ **BI** : Operation controlled by Blocking Digital Input
- ☐ **Trg** : Function operation triggers the oscillographic wave form capture (see § Oscillographic)
- ☐ **V1<** : Trip level of positive sequence overvoltage protection
- ☐ **tV1<** : Trip time delay

### 2.2.3.9 – **V2> (F59V2)** – Negative sequence overvoltage protection level (Negative sequence symmetrical component)

|                 |   |                |                                    |
|-----------------|---|----------------|------------------------------------|
| <b>FuncEnab</b> | → | Enable         | [Disable / Enable]                 |
| <b>Options</b>  | → | <b>BI</b>      | Disable                            |
|                 | → | <b>Trg</b>     | Enable                             |
| <b>TripLev</b>  | → | <b>V2&gt;</b>  | 0.20 Vn (0.02 ÷ 1.50) step 0.01 Vn |
| <b>Timers</b>   | → | <b>tV2&gt;</b> | 5.00 s (0.05 ÷ 60.00) step 0.01 s  |

- ☐ **FuncEnab** : If disable the function is deactivated
- ☐ **BI** : Operation controlled by Blocking Digital Input
- ☐ **Trg** : Function operation triggers the oscillographic wave form capture (see § Oscillographic)
- ☐ **V2>** : Trip level of negative sequence overvoltage protection
- ☐ **tV2>** : Trip time delay

### 2.2.3.10 - *RTD* - Remote Trip

Remote trip is controlled via the Digital Input D2.

|                 |   |          |                    |
|-----------------|---|----------|--------------------|
| <b>FuncEnab</b> | → | Disable  | [Disable / Enable] |
| <b>Options</b>  | → | No Param | No Parameters      |
| <b>TripLev</b>  | → | No Param | No Parameters      |
| <b>Timers</b>   | → | No Param | No Parameters      |

- ☐ **FuncEnab** : If disable the function is disactivated

### 2.2.3.11 - *I.R.F.* - Internal Relay Failure

|                 |              |          |                 |
|-----------------|--------------|----------|-----------------|
| <b>FuncEnab</b> | →            | No Param | No Parameters   |
| <b>Options</b>  | → <b>Opz</b> | Trip     | [NoTrip / Trip] |
| <b>TripLev</b>  | →            | No Param | No Parameters   |
| <b>Timers</b>   | →            | No Param | No Parameters   |

- ☐ **Opz** : The variable “ Opz “ can be programmed to trip the output relays same as the other protection functions (Opz = TRIP), or to only operate the “ IRF “ signal led without tripping the output relays (Opz = NoTRIP).

### 2.2.3.9 - Osc - Oscillographic Recording

|                 |                |          |                                     |
|-----------------|----------------|----------|-------------------------------------|
| <b>FuncEnab</b> | →              | Enable   | [Disable / Enable]                  |
| <b>Options</b>  | → <b>Trg</b>   | Trip     | [Disable / Start / Trip / Ext.Inp.] |
| <b>TripLev</b>  | →              | No Param | No Parameters                       |
| <b>Timers</b>   | → <b>tPre</b>  | 0.30     | s (0.10 ÷ 0.50) step 0.1 s          |
|                 | → <b>tPost</b> | 0.30     | s (0.10 ÷ 1.50) step 0.1 s          |

- 
- ☐ **FuncEnab** : If disable the function is deactivated

---

  - ☐ **Trg** :
    - Disab* = Function Disable (no recording)
    - Start.* = Trigger on time start of protection functions
    - Trip* = Trigger on trip (time delay end) of protection functions
    - Ext.Inp.* = Trigger from the Digital Input D3

---

  - ☐ **tPre** : Recording time before Trigger (Pre-trigger)
  - ☐ **tPost** : Recording time after Trigger (Post-trigger)
- 

When the option “Start” or “Trip” is selected:

The oscillographic recording is started respectively by the “Time Start” or by the “Trip at time end” of any of the functions that have been programmed to Trigger the Wave Form Capture (V>, V>>, V<, V<<, f>, f<, Vo>, V1<, V2>).

The “Osc” Function includes the wave Form Capture of the input quantities (U, f) and can totally store a record of 3 seconds.

The number of events recorded depends on the duration of each individual recording (tPre + tPost). In any case the number of event stored can not exceed ten (10 x 0.3 sec). Any new event beyond the 3 sec capacity of the memory, cancel and overwrites the former records (FIFO Memory).

**2.2.3.10 - Comm – Communication Parameters**

|                 |              |          |                         |
|-----------------|--------------|----------|-------------------------|
| <b>FuncEnab</b> | →            | No Param | No Parameters           |
| <b>Options</b>  | → <b>LBd</b> | 9600     | [9600 / 19200 / 38400]  |
|                 | → <b>RBd</b> | 9600     | [9600 / 19200]          |
|                 | → <b>Mod</b> | 8,n,1    | [8,n,1 / 8,o,1 / 8,e,1] |
|                 | → <b>RPr</b> | Modbus   | [Iec103 / Modbus]       |
| <b>TripLev</b>  | →            | No Param | No Parameters           |
| <b>Timers</b>   | →            | No Param | No Parameters           |

- ☐ **LBd** : Local Baud Rate (Front panel RS232 communication speed)
- ☐ **RBd** : Remote Baud Rate  
(Rear panel terminal blocks RS485 communication speed)
- ☐ **Mod** : Communication mode (communication parameters)  
**Note:** Any change of this setting becomes valid at the next power on
- ☐ **RPr** : Remote Protocol

**2.2.3.11 - LCD – Display and Buzzer operation**

|                 |              |          |                    |
|-----------------|--------------|----------|--------------------|
| <b>FuncEnab</b> | →            | No Param | No Parameters      |
| <b>Options</b>  | → <b>Key</b> | BeepON   | [BeepOFF / BeepON] |
|                 | → <b>BkL</b> | Auto     | [Auto / On]        |
| <b>TripLev</b>  | →            | No Param | No Parameters      |
| <b>Timers</b>   | →            | No Param | No Parameters      |

- ☐ **Key** : Buzzer “Beep” on operation of Keyboard buttons.
- ☐ **BkL** : LCD Backlight continuously “ON” or switched-on Automatically on operation of Keyboard buttons.

---

### **3. Instantaneous Output and Blocking Input**

---

---

#### **3.1 - Instantaneous Output**

---

- ❑ The instantaneous element of each of the protection functions (F59, F27, F81) can be programmed to control one of the Output Relays.  
This relay picks-up as soon as the input quantity exceeds the set trip level of the Protection Function and automatically resets when the input quantity drops below the function reset level ( $\approx 95\%$  of the trip level).

---

#### **3.2 – Blocking Input**

---

- ❑ Tripping at time end of any time delayed protection function (tF59, tF27, fF81, tF81<, tF59Vo,) can be blocked by activating the Digital Input D1 (BI = Enable).

---

### **4. Output Relays**

---

Three user programmable Output Relays are normally available on main relay R1, R2, R3, by a Field Bus output (CANBUS) that controls additional number of user programmable Output Relays 1.R1, 1.R2, 1.R3, 1.R4.

Each of them can be programmed to be controlled by any element (instantaneous or time delayed) of any of the Relay Functions including Remote trip and Internal Relay Fault.

Moreover, the operation of each of the output relays can be programmed to be either Normally Deenergized (energized on tripping of the controlling Functional Element) or Normally Energized (Deenergized on tripping of the controlling Functional Element).

## 5. Digital Inputs

The firmware can manage up to 13 digital inputs and 7 output relays; among these, 3 digital inputs and 3 output relays are available on the relay module, the remaining are available on additional expansion (UX10-4) modules controlled via the CAN-Bus communication channel.

A Digital Input is activated when its terminals are shorted by a cold contact.

| Available in the Main relay          |                                        |                                                                                                        |
|--------------------------------------|----------------------------------------|--------------------------------------------------------------------------------------------------------|
| <b>D1</b>                            | Digital Input "D1" (terminals 22 - 19) | It is usable as Function Blocking Input.                                                               |
| <b>D2</b>                            | Digital Input "D2" (terminals 22 - 21) | It is used for Remote Trip.                                                                            |
| <b>D3</b>                            | Digital Input "D3" (terminals 22 - 20) | The digital Input triggers the oscillographic recording, any time the DI changes from closed to open.  |
| (UX10-4) Additional Expansion Module |                                        |                                                                                                        |
| <b>D1</b>                            | Digital Input "1.D1"                   | By the interface program "MSCom 2" it is possible view the status or via RS485 port (Modbus protocol). |
| <b>D2</b>                            | Digital Input "1.D2"                   |                                                                                                        |
| <b>D3</b>                            | Digital Input "1.D3"                   |                                                                                                        |
| <b>D4</b>                            | Digital Input "1.D4"                   |                                                                                                        |
| <b>D5</b>                            | Digital Input "1.D5"                   |                                                                                                        |
| <b>D6</b>                            | Digital Input "1.D6"                   |                                                                                                        |
| <b>D7</b>                            | Digital Input "1.D7"                   |                                                                                                        |
| <b>D8</b>                            | Digital Input "1.D8"                   |                                                                                                        |
| <b>D9</b>                            | Digital Input "1.D9"                   |                                                                                                        |
| <b>D10</b>                           | Digital Input "1.D10"                  |                                                                                                        |

## 6. Self-diagnostic

The Relay incorporates a sophisticated self-diagnostic feature that continuously checks the following elements:

- ☐ A/D conversion
- ☐ Checksum of the settings stored into E<sup>2</sup>Prom.
- ☐ DSP general operation (Power, Routines, etc.)
- ☐ Lamp test (only on manual test).

Any time Power is switched on, a complete test is run; then, during normal operation, the test runs continuously and the checksum is done any time a parameter is stored into E<sup>2</sup>Prom.


If during the test any Relay Internal Failure (I.R.F) is detected:

- ☐ If " I.R.F. " is programmed to " Trip ", the programmed output relays are operated same as on tripping of any protection function operation is stored in the " Last Trip " and the I.R.F. signal led is set to flashing.
- ☐ If " I.R.F. " is programmed to "NO Trip", and only the I.R.F. signal led is set to flashing.

## 7. Relay Management


The relay can be totally managed locally, either by the RS232 communication port or by the 4 key buttons and the LCD display, or remotely via the communication bus RS485 connected to the rear terminal blocks. The 2 line x 8 characters LCD display shows the available information.

Key buttons operate according to the flow-chart herebelow.

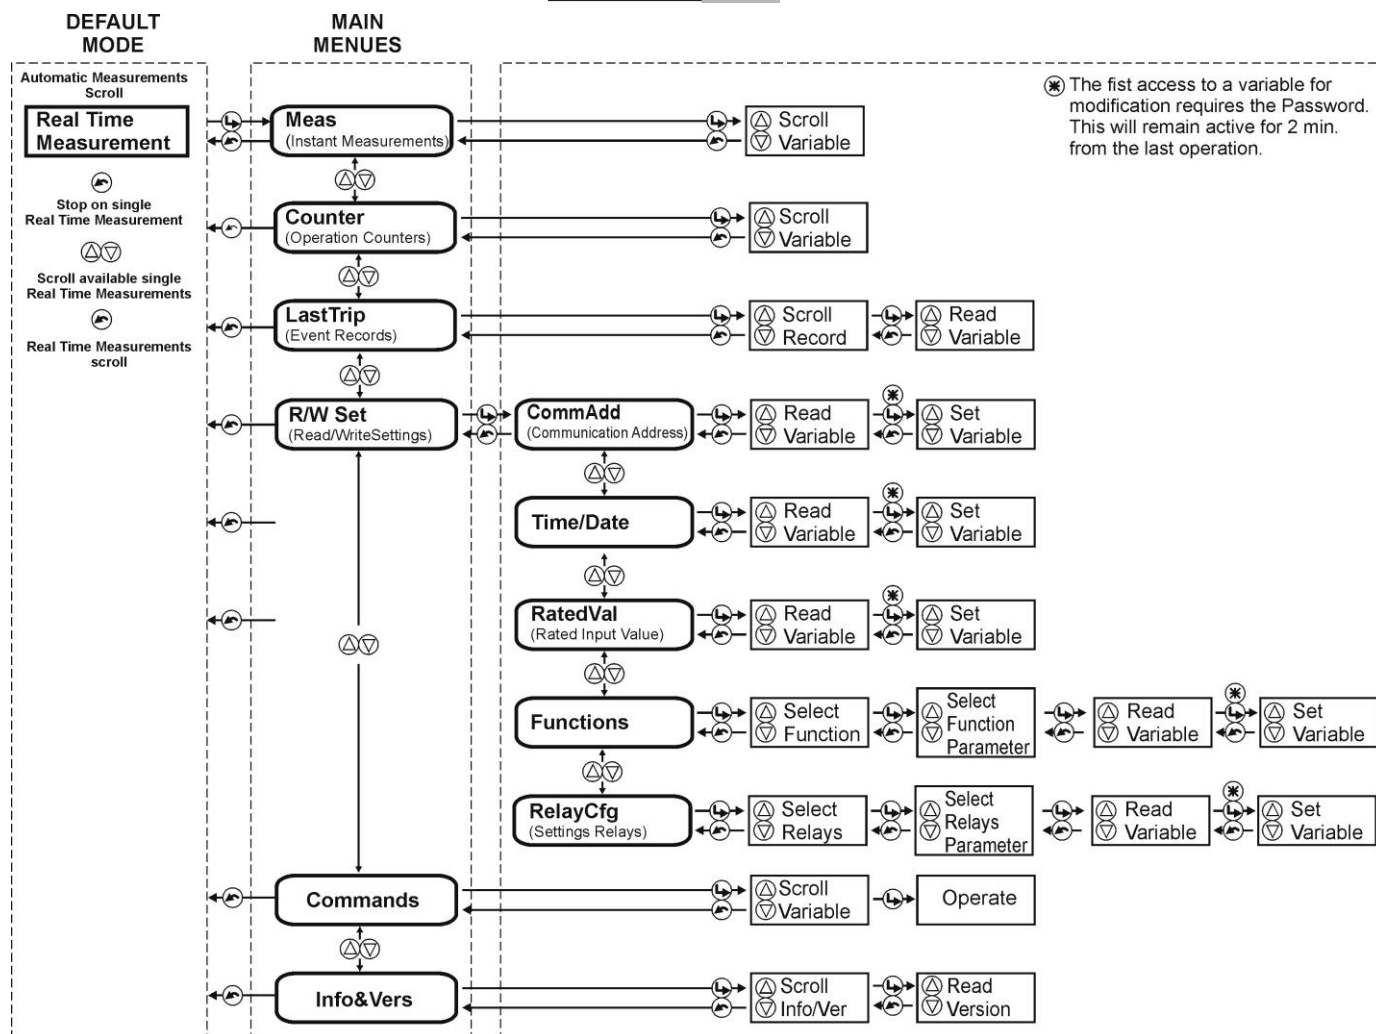

## 8. Signalizations

Four signal leds are available on the Front Face Panel:

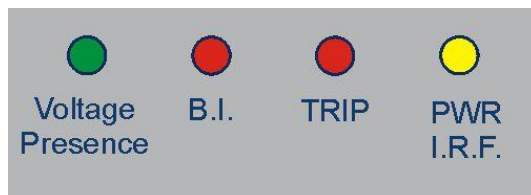

|    |            |                  |                                                                                                                                                                                                                             |
|----|------------|------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| a) | Green LED  | Voltage Presence | <input type="checkbox"/> Illuminated when the input voltage is present (at least one phase-to-neutral voltage exceeding 5% of its rated input value).<br><input type="checkbox"/> Off when the input voltage is not present |
| b) | Red LED    | B.I.             | <input type="checkbox"/> Illuminated when a blocking signal is present at the relevant input terminals.                                                                                                                     |
| c) | Red LED    | TRIP (*)         | <input type="checkbox"/> Flashing when a timed function starts to operate.<br><input type="checkbox"/> Illuminated when any function is tripped; reset takes places by pressing the reset button.                           |
| d) | Yellow LED | PWR/ I.R.F.      | <input type="checkbox"/> Illuminated during normal operation when Power Supply is ON.<br><input type="checkbox"/> Flashing when a Relay Internal Fault is detected.                                                         |

(\*) When any protection function is tripped besides the Led which gives the general trip indication. The display shows the function that caused the tripping:

LastTrip  
"Cause"      steady  
                         blinking

## 9. Keyboard Buttons

|                                                                                     |                 |                                                                                           |
|-------------------------------------------------------------------------------------|-----------------|-------------------------------------------------------------------------------------------|
|  | <b>Enter</b>    | Give access to any menu or convalidate any programming changement.                        |
|  | <b>Reset</b>    | Return from the actual selected menu to the former menu.                                  |
|  | <b>Select +</b> | Scrolls variables available in the different menus or increases/decreases setting values. |
|  | <b>Select -</b> |                                                                                           |

## 10. Serial Communication Port

### 10.1 - Main RS485 Serial Communication Port

This port is accessible via the terminals 1-2-3 provided on the relay terminal board.

It is used for connection to a serial bus interfacing up to 31 units with the Central Supervision System (SCADA, DCS, ecc).

The serial bus is a shielded pair of twisted cables connecting in parallel (Multi Drop) the different units (slaves) by the relevant terminals.

The physical link is RS485 and the Communication Protocol is MODBUS/RTU / IEC60870-5-103.

The configuration of transmission parameters is selectable.

|                          |           |   |                |                |                |
|--------------------------|-----------|---|----------------|----------------|----------------|
| <input type="checkbox"/> | Baud Rate | : | 9600/19200 bps | 9600/19200 bps | 9600/19200 bps |
| <input type="checkbox"/> | Start bit | : | 1              | 1              | 1              |
| <input type="checkbox"/> | Data bit  | : | 8              | 8              | 8              |
| <input type="checkbox"/> | Parity    | : | None           | Odd            | Even           |
| <input type="checkbox"/> | Stop bit  | : | 1              | 1              | 1              |

**Note:** any change of this setting becomes valid at the next power on.


Each relay is identified by its programmable address code (NodeAd) and can be called from the P.C.

A dedicated communication software (MCom 2) for windows 95/98/NT4 SP3 (or later) is available.

Please refer to the MCom instruction manual for more information.

Maximum length of the serial bus can be up to 200m.

### CONNECTION TO RS485

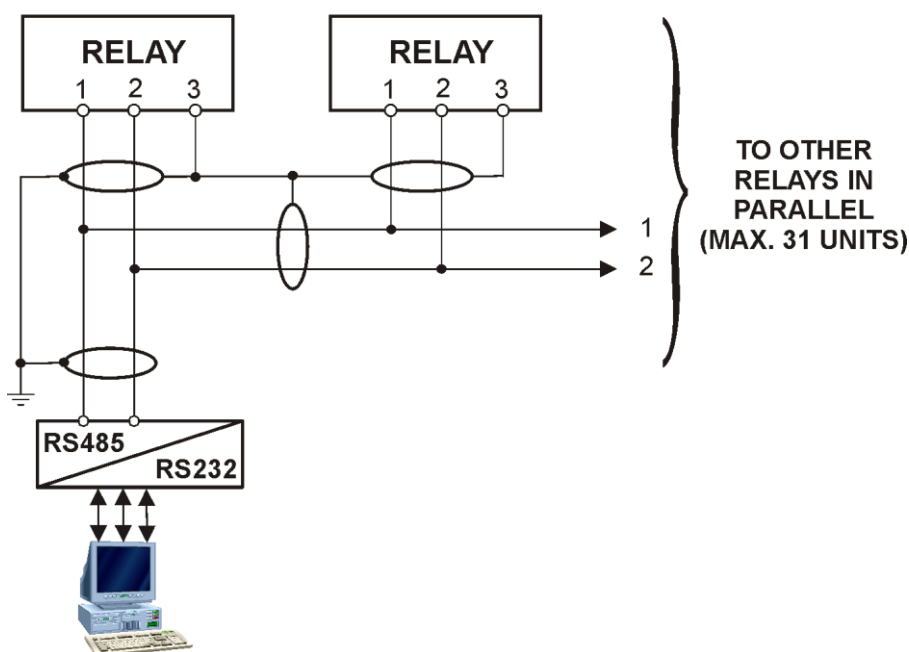


For longer distance and for connection of up to 250 Relays, optical interconnection is recommend.  
(please ask Microelettrica for accessories)

## **10.2 - Communication Port on Front Face Panel**

This port is used for communication through the Front Face Panel between a local Lap-top PC.

The physical link is RS232 by the standard female 9-pin D-sub connector available on the Front Face Panel. Via this Port complete Relay management and data acquisition is possible.

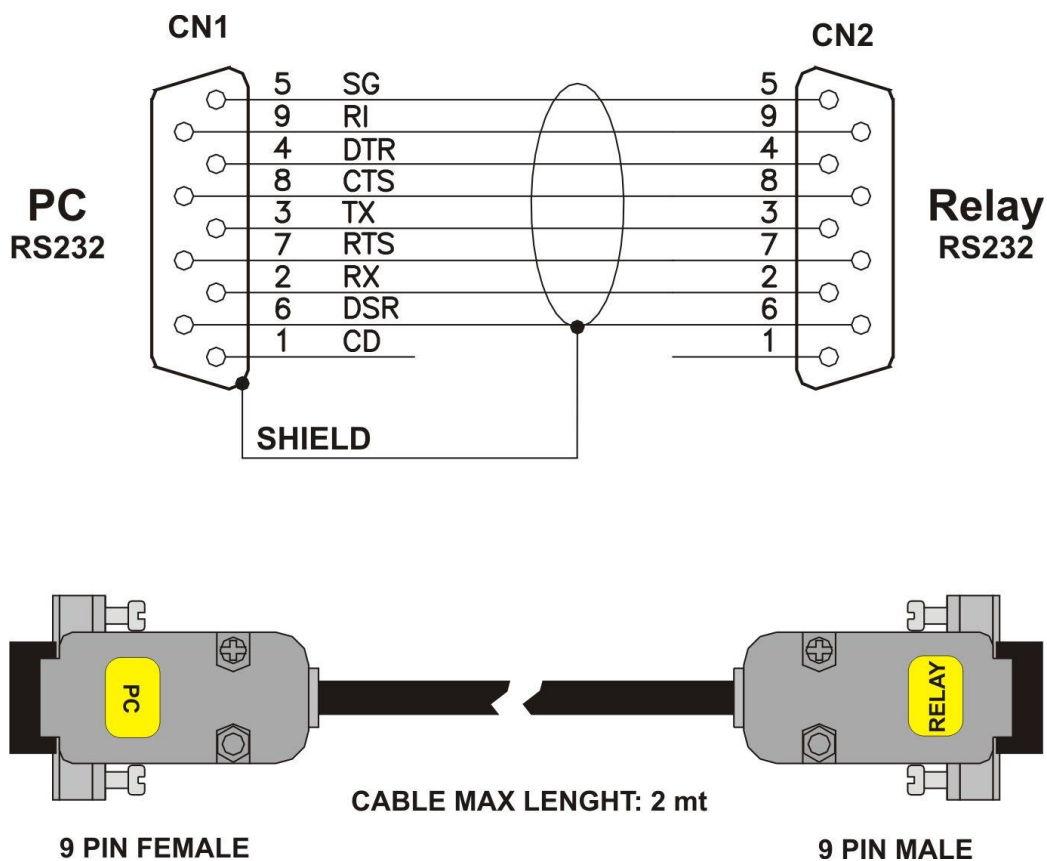

## 11. MENU AND VARIABLES

### 11.1 - Real Time Measurements

Scrolling display of the Real Time Measurements is the Default operation.

Scrolling can be stopped at any of the measurements and restarted by pressing the Reset button .

When stopped on one variable,  appears aside the measurement and the different available measurements can be selected by the   buttons.

| Display   |               |           | Description                                              |
|-----------|---------------|-----------|----------------------------------------------------------|
| <b>EA</b> | = 0 – 999999  | <b>V</b>  | RMS value of primary phase-to-neutral voltage of phase A |
| <b>EB</b> | = 0 – 999999  | <b>V</b>  | RMS value of primary phase-to-neutral voltage of phase B |
| <b>EC</b> | = 0 – 999999  | <b>V</b>  | RMS value of primary phase-to-neutral voltage of phase C |
| <b>f</b>  | = 40.00-70.00 | <b>Hz</b> | System Frequency                                         |
| <b>Vo</b> | = 0 – 999999  | <b>V</b>  | RMS primary zero sequence voltage                        |
| <b>V1</b> | = 0 – 999999  | <b>%</b>  | % of rated system voltage                                |
| <b>V2</b> | = 0 – 999999  | <b>%</b>  | % of rated system voltage                                |

### 11.2 - Meas (Instantaneous Measurements)

Real time measurements can be frozen at any moment selecting the menu “ Instant Measure “:

- “ Real Time Meas “ 
- “ Meas “ 
- “ 1<sup>st</sup> Measurement  other measurements 
-  to go back to “ Meas “

| Display   |               |           | Description                                              |
|-----------|---------------|-----------|----------------------------------------------------------|
| <b>EA</b> | = 0 – 999999  | <b>V</b>  | RMS value of primary phase-to-neutral voltage of phase A |
| <b>EB</b> | = 0 – 999999  | <b>V</b>  | RMS value of primary phase-to-neutral voltage of phase B |
| <b>EC</b> | = 0 – 999999  | <b>V</b>  | RMS value of primary phase-to-neutral voltage of phase C |
| <b>f</b>  | = 40.00-70.00 | <b>Hz</b> | System Frequency                                         |
| <b>Vo</b> | = 0 – 999999  | <b>V</b>  | RMS primary zero sequence voltage                        |
| <b>V1</b> | = 0 – 999999  | <b>%</b>  | % of rated system voltage                                |
| <b>V2</b> | = 0 – 999999  | <b>%</b>  | % of rated system voltage                                |

### 11.3 - Counter (Operation Counters)

The operation of any of the function herebelow reported, is counted and recorded in the menu “Counters “.

- “ Real Time Meas “ 
- “Counter “ 
- “ 1<sup>st</sup> counters  other counters 
-  to go back to “Counter “

| Display          |   |           | Description                                                  |
|------------------|---|-----------|--------------------------------------------------------------|
| <b>V&gt;</b>     | = | 0 – 65535 | Number of 1 <sup>st</sup> Overvoltage (time delayed) trip    |
| <b>V&gt;&gt;</b> | = | 0 – 65535 | Number of 2 <sup>nd</sup> Overvoltage (time delayed) trip    |
| <b>V&lt;</b>     | = | 0 – 65535 | Number of 1 <sup>st</sup> Undervoltage (time delayed) trip   |
| <b>V&lt;&lt;</b> | = | 0 – 65535 | Number of 2 <sup>nd</sup> Undervoltage (time delayed) trip   |
| <b>f&gt;</b>     | = | 0 – 65535 | Number of Overfrequency (time delayed) trip                  |
| <b>f&lt;</b>     | = | 0 – 65535 | Number of Underfrequency (time delayed) trip                 |
| <b>Vo&gt;</b>    | = | 0 – 65535 | Number of Zero sequence overvoltage (time delayed) trip      |
| <b>V1&lt;</b>    | = | 0 – 65535 | Number of Positive sequence undervoltage (time delayed) trip |
| <b>RTD</b>       | = | 0 – 65535 | Number of External Trip commands                             |
| <b>V2&gt;</b>    | = | 0 – 65535 | Number of Negative sequence overvoltage (time delayed) trip  |
| <b>I.R.F.</b>    | = | 0 – 65535 | Number of Internal Relay Faults                              |
| <b>HR</b>        | = | 0 – 65535 | Number of HW recovery operations                             |

### 11.4 - LastTrip (Event Recording)

The Relay records any tripping and stores the information relevant to the last 20 tripping of protection functions (FIFO).

Each event recording includes the following information.

- " Real Time Meas " 
- " LastTrip " 
-  1<sup>st</sup> event,
-  to scroll available events,
-  to " Rec # " selected,
-  to select the different fields;

| Display       |                  | Description                                                                                                                                 |
|---------------|------------------|---------------------------------------------------------------------------------------------------------------------------------------------|
| <b>Date</b>   | = YYYY/MM/GG     | Date: Year/Month/Day                                                                                                                        |
| <b>Time</b>   | = hh:mm:ss:cc    | Time: hours/minutes/second/hundredths of seconds                                                                                            |
| <b>Func</b>   | xxxxx            | Indication of the protection function which caused the relay tripping.<br>For indication of the TRIP Cause the following acronyms are used: |
|               | - V>             | = 1 <sup>st</sup> Overvoltage                                                                                                               |
|               | - V>>            | = 2 <sup>nd</sup> Overvoltage                                                                                                               |
|               | - V<             | = 1 <sup>st</sup> Undervoltage                                                                                                              |
|               | - V<<            | = 2 <sup>nd</sup> Undervoltage                                                                                                              |
|               | - f>             | = Overfrequency                                                                                                                             |
|               | - f<             | = Underfrequency                                                                                                                            |
|               | - Vo>            | = Zero sequence overvoltage                                                                                                                 |
|               | - V1<            | = Positive sequence undervoltage                                                                                                            |
|               | - V2>            | = Negative sequence overvoltage                                                                                                             |
|               | - RTD            | = External Trip commands                                                                                                                    |
|               | - IRF            | = Internal Relay Fault                                                                                                                      |
| <b>EA</b>     | = 0 - 999999 V   | RMS value of primary phase-to-neutral voltage of phase A                                                                                    |
| <b>EB</b>     | = 0 - 999999 V   | RMS value of primary phase-to-neutral voltage of phase B                                                                                    |
| <b>EC</b>     | = 0 - 999999 V   | RMS value of primary phase-to-neutral voltage of phase C                                                                                    |
| <b>f</b>      | = 40.00-70.00 Hz | System Frequency                                                                                                                            |
| <b>Vo&gt;</b> | = 0 - 999999 V   | RMS primary zero sequence voltage                                                                                                           |
| <b>V1&lt;</b> | = 0 - 999999 %   | % of rated system voltage                                                                                                                   |
| <b>V2&gt;</b> | = 0 - 999999 %   | % of rated system voltage                                                                                                                   |

-  to go back to " Rec # ",
-  to go back to " Real Time Meas ".

## 11.5 - R/W Set (Programming / Reading the Relay Settings)

-  " Main Menu "
-  select " Function " 
-  select among following sub menus:

### 11.5.1 - CommAdd (Communication Address)

-  " Common " 
- " Add: # " 
- " Password ???? " (if not yet entered; see § Password)
-  to select the Address (1-250)
-  to validate. Set Done!

The default address is 1.

| Display       | Description                                                      | Setting Range | Step | Unit |
|---------------|------------------------------------------------------------------|---------------|------|------|
| <b>Add:</b> 1 | Identification number for connection on serial communication bus | 1 - 250       | 1    | -    |

### 11.5.2 - Time/Date (Time/Date)

-  " Time/Date "  Date: Current Date, Time: Current time
-  " YY/..... "  to set year,
-  " XX/MM "  to set month,
-  " XX/XX/DD "  to set day,
-  " XX/XX/XX " 
-  " hh/mm "  to set hour,
-  " XX/mm "  to set minutes,
-  To validate Set Done!
-  Exit

### 11.5.3 - RatedVal (Rated Input Values)

-  "RatedVal "
-  1<sup>st</sup> Variable
-  to scroll variables
-  to modify selected variable
- " Password ???? " (if not yet entered) or #??? (if not yet entered; see § Password)
-  to set variable value,
-  to validate. Set Done!

| Display           | Description                           | Setting Range | Step | Unit |
|-------------------|---------------------------------------|---------------|------|------|
| <b>V1</b> 10 kV   | Rated Primary voltage of phase V.T.   | 0.05 - 500    | 0.01 | kV   |
| <b>V2</b> 100 V   | Rated Secondary voltage of phase V.T. | 50 - 400      | 0.01 | V    |
| <b>Freq</b> 50 Hz | System rated frequency                | 50 - 60       | 10   | Hz   |

**11.5.4 - Function (Functions)**

-  “Function “,
-  1<sup>st</sup> function,
-  to scroll available Functions,
-  to Read/Write setting of the selected function,
-  to select the different definable fields
  - FuncEnab
  - Options
  - TripLev
  - Timers
-  to access the selected field and read the actual setting of the relevant variable
-  to modify the actual setting;
-  to set the new value.
-  to validate.

Set Done!

| Display                     |          |      |          |                 |                 | Description                                                      | Setting Range  | Step |
|-----------------------------|----------|------|----------|-----------------|-----------------|------------------------------------------------------------------|----------------|------|
| Function                    | Type     |      | Variable | Default Setting | Unit            |                                                                  |                |      |
| Password = 0000-9999 1111 - |          |      |          |                 |                 | Password for programming enable (see § Password)                 |                |      |
| V><br>(1F59)                | FuncEnab | →    |          | Enable          |                 | Enable of the protection function                                | Enable/Disable | -    |
|                             | Options  | →    | BI       | Disable         |                 | Operation controlled by Blocking Digital Input                   | Enable/Disable | -    |
|                             |          |      | Trg      | Enable          |                 | Function operation triggers the oscillographic wave form capture | Enable/Disable | -    |
|                             | TripLev  | →    | V>       | 1.10            | Vn              | Trip level of overvoltage protection                             | 0.50 – 1.50    | 0.01 |
| Timers                      | →        | tV>  | 1.00     | s               | Trip time delay | 0.05 – 60.00                                                     | 0.01           |      |
| V>><br>(2F59)               | FuncEnab | →    |          | Enable          |                 | Enable of the protection function                                | Enable/Disable | -    |
|                             | Options  | →    | BI       | Disable         |                 | Operation controlled by Blocking Digital Input                   | Enable/Disable | -    |
|                             |          |      | Trg      | Enable          |                 | Function operation triggers the oscillographic wave form capture | Enable/Disable | -    |
|                             | TripLev  | →    | V>>      | 1.30            | Vn              | Trip level of overvoltage protection                             | 0.50 – 1.50    | 0.01 |
| Timers                      | →        | tV>> | 0.30     | s               | Trip time delay | 0.05 – 60.00                                                     | 0.01           |      |
| V<<br>(1F27)                | FuncEnab | →    |          | Enable          |                 | Enable of the protection function                                | Enable/Disable | -    |
|                             | Options  | →    | BI       | Disable         |                 | Operation controlled by Blocking Digital Input                   | Enable/Disable | -    |
|                             |          |      | Trg      | Enable          |                 | Function operation triggers the oscillographic wave form capture | Enable/Disable | -    |
|                             | TripLev  | →    | V<       | 0.90            | Vn              | Trip level of undervoltage protection                            | 0.20 – 1.20    | 0.01 |
| Timers                      | →        | tV<  | 1.00     | s               | Trip time delay | 0.05 – 60.00                                                     | 0.01           |      |
| V<<<br>(1F27)               | FuncEnab | →    |          | Enable          |                 | Enable of the protection function                                | Enable/Disable | -    |
|                             | Options  | →    | BI       | Disable         |                 | Operation controlled by Blocking Digital Input                   | Enable/Disable | -    |
|                             |          |      | Trg      | Disable         |                 | Function operation triggers the oscillographic wave form capture | Enable/Disable | -    |
|                             | TripLev  | →    | V<<      | 0.70            | Vn              | Trip level of undervoltage protection                            | 0.20 – 1.20    | 0.01 |
| Timers                      | →        | tV<< | 0.30     | s               | Trip time delay | 0.05 – 60.00                                                     | 0.01           |      |
| f><br>(F81)                 | FuncEnab | →    |          | Enable          |                 | Enable of the protection function                                | Enable/Disable | -    |
|                             | Options  | →    | BI       | Disable         |                 | Operation controlled by Blocking Digital Input                   | Enable/Disable | -    |
|                             |          |      | Trg      | Enable          |                 | Function operation triggers the oscillographic wave form capture | Enable/Disable | -    |
|                             | TripLev  | →    | f>       | 50.50           | Hz              | Trip level of overfrequency protection                           | 40 – 70        | 0.01 |
| Timers                      | →        | tf>  | 1.00     | s               | Trip time delay | 0.05 – 60.00                                                     | 0.01           |      |
| f<<br>(F81)                 | FuncEnab | →    |          | Enable          |                 | Enable of the protection function                                | Enable/Disable | -    |
|                             | Options  | →    | BI       | Disable         |                 | Operation controlled by Blocking Digital Input                   | Enable/Disable | -    |
|                             |          |      | Trg      | Enable          |                 | Function operation triggers the oscillographic wave form capture | Enable/Disable | -    |
|                             | TripLev  | →    | f<       | 40.50           | Hz              | Trip level of underfrequency protection                          | 40 – 70        | 0.01 |
| Timers                      | →        | tf<  | 1.00     | s               | Trip time delay | 0.05 – 60.00                                                     | 0.01           |      |

| Display        |          |   |          |               |      | Description                                                                                                         | Setting Range                       | Step |
|----------------|----------|---|----------|---------------|------|---------------------------------------------------------------------------------------------------------------------|-------------------------------------|------|
| Function       | Type     |   | Variable | Default Value | Unit |                                                                                                                     |                                     |      |
| Vo><br>(F590)  | FuncEnab | → |          | Enable        |      | Enable of the protection function                                                                                   | Enable/Disable                      | -    |
|                | Options  | → | BI       | Disable       |      | Operation controlled by Blocking Digital Input                                                                      | Enable/Disable                      | -    |
|                |          |   | Trg      | Enable        |      | Function operation triggers the oscillographic wave form capture                                                    | Enable/Disable                      | -    |
|                | TripLev  | → | Vo>      | 1.10          | Vn   | Trip level of zero sequence overvoltage protection                                                                  | 0.10 – 1.50                         | 0.1  |
|                | Timers   | → | tVo>     | 1.00          | s    | Trip time delay                                                                                                     | 0.05 – 60.00                        | 0.01 |
| V1<<br>(F27V1) | FuncEnab | → |          | Enable        |      | Enable of the protection function                                                                                   | Enable/Disable                      | -    |
|                | Options  | → | BI       | Disable       |      | Operation controlled by Blocking Digital Input                                                                      | Enable/Disable                      | -    |
|                |          |   | Trg      | Enable        |      | Function operation triggers the oscillographic wave form capture                                                    | Enable/Disable                      | -    |
|                | TripLev  | → | V1<      | 1.10          | Vn   | Trip level of positive sequence undervoltage protection                                                             | 0.10 – 1.50                         | 0.01 |
|                | Timers   | → | tV1<     | 1.00          | s    | Trip time delay                                                                                                     | 0.05 – 60.00                        | 0.01 |
| V2><br>(F59V2) | FuncEnab | → |          | Enable        |      | Enable of the protection function                                                                                   | Enable/Disable                      | -    |
|                | Options  | → | BI       | Disable       |      | Operation controlled by Blocking Digital Input                                                                      | Enable/Disable                      | -    |
|                |          |   | Trg      | Enable        |      | Function operation triggers the oscillographic wave form capture                                                    | Enable/Disable                      | -    |
|                | TripLev  | → | V2>      | 1.30          | Vn   | Trip level of negative sequence overvoltage protection                                                              | 0.02 – 1.50                         | 0.01 |
|                | Timers   | → | tV2>     | 0.30          | s    | Trip time delay                                                                                                     | 0.05 – 60.00                        | 0.01 |
| RTD            | FuncEnab | → |          | Disable       |      | Enable of the protection function                                                                                   | Enable/Disable                      | -    |
|                | Options  | → |          | No Param.     |      | No Parameters                                                                                                       |                                     |      |
|                | TripLev  | → |          | No Param.     |      | No Parameters                                                                                                       |                                     |      |
|                | Timers   | → |          | No Param.     |      | No Parameters                                                                                                       |                                     |      |
| IRF            | FuncEnab | → |          | Enable        |      | Enable of the protection function                                                                                   | Enable/Disable                      | -    |
|                | Options  | → | Opz      | Trip          |      | Operation of output Relays on detection of Internal Relay Fault                                                     | NoTrip – Trip                       | -    |
|                |          |   |          | No Param.     |      | No Parameters                                                                                                       |                                     |      |
|                | TripLev  | → |          | No Param.     |      | No Parameters                                                                                                       |                                     |      |
|                | Timers   | → |          | No Param.     |      | No Parameters                                                                                                       |                                     |      |
| Osc            | FuncEnab | → |          | Enable        |      | Enable of the protection function                                                                                   | Enable/Disable                      | -    |
|                | Options  | → | Trg      | Trip          |      | Trigger operation mode                                                                                              | Disable<br>Start<br>Trip<br>Ext.Inp | -    |
|                |          |   |          | No Param.     |      | No Parameters                                                                                                       |                                     |      |
|                | TripLev  | → |          | No Param.     |      | No Parameters                                                                                                       |                                     |      |
|                | Timers   | → | tPre     | 0.30          |      | Recording time before Trigger                                                                                       | 0.10 – 0.50                         | 0.1  |
|                |          | → | tPost    | 0.30          |      | Recording time after Trigger                                                                                        | 0.10 – 1.50                         | 0.1  |
| Comm           | FuncEnab | → |          | No Param.     |      | No Parameters                                                                                                       |                                     |      |
|                | Options  | → | LBd      | 9600          |      | Local Baud Rate<br>(Front panel RS232 communication speed)                                                          | 9600 - 19200<br>38400 - 57600       | -    |
|                |          |   | RBd      | 9600          |      | Remote Baud Rate (Rear panel terminal blocks RS485 communication speed)                                             | 9600 - 19200                        | -    |
|                |          |   | Mod      | 8,N,1         |      | Remote mode (communication parameters)<br><i>Note: any change of this setting became valid at the next power on</i> | 8,N,1<br>8,O,1<br>8,E,1             | -    |
|                |          |   | RPr      | Modbus        |      | Remote Protocol                                                                                                     | IEC103-Modbus                       | -    |
|                | TripLev  | → |          | No Param.     |      | No Parameters                                                                                                       |                                     |      |
|                | Timers   | → |          | No Param.     |      | No Parameters                                                                                                       |                                     |      |
| LCD            | FuncEnab | → |          | No Param.     |      | No Parameters                                                                                                       |                                     |      |
|                | Options  | → | Key      | BeepON        |      | Buzzer "Beep" on operation of Keyboard buttons.                                                                     | BeepON-BeepOFF                      | -    |
|                |          |   | BkL      | ON            |      | LCD Backlight continuously "ON" or switched-on Automatically on operation of Keyboard buttons.                      | ON - OFF                            | -    |
|                | TripLev  | → |          | No Param.     |      | No Parameters                                                                                                       |                                     |      |
|                | Timers   | → |          | No Param.     |      | No Parameters                                                                                                       |                                     |      |

Settings can also be programmed via the serial communication ports.

### 11.6 - RelayCfg (Relay Configuration)

To associate one of the Output Relays to one or more functions (see § Password): enter the menu “R/W Set”, select “Relay Cfg”, select the “Relay #” to be programmed, select “Link”; at this stage the list of the available functions is displayed. Scrolling the list by the “+” and “-” keys the function is selected and then assigned by the key “Enter”. The assignation is confirmed by the function indication that switches from blinking to steady.

Any of the Output Relays can be programmed to work in two different modes:

- **N.D.** Normally Deenergized Relay is energized on trip of the associated functions
- **N.E.** Normally Energized Relay is deenergized on trip of the associated functions

Programming of working mode is made as above selecting “OpMode” instead of “Link”.

| Display     |        |   |                            | Description                                              | Setting Range                                                                                                                                                                                             | Step |
|-------------|--------|---|----------------------------|----------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------|
| Relay       | Type   |   | Default Value              |                                                          |                                                                                                                                                                                                           |      |
| Relay1 (R1) | Link   | → | tV>, tV>>, tF>, tVo>, tV2> | Association of functions to output relay R1              | V> - tV> - V>> - tV>> - V< - tV< - V<< - tV<< - f> - tF> - f< - tF< - Vo> - tVo> - V1< - tV1< - V2> - tV2> - RTD - IRF - HwRecov. 1.D1, 1.D2, 1.D3, 1.D4, 1.D5, 1.D6, 1.D7, 1.D8, 1.D9, 1.D10, Canstatus. | -    |
|             | OpMode | → | N.D.                       | N.D. (Normally Deenergized)<br>N.E. (Normally Energized) | N.D./N.E.                                                                                                                                                                                                 | -    |
| Relay2 (R2) | Link   | → | tV<, tV<<, tF<, tV1<       | Association of functions to output relay R2              | V> - tV> - V>> - tV>> - V< - tV< - V<< - tV<< - f> - tF> - f< - tF< - Vo> - tVo> - V1< - tV1< - V2> - tV2> - RTD - IRF - HwRecov. 1.D1, 1.D2, 1.D3, 1.D4, 1.D5, 1.D6, 1.D7, 1.D8, 1.D9, 1.D10, Canstatus. | -    |
|             | OpMode | → | N.D.                       | N.D. (Normally Deenergized)<br>N.E. (Normally Energized) | N.D./N.E.                                                                                                                                                                                                 | -    |
| Relay3 (R3) | Link   | → | V>, V>>, V<, V<<, Vo>      | Association of functions to output relay R3              | V> - tV> - V>> - tV>> - V< - tV< - V<< - tV<< - f> - tF> - f< - tF< - Vo> - tVo> - V1< - tV1< - V2> - tV2> - RTD - IRF - HwRecov. 1.D1, 1.D2, 1.D3, 1.D4, 1.D5, 1.D6, 1.D7, 1.D8, 1.D9, 1.D10, Canstatus. | -    |
|             | OpMode | → | N.D.                       | N.D. (Normally Deenergized)<br>N.E. (Normally Energized) | N.D./N.E.                                                                                                                                                                                                 | -    |

### (UX10-4) Additional Expansion Module (10 Digital Input – 4 Output Relay)

By the interface program “MCom 2” it is possible to Activate/Deactivate the modules.

| Display |        |   |               | Description                                              | Setting Range                                                                                                                                                                                             | Step |
|---------|--------|---|---------------|----------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------|
| Relay   | Type   |   | Default Value |                                                          |                                                                                                                                                                                                           |      |
| 1.R1    | Link   | → | -             | Association of functions to output relay 1.R1            | V> - tV> - V>> - tV>> - V< - tV< - V<< - tV<< - f> - tF> - f< - tF< - Vo> - tVo> - V1< - tV1< - V2> - tV2> - RTD - IRF - HwRecov. 1.D1, 1.D2, 1.D3, 1.D4, 1.D5, 1.D6, 1.D7, 1.D8, 1.D9, 1.D10, Canstatus. | -    |
|         | OpMode | → | N.D.          | N.D. (Normally Deenergized)<br>N.E. (Normally Energized) | N.D./N.E.                                                                                                                                                                                                 | -    |
| 1.R2    | Link   | → | -             | Association of functions to output relay 1.R2            | V> - tV> - V>> - tV>> - V< - tV< - V<< - tV<< - f> - tF> - f< - tF< - Vo> - tVo> - V1< - tV1< - V2> - tV2> - RTD - IRF - HwRecov. 1.D1, 1.D2, 1.D3, 1.D4, 1.D5, 1.D6, 1.D7, 1.D8, 1.D9, 1.D10, Canstatus. | -    |
|         | OpMode | → | N.D.          | N.D. (Normally Deenergized)<br>N.E. (Normally Energized) | N.D./N.E.                                                                                                                                                                                                 | -    |
| 1.R3    | Link   | → | -             | Association of functions to output relay 1.R3            | V> - tV> - V>> - tV>> - V< - tV< - V<< - tV<< - f> - tF> - f< - tF< - Vo> - tVo> - V1< - tV1< - V2> - tV2> - RTD - IRF - HwRecov. 1.D1, 1.D2, 1.D3, 1.D4, 1.D5, 1.D6, 1.D7, 1.D8, 1.D9, 1.D10, Canstatus. | -    |
|         | OpMode | → | N.D.          | N.D. (Normally Deenergized)<br>N.E. (Normally Energized) | N.D./N.E.                                                                                                                                                                                                 | -    |
| 1.R4    | Link   | → | -             | Association of functions to output relay 1.R4            | V> - tV> - V>> - tV>> - V< - tV< - V<< - tV<< - f> - tF> - f< - tF< - Vo> - tVo> - V1< - tV1< - V2> - tV2> - RTD - IRF - HwRecov. 1.D1, 1.D2, 1.D3, 1.D4, 1.D5, 1.D6, 1.D7, 1.D8, 1.D9, 1.D10, Canstatus. | -    |
|         | OpMode | → | N.E.          | N.D. (Normally Deenergized)<br>N.E. (Normally Energized) | N.D./N.E.                                                                                                                                                                                                 | -    |

### 11.7 - Commands

-  " Commands "
-  1<sup>st</sup> Control,
-  to select other available control,
-  to operate selected control.


| Display      | Description                                     |
|--------------|-------------------------------------------------|
| <b>Clear</b> | : Erase memory of Trip Counters, Event Records. |
| <b>Test</b>  | : Starts a relay diagnostic test                |
| <b>Reset</b> | : Reset after trip                              |

### 11.8 - Info&Ver (Firmware - Info&Version)

The menu displays the Relay Model and the Firmware Version

- " Real Time Meas " 
-  " Info/Ver ",
-  " Model XXXXXX ", Model Relay
-  " RelayVrs ###.#.#X ", Firmware Version
-  to go back to " Info&Ver ".
-  to go back to " Real Time Meas "

## 12. Keyboard Operational Diagram

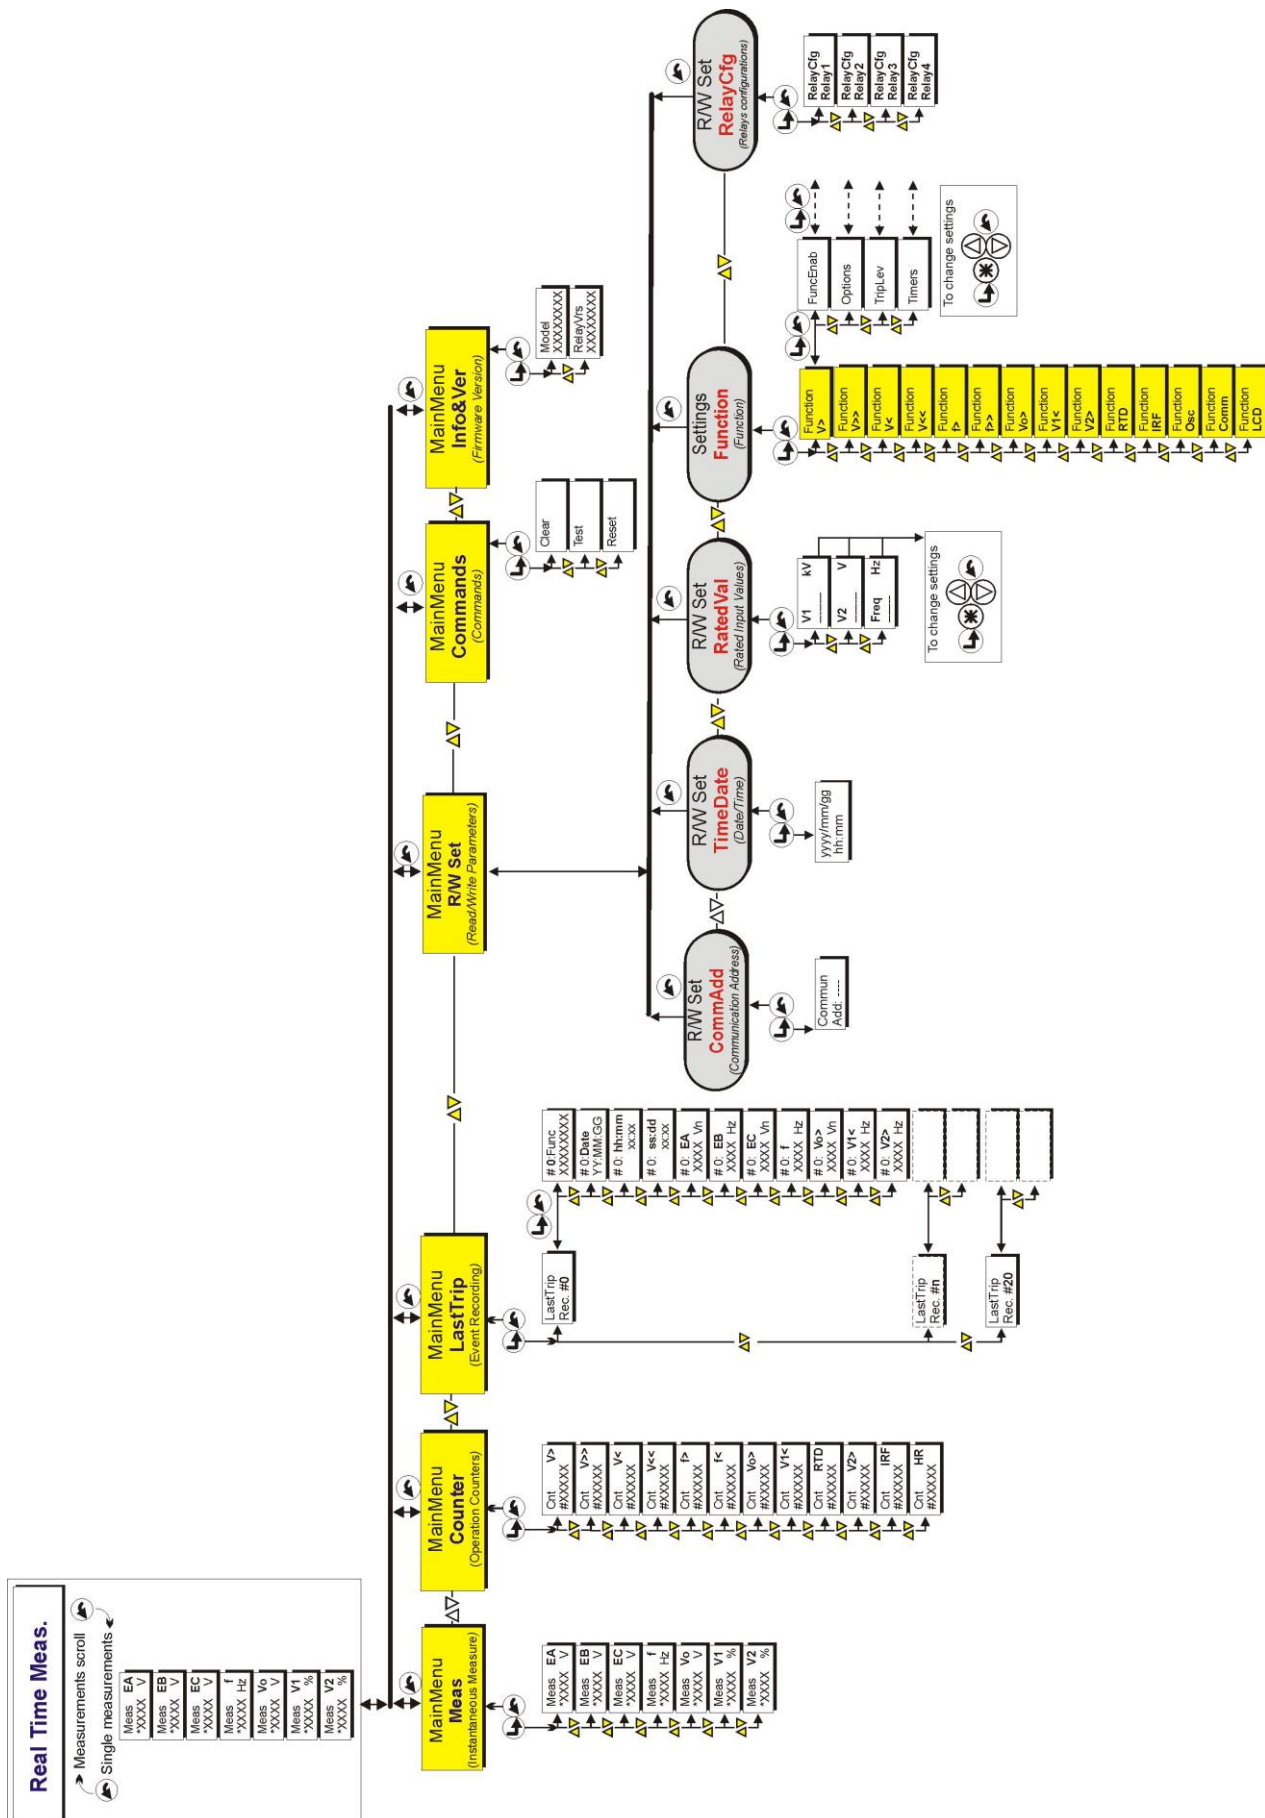

---

## 13. Password

---

This password is requested anytime the user wants to write in the “Settings” menu a command of the “Commands” menu.

The default password is “ 1111 “

When password is required, proceed as follows

The Display shows the message “ Password ????? “

- |   |                                                                                   |                                       |                                                                                   |                        |
|---|-----------------------------------------------------------------------------------|---------------------------------------|-----------------------------------------------------------------------------------|------------------------|
| - |  | to select 1 <sup>st</sup> digit (1-9) |  | to validate            |
| - |  | to select 2 <sup>nd</sup> digit (1-9) |  | to validate            |
| - |  | to select 3 <sup>rd</sup> digit (1-9) |  | to validate            |
| - |  | to select 4 <sup>th</sup> digit (1-9) |  | to complete procedure. |

The “ password “ is required any time you attempt to modify one of the programmable variables at the first entrance in the “Settings” and/or “Commands” menus.

The “ password “remains valid for 2 minutes from the last operation of the programming buttons or until the  button is pressed to return to the default display (RT Meas).

Once the Password has been entered, a “ # “ appears before the variable that can be modified.

---

### 13.1 - MS-Com Password

---

This password is requested anytime the user wants to send to the relay a setting parameters modification or to issue a command through the relay itself using the managing software MSCom.

The user can decide whether inserting his own password (see MS-Com Operational Manual) or keeping the password disabled just clicking on the OK button when the password is requested.

---

## 14. Maintenance

---

No maintenance is required. In case of malfunctioning please contact Microelettrica Scientifica Service or the local Authorised Dealer mentioning the relay's Serial No reported in the label on relays enclosure.

---


## 15. Power Frequency Insulation Test

---


Every relay individually undergoes a factory insulation test according to IEC255-5 standard at 2 kV, 50 Hz 1min. Insulation test should not be repeated as it unusefully stresses the dielectrics.

When doing the insulation test, the terminals relevant to serial output, digital inputs and RTD input must always be short circuited to ground. When relays are mounted in switchboards or relay boards that have to undergo the insulation tests, the relay should be isolated. This is extremely important as discharges eventually taking place in other parts or components of the board can severely damage the relays or cause damages not immediately evident to the electronic components.

## 16. Connection Diagram

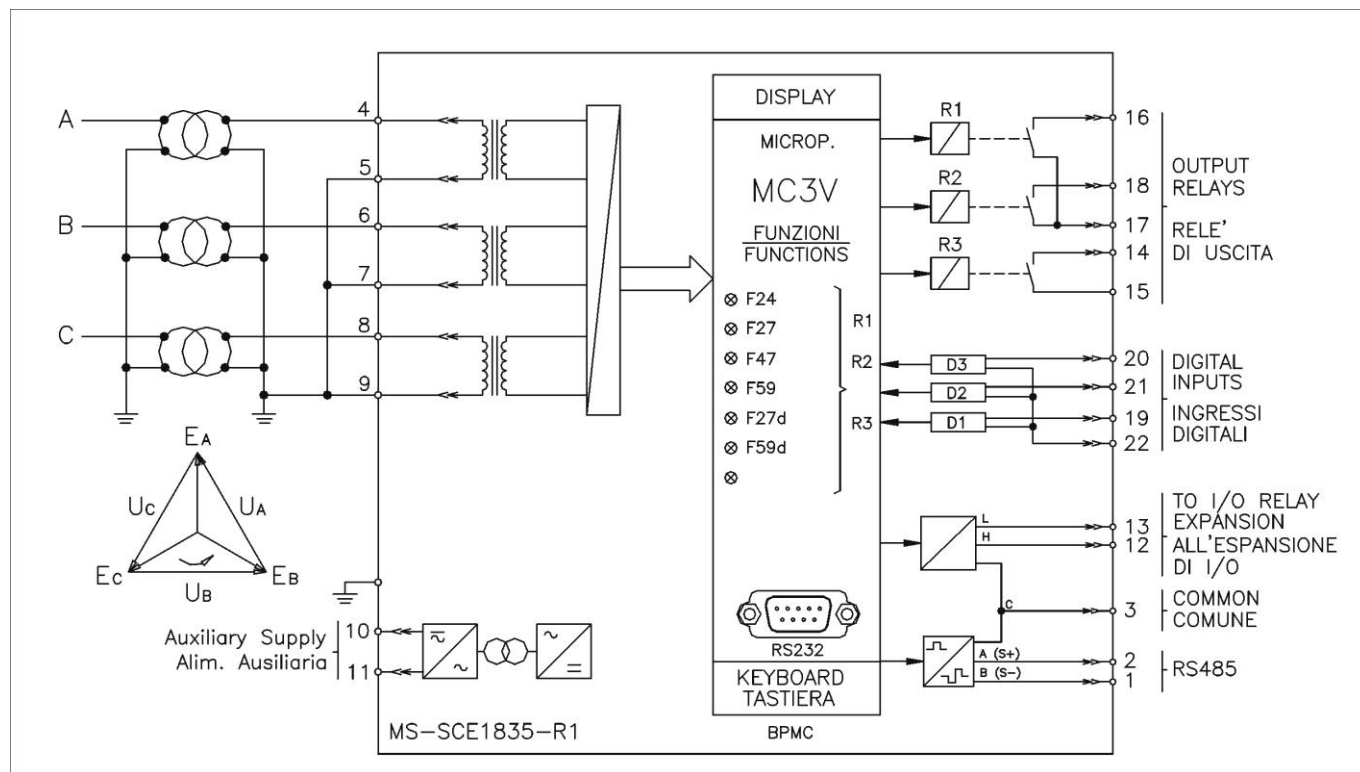


### 16.1 – UX10-4 - Expansion Module - Wiring Diagram (10 Digital Inputs + 4 Output Relays)

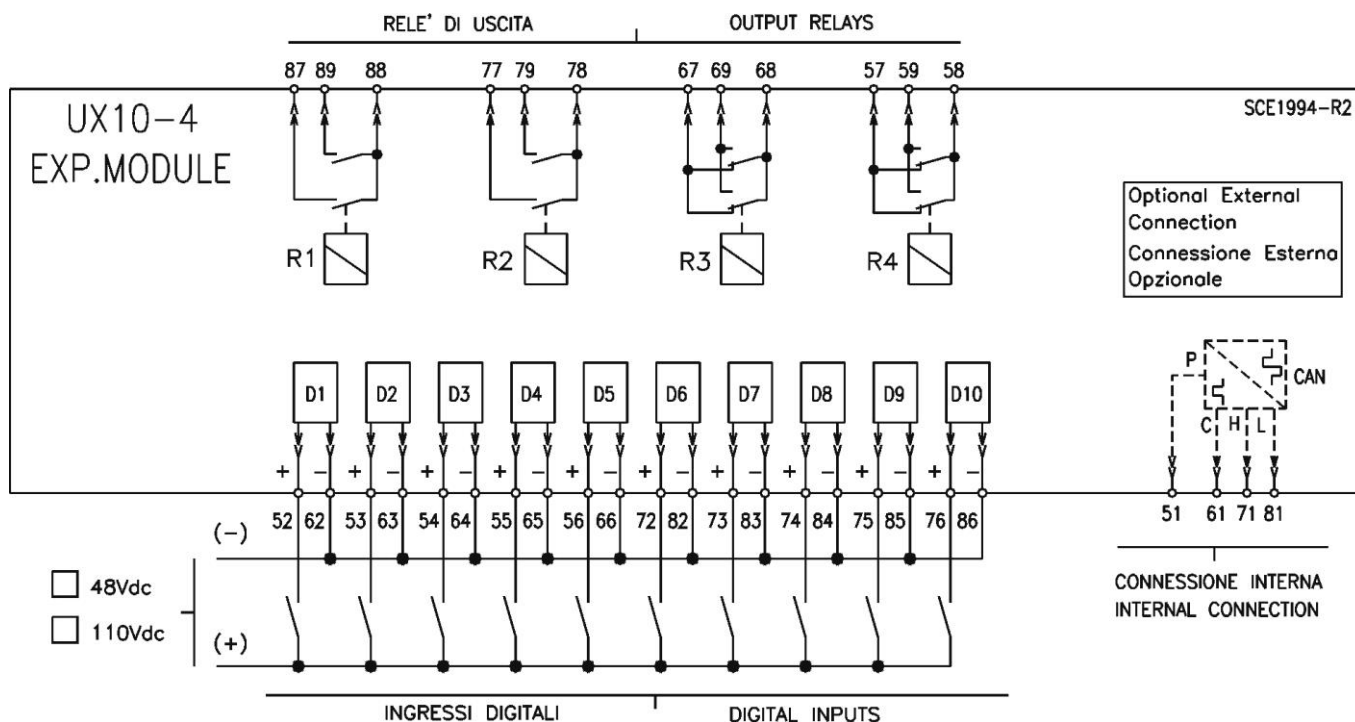

## 17. Overall Dimensions

**PROTECTION DEGREE IP44 (IP54 on request)**

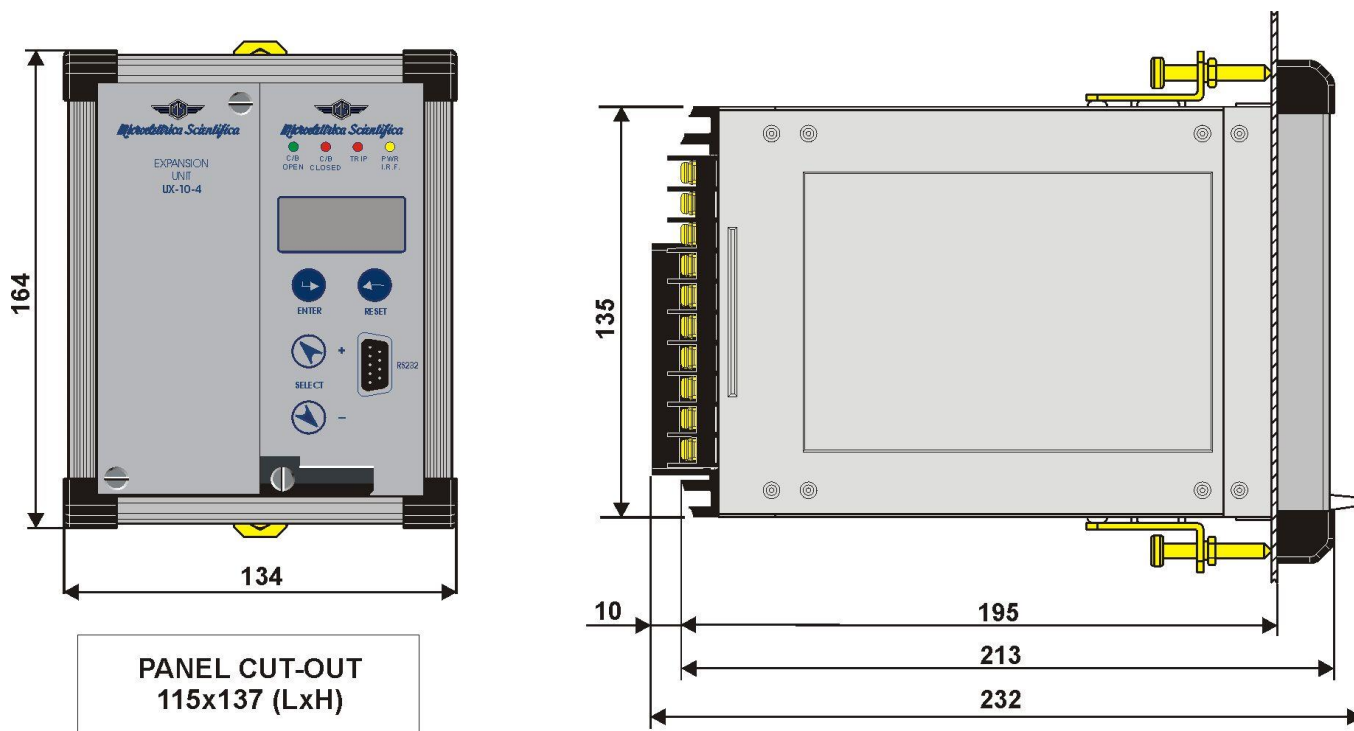


## 18. Direction for Pcb's Draw-Out And Plug-In

### 18.1 - Draw-Out

Rotate clockwise the screws ① in the horizontal position of the screws-driver mark.  
Draw-out the PCB by pulling on the handle ②

### 18.2 - Plug-In

Rotate clockwise the screws ① in the horizontal position of the screws-driver mark.  
Slide-in the card on the rails provided inside the enclosure.  
Plug-in the card completely and by pressing the handle to the closed position.  
Rotate anticlockwise the screws ① with the mark in the vertical position (locked).

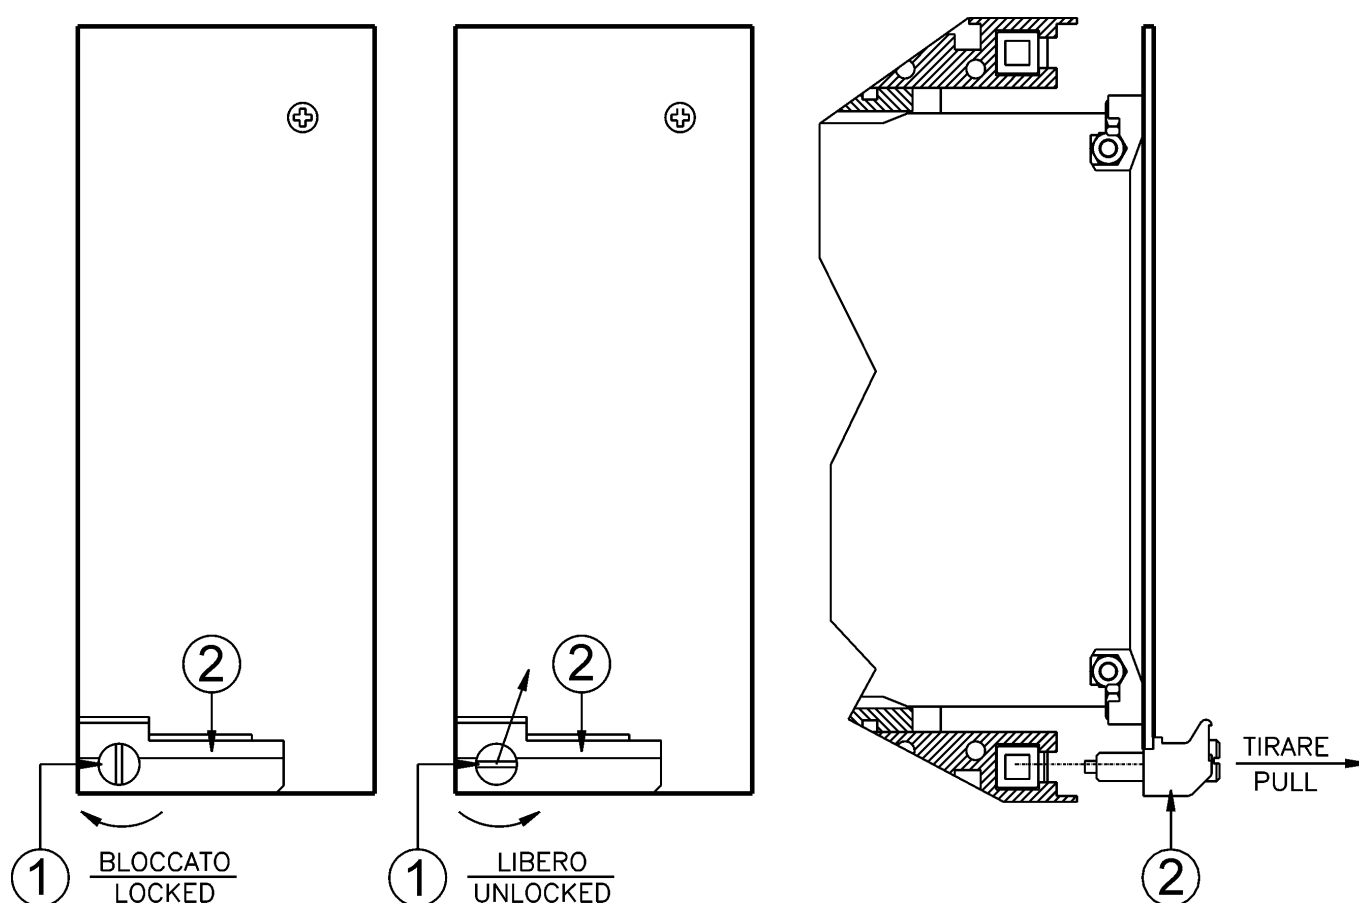

## 19. Electrical Characteristics

### APPROVAL: CE

#### REFERENCE STANDARDS IEC 60255 - CE Directive - EN/IEC61000 - IEEE C37

|                                                  |             |                                   |
|--------------------------------------------------|-------------|-----------------------------------|
| <input type="checkbox"/> Dielectric test voltage | IEC 60255-5 | 2kV, 50/60Hz, 1 min.              |
| <input type="checkbox"/> Impulse test voltage    | IEC 60255-5 | 5kV (c.m.), 2kV (d.m.) – 1,2/50µs |
| <input type="checkbox"/> Insulation resistance   | > 100MΩ     |                                   |

#### Environmental Std. Ref. (IEC 60068)

|                                                        |                           |                                                 |
|--------------------------------------------------------|---------------------------|-------------------------------------------------|
| <input type="checkbox"/> Operation ambient temperature | -10°C / +55°C             |                                                 |
| <input type="checkbox"/> Storage temperature           | -25°C / +70°C             |                                                 |
| <input type="checkbox"/> Environmental testing         | (Cold)                    | IEC60068-2-1                                    |
|                                                        | (Dry heat)                | IEC60068-2-2                                    |
|                                                        | (Change of temperature)   | IEC60068-2-14                                   |
|                                                        | (Damp heat, steady state) | IEC60068-2-78 RH 93% Without Condensing AT 40°C |

#### CE EMC Compatibility (EN61000-6-2 - EN61000-6-4 - EN50263)

|                                                                                             |                               |                        |                                  |         |
|---------------------------------------------------------------------------------------------|-------------------------------|------------------------|----------------------------------|---------|
| <input type="checkbox"/> Electromagnetic emission                                           | EN55011                       | industrial environment |                                  |         |
| <input type="checkbox"/> Radiated electromagnetic field immunity test                       | IEC61000-4-3                  | level 3                | 80-2000MHz                       | 10V/m   |
|                                                                                             | ENV50204                      |                        | 900MHz/200Hz                     | 10V/m   |
| <input type="checkbox"/> Conducted disturbances immunity test                               | IEC61000-4-6                  | level 3                | 0.15-80MHz                       | 10V     |
| <input type="checkbox"/> Electrostatic discharge test                                       | IEC61000-4-2                  | level 3                | 6kV contact / 8kV air            |         |
| <input type="checkbox"/> Power frequency magnetic test                                      | IEC61000-4-8                  |                        | 1000A/m                          | 50/60Hz |
| <input type="checkbox"/> Pulse magnetic field                                               | IEC61000-4-9                  |                        | 1000A/m, 8/20µs                  |         |
| <input type="checkbox"/> Damped oscillatory magnetic field                                  | IEC61000-4-10                 |                        | 100A/m, 0.1-1MHz                 |         |
| <input type="checkbox"/> Immunity to conducted common mode disturbance 0Hz-150KHz           | IEC61000-4-16                 | level 4                |                                  |         |
| <input type="checkbox"/> Electrical fast transient/burst                                    | IEC61000-4-4                  | level 3                | 2kV, 5kHz                        |         |
| <input type="checkbox"/> HF disturbance test with damped oscillatory wave (1MHz burst test) | IEC60255-22-1                 | class 3                | 400pps, 2,5kV (m.c.), 1kV (d.m.) |         |
| <input type="checkbox"/> Oscillatory waves (Ring waves)                                     | IEC61000-4-12                 | level 4                | 4kV(c.m.), 2kV(d.m.)             |         |
| <input type="checkbox"/> Surge immunity test                                                | IEC61000-4-5                  | level 4                | 2kV(c.m.), 1kV(d.m.)             |         |
| <input type="checkbox"/> Voltage interruptions                                              | IEC60255-4-11                 |                        |                                  |         |
| <input type="checkbox"/> Resistance to vibration and shocks                                 | IEC60255-21-1 - IEC60255-21-2 |                        | 10-500Hz                         | 1g      |

#### ELECTRIC RATED VALUE

|                                                                             |                                                                                                                                                               |                          |
|-----------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------|
| <input type="checkbox"/> Accuracy at reference value of influencing factors | 2% Un<br>2% + to (to=20÷30ms)                                                                                                                                 | for measure<br>for times |
| <input type="checkbox"/> Rated Voltage                                      | Un = (50 ÷ 400)Vac                                                                                                                                            |                          |
| <input type="checkbox"/> Voltage overload                                   | 2Un 1sec                                                                                                                                                      |                          |
| <input type="checkbox"/> Burden on voltage inputs                           | 0,2VA at Un                                                                                                                                                   |                          |
| <input type="checkbox"/> Average power supply consumption                   | ≤ 7 VA                                                                                                                                                        |                          |
| <input type="checkbox"/> Output relays                                      | rating 6 A; Vn = 250 V<br>A.C. resistive switching = 1500VA (400V max)<br>make = 30 A (peak) 0,5 sec.<br>break = 0.3 A, 110 Vcc,<br>L/R = 40 ms (100.000 op.) |                          |

#### COMMUNICATION PARAMETER

|                                        |                                                                       |
|----------------------------------------|-----------------------------------------------------------------------|
| <input type="checkbox"/> RS485 (Back)  | 9600/19200 bps – 8,n,1 - 8,e,1 - 8,o,1 – Modbus RTU or IEC60870-5-103 |
| <input type="checkbox"/> RS232 (Front) | 9600 - 19200 - 38400 - 57600 – 8,N,1 – Modbus RTU                     |

Microelettrica Scientifica S.p.A. - 20089 Rozzano (MI) - Italy - Via Alberelle, 56/68

Tel. (+39) 02 575731 - Fax (+39) 02 57510940 <http://www.microelettrica.com> e-mail : [info@microelettrica.com](mailto:info@microelettrica.com)

The performances and the characteristics reported in this manual are not binding and can modified at any moment without notice